
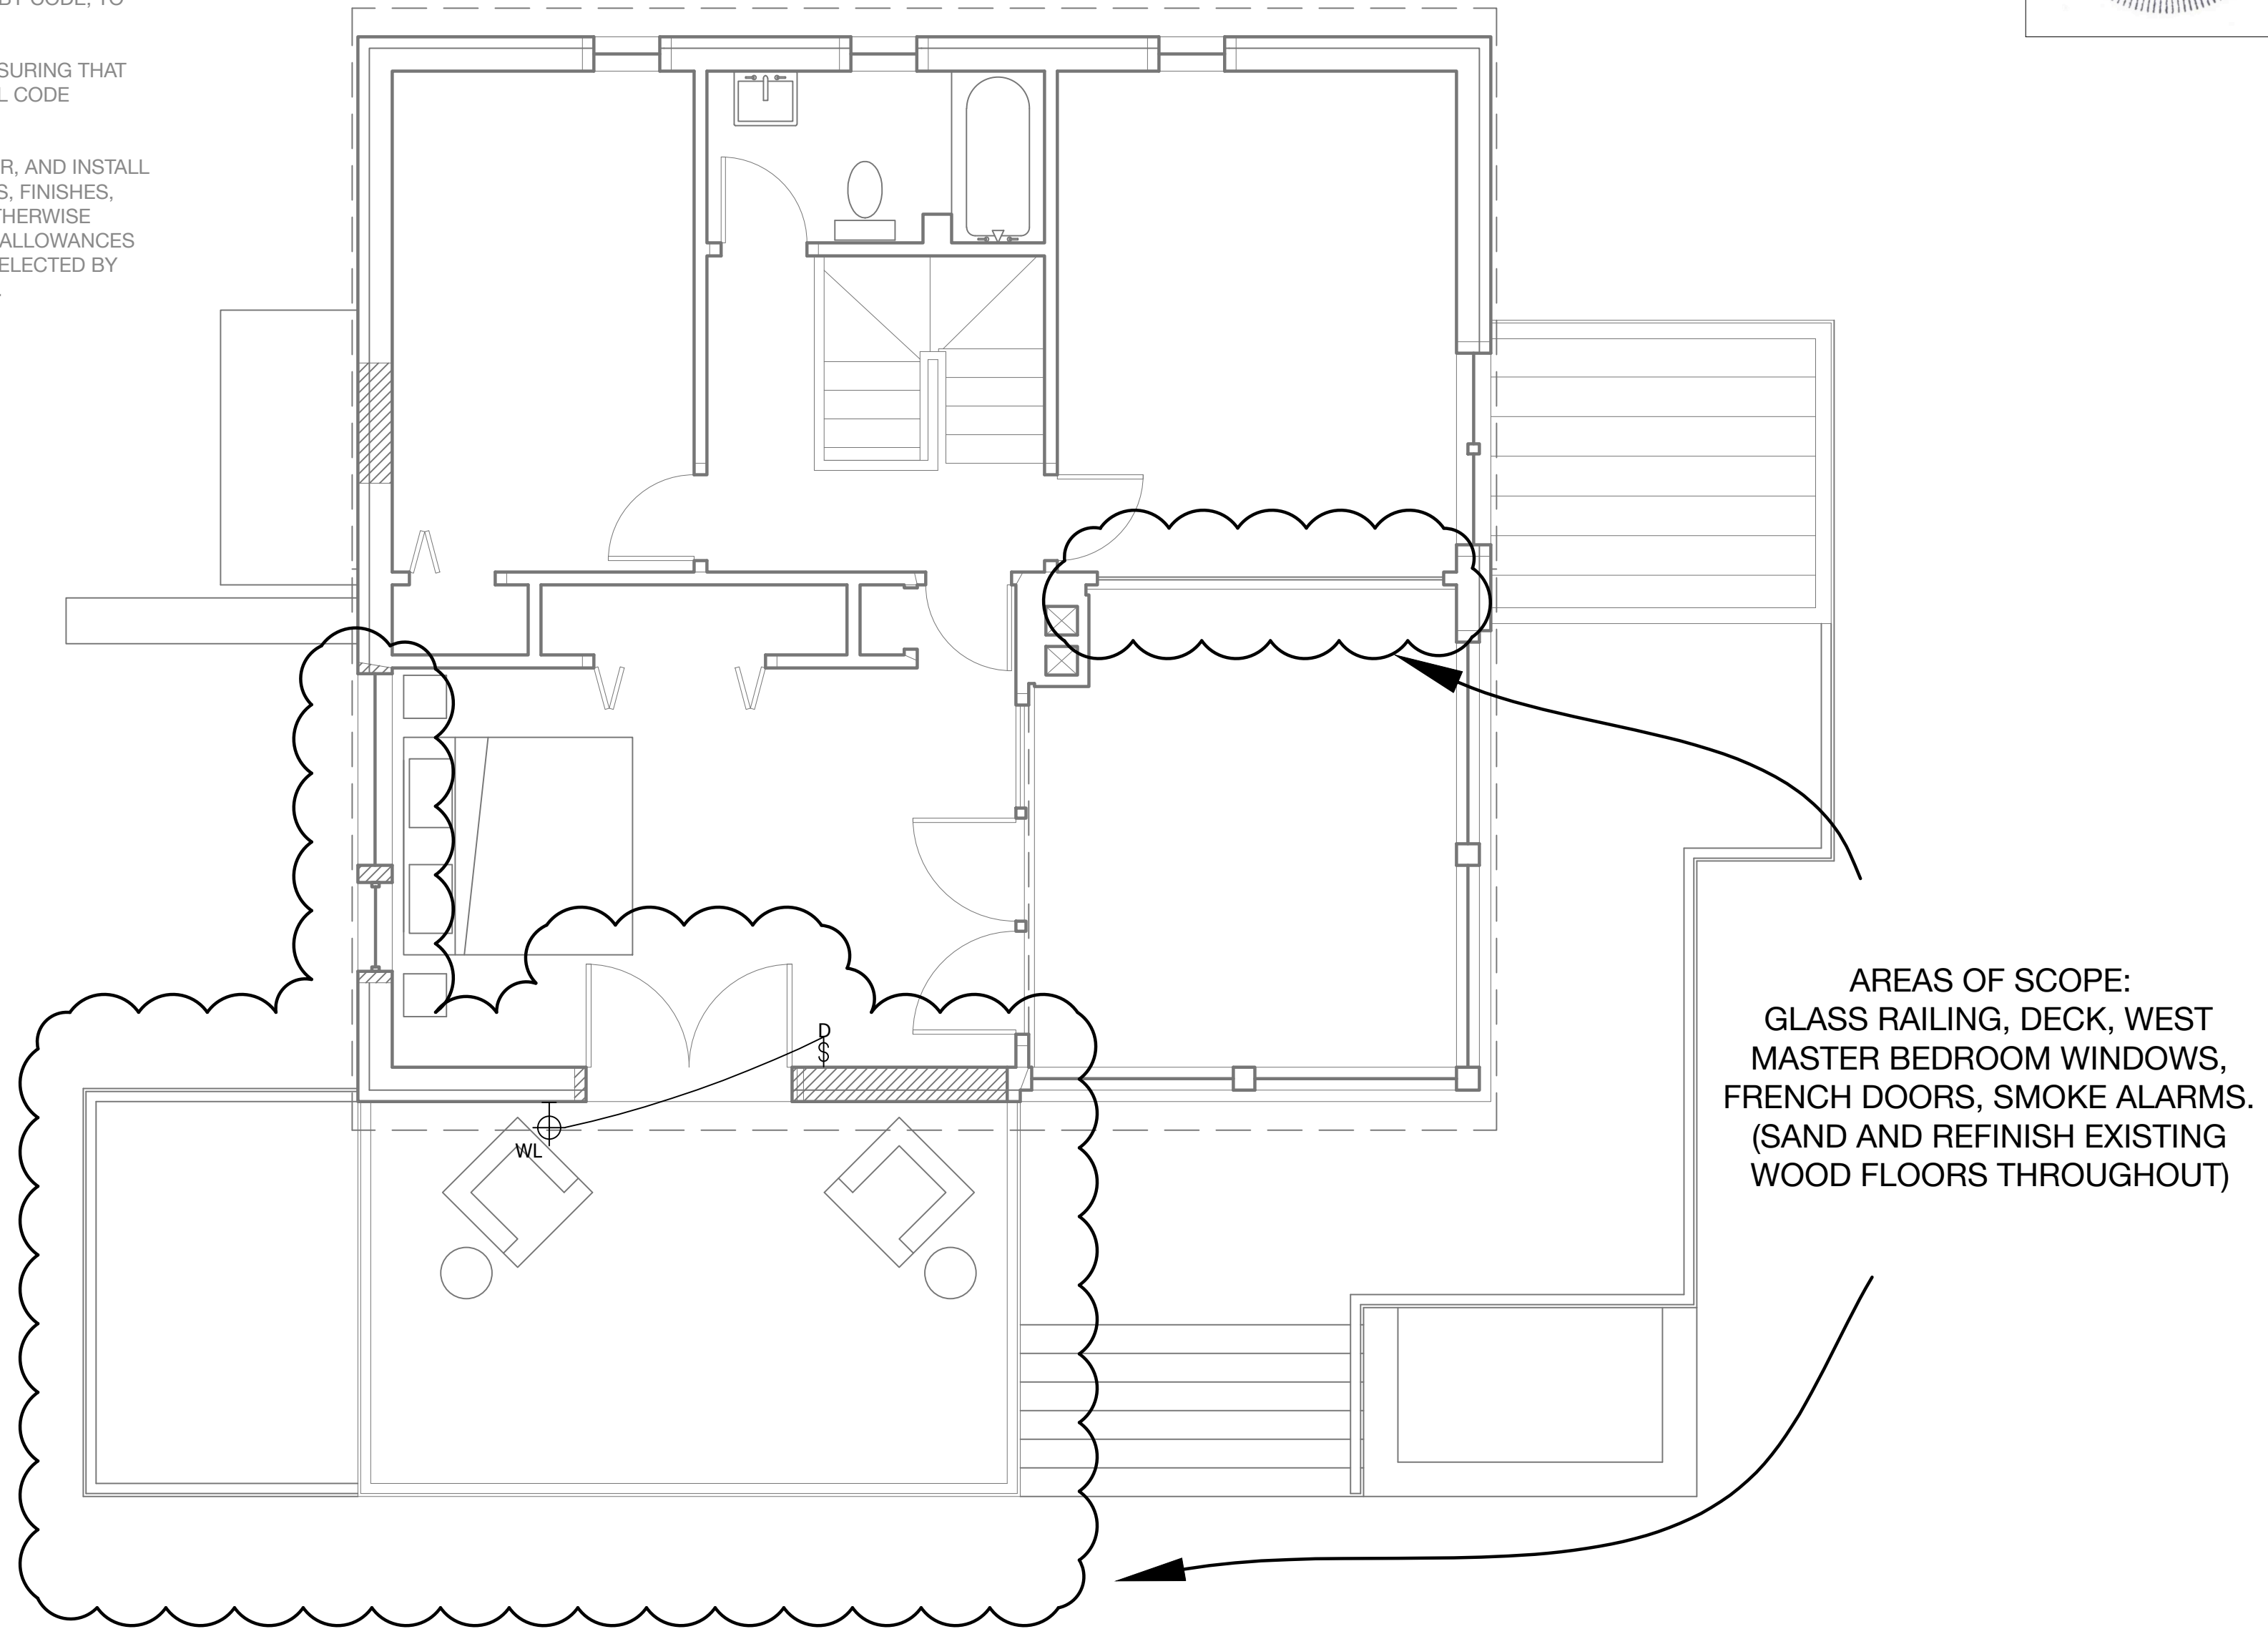


NOTES:

- 1.) ELECTRICAL, MECHANICAL, AND PLUMBING SPECIFICATIONS AND PERMITS BY OTHERS.
- 2.) PROVIDE AFCI CIRCUIT BREAKERS IN ELECTRICAL PANEL AND SUB-PANELS, AS REQUIRED BY CODE, TO PROTECT LISTED ROOM TYPES.
- 3.) CONTRACTOR RESPONSIBLE FOR ENSURING THAT PROJECT MEETS ALL LOCAL ELECTRICAL CODE REQUIREMENTS.
- 4.) CONTRACTOR TO PURCHASE, DELIVER, AND INSTALL ALL PROJECT MATERIALS, COMPONENTS, FINISHES, APPLIANCES AND FIXTURES, UNLESS OTHERWISE NOTED IN CONTRACT. PROVIDE STATED ALLOWANCES IN QUOTE/ESTIMATE FOR ITEMS TO BE SELECTED BY CLIENT AND PAID FOR BY CONTRACTOR.

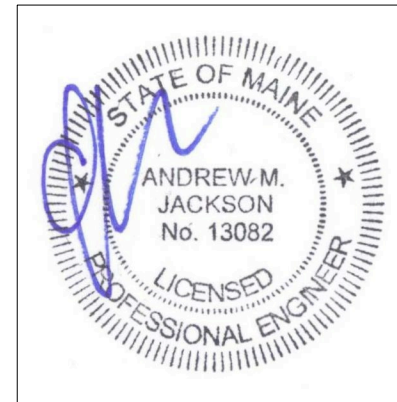

Rachel Conly Design LLC
26 Sterling Street
Peaks Island, Maine 04108
207.766.5625

DATE	NOTES
2016.12.06	
REVISION	

1/4" = 1'

PROJECT
Scott Residence
Peaks Island, ME
04108

A Proposed Second Floor Lighting Plan

NOTES:

- | | | | | | | |
|----------------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <ul style="list-style-type: none"> ⊕ DUPLEX RECEPTACLE ⊕ GFI GROUND FAULT CIRCUIT INTERRUPTER ⊕ 240 V ⊕ SWITCH | <ul style="list-style-type: none"> ⊕ 3-WAY SWITCH ⊕ DIMMER SWITCH ⊕ SD SMOKE DETECTOR ⊕ CO CARBON MONOXIDE DETECTOR | <ul style="list-style-type: none"> ⊕ CEILING MOUNT LIGHT FIXTURE ⊕ WALL SCONCE LIGHT FIXTURE ⊕ LOW PROFILE WALL SCONCE LIGHT FIXTURE ⊕ WET LOCATION WALL SCONCE LIGHT FIXTURE | <ul style="list-style-type: none"> ⊕ PENDANT LIGHT FIXTURE ⊕ RC RECESSED CAN LIGHT FIXTURE ⊕ FC COMPACT FLUORESCENT RECESSED CAN LIGHT ⊕ LED 3" LED RECESSED CAN LIGHT | <ul style="list-style-type: none"> — UNDER-COUNTER LIGHTS — TRACK LIGHTING — LOCALLY SWITCHED CLOSET RATED LIGHT | <ul style="list-style-type: none"> ⊗ CEILING FAN WITH INTEGRAL LIGHT ⊗ CEILING FAN ⊗ MINIMUM 50 CFM VENT FAN ⊗ MINIMUM 50 CFM VENT FAN/LIGHT COMBO | <ul style="list-style-type: none"> △ PHONE JACK △ DSL DSL JACK △ C CABLE JACK ⊕ CS CAT 5 JACK ⊕ CV CENTRAL VACUUM PORT |
|----------------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------|

E2
Proposed
Second Floor
Lighting Plan