


SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Maine Department of Human Services
Division of Health Engineering, Station 10 SHS
(207) 287-5672 FAX (207) 287-4172

PROPERTY LOCATION		>> Caution: Permit Required - Attach in Space Below <<
City, Town, or Plantation	PORTLAND (PEAKS ISLAND)	The Subsurface Wastewater Disposal System shall not be installed until a Permit is attached HERE by the Local Plumbing Inspector. The Permit shall authorize the owner or installer to install the disposal system in accordance with this application and the Maine Subsurface Wastewater Disposal Rules.
Street or Road	18 WILEY AVENUE	
Subdivision, Lot #		
OWNER/APPLICANT INFORMATION		
Name (last, first, MI)	PECK HELEN	Owner Applicant
Mailing Address of	424 SANTA BARTOLA SOLANA BEACH, CA. 92075	
<input type="checkbox"/> Owner <input type="checkbox"/> Applicant		
Daytime Tel. #	(858) 337-5588	
Owner or Applicant Statement		Caution: Inspections Required
I state and acknowledge that the information submitted is correct to the best of my knowledge and understand that any falsification is reason for the Department and/or Local Plumbing Inspector to deny a permit.		I have inspected the installation authorized above and found it to be in compliance with the Subsurface Wastewater Disposal Rules Application.
 Signature of Owner/Applicant		Date: 1-26-11
		Municipal Tax Map * <u>87</u> Lot * <u>D-10</u>
		(1st) Date Approved _____ Local Plumbing Inspector Signature _____ (2nd) Date Approved _____

PERMIT INFORMATION


TYPE OF APPLICATION 1. <input type="checkbox"/> First Time System 2. <input checked="" type="checkbox"/> Replacement System Type Replaced: <u>CESSPOOL</u> Year Installed: <u>PRE-1974</u> 3. <input type="checkbox"/> Expanded System a. <input type="checkbox"/> Minor Expansion b. <input type="checkbox"/> Major Expansion 4. <input type="checkbox"/> Experimental System 5. <input type="checkbox"/> Seasonal Conversion	THIS APPLICATION REQUIRES 1. <input type="checkbox"/> No Rule Variance 2. <input type="checkbox"/> First Time System Variance a. <input type="checkbox"/> Local Plumbing Inspector Approval b. <input type="checkbox"/> State & Local Plumbing Inspector Approval 3. Replacement System Variance a. <input checked="" type="checkbox"/> Local Plumbing Inspector Approval b. <input type="checkbox"/> State & Local Plumbing Inspector Approval 4. <input type="checkbox"/> Minimum Lot Size Variance 5. <input type="checkbox"/> Seasonal Conversion Approval	DISPOSAL SYSTEM COMPONENTS 1. <input checked="" type="checkbox"/> Complete Non-Engineered System 2. <input type="checkbox"/> Primitive System (graywater & alt toilet) 3. <input type="checkbox"/> Alternative Toilet, specify: _____ 4. <input type="checkbox"/> Non-Engineered Treatment Tank (only) 5. <input type="checkbox"/> Holding Tank, _____ Gallons 6. <input type="checkbox"/> Non-Engineered Disposal Field (only) 7. <input type="checkbox"/> Separated Laundry System 8. <input type="checkbox"/> Complete Engineered System (2000 gpd+) 9. <input type="checkbox"/> Engineered Treatment Tank (only) 10. <input type="checkbox"/> Engineered Disposal Field (only) 11. <input type="checkbox"/> Pre-treatment, specify: _____ 12. <input type="checkbox"/> Miscellaneous components
SIZE OF PROPERTY +/- <u>0.24</u> <input type="checkbox"/> sq. ft. <input checked="" type="checkbox"/> acres	DISPOSAL SYSTEM TO SERVE 1. <input checked="" type="checkbox"/> Single Family Dwelling Unit, No. of Bedrooms: <u>2</u> 2. <input type="checkbox"/> Multiple Family Dwelling, No of Units: _____ 3. <input type="checkbox"/> Other: _____ SPECIFY Current Use <input type="checkbox"/> Seasonal <input checked="" type="checkbox"/> Year Round <input type="checkbox"/> Undeveloped	TYPE OF WATER SUPPLY 1. <input type="checkbox"/> Drilled Well 2. <input type="checkbox"/> Dug Well 3. <input type="checkbox"/> Private 4. <input checked="" type="checkbox"/> Public 5. <input type="checkbox"/> Other: _____
SHORELAND ZONING <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No		

DESIGN DETAILS (SYSTEM LAYOUT SHOWN ON PAGE 3)

TREATMENT TANK 1. <input checked="" type="checkbox"/> Concrete a. <input type="checkbox"/> Regular b. <input checked="" type="checkbox"/> Low Profile (IF NEC.) 2. <input type="checkbox"/> Plastic 3. <input type="checkbox"/> Other: _____ CAPACITY <u>1000</u> gallons	DISPOSAL FIELD TYPE & SIZE 1. <input type="checkbox"/> Stone Bed 2. <input type="checkbox"/> Stone Trench 3. <input checked="" type="checkbox"/> Proprietary Device a. <input type="checkbox"/> Cluster array c. <input checked="" type="checkbox"/> Linear b. <input checked="" type="checkbox"/> Regular d. <input type="checkbox"/> H-20 loaded 4. <input type="checkbox"/> Other: _____ SIZE <u>672</u> <input type="checkbox"/> sq. ft. <input type="checkbox"/> lin. ft. 14 ELJEN IN-DRAIN UNITS	GARBAGE DISPOSAL UNIT 1. <input checked="" type="checkbox"/> No 3. <input type="checkbox"/> Maybe 2. <input type="checkbox"/> Yes >> Specify one below: a. <input type="checkbox"/> Multi-compartment tank b. <input type="checkbox"/> _____ tanks in series c. <input type="checkbox"/> Increase in tank capacity d. <input type="checkbox"/> Filter on tank outlet	DESIGN FLOW 180 gallons per day BASED ON: 1. <input type="checkbox"/> Table 501.1 (dwelling unit(s)) 2. <input type="checkbox"/> Table 501.2 (other facilities) SHOW CALCULATIONS for other facilities - 2 BEDROOMS AT 90 GALLONS PER DAY EACH
SOIL DATA & DESIGN CLASS PROFILE <u>2</u> / CONDITION <u>AIII</u> / DESIGN <u>I</u> AT Observation Hole # <u>TP 1</u> Depth <u>20</u> " Elevation <u>-46</u> " OF MOST LIMITING SOIL FACTOR	DISPOSAL FIELD SIZING 1. <input type="checkbox"/> Small - 2.0 sq.ft./gpd 2. <input type="checkbox"/> Medium - 2.6 sq.ft./gpd 3. <input checked="" type="checkbox"/> Medium-Large - 3.3 sq.ft./gpd 4. <input type="checkbox"/> Large - 4.1 sq.ft./gpd 5. <input type="checkbox"/> Extra-Large - 5.0 sq.ft./gpd	EFFLUENT/EJECTOR PUMP 1. <input type="checkbox"/> Not required SEE NOTE ON PAGE 3 2. <input checked="" type="checkbox"/> May be required 3. <input type="checkbox"/> Required Specify only for engineered systems: DOSE: _____ Gallons	3. <input type="checkbox"/> Section 503.0 (meter readings) ATTACH WATER-METER DATA LATITUDE AND LONGITUDE at center of disposal area Lat. <u>N 43</u> d <u>39</u> m <u>39</u> s Lon. <u>W 70</u> d <u>11</u> m <u>35</u> s if g.p.s., state margin of error

SITE EVALUATOR STATEMENT

I certify that on 1/10/11 (date) I completed a site evaluation on this property and state that the data reported is accurate and that the proposed system is in compliance with the Subsurface Wastewater Disposal Rules (10-14.4A CMR 241).


163
1/18/2011

Site Evaluator Signature SE * Date

SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Maine Department of Human Services
 Division of Health Engineering, Station 10 SHS
 (207) 287-5672 FAX (207) 287-4172



Town, City, Plantation
PORTLAND (PEAKS ISLAND)

Street, Road Subdivision
18 WILEY AVENUE

Owner's Name
HELEN PECK

SITE PLAN Scale 1" = 50 Ft.
 or as shown

SITE LOCATION PLAN
 (Attach Map from Maine Atlas for New System Variance)

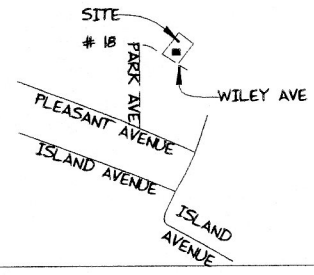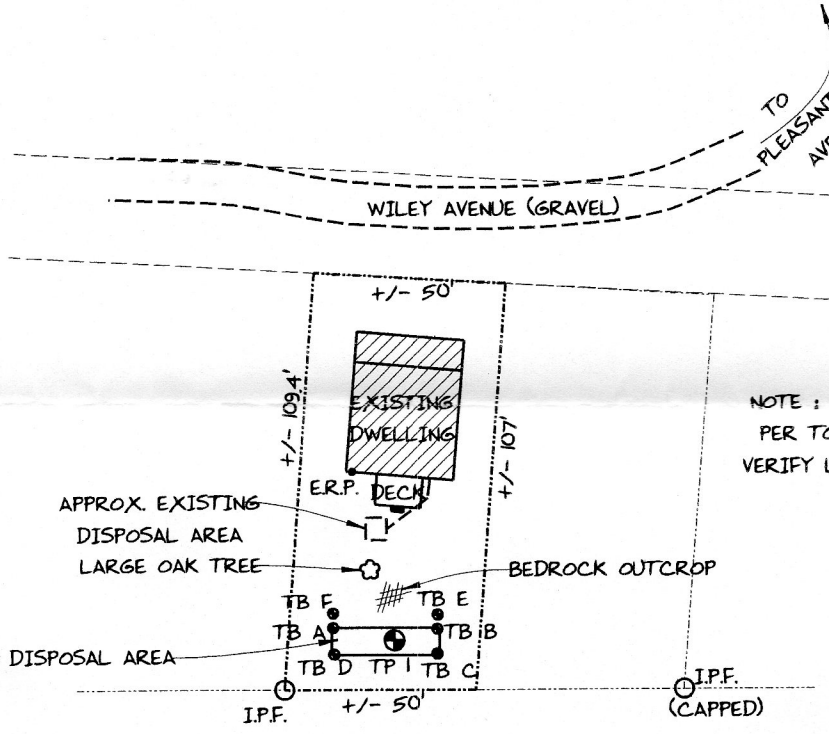

NOTE : PROPERTY INFORMATION APPROXIMATED PER TOWN TAX MAP AND AERIAL PHOTOGRAPH. VERIFY LOT LINES TO ASSURE PROPER SETBACKS.

SOIL DESCRIPTION AND CLASSIFICATION (Location of Observation Holes Shown Above)

Observation Hole TP 1 Test Pit Boring
 " Depth of Organic Horizon Above Mineral Soil

Texture	Consistency	Color	Mottling
		DARK BROWN	
GRAVELLY			
SANDY	FRIABLE	DARK	
LOAM		YELLOWISH BROWN	
BEDROCK			

Soil Classification: Profile 2 Condition AIII Slope %
 Limiting Factor: 21" Ground Water Restrictive Layer Bedrock Pit Depth

Observation Hole TB A-F Test Pit Boring
 " Depth of Organic Horizon Above Mineral Soil

Texture	Consistency	Color	Mottling
TB A = 20" TO REFUSAL			
TB B = 4" TO REFUSAL			
TB C = 26" TO REFUSAL			
TB D = 30" TO REFUSAL			
TB E = 14" TO REFUSAL			
TB F = 11" TO REFUSAL			

Soil Classification: Profile Condition Slope %
 Limiting Factor: Ground Water Restrictive Layer Bedrock Pit Depth

Albert Frick
 Site Evaluator Signature

163
 SE *

1/18/2011
 Date

SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Maine Department of Human Services
 Division of Health Engineering, Station 10 SHS
 (207) 287-5672 FAX (207) 287-4172


Town, City, Plantation
PORTLAND (PEAKS ISLAND)

Street, Road, Subdivision
18 WILEY AVENUE

Owner's Name
HELEN PECK

SUBSURFACE WASTEWATER DISPOSAL PLAN

SCALE 1" = 20 FT.

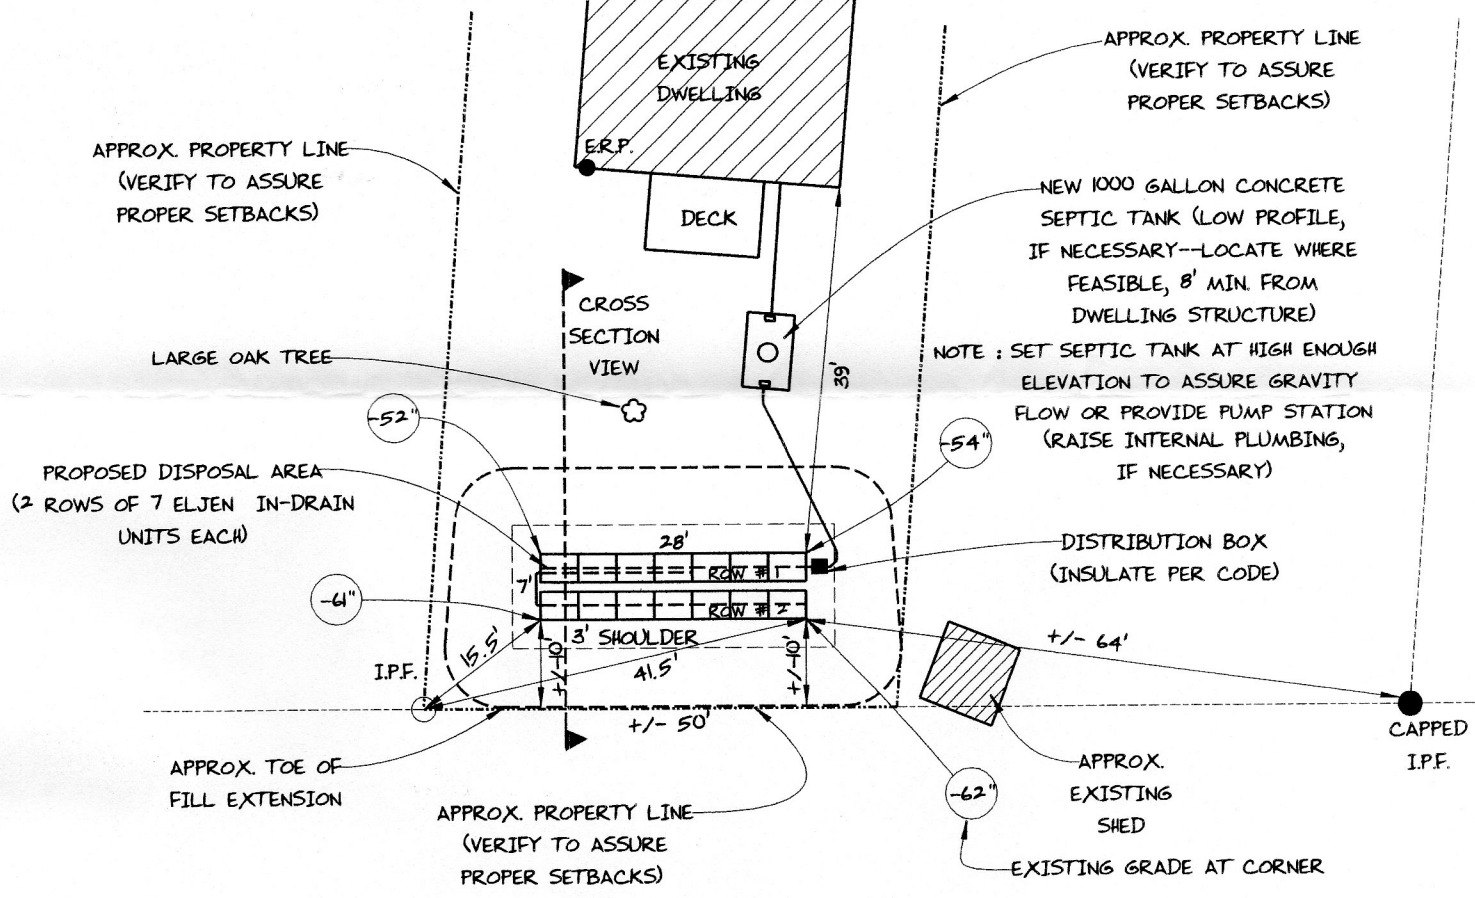

FILL REQUIREMENTS


Depth of Fill (Upslope) : 27"-29"
 Depth of Fill (Downslope) : 26"-27"
 DEPTHS AT CROSS-SECTION (shown below)

CONSTRUCTION ELEVATIONS

Finished Grade Elevation
 Top of Distribution Pipe or Proprietary Device
 Bottom of Disposal Area

ELEVATION REFERENCE POINT
 SEE DETAIL 18 BELOW
 Location & Description BOTTOM OF SIDING, ABOVE GRADE AT FOUNDATION (SEE ABOVE)
 Reference Elevation is: 0.0" or -----

DISPOSAL AREA CROSS SECTION

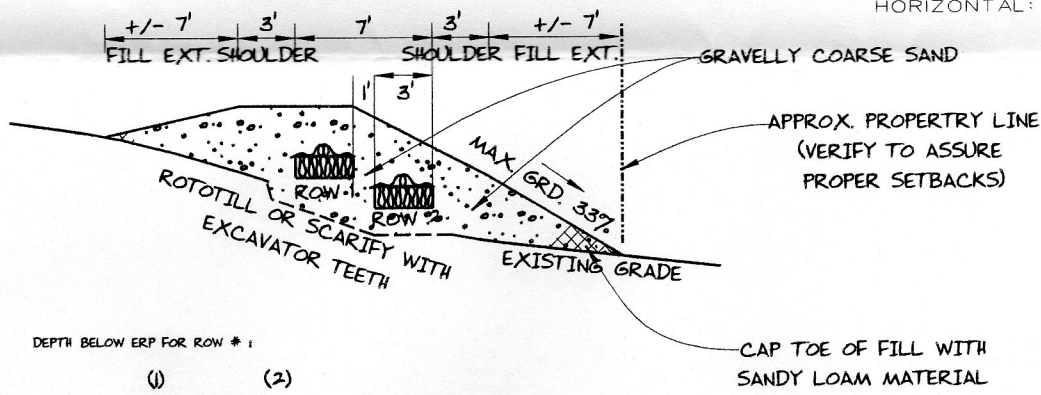

DEPTH BELOW ERP FOR ROW #:

	(1)	(2)
CLEAN FILL	-25"	-35"
GEOTEXTILE FABRIC	-37"	-47"
OVER 4" DIA. PERF. PIPE	-41"	-51"
ELJEN IN-DRAIN UNIT	-48"	-58"
	-54"	-64"

SEE ELJEN IN-DRAIN MANUAL ON SERIAL DISTRIBUTION ON SLOPES FOR PROPER PIPING

FINISHED GRADE

GRAVELLY COARSE SAND NO PARTICLES OR GRAVEL LARGER THAN 2 1/4"

Albert Frick
 Site Evaluator Signature

163
 SE *

1/18/2011
 Date

REPLACEMENT SYSTEM VARIANCE REQUEST

THE LIMITATIONS OF THE REPLACEMENT SYSTEM VARIANCE REQUEST

This form must be attached to an application (HHE-200) for any replacement system which requires a variance to the Rules. The LPI shall review the Replacement System Variance Request and HHE-200 and may approve the Request if all of the following requirements are met.

1. The proposed design meets the definition of a Replacement System as defined in the Rules (Sec. 1906.0)
2. The replacement system is determined by the Site Evaluator to be the most practical method to treat and dispose of the wastewater.
3. The BOD5 plus S.S. content of the wastewater is no greater than that of normal domestic effluent.

GENERAL INFORMATION

Town of Portland (Peaks Island)

Permit No. _____

Date Permit Issued _____

Property Owner's Name: Helen Peck

Tel. No.: 1(858)337-5588

System's Location: 18 Wiley Avenue (Map 87, Lot D-10)

Property Owner's Address: 424 Santa Bartola

(if different from above) Solana Beach, Ca. 92075

SPECIFIC INSTRUCTIONS TO THE:

LOCAL PLUMBING INSPECTOR (LPI):

If any of the variances exceed your approval authority and/or do not meet all of the requirements listed under the Limitations Section above, then you are to send this Replacement System Variance Request, along with the Application, to the Department for review and approval consideration before issuing a Permit. (See reverse side for Comments Section and your signature.)

SITE EVALUATOR:

If after completing the Application, you find that a variance for the proposed replacement system is needed, complete the Replacement Variance Request with your signature on reverse side of form.

PROPERTY OWNER:

If has been determined by the Site Evaluator that a variance to the Rules is required for the proposed replacement system. This variance request is due to physical limitations of the site and/or soil conditions. The Site Evaluator has considered the site/soil restrictions and has concluded that a replacement system in total compliance with the Rules is not possible.

PROPERTY OWNER

I understand that the proposed system requires a variance to the Rules. Should the proposed system malfunction, I release all concerned provided they have performed their duties in a reasonable and proper manner, and I will promptly notify the Local Plumbing Inspector and make any corrections required by the Rules. By signing the variance request form, I acknowledge permission for representatives of the Department to enter onto the property to perform such duties as may be necessary to evaluate the variance request.


SIGNATURE OF OWNER

1-26-11
DATE

LOCAL PLUMBING INSPECTOR

I, _____, the undersigned, have visited the above property and have determined to the best of my knowledge that it cannot be installed in compliance with the Rules. As a result of my review of the Replacement Variance Request, the Application, and my on-site investigation, I (approve, disapprove) the variance request based on my authority to grant this variance. Note: If the LPI does not give his approval, he shall list his reasons for denial in **Comments** Section below and return to the applicant.

Comments: _____

LPI SIGNATURE

DATE


Replacement System Variance Request

VARIANCE CATEGORY							VARIANCE REQUESTED TO:	
SOILS								
Soil Profile	Ground Water Table						inches	
Soil Condition	Restrictive Layer						inches	
from HHE-200	Bedrock						inches	
SETBACK DISTANCES (in feet)	Disposal Fields			Septic Tanks			Disposal Fields	Septic Tanks
	From	Less than 1000 gpd	1000 to 2000 gpd	Over 2000 gpd	Less than 1000 gpd	1000 to 2000 gpd	Over 2000 gpd	To To
Wells with water usage of 2000 or more gpd or public water system wells	300 ft	300 ft	300 ft	150 ft	150 ft	150 ft		
Private Potable Water Supply	100 ft [a]	200 ft	300 ft	50 ft	100 ft	100 ft		
Water supply line	10 ft	20 ft	25 ft [g]	10 ft	10 ft	10 ft [g]		
Water course, major -	100 ft [c]	200 ft [c]	300 ft [c]	100 ft	100 ft	100 ft		
Water course, minor	50 ft [d]	100 ft [d]	150 ft [d]	50 ft [d]	50 ft [d]	50 ft [d]		
Drainage ditches	25 ft	50 ft	75 ft	25 ft	25 ft	25 ft		
Edge of fill extension -- Coastal wetlands, special freshwater wetlands, great ponds, rivers, streams	25 ft [d]	25 ft [d]	25 ft [d]	25 ft [d]	25 ft [d]	25 ft [d]		
Slopes greater than 3:1	10 ft [f]	18 ft [f]	25 ft [f]	N/A	N/A	N/A		
No full basement [e.g. slab, frost wall, columns]	15 ft	30 ft	40 ft	8 ft	14 ft	20 ft		
Full basement [below grade foundation]	20 ft	30 ft	40 ft	8 ft	14 ft	20 ft		
Property lines	10 ft [b]	18 ft [b]	20 ft [b]	10 ft [b]	15 ft [b]	20 ft [b]		
Burial sites or graveyards, measured from the down toe of the fill extension	25 ft	25 ft	25 ft	25 ft	25 ft	25 ft		


OTHER

1. 3 : 1 slope fill extensions to retain fill on property _____
2. _____
3. _____

Footnotes: [a.] Private Potable water Supply setbacks may be reduced as prescribed in Chapter 7
 [b.] Additional setbacks may be needed to prevent fill material extensions from encroaching onto abutting property.
 [c.] Additional setbacks may be required by local Shoreland zoning.
 [d.] Natural Resource Protection Act requires a 25 feet setback, on slopes of less than 20%, from the edge of soil disturbance and 100 feet on slopes greater than 20%. See Chapter 15.
 [e.] May not be any closer to a private potable water supply than the existing disposal field or septic tank . This setback may be reduced for single family houses with Department approval. See Section 702.3.
 [f.] The fill extension shall reach the existing ground before the 3:1 slope or within 100 feet of the disposal field.
 [g.] See Section 1402.8 for special procedures when these minimum setbacks cannot be achieved.

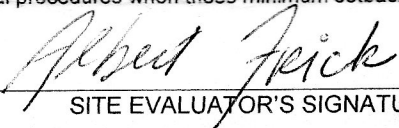

 SITE EVALUATOR'S SIGNATURE



 DATE

FOR USE BY THE DEPARTMENT ONLY

The Department has reviewed the variance(s) and (does does not) give its approval. Any additional requirements, recommendations, or reasons for the Variance denial, are given in the attached letter.

 SIGNATURE OF THE DEPARTMENT

 DATE