

088 L 012

REPLACEMENT SYSTEM VARIANCE REQUEST

THE LIMITATIONS OF THE REPLACEMENT SYSTEM VARIANCE REQUEST

This form shall be attached to an application (HHE-200) for the proposed replacement system which requires a variance to the Rules. The LPI shall review the Replacement System Variance Request and may approve the Request if all of the following requirements can be met, and the variance(s) requested fall within the limits of LPI's authority.

1. The proposed design meets the definition of a Replacement System as defined in the Rules (Sec. 1903)
2. There will be no change in use of the structure except as authorized for one-time exempted expansions outside the shoreland zone of major waterbodies/courses.
3. The replacement system is determined by the Site Evaluator and LPI to be the most practical method to treat and dispose of the wastewater.
4. The BOD5 plus S.S. content of the wastewater is no greater than that of normal domestic effluent.

GENERAL INFORMATION		Town of <u>PEAKS ISLAND</u>
Permit No. _____	Date Permit Issued _____	
Property Owner's Name: <u>WALTER SCHNELLER</u>	Tel. No.: <u>766-2091</u>	
System's Location: <u>123 UPPER A S STREET</u>		
Property Owner's Address: _____		
(if different from above)		

SPECIFIC INSTRUCTIONS TO THE:
LOCAL PLUMBING INSPECTOR (LPI):
 If any of the variances exceed your approval authority and/or do not meet all of the requirements listed under the Limitations Section above, then you are to send this Replacement System Variance Request, along with the Application, to the Department for review and approval consideration before issuing a Permit. (See reverse side for Comments Section and your signature.)

SITE EVALUATOR:
 If after completing the Application, you find that a variance for the proposed replacement system is needed, complete the Replacement Variance Request with your signature on reverse side of form.

PROPERTY OWNER:
 If has been determined by the Site Evaluator that a variance to the Rules is required for the proposed replacement system. This variance request is due to physical limitations of the site and/or soil conditions. Both the Site Evaluator and the LPI have considered the site/soil restrictions and have concluded that a replacement system in total compliance with the Rules is not possible.

PROPERTY OWNER

I understand that the proposed system requires a variance to the Rules. Should the proposed system malfunction, I release all concerned provided they have performed their duties in a reasonable and proper manner, and I will promptly notify the Local Plumbing Inspector and make any corrections required by the Rules. By signing the variance request form, I acknowledge permission for representatives of the Department to enter onto the property to perform such duties as may be necessary to evaluate the variance request.

_____ SIGNATURE OF OWNER _____ DATE _____

LOCAL PLUMBING INSPECTOR

I, MIKE NOGARD, the undersigned, have visited the above property and have determined to the best of my knowledge that it cannot be installed in compliance with the Rules. As a result of my review of the Replacement Variance Request, the Application, and my on-site investigation, I (check and complete either a or b):

a. (Approve, disapprove) the variance request based on my authority to grant this variance. Note: If the LPI does not give his approval, he shall list his reasons for denial in Comments Section below and return to the applicant. —OR—

b. find that one or more of the requested Variances exceeds my approval authority as LPI. I (recommend, do not recommend) the Department's approval of the variances. Note: If the LPI does not recommend the Department's approval, she shall state his reasons in Comments Section below as to why the proposed replacement system is not being recommended.

Comments: _____

_____ LPI SIGNATURE _____ DATE 08/28/03

Replacement System Variance Request

VARIANCE CATEGORY	VARIANCE REQUESTED		LIMIT OF LPI'S APPROVAL AUTHORITY		VARIANCE REQUESTED TO:	
SOILS						
Soil Profile	Ground Water Table		to 7"		Inches	
Soil Condition from HHE-200	Restrictive Layer		to 7"		Inches	
	Bedrock		to 12"		Inches	
SETBACK DISTANCES (in feet)	Disposal Fields		Septic Tanks		Disposal Fields	Septic Tanks
From:	Less than 1000 gpd	1000 to 2000 gpd	Less Than 1000 gpd	1000 to 2000 gpd	To	To
Wells with water usage of 2000 or more gpd	300 ft	300 ft	100 ft	100 ft		
Owner's wells	100 down to 50 ft	200 down to 100 ft	100 ^D down to 50 ft	100 down to 50 ft	* 90'	25'
Neighbor's wells	100 ^D down to 80 ft	200 ^D down to 120 ft	100 ^D down to 50 ft	100 ^D down to 75 ft		
Water supply line	10 ft ^A	20 ft ^A	10 ft ^A	10 ft ^A		
Water course, major - for replacements only, see Table 400.4 for exempted expansions	100 down to 60 ft	200 down to 120 ft	100 down to 50 ft	100 down to 50 ft		
Water course, minor	50 down to 25 ft	100 down to 50 ft	50 down to 25 ft	50 down to 25 ft		
Drainage ditches	25 down to 12 ft	50 down to 25 ft	25 down to 12 ft	25 down to 12 ft		
Coastal wetlands, special freshwater wetlands, great ponds, rivers, streams (edge of fill extension)	25 ft ^d	25 ft ^d	25 ft ^d	25 ft ^d		
Slopes greater than 3:1	10 ft	18 ft	N/A	N/A		
No full basement [e.g. slab, frost wall, columns]	15 down to 7 ft	30 down to 15 ft	8 down to 5 ft	14 down to 7 ft		
Full basement [below grade foundation]	20 down to 10 ft	30 down to 15 ft	8 down to 5 ft	14 down to 7 ft		
Property lines	10 down to 5 ^B ft	18 ft down to 9 ^C ft	10 ft down to 4 ^C ft	15 ft down to 7 ^C ft		
Burial sites or graveyards, measured from the down toe of the fill extension	25 ft	25 ft	25 ft	25 ft		

OTHER

1. Fill extension Grade - to 3:1
2. * PROPOSED DISPOSAL AREA FURTHER AWAY FROM WELL THAN EXISTING LESS POOL
- 3.

Footnotes:

- a. This setback distance cannot be reduced by the LPI, but may be considered for reduction by State variance.
- b. Written Permission from the owner of a well is required when a replacement system will be bated less than 100 (or 200 ft. for 1000-2000 gpd) feet and closer to that well than the system it is replacing.
- c. Sufficient distance shall be maintained to assure that the toe of the fill does not extend to the 3:1 slope or property line.
- d. Natural Resources Protection Act requires a 25 foot setback on slopes with less than 20% from the edge of disturbance and 100 feet on slopes greater than 20% except for the repair or installation of a replacement system when no practical alternative exists.

Albert Frick

 SITE EVALUATOR'S SIGNATURE

1/16/2001

 DATE

FOR USE BY THE DEPARTMENT ONLY

The Department has reviewed the variance(s) and (do or does not) give its approval. Any additional requirements, recommendations, or reasons for the Variance denial, are given in the attached letter.

 SIGNATURE OF THE DEPARTMENT

 DATE

SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Maine Department of Human Services
Division of Health Engineering, Station 10 SHS
(207) 287-5672 FAX (207) 287-4172

PROPERTY LOCATION		>> Caution: Permit Required - Attach In Space Below <<
City, Town, or Plantation	PEAKS ISLAND, PORTLAND	PORTLAND TV _____ Date _____ Pt _____ Permit _____ or _____ issued _____ or _____ Local Plumbing Inspector Signature
Street or Road	123 UPPER A STREET	
Subdivision, Lot *	LOT 18	

OWNER/APPLICANT INFORMATION		8590 TOWN COPY	<input type="checkbox"/> Double Fee Charged
Name (last, first, MI)	SCINELLER WALTER	L.P.I. #	\$110.00
Mailing Address of	Owner Applicant		
<input type="checkbox"/> Owner <input type="checkbox"/> Applicant			
Daytime Tel. *	766-2091	Municipal Tax Map * 085 L Lot * 012	

Owner or Applicant Statement	Caution: Inspections Required
I state and acknowledge that the information submitted is correct to the best of my knowledge and understand that my falsification is reason for the Department and/or Local Plumbing Inspector to deny a permit.	I have inspected the installation authorized above and found it to be in compliance with the Subsurface Wastewater Disposal Rules Application.
Signature of Owner/Applicant _____ Date _____	Local Plumbing Inspector Signature _____ (1st) Date Approved _____ _____ (2nd) Date Approved _____

PERMIT INFORMATION

TYPE OF APPLICATION	THIS APPLICATION REQUIRES	DISPOSAL SYSTEM COMPONENTS
1. <input type="checkbox"/> First Time System 2. <input checked="" type="checkbox"/> Replacement System Type Replaced: _____ Year Installed: _____ 3. <input type="checkbox"/> Expanded System a. CI Minor Expansion b. CI Major Expansion 4. <input type="checkbox"/> Experimental System 5. <input type="checkbox"/> Seasonal Conversion	1. <input type="checkbox"/> No Rule Variance 2. <input type="checkbox"/> First Time System Variance o. <input type="checkbox"/> Local Plumbing Inspector Approval b. <input type="checkbox"/> State & Local Plumbing Inspector Approval 3. Replacement System Variance o. <input checked="" type="checkbox"/> Local Plumbing Inspector Approval b. <input type="checkbox"/> State & Local Plumbing Inspector Approval 4. <input type="checkbox"/> Minimum Lot Size Variance 5. <input type="checkbox"/> Seasonal Conversion Approval	1. <input checked="" type="radio"/> Complete Non-Engineered System 2. <input type="checkbox"/> Primitive System for water & oil toilet 3. CI Alternative Toilet, specify: _____ 4. <input type="checkbox"/> Non-Engineered Treatment Tank (only) 5. <input type="checkbox"/> Holding Tank, _____ Gallons 6. <input type="checkbox"/> Non-Engineered Disposal Field (only) 7. <input type="checkbox"/> Separated Laundry System 8. <input type="checkbox"/> Complete Engineered System (2000 gpd) 9. <input type="checkbox"/> Engineered Treatment Tank (only) 10. <input type="checkbox"/> Engineered Disposal Field (only) 11. <input type="checkbox"/> Pre-treatment, specify: 12. <input type="checkbox"/> Miscellaneous components
SIZE OF PROPERTY	DISPOSAL SYSTEM TO SERVE	TYPE OF WATER SUPPLY
2 ACRES +- <input type="checkbox"/> sq. ft. <input checked="" type="checkbox"/> acres	1. <input checked="" type="checkbox"/> Single Family Dwelling Unit, No. of Bedrooms: <u>3</u> 2. <input type="checkbox"/> Multiple Family Dwelling, No of Units: _____ 3. <input type="checkbox"/> Other: _____ SPECIFY Current Use <input type="checkbox"/> Seasonal <input checked="" type="checkbox"/> Year Round <input type="checkbox"/> Undeveloped	1. <input checked="" type="checkbox"/> Drilled Well 2. <input type="checkbox"/> Dug Well 3. <input type="checkbox"/> Private 4. <input type="checkbox"/> Public 5. <input type="checkbox"/> Other: _____
SHORELAND ZONING		
<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No		

DESIGN DETAILS (SYSTEM LAYOUT SHOWN ON PAGE 3)

ASBESTOS WATER TIGHTNESS TREATMENT TANK OR USE NON-LITIC TANK	DISPOSAL FIELD TYPE & SIZE	GARBAGE DISPOSAL UNIT	DESIGN FLOW
1. <input checked="" type="checkbox"/> Concrete a. <input checked="" type="checkbox"/> Regular b. <input type="checkbox"/> Low Profile 2. <input type="checkbox"/> Plastic 3. <input type="checkbox"/> Other: _____ CAPACITY 1000 l o n s	1. <input type="checkbox"/> Stone Bed 2. Stone Trench 3. <input checked="" type="checkbox"/> Proprietary Device a. <input type="checkbox"/> Cluster array c. <input checked="" type="checkbox"/> Linear b. <input checked="" type="checkbox"/> Regular d. <input type="checkbox"/> H-20 loaded 4. <input type="checkbox"/> Other: _____ SIZE <u>940</u> <input checked="" type="checkbox"/> sq. ft. <input type="checkbox"/> lin. ft. 20 ELJEN IN DRAINS	1. <input checked="" type="checkbox"/> No 3. <input type="checkbox"/> Maybe 2. <input type="checkbox"/> Yes >> Specify one below: a. <input type="checkbox"/> Multi-compartment tank b. <input type="checkbox"/> _____ tanks in series c. <input type="checkbox"/> Increase in tank capacity d. <input type="checkbox"/> Filter on tank outlet	270 gallons per day BASED ON: 1. <input checked="" type="checkbox"/> Table 501.1 (dwelling unit(s)) 2. <input type="checkbox"/> Table 501.2 (other facilities) SHOW CALCULATIONS - for other facilities -
SOIL DATA & DESIGN CLASS	DISPOSAL FIELD SIZING	PUMPING	
PROFILE <u>2</u> / CONDITION <u>A</u> / DESIGN <u>1</u> T Observation Hole . TB B eph <u>17</u> " F MOST LIMITING SOIL FACTOR	1. <input type="checkbox"/> Small - 2.0 sq.ft./gpd 2. <input type="checkbox"/> Medium - 2.6 sq.ft./gpd 3. <input checked="" type="checkbox"/> Medium-Large - 3.3 sq.ft./gpd 4. <input type="checkbox"/> Large - 4.1 sq.ft./gpd 5. <input type="checkbox"/> Extra-Large - 5.0 sq.ft./gpd	1. <input type="checkbox"/> Not required 2. <input checked="" type="checkbox"/> May be required 3. <input type="checkbox"/> Required >> Specify only for engineered or experimental systems: DOSE: _____ Gallons	3 BEDROOMS AT 90 GALLONS PER DAY EACH 3. <input type="checkbox"/> Section 503.0 (meter readings) ATTACH WATER-METER DATA

SITE EVALUATOR STATEMENT

I certify that on 8/15/00 (date) I completed a site evaluation on this property and state that the data reported is accurate and that the proposed system is in compliance with the Subsurface Wastewater Disposal Rules (10-144A CMR 211).

 Site Evaluator Signature

 K.S.
 SE

 Date



SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Maine Department of Human Services
 Division of Health Engineering, Station 10 SHS
 (207) 287-5672 FAX (207) 287-4172

Town, City, Plantation: **PEAKS ISLAND, PORTLAND** Street, Road Subdivision: **123 UPPER A STREET, LOT 1B** Owner's Name: **WALTER SCHNELLER**

SITE PLAN Scale 1" = 100 Ft. or as shown

SITE LOCATION PLAN (Attach Map from Maine Atlas for New System Variance)

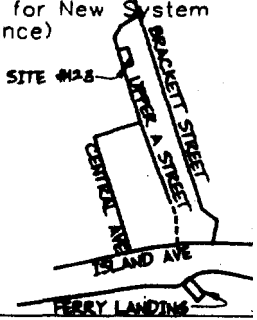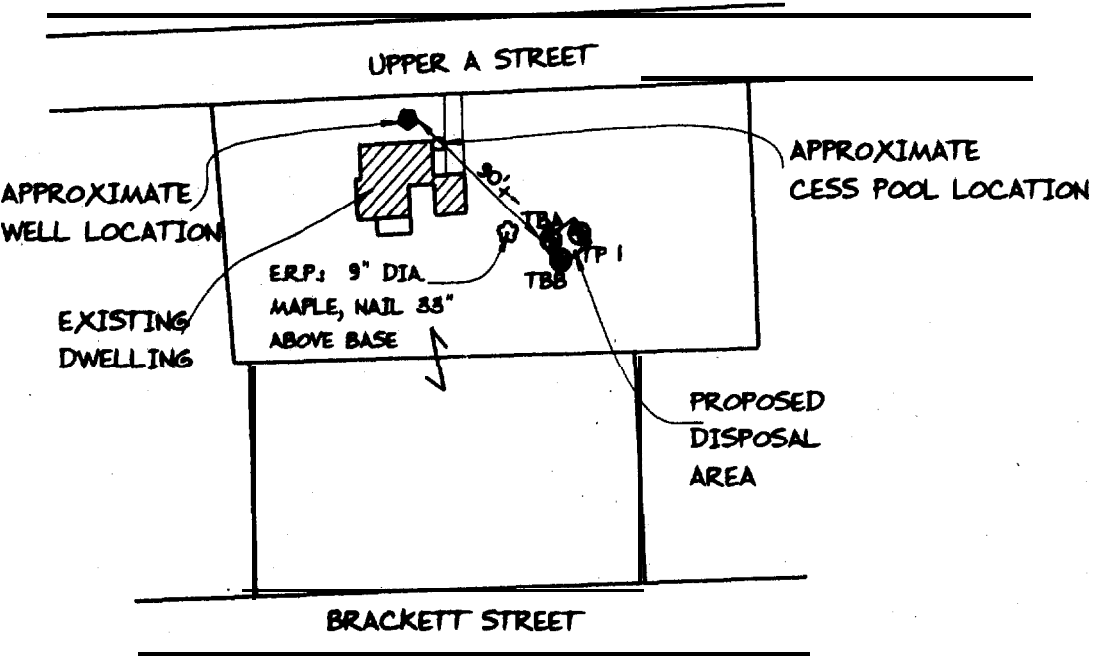

*PROPERTY LINES PER TOWN TAX MAP TO BE VERIFIED PRIOR TO INSTALLATION

SOIL DESCRIPTION AND CLASSIFICATION (Location of Observation Holes Shown Above)

Observation Hole TP 1 Test Pit Boring
 "Depth of Organic Horizon Above Mineral Soil _____"

DEPTH BELOW MINERAL SOIL SURFACE (Inches)	Texture	Consistency	Color	Mottling
0	SANDY		DARK BROWN	
10	LOAM W/ CRANNERY STONES	FRIABLE	DARK REDDISH BROWN	
20	BEDROCK			
30				
40				
50				

Soil Classification	Slope	Limiting Factor	<input type="checkbox"/> Ground Water
<u>2</u> Profile <u>A</u> Condition		<u>6</u> "	<input type="checkbox"/> Restrictive Layer
			<input checked="" type="checkbox"/> Bedrock
			<input type="checkbox"/> Pit Depth

Observation Hole _____ Test Pit Boring
 "Depth of Organic Horizon Above Mineral Soil _____"

DEPTH BELOW MINERAL SOIL SURFACE (Inches)	Texture	Consistency	Color	Mottling
0				
10				
20	TBA = 21" TO BEDROCK			
25	TBB = 17" TO BEDROCK			
30				
40				
50				

Soil Classification	Slope	Limiting Factor	<input type="checkbox"/> Ground Water
Profile _____ Condition _____			<input type="checkbox"/> Restrictive Layer
			<input type="checkbox"/> Bedrock
			<input type="checkbox"/> Pit Depth

Albert Frick
 Site Evaluator Signature


63
 SE

8/15/2003
 Date

SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Maine Department of Human Services
 Division of Health Engineering, Station 10 SHS
 (207) 287-5672 FAX (207) 287-4172

Town, City, Plantation PEAKS ISLAND, PORTLAND	Street, Road, Subdivision 123 UPPER A STREET, LOT 18	Owner's Name WALTER SCHNELLER
---	--	---

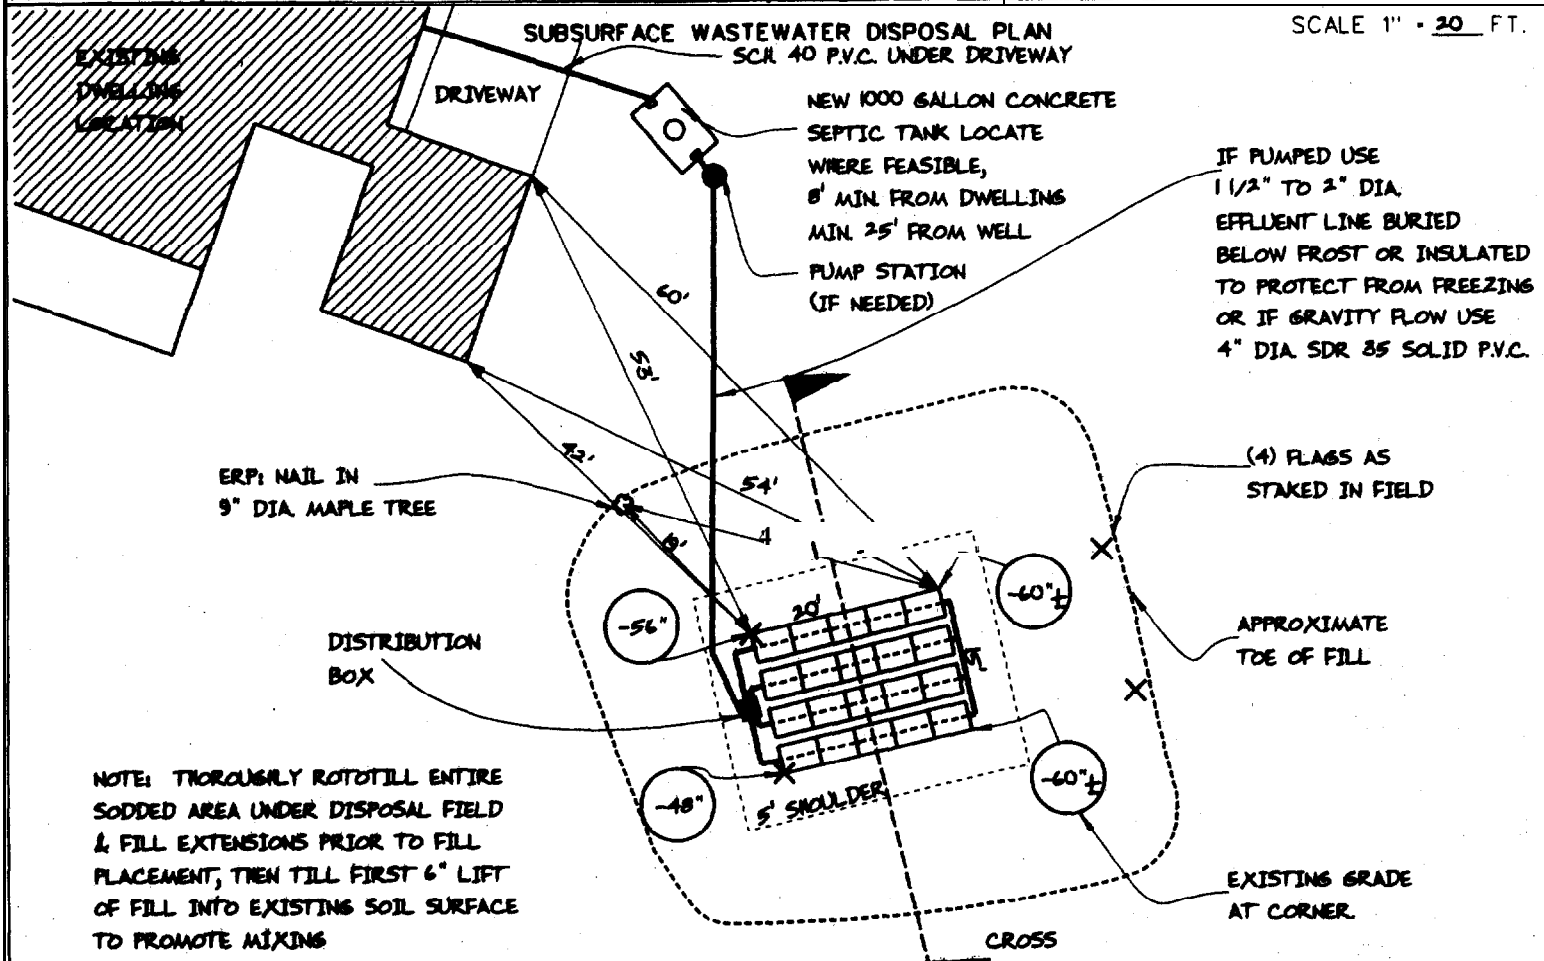

FILL REQUIREMENTS

Depth of Fill (Upslope) : 29" - 41"
 Depth of Fill (Downslope) : 37" - 41"
 DEPTHS AT CROSS-SECTION (shown below)

CONSTRUCTION ELEVATIONS


Finished Grade Elevation
 Top of Distribution Pipe or Proprietary Device
 Bottom of Disposal Area

SEE
 DETAIL
 BELOW

ELEVATION REFERENCE POINT
 Location & Description NAIL IN 9" DIA. MAPLE, 33" ABOVE BASE OF TREE
 Reference Elevation is: 0.0' or -----

DISPOSAL AREA CROSS SECTION

SCALE:
 VERTICAL: 1" = 5' FT
 HORIZONTAL: 1" = 10' FT

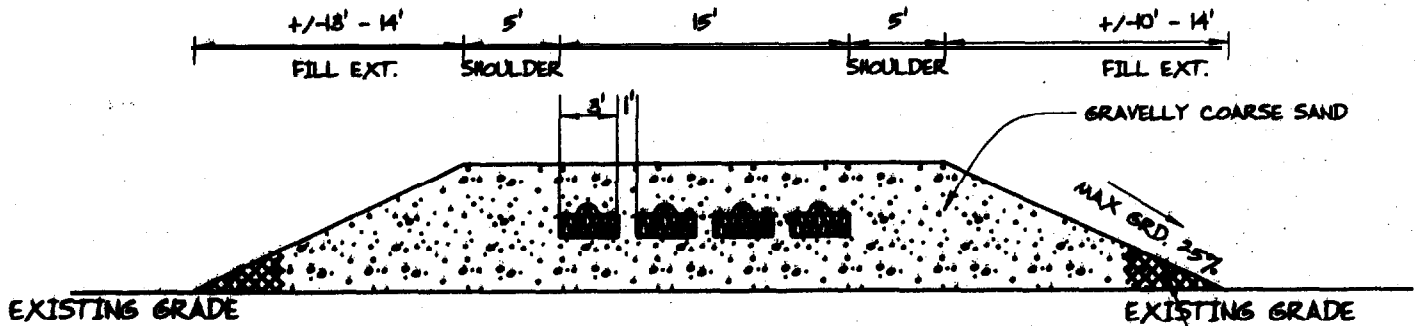

CLEAN FILL

GEOTEXTILE FABRIC OVER 4" DIA. PERF. PIPE

ELTEN IN-DRAIN UNIT

DEPTH BELOW ERP

-18"

-30"

-34"

-41"

CAP TOE OF FILL WITH SANDY LOAM MATERIAL TO PREVENT WASTEWATER BREAKOUT

Site Evaluator Signature

163
 SE

8/15/2003
 Date

Page 3 of 3
 HHE-200 Rev. 10/02



Albert Frick Associates, Inc.

Soil Scientists & Site Evaluators

95A County Road Corham, Maine 04038

(207) 839-5563

Peaks Island 123 Upper A Street Walter Schneller
TOWN LOCATION APPLICANT'S NAME

1) **The Plumbing and Subsurface Wastewater Disposal Rules adopted by the State of Maine, Department of Human Services pursuant to 22 M.R.S.A. § 42 (the "Rules") are incorporated herein by reference and made a part of this application and shall be consulted by the owner/applicant, the system Installer and/or building contractor for further construction details and material specifications. The system Installer should contact Albert Frick Associates, Inc. 839-5563, if there are any questions concerning materials, procedures or designs. The system installer and/or building contractor installing the system shall be solely responsible for compliance with the Rules and with all state and municipal laws and ordinances pertaining to the permitting, inspection and construction of subsurface wastewater disposal systems.**

2) **This application is intended to represent facts pertinent to the Rules only. It shall be the responsibility of the owner/applicant, system installer and/or building contractor to determine compliance with and to obtain permits under all applicable local, state and/or federal laws and regulations (including, without limitation, Natural Resources Protection Act, wetland regulations, zoning ordinances, subdivision regulations, Site Location of Development Act and minimum lot size laws) before installing this system or considering the property on which the system is to be installed a "buildable" lot. It is recommended that a wetland scientist be consulted regarding wetland regulations.**

Prior to the commencement of construction/installation, the local plumbing inspector shall inform the owner/Applicant and Albert Frick Associates, Inc. of any local ordinances which are more restrictive than the Rules in order that the design may be amended. All designs are subject to review by local, state and/or federal authorities. Albert Frick Associates, Inc.'s liability shall be limited to revisions required by regulatory agencies pursuant to laws or regulations in effect at the time of preparation of this application.

3) **All information shown on this application relating to property lines, well locations, subsurface structures and underground facilities (such as, utility lines, drains, septic systems, water tanks, etc.) are based solely upon information provided by the owner/applicant and has been relied upon by Albert Frick Associates, Inc. in preparing this application. The owner/applicant shall review this application prior to the start of construction and confirm this information.**

4) **Installation of a garbage (grinder) disposal is not recommended. If one is installed, an additional 1000 gallon septic tank or a septic tank filter should be connected in series to the proposed septic tank.**

5) **The system user shall avoid introducing kitchen grease or fats into this system. Chemicals such as septic tank cleaners and/or chlorine (such as from water treatment) and controlled or hazardous substances shall not be disposed of in this system.**

ATTACHMENT TO SUBSURFACE WASTEWATER DISPOSAL APPLICATION

Peaks Island
TOWN

123 Upper A Street
LOCATION

Walter Schneller
APPLICANT'S NAME

6) The septic tank should be pumped within two years of installation and subsequently as recommended by the pump service, but in no event should the septic tank be pumped less often than once every three years.

7) The actual water flow or number of bedrooms shall not exceed the design criteria indicated on this application without a re-evaluation of the system as proposed. If the system is supplied by public water or a private service with a water meter, the water consumption per period should be divided by the number of days to calculate the average daily water consumption (water usage (cu. ft.) x 7.48 cu. ft. (gallons per cu. ft.) + # of days ill period).

8) The general minimum setbacks between a well and septic system serving a single family residence is 100-300 feet, unless the local municipality has a more stringent requirement. A well installed by an abutter within the minimum setback distances prior to the issuance of a permit for the proposed disposal system may void this design.

9) When a gravity system is proposed: **BEFORE CONSTRUCTION/INSTALLATION BEGINS**, the system installer or building contractor shall review the elevations of all points given in this application and the elevation of the existing and/or proposed building drain and septic tank inverts for compatibility to minimum slope requirements. In gravity systems, the invert of the septic tank(s) outlet(s) shall be at least 4 inches above the invert of the distribution box outlet at the disposal area. When an effluent pump is required, provisions shall be made to make certain that surface ground water does not enter the septic tank or pump station. An alarm device warning of a pump failure shall be installed. Also, when pumping is required to a chamber system, install a "T" connection in the distribution box and place 3 inches of stone or a splash plate in the first chamber. Insulate gravity pipes, pump lines and the distribution box as necessary to prevent freezing.

10) On all systems, remove the vegetation, organic duff and Old fill material from under the disposal area and any fill extension. On sites where the proposed system is to be installed in natural soil, scarify the bottom and sides of the excavated disposal area with a rake. Do not use wheeled equipment on the scarified soil surface. For systems installed in fill, scarify the native soil by roto-tilling to a depth of at least 8 inches over the entire disposal and fill extension area to prevent glazing and to promote fill bonding. Place fill in loose layers no deeper than 8 inches and compact thoroughly before placing more fill (this ensures that voids and loose pockets are eliminated to minimize the chance of leakage). Do not use wheeled equipment on the scarified soil area until after 12 inches of fill is in place. Keep equipment off the chambers. Divert the surface water away from the disposal area by ditching or shallow swales.

11) Unless noted otherwise, fill shall be gravelly coarse sand which contains no more than 5 % fines (Silt and clay).

12) Do not install systems on loamy, silty, or clayey soils during wet periods since soil smearing/glazing may seal off the soil interface.

13) Seed all filled and disturbed surfaces with perennial grass seed, then mulch with hay or equivalent material to prevent erosion.



Albert Erick Associates, Inc.
Soil Scientists & Site Evaluators
954 County Road 1, Graham, Maine 04036
(207) 839-7563