
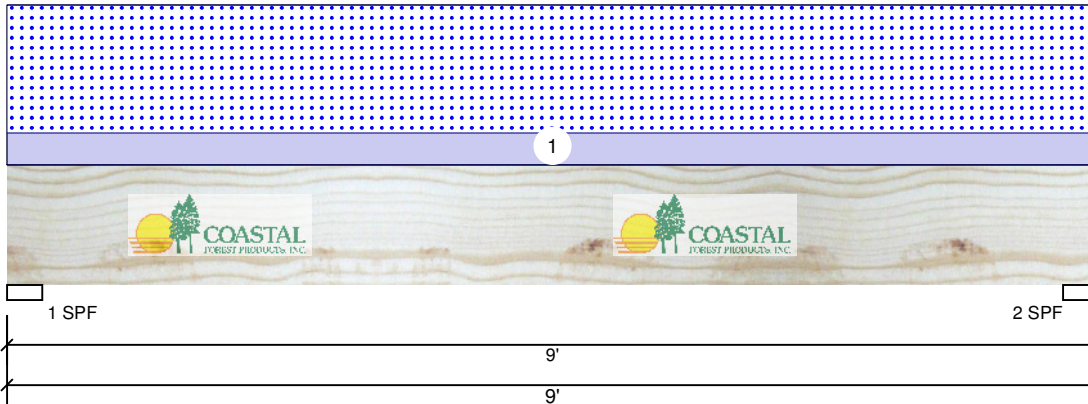


**B2 2.0E CP-LAM 1.750" X 11.875" 2-Ply - PASSED**

Level: Level


**Member Information**

Type:	Girder
Plies:	2
Moisture Condition:	Dry
Deflection LL:	360
Deflection TL:	240
Importance:	Normal
Temperature:	Temp <= 100°F

Application:	Floor
Design Method:	ASD
Building Code:	IBC 2012
Load Sharing:	No
Deck:	Not Checked

**Reactions lb (Uplift)**

Brg	Live	Dead	Snow	Wind	Const
1	0	1061	4050	0	0
2	0	1061	4050	0	0

**Bearings**

Bearing	Length	Cap. React	D/L lb	Total	Ld. Case	Ld. Comb.
1 - SPF	3.500"	98%	1061 / 4050	5111	L	D+S
2 - SPF	3.500"	98%	1061 / 4050	5111	L	D+S

**Analysis Results**

Analysis	Actual	Location	Allowed	Capacity	Comb.	Case
Moment	10358 ft-lb	4'6"	24489 ft-lb	0.423 (42%)	D+S	L
Unbraced	10358 ft-lb	4'6"	10463 ft-lb	0.990 (99%)	D+S	L
Shear	3727 lb	1'2 5/8"	9081 lb	0.410 (41%)	D+S	L
LL Defl inch	0.110 (L/929)	4'6"	0.285 (L/360)	0.390 (39%)	S	L
TL Defl inch	0.139 (L/736)	4'6"	0.427 (L/240)	0.330 (33%)	D+S	L

**Design Notes**

- Girders are designed to be supported on the bottom edge only.
- Multiple plies must be fastened together as per manufacturer's details.
- Top loads must be supported equally by all plies.
- Lateral slenderness ratio based on single ply width.

ID	Load Type	Location	Trib Width	Side	Dead 0.9	Live 1	Snow 1.15	Wind 1.6	Const. 1.25	Comments
1	Uniform		15-0-0	Top	15 PSF	0 PSF	60 PSF	0 PSF	0 PSF	
	Self Weight				11 PLF					

**Notes**

Calculated Structured Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

**Lumber**

- Dry service conditions, unless noted otherwise
- LVL not to be treated with fire retardant or corrosive chemicals

**Handling & Installation**

- LVL beams must not be cut or drilled
- Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
- Damaged Beams must not be used
- Design assumes top edge is laterally restrained
- Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding

**Manufacturer Info**

 Pacific Woodtech Corp  
 1850 Park Lane  
 Burlington, WA 98233  
 (888) 707-2285  
 www.pacificwoodtech.com  
 APA: PR-L233, ICC-ES: ESR-2909

 Coastal Forest Products  
 451 South River Rd, NH  
 USA  
 03110
