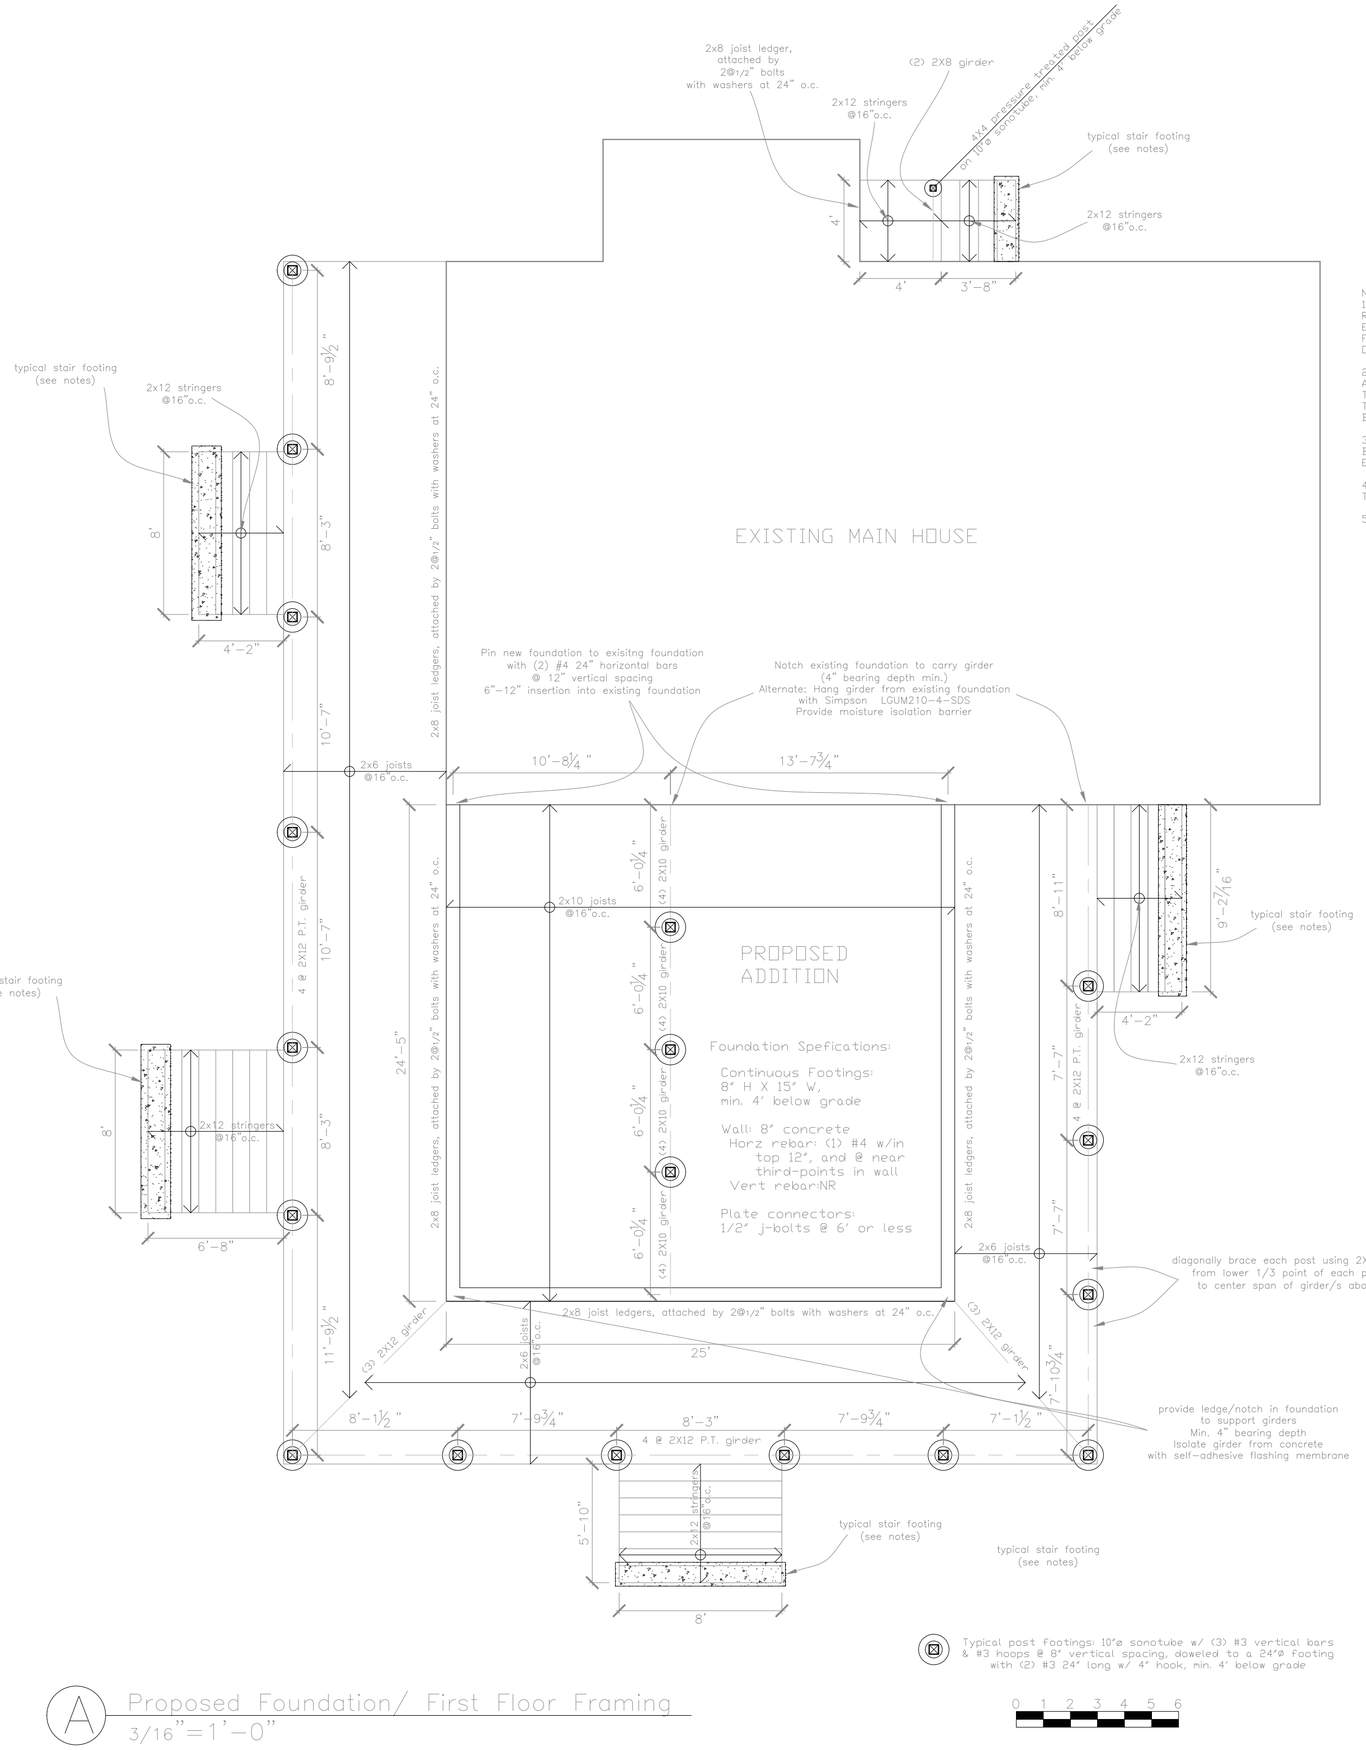


NOTES:
1.)ALL WOOD FRAMING MEMBERS THAT REST ON CONCRETE OR MASONRY EXTERIOR WALLS AND ARE LESS THAN 8" FROM THE EXPOSED GROUND SHALL BE OF A ROT RESISTANT MATERIAL

2.)ALL WOOD JOISTS OR THE BOTTOM OF A WOOD STRUCTURAL FLOOR WHEN CLOSER THAN 18", OR WOOD GIRDERS WHEN CLOSER THAN 12", TO THE EXPOSED GROUND, SHALL BE OF A ROT REISTANT MATERIAL.

3.)NEW WOOD SIDING AND/OR SHEATHING TO BE ABOVE GRADE A MINIMUM OF 6" OR ELSE OF A ROT RESISTANT MATERIAL.

4.) ALL DECK/STAIR FRAMING/DECKING TO BE OF ROT RESISTANT WOOD.

5.) SPECIFICATIONS FOR FOUNDATION WORK:

A) CONTRACTOR TO SURVEY EXISTING POSTS AND FOOTINGS THAT DO NOT COMPLY WITH ANY OF THE FOLLOWING CRITERIA:
1) POST MIN. SIZE 4X4
2) POST NO MORE THAN 1/4" OUT OF PLUMB
3) POST IS PRESSURE TREATED
4) POST BASE SIMPSON AB-TYPE OR EQUAL INSTALLED PER MANUFACTURER'S RECOMMENDATIONS.
5) TOP OF FOOTING/PIER IS NO MORE THAN 1/2" OUT OF LEVEL

B) NEW/REPLACEMENT POST FOOTINGS SHALL BE MIN 4'-0" DEEP ON SOIL (OR PINNED TO ROCK) WITH 24"ø X 8" THICK FOOTING. PIERS TO BE MIN. 10ø ROUND DOWELED TO FOOTING WITH (2) #3 24" LONG W/ 4" HOOK & (3) #3 VERTICAL BARS & #3 HOOPS AT 8" VERTICAL SPACING

C) TYPICAL NEW EXTERIOR STAIR FOOTINGS SHALL BE MIN 4'-0" DEEP ON SOIL (OR PINNED TO ROCK) WITH 12" X 6" FOOTING (R403.1.1) 8" HOLLOW CMU FROSTWALL (R404.1.1), 2X8 P.T. SOLE PLATE ANCHORED TO FROSTWALL ACCORDING TO R403.1.6 (FULLY GROUT CELLS OF TOP COURSE OF CMU TO HOLD ANCHOR BOLTS)

A Proposed Foundation/ First Floor Framing
3/16"=1'-0"

**Rachel Conly**
Architectural Design

26 Sterling Street
Peaks Island, Maine 04108
207.766.5625

# Proposed Foundation and First Floor Framing Plan

PROJECT

Arnold Residence
398 Island Ave.
Peaks Island, ME

| DATE | REVISED |
|---|---|
| 06.02.14 | |
| SCALE 3/16"=1'-0" | DRAWN BY Rachel & Harvey |

NOTES

S1