


SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Maine Department of Human Services
 Division of Health Engineering, Station 10 SHS
 (207) 287-5672 FAX (207) 287-4172

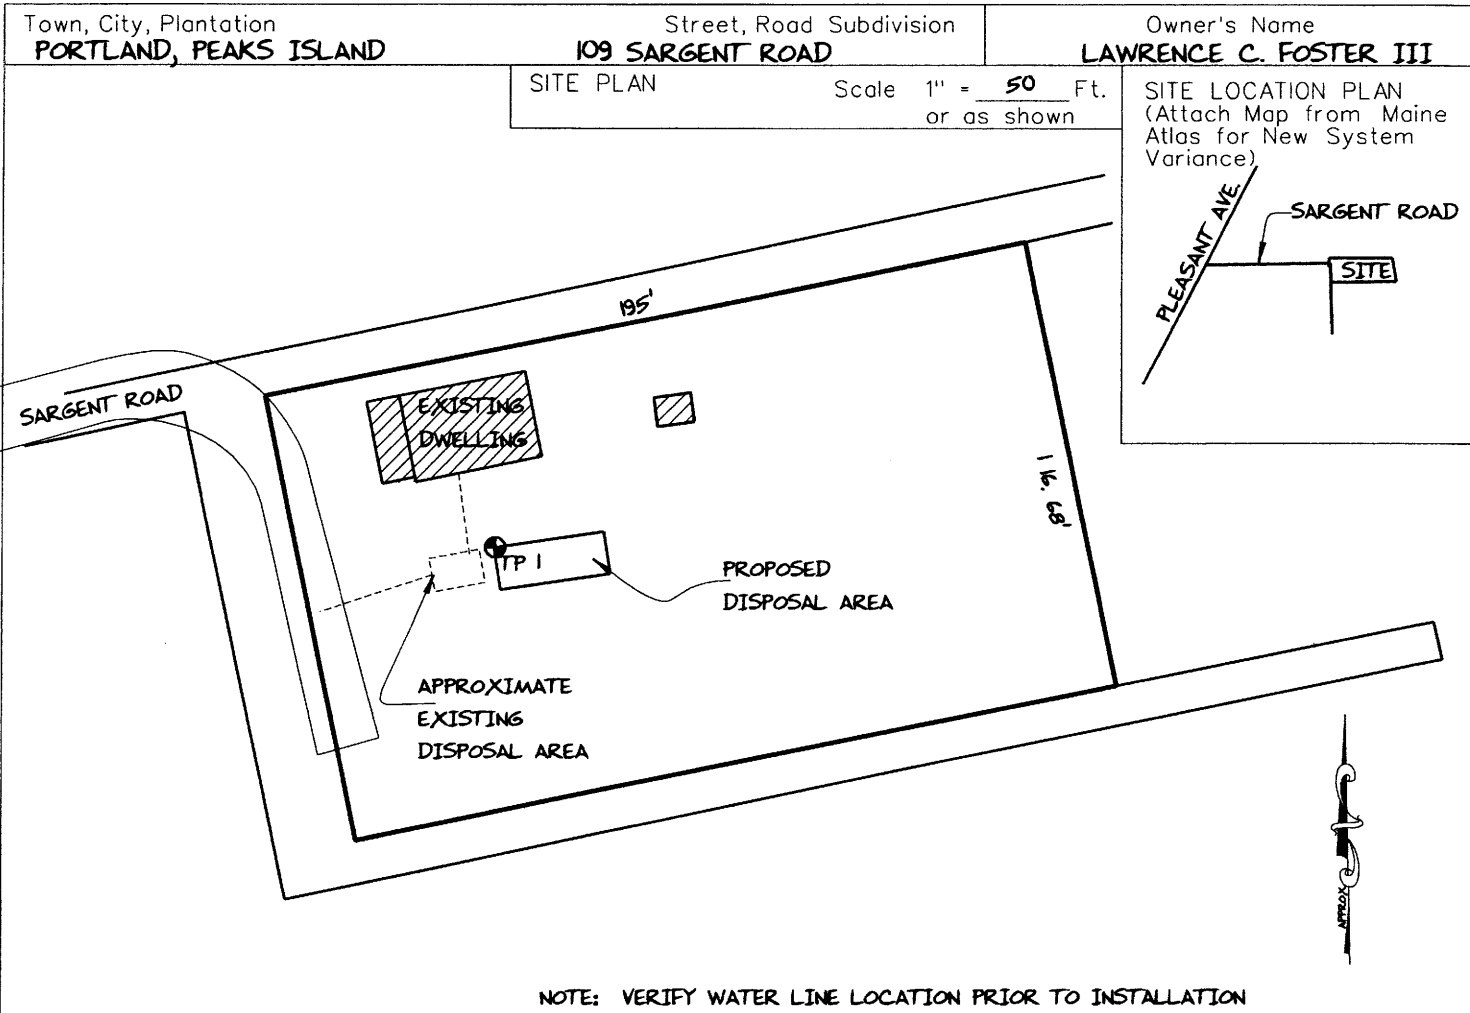

NOTE: VERIFY WATER LINE LOCATION PRIOR TO INSTALLATION

SOIL DESCRIPTION AND CLASSIFICATION (Location of Observation Holes Shown Above)

Observation Hole TP 1 Test Pit Boring
 " Depth of Organic Horizon Above Mineral Soil

DEPTH BELOW MINERAL SOIL SURFACE (inches)	Texture	Consistency	Color	Mottling
0	GRAVELLY		DARK	
	SANDY		BROWN	
10	LOAM			
20	GRAVELLY	FRIABLE	YELLOWISH	
	SAND		BROWN	NONE
				EVIDENT
50	LIMIT OF EXCAVATION			

Soil Classification S	Slope 0-3 %	Limiting Factor -	<input type="checkbox"/> Ground Water
Profile	Condition		<input type="checkbox"/> Restrictive Layer
			<input type="checkbox"/> Bedrock
			<input type="checkbox"/> Pit Depth

Observation Hole _____ Test Pit Boring
 " Depth of Organic Horizon Above Mineral Soil

DEPTH BELOW MINERAL SOIL SURFACE (inches)	Texture	Consistency	Color	Mottling
0				
10				
20				
30				
40				
50				

Soil Classification	Slope	Limiting Factor	<input type="checkbox"/> Ground Water
Profile	Condition	%	<input type="checkbox"/> Restrictive Layer
			<input type="checkbox"/> Bedrock
			<input type="checkbox"/> Pit Depth

Albert Frick
 Site Evaluator Signature

163
 SE *

8/3/2015
 Date

Page 2 of 3
 HHE-200 Rev. 10/02