

SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

John Department of Health Services
2001-2002

PROPERTY LOCATION		>> Caution: Permit Required - Attach in Space Below <<	
City, Town, or Plantation	PORTLAND PEAKS ISLAND	The Subsurface Wastewater Disposal System shall be installed under Permit is attached HERE by the Local Plumbing Inspector. The Permit shall authorize the owner or installer to install the disposal system in accordance with this application and the Major Subsurface Wastewater Disposal Rules.	
Street or Road	38 WOODS ROAD		
Subdivision, Lot #			
OWNER/APPLICANT INFORMATION			
Name (last, first, MI)	N/F ANDERSON JACK	Owner	Applicant
Mailing Address of	ARIANE COMETA 1827 RESWICK RD BALTIMORE, MD. 21210		
Daytime Tel. #			
Owner or Applicant Statement		Caution: Inspections Required	
I state that the information submitted is correct to the best of my knowledge and understand that any falsification is reason for the Department or Local Plumbing Inspector to deny a permit.		I have inspected the installation authorized above and found it to be in compliance with the Subsurface Wastewater Disposal Rules Application.	
Signature of Owner/Applicant: <i>[Signature]</i> Date: 9/18/00		Local Plumbing Inspector Signature: _____ Date: _____	

PERMIT INFORMATION

TYPE OF APPLICATION 1. <input type="checkbox"/> First Time System 2. <input checked="" type="checkbox"/> Replacement System Type Replaced: _____ Year Installed: _____ 3. <input type="checkbox"/> Expanded System a. <input type="checkbox"/> One-time exempted b. <input type="checkbox"/> Non exempted 4. <input type="checkbox"/> Experimental System 5. <input type="checkbox"/> Seasonal Conversion	THIS APPLICATION REQUIRES 1. <input type="checkbox"/> No Rule Variance 2. <input type="checkbox"/> First Time System Variance a. <input type="checkbox"/> Local Plumbing Inspector Approval b. <input type="checkbox"/> State & Local Plumbing Inspector Approval 3. Replacement System Variance a. <input checked="" type="checkbox"/> Local Plumbing Inspector Approval b. <input type="checkbox"/> State & Local Plumbing Inspector Approval 4. <input type="checkbox"/> Minimum Lot Size Variance 5. <input type="checkbox"/> Seasonal Conversion Approval	DISPOSAL SYSTEM COMPONENT(S) 1. <input checked="" type="checkbox"/> Complete Non-Engineered System 2. <input type="checkbox"/> Primitive System (graywater & alt toilet) 3. <input type="checkbox"/> Alternative Toilet, specify: _____ 4. <input type="checkbox"/> Non-Engineered Treatment Tank (only) 5. <input type="checkbox"/> Holding Tank, _____ Gallons 6. <input type="checkbox"/> Non-Engineered Disposal Field (only) 7. <input type="checkbox"/> Separated Laundry System 8. <input type="checkbox"/> Complete Engineered System (2000 gpd) 9. <input type="checkbox"/> Engineered Treatment Tank (only) 10. <input type="checkbox"/> Engineered Disposal Field (only) 11. <input type="checkbox"/> Pre-treatment, specify: _____ 12. <input type="checkbox"/> Miscellaneous components
SIZE OF PROPERTY 6,300 +/- <input checked="" type="checkbox"/> sq ft <input type="checkbox"/> acres	DISPOSAL SYSTEM TO SERVE 1. <input checked="" type="checkbox"/> Single Family Dwelling Unit, No. of Bedrooms: 3 2. <input type="checkbox"/> Multiple Family Dwelling, No. of Units: _____ 3. <input type="checkbox"/> Other: _____ SPECIFY: _____	TYPE OF WATER SUPPLY 1. <input checked="" type="checkbox"/> Drilled Well 2. <input type="checkbox"/> Dug Well 3. <input type="checkbox"/> Private 4. <input type="checkbox"/> Public 5. <input type="checkbox"/> Other: _____
SHORELAND ZONING <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No		

DESIGN DETAILS (SYSTEM LAYOUT SHOWN ON PAGE 3)

TREATMENT TANK 1. <input checked="" type="checkbox"/> Concrete a. <input type="checkbox"/> Regular b. <input checked="" type="checkbox"/> Low Profile (if NECESSARY) 2. <input type="checkbox"/> Plastic 3. <input type="checkbox"/> Other: _____ CAPACITY: 1000 gallons	DISPOSAL FIELD TYPE & SIZE 1. <input type="checkbox"/> Stone Bed 2. <input type="checkbox"/> Stone Trench 3. <input checked="" type="checkbox"/> Proprietary Device a. <input type="checkbox"/> Cluster array c. <input checked="" type="checkbox"/> linear b. <input checked="" type="checkbox"/> Regular d. <input type="checkbox"/> H-20 loaded 4. <input type="checkbox"/> Other: _____ SIZE: 92 sq. ft. <input type="checkbox"/> lin. ft. 15 ELJEN IN-DRAINS	GARBAGE DISPOSAL UNIT 1. <input checked="" type="checkbox"/> No 3. <input type="checkbox"/> Maybe 2. <input type="checkbox"/> Yes >> Specify one below: a. <input type="checkbox"/> Multi-compartment tank b. <input type="checkbox"/> Tank in series c. <input type="checkbox"/> Increase in tank capacity d. <input checked="" type="checkbox"/> Filter on tank outlet RECOMMENDED	DESIGN FLOW 270 gallons per day BASED ON: 1. <input checked="" type="checkbox"/> Table 501.1 (dwelling unit(s)) 2. <input type="checkbox"/> Table 501.2 (other facilities) SHOW CALCULATIONS - for other facilities - 3 BEDROOMS AT 90 GALLONS PER DAY EACH 3. <input type="checkbox"/> Section 503.0 (meter readings) ATTACH WATER-METER DATA
SOIL DATA & DESIGN CLASS PROFILE: C / A / 1 AT Observation Hole: TB 4A Depth: 24" Elevation: _____ OF MOST LIMITING SOIL FACTOR	DISPOSAL FIELD SIZING 1. <input type="checkbox"/> Small - 2.0 sq.ft./gpd 2. <input type="checkbox"/> Medium - 2.6 sq.ft./gpd 3. <input checked="" type="checkbox"/> Medium-Large - 3.3 sq.ft./gpd 4. <input type="checkbox"/> Large - 4.1 sq.ft./gpd 5. <input type="checkbox"/> Extra-Large - 5.0 sq.ft./gpd	PUMPING 1. <input type="checkbox"/> Not required SEE NOTE ON 2. <input checked="" type="checkbox"/> May be required PAGE 03 3. <input type="checkbox"/> Required >> Specify only for engineered or experimental systems DOSE: _____ Gallons	

SITE EVALUATOR STATEMENT

I certify that on 7/27/2000 date I completed a site evaluation on this property and state that the data reported is accurate and that the proposed system is in compliance with the Subsurface Wastewater Disposal Rules (10-M4A CMR 241).

Site Evaluator Signature: *Albert Frick* SE # *K8* Date: *7/27/2000*
 Page 1 of 3
 HNE-260 Rev. 1-99

SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Department of Human Services
Division of Health Engineering

Town, City, Plantation
PORTLAND PEAKS ISLAND

Street, Road Subdivision
33 WOODS ROAD


Owner's Name
N/V ANDERSON (ARIANE COMETA)

SITE PLAN

Scale 1" = 30 Ft.
or as shown

SITE LOCATION PLAN
(Attach Map from Maine Atlas for New System Variance)

PLEASANT AVE.

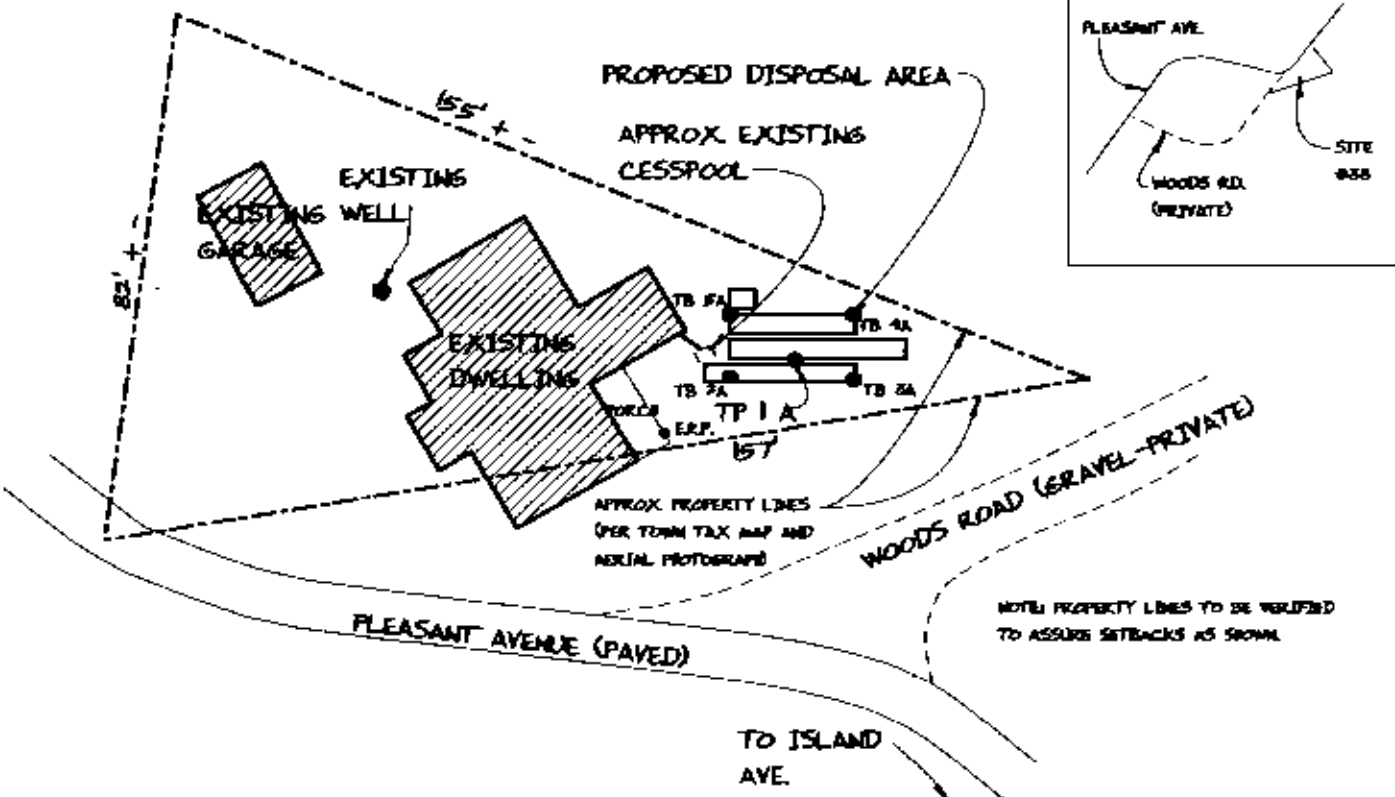

SOIL DESCRIPTION AND CLASSIFICATION (Location of Observation Holes Shown Above)

Observation Hole TP 1 A Test Pit Boring
" Depth of Organic Horizon Above Mineral Soil

DEPTH BELOW MINERAL SOIL SURFACE (inches)	Texture	Consistency	Color	Mottling
0	SANDY		DARK	
	LOAM		BROWN	
10				
	LOAMY	FRJABLE	DARK	
	SAND		YELLOW	
20			BROWN	
30				
35	REFUSAL			
40				
50				

Soil Classification 2 A Slope 30° Limiting Factor 30°
 Ground Water
 Restrictive Layer
 Bedrock
 Pit Depth

Observation Hole TB 2 A - 5 A Test Pit Boring
" Depth of Organic Horizon Above Mineral Soil

DEPTH BELOW MINERAL SOIL SURFACE (inches)	Texture	Consistency	Color	Mottling
0				
10				
15	TB 2 A = 25" TO REFUSAL			
20	TB 3 A = 24" TO REFUSAL			
25	TB 4 A = 24" TO REFUSAL			
30	TB 5 A = 25" TO REFUSAL			
40				
50				

Soil Classification 2 A Slope 24° Limiting Factor 24°
 Ground Water
 Restrictive Layer
 Bedrock
 Pit Depth

Albert Frick
Site Evaluator Signature

K-3
SE

7/27/2000
Date

SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Department of Human Services
Division of Health Engineering

Town, City, Plantation
PORTLAND PEAKS ISLAND


Street, Road, Subdivision
33 WOODS ROAD

Owner's Name
ARIANE COMETA

SUBSURFACE WASTEWATER DISPOSAL PLAN

SCALE 1" = 20' FT.

NOTE: PROPERTY LINE INFORMATION PER TOWN TAX MAP. LINES TO BE VERIFIED TO ASSURE SETBACKS AS SHOWN.

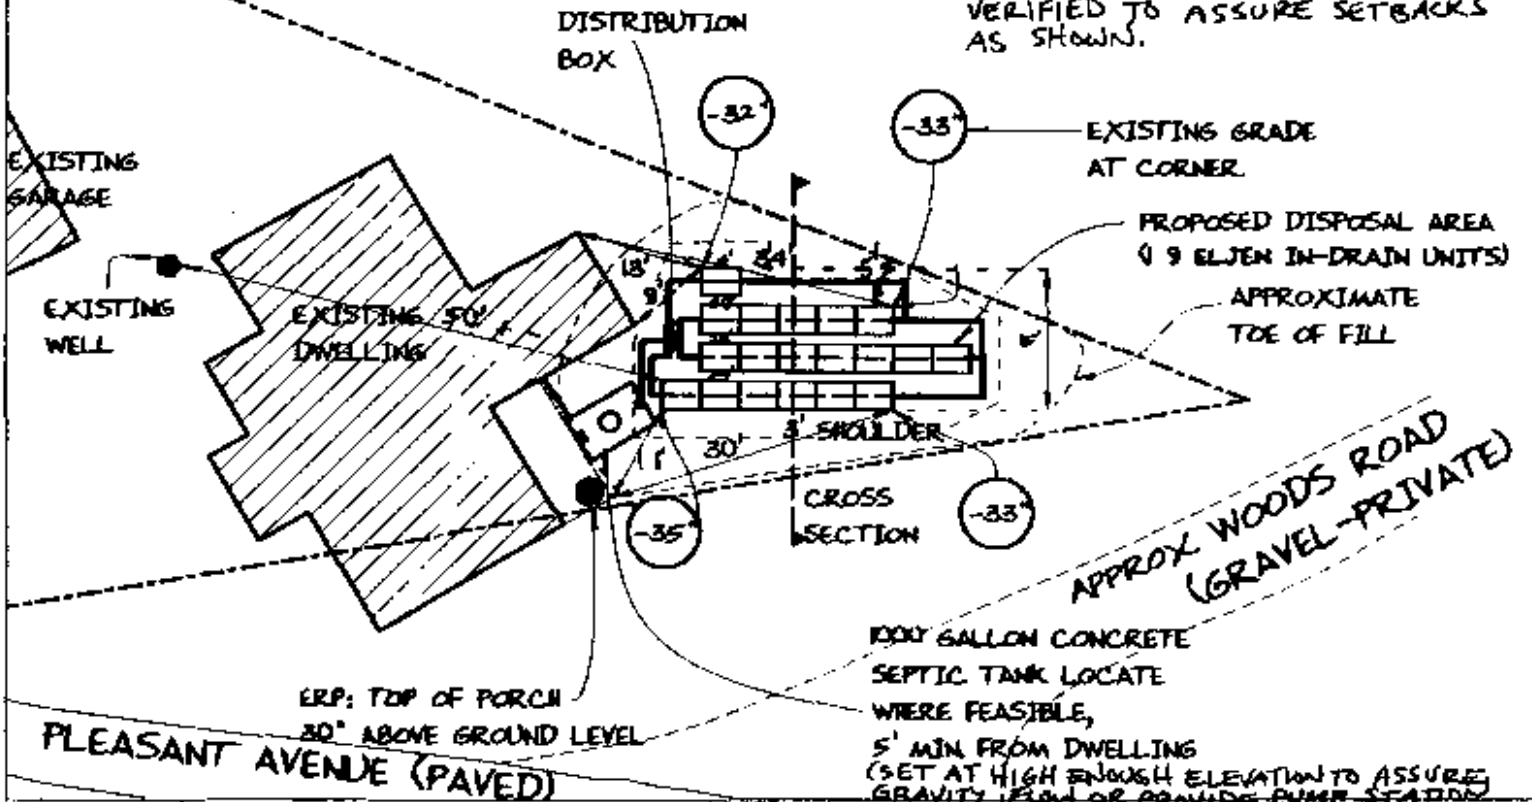


1000 GALLON CONCRETE SEPTIC TANK LOCATE WHERE FEASIBLE, 5' MIN FROM DWELLING (SET AT HIGH ENOUGH ELEVATION TO ASSURE GRAVITY FLOW OR PROVIDE PUMP SECTION)

FILL REQUIREMENTS		CONSTRUCTION ELEVATIONS		ELEVATION REFERENCE POINT	
Depth of Fill @top of disposal	± 25" - 26"	Final Grade Elevation	-7'	Location & Description	TOP OF PORCH
Depth of Fill @bottom of disposal	± 26" - 28"	(Top of Distribution Pipe) or Proprietary Section	-6'		50" ABOVE GRADE
		Bottom of Disposal Area (ELJEN IN-DRAIN UNIT)	-50'		Reference Elevation 00'

DISPOSAL AREA CROSS SECTION

SCALE:
VERTICAL: 1" = 5 FT
HORIZONTAL: 1" = 10 FT

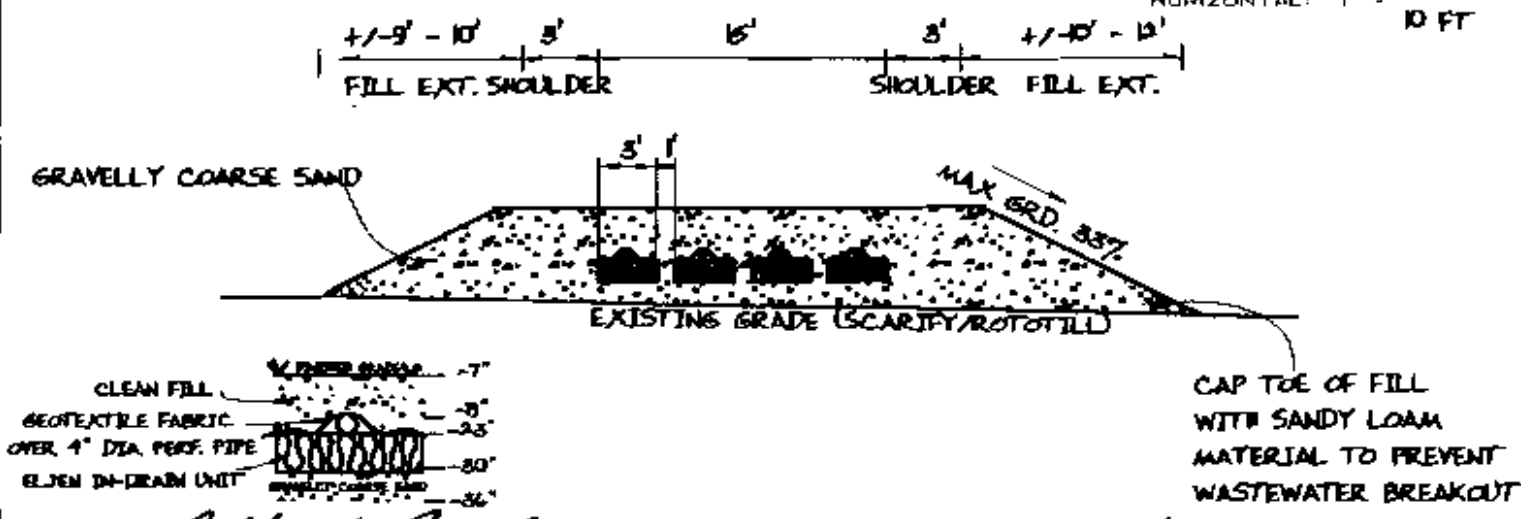

Albert Frick
Site Evaluator Signature

K3
SE *

7/27/2000
Date



Albert Frick Associates, Inc.

Soil Scientists & Site Evaluators

95A County Road Corham, Maine 04038

(207) 839-3563

PORTLAND (PEAKS ISLAND)

TOWN

33 WOODS ROAD

LOCATION

ARIANE COMETA

APPLICANT'S NAME

1) The Plumbing and Subsurface Wastewater Disposal Rules adopted by the State of Maine, Department of Human Services pursuant to 22 M.R.S.A. § 42 (the "Rules") are incorporated herein by reference and made a part of this application and shall be consulted by the owner/applicant, the system installer and/or building contractor for further construction details and material specifications. The system installer should contact Albert Frick Associates, Inc. 839-3563, if there are any questions concerning materials, procedures or designs. The system installer and/or building contractor installing the system shall be solely responsible for compliance with the Rules and with all state and municipal laws and ordinances pertaining to the permitting, inspection and construction of subsurface wastewater disposal systems.

2) This application is intended to represent facts pertinent to the Rules only. It shall be the responsibility of the owner/applicant, system installer and/or building contractor to determine compliance with and to obtain permits under all applicable local, state and/or federal laws and regulations (including, without limitation, Natural Resources Protection Act, wetland regulations, zoning ordinances, subdivision regulations, Site Location of Development Act and minimum lot size laws) before installing this system or considering the property on which the system is to be installed a "buildable" lot. It is recommended that a wetland scientist be consulted regarding wetland regulations.

Prior to the commencement of construction/installation, the local plumbing inspector shall inform the owner/applicant and Albert Frick Associates, Inc. of any local ordinances which are more restrictive than the Rules in order that the design may be amended. All designs are subject to review by local, state and/or federal authorities. Albert Frick Associates, Inc.'s liability shall be limited to revisions required by regulatory agencies pursuant to laws or regulations in effect at the time of preparation of this application.

3) All information shown on this application relating to property lines, well locations, subsurface structures and underground facilities (such as, utility lines, drains, septic systems, water lines, etc.) are based solely upon information provided by the owner/applicant and has been relied upon by Albert Frick Associates, Inc. in preparing this application. The owner/applicant shall review this application prior to the start of construction and confirm this information.

4) Installation of a garbage (grinder) disposal is not recommended. If one is installed, an additional 1000 gallon septic tank or a septic tank filter should be connected in series to the proposed septic tank.

5) The system user shall avoid introducing kitchen grease or fats into this system. Chemicals such as septic tank cleaners and/or chlorine (such as from water treatment) and controlled or hazardous substances shall not be disposed of in this system.

ATTACHMENT TO SUBSURFACE WASTEWATER DISPOSAL APPLICATION

PORTLAND (PEAKS ISLAND) 33 WOODS ROAD ARIANE COMETA
TOWN LOCATION APPLICANT'S NAME

- 6) The septic tank should be pumped within two years of installation and subsequently as recommended by the pump service, but in no event should the septic tank be pumped less often than once every three years.
- 7) The actual water flow or number of bedrooms shall not exceed the design criteria indicated on this application without a re-evaluation of the system as proposed. If the system is supplied by public water or a private service with a water meter, the water consumption per period should be divided by the number of days to calculate the average daily water consumption (water usage (cu.ft.) x 7.48 cu.ft. (gallons per cu.ft.) ÷ # of days in period).
- 8) The general minimum setbacks between a well and septic system serving a single family residence is 100-300 feet, unless the local municipality has a more stringent requirement. A well installed by an abutter within the minimum setback distances prior to the issuance of a permit for the proposed disposal system may void this design.
- 9) When a gravity system is proposed: **BEFORE CONSTRUCTION/INSTALLATION BEGINS**, the system installer or building contractor shall review the elevations of all points given in this application and the elevation of the existing and/or proposed building drain and septic tank inverts for compatibility to minimum slope requirements. In gravity systems, the invert of the septic tank(s) outlet(s) shall be at least 4 inches above the invert of the distribution box outlet at the disposal area. When an effluent pump is required, provisions shall be made to make certain that surface ground water does not enter the septic tank or pump station. An alarm device warning of a pump failure shall be installed. Also, when pumping is required to a chamber system, install a "T" connection in the distribution box and place 3 inches of stone or a splash plate in the first chamber. Insulate gravity pipes, pump lines and the distribution box as necessary to prevent freezing.
- 10) On all systems, remove the vegetation, organic duff and old fill material from under the disposal area and any fill extension. On sites where the proposed system is to be installed in natural soil, scarify the bottom and sides of the excavated disposal area with a rake. Do not use wheeled equipment on the scarified soil surface. For systems installed in fill, scarify the native soil by rero-filling to a depth of at least 8 inches over the entire disposal and fill extension area to prevent glazing and to promote fill bonding. Place fill in loose layers no deeper than 8 inches and compact thoroughly before placing more fill (this ensures that voids and loose pockets are eliminated to minimize the chance of leakage). Do not use wheeled equipment on the scarified soil area until after 12 inches of fill is in place. Keep equipment off the chambers. Divert the surface water away from the disposal area by ditching or shallow swales.
- 11) Unless noted otherwise, fill shall be gravelly coarse sand which contains no more than 5% fines (silt and clay).
- 12) Do not install systems on loamy, silty, or clayey soils during wet periods since soil smearing/glazing may seal off the soil interface.
- 13) Seed all filled and disturbed surfaces with perennial grass seed, then mulch with hay or equivalent material to prevent erosion.

