

SHEAR WALLS

- "SW1" INDICATES: 2x4 WALL W/2x4 SOLID BLOCKING AT ALL SHEATHING PANEL EDGES. PROVIDE 1/2" THICK APA RATED EXTERIOR SHEATHING ON ONE SIDE OF WALL FASTENED W/10d NAILS @ 4" O.C. AT PANEL EDGES AND 6" O.C. INTERMEDIATE (TYP. AT ALL EXTERIOR WALLS AND AS NOTED).
- "SW2" INDICATES: 2x4 WALL W/2x4 SOLID BLOCKING AT ALL SHEATHING PANEL EDGES. PROVIDE 1/2" THICK APA RATED EXTERIOR SHEATHING ON BOTH SIDES OF WALL FASTENED W/10d NAILS @ 4" O.C. AT PANEL EDGES AND 6" O.C. INTERMEDIATE (AS NOTED).
- "*" INDICATES: PROVIDE (4)2x4 POST (MIN.) AT BOTH ENDS OF SW W/2) SIMPSON CS16 x 3'-0" LONG STRAP TIES (WITH ONE EACH SIDE OF POST) OR (4) SIMPSON CS20 x 3'-0" LONG STRAP TIES (WITH (2) EACH SIDE OF POST) FASTENING POST ABOVE TO BEAM BELOW (THRU AND CENTERED ON FLOOR SYSTEM) AND SIMPSON ABU66 HDG POST BASE FASTENING BEAM TO CONCRETE SONOTUBE PIER UTILIZING 3/8" x 10" EMBEDMENT HILTI HIT-HY 200 ADHESIVE ANCHORS (TYP.).


PARTIAL SECOND FLOOR/LOFT FRAMING PLAN

1/4" = 1'-0"

NOTES:

- SEE GENERAL NOTES ON DWG S0.1.
- "E" INDICATES: EXISTING CONDITIONS, OR MEMBERS.
- "TYP." INDICATES: TYPICAL (ALSO SEE GENERAL NOTE #5).
- "V.I.F." INDICATES: G.C. SHALL "VERIFY IN FIELD" EXISTING DIMENSIONS, ELEVATIONS, OR CONDITIONS INDICATED AND REPORT ANY DISCREPANCIES TO THE ENGINEER.
- "U.O.N." INDICATES: UNLESS OTHERWISE NOTED.
- "S.S." INDICATES: STAINLESS STEEL.

THESE DRAWINGS HAVE BEEN DEVELOPED BY L&L STRUCTURAL ENGINEERING SERVICES, INC. FOR THE TITLED SET ONLY. THE DRAWINGS ARE THE SOLE PROPERTY OF L&L ENGINEERING SERVICES, INC. AND THEY SHALL NOT BE USED, LENT, COPIED OR ALTERED WITHOUT THE WRITTEN CONSENT OF L&L STRUCTURAL ENGINEERING SERVICES, INC.

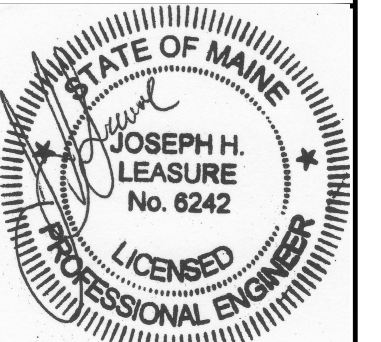

rev.	date	description	designed by: JHL	checked by: JHL
A	04/12/17	FOR PERMIT & COORD.		
0	06/30/17	FOR CONSTRUCTION		
1	11/02/17	GENERAL REVISIONS		

scale: AS NOTED
 date: 04/12/2017
 plot date: 11/02/2017
 project #: 2015-150