


- NOTES:**
1. SEPTIC TANK: SUPERIOR CONCRETE SEPTIC TANK, HEAVY DUTY MODEL 1000LB, W/ HEAVY DUTY SEPTIC TANK COVER.
 2. KEYED JOINTS IN TANK TO BE SEALED WITH BUTYL RUBBER.
 3. EXCAVATION MUST BE AT LEAST 12" WIDER, LONGER AND DEEPER THAN TANK SIZE.


BACKFILL WITH SUITABLE SOILS FROM ON-SITE EXCAVATION OR IF SUITABLE SOILS ARE UNAVAILABLE USE GRANULAR BORROW (MDOT 703.19). SUITABLE SOILS SHALL MEET THE REQUIREMENTS OF MDOT 703.18. PLACE AND COMPACT IN LAYERS OF 12" THICK OR LESS.

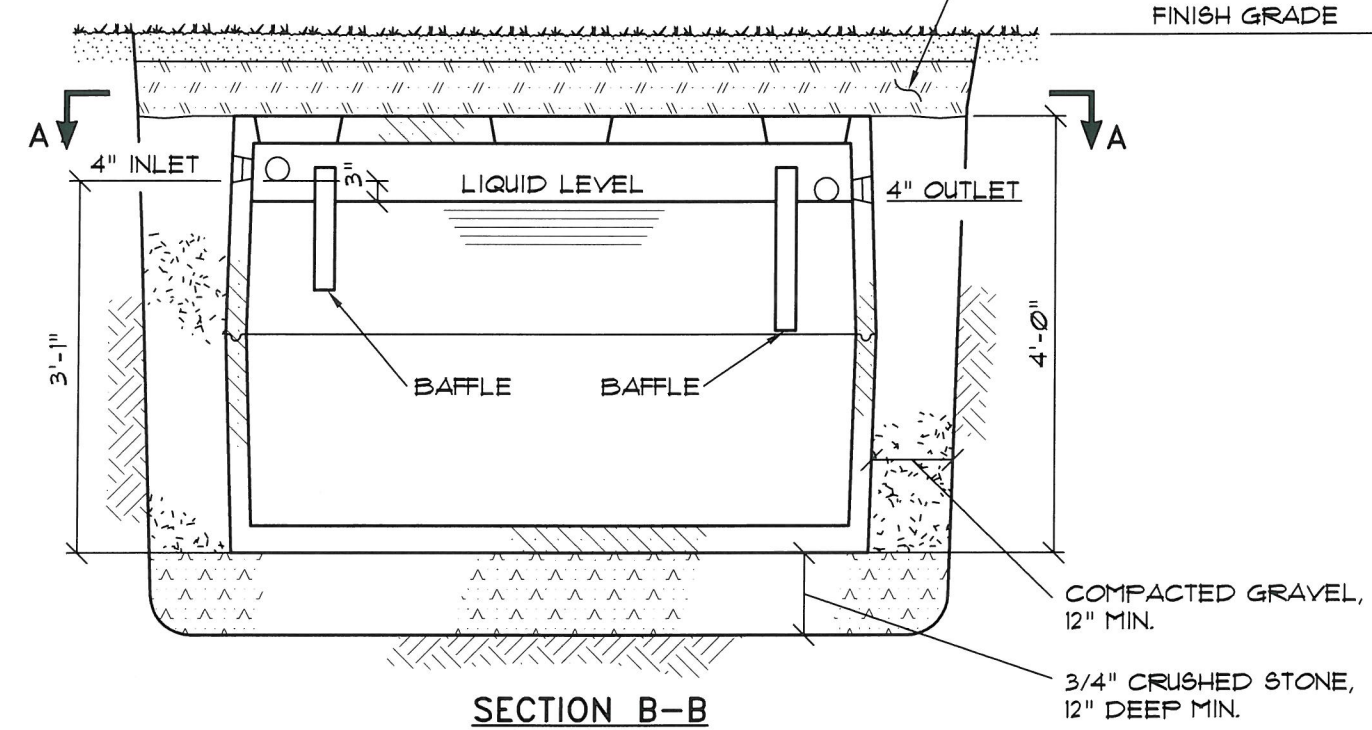

SECTION B-B


2 PRECAST CONCRETE SEPTIC TANK

NOT TO SCALE

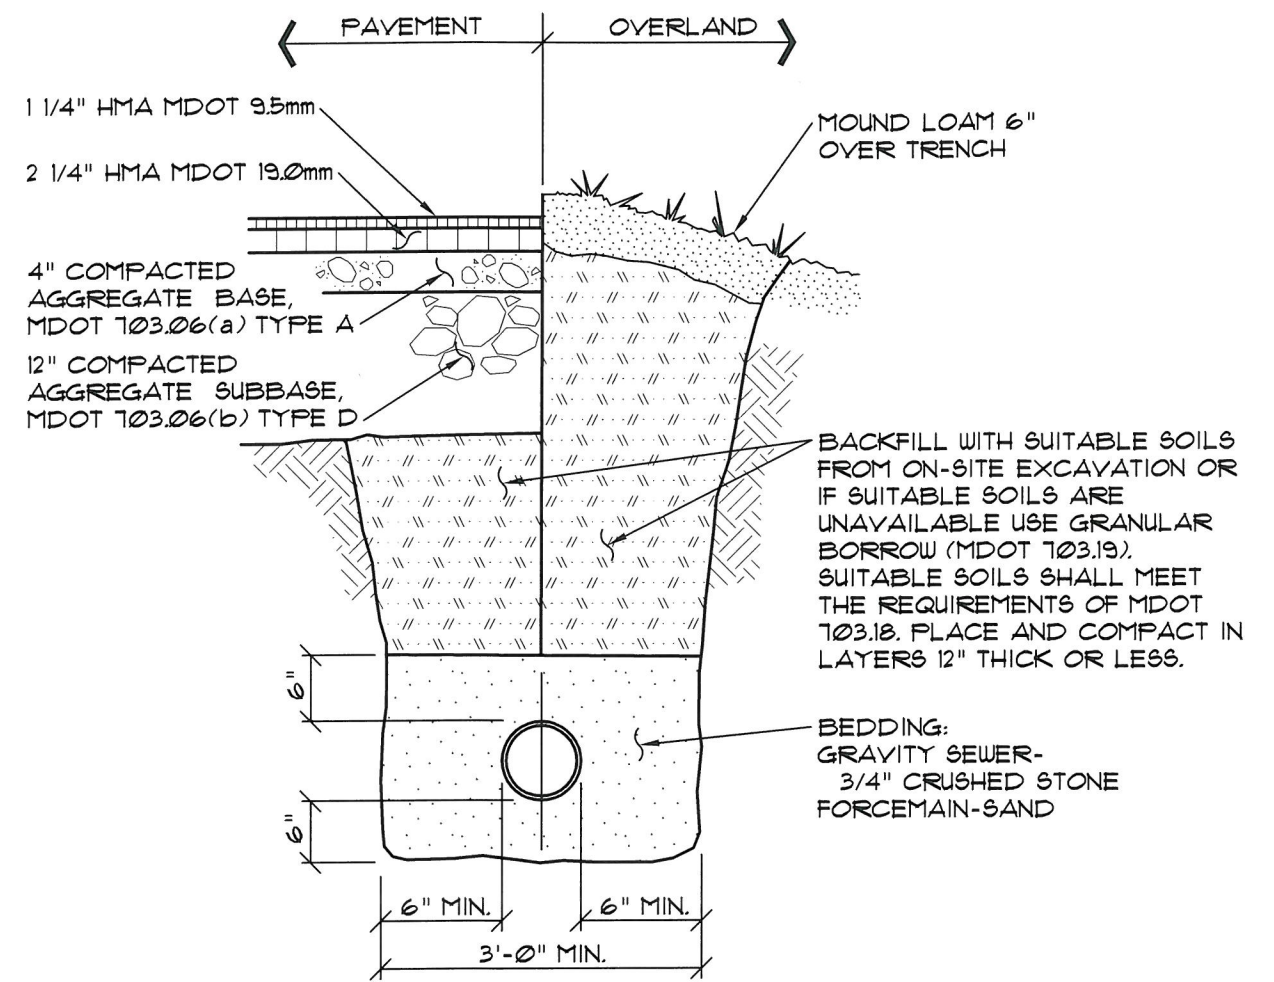

1 TYPICAL TRENCH SECTION

NOT TO SCALE

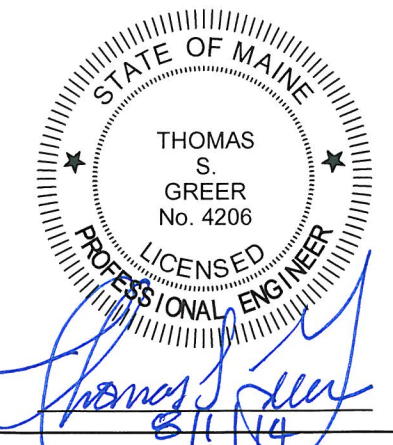

CLIFF ISLAND SEPTIC SYSTEM ASSOCIATION
COVE COLLECTION SYSTEM
WHARF ROAD, CLIFF ISLAND, MAINE

C1.2B