

SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Maine Department of Human Services
 Division of Health Engineering, Station 10
 (207) 287-5672 Fax: (207) 287-3165



Town, City, Plantation
 Cliff Island (Portland)

Street, Road, Subdivision
 275 Church Road

Owner or Applicant Name
 Edward G. Scheu

SITE PLAN Scale 1" = 60 ft.

SITE LOCATION PLAN

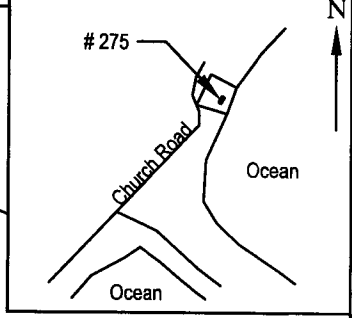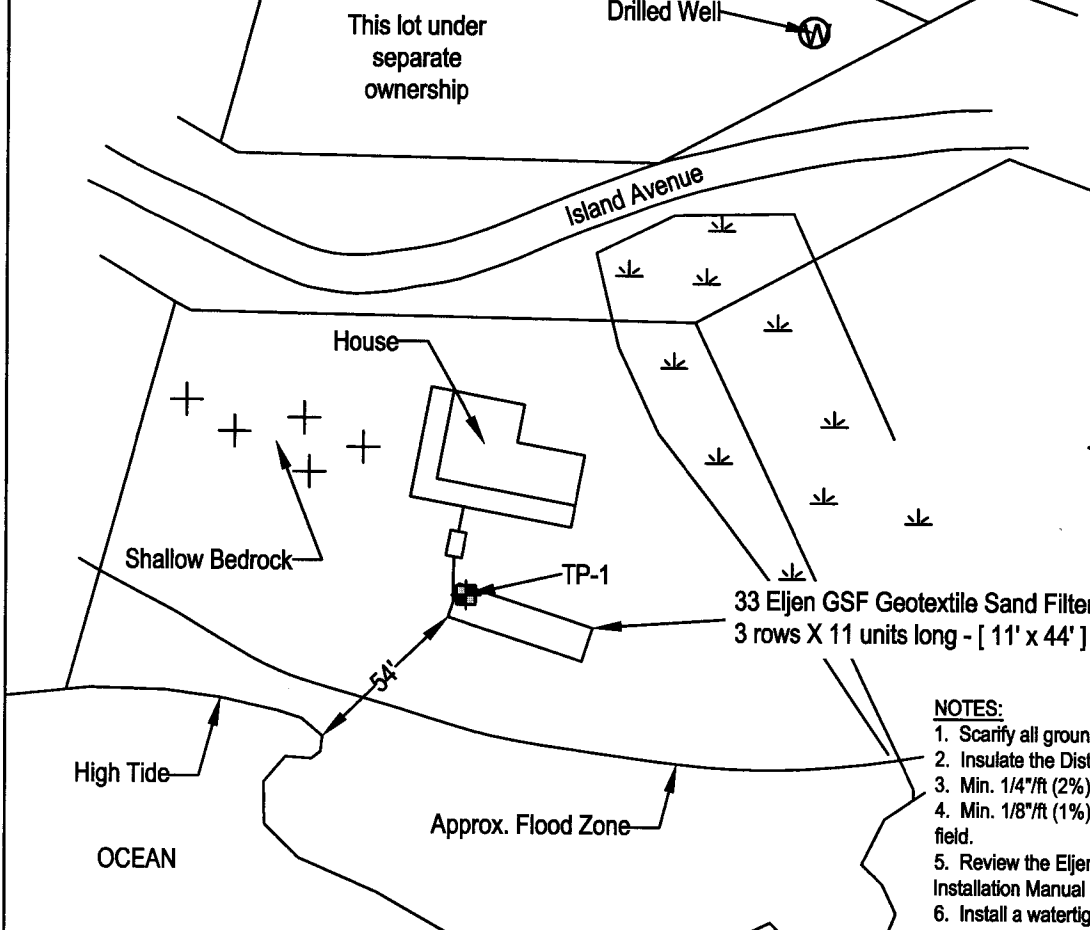

NOTES:

1. Scarify all ground to be filled.
2. Insulate the Distribution Box (D-Box).
3. Min. 1/4"/ft (2%) pitch of pipe from building to septic tank.
4. Min. 1/8"/ft (1%) pitch of pipe from septic tank to disposal field.
5. Review the Eljen Geotextile Sand Filter (GSF) Design and Installation Manual before installing this system.
6. Install a watertight septic tank.

SOIL PROFILE DESCRIPTION AND CLASSIFICATION (Location of Observation Holes Shown Above)

Observation Hole # TP-1 Test Pit Boring

_____ " Depth of organic horizon above mineral soil

Texture	Consistency	Color	Mottling
0			
6	Fine Sandy Loam	Friable	Dark Brown
12	Fine Sandy Loam	Friable	Reddish Brown
18			
24	Silty Sand	Firm	Olive Brown Common & Faint
30			
36	Bedrock at 27 inches		
42			
48			

Soil Profile	Classification	Slope	Limiting Factor	<input type="checkbox"/> Groundwater
<u>3</u>	<u>All</u>	<u>2</u>	<u>27"</u>	<input type="checkbox"/> Restrictive Layer
Profile	Condition	Percent	Depth	<input checked="" type="checkbox"/> Bedrock

Observation Hole # _____ Test Pit Boring

_____ " Depth of organic horizon above mineral soil

Texture	Consistency	Color	Mottling
0			
6			
12			
18			
24			
30			
36			
42			
48			

Soil Profile	Classification	Slope	Limiting Factor	<input type="checkbox"/> Groundwater
				<input type="checkbox"/> Restrictive Layer
Profile	Condition	Percent	Depth	<input type="checkbox"/> Bedrock

Richard [Signature]
 Site Evaluator Signature

034
 SE #

02/13/15
 Date