
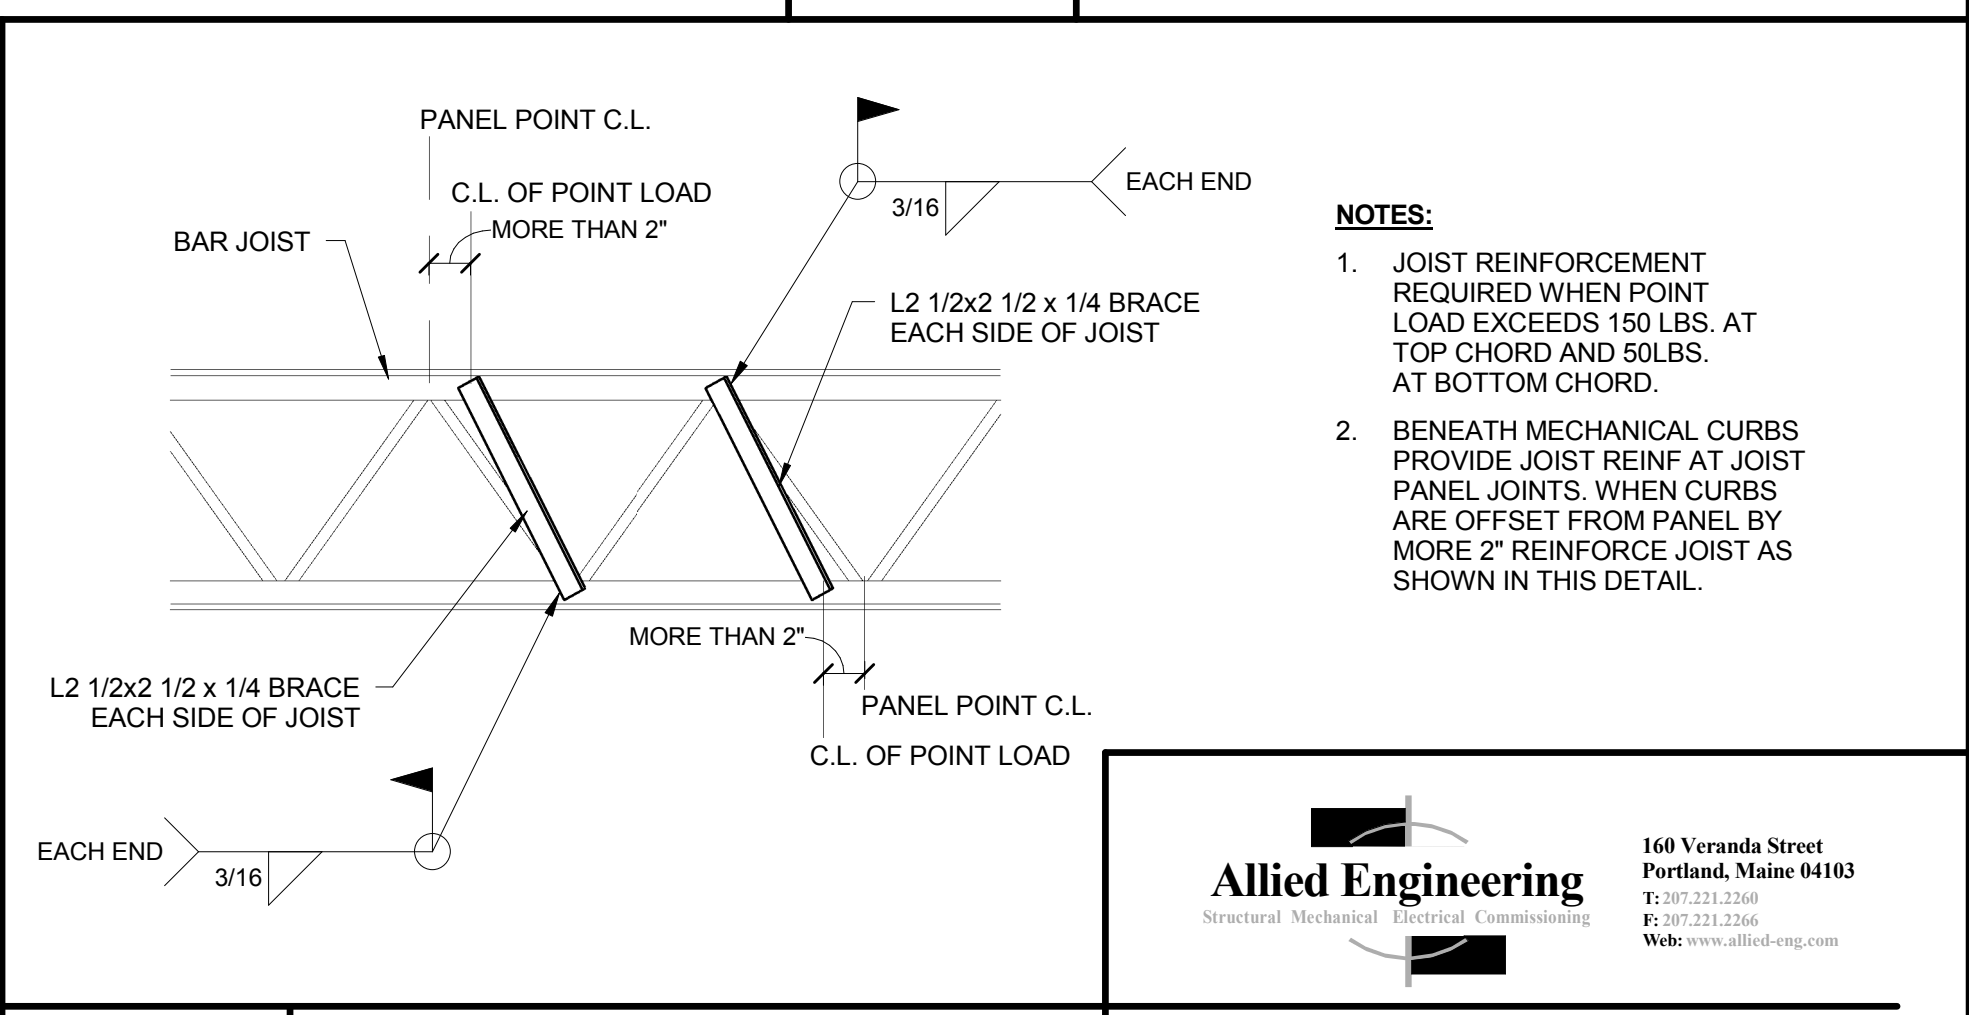


CONNECTION SCHEDULE						
BEAM	N	L	T	D	S	CAPACITY (KIP)
W8	2	6"	1/4"	1"	3"	16.3
W10	2	6"	1/4"	1 1/2"	3"	16.3
W12	3	9"	1/4"	1 1/2"	3"	25.6
W14	4	11 1/2"	3/8"	1 1/2"	3"	42.4
W16	4	12"	3/8"	1 1/2"	3"	42.4
W18	5	15"	3/8"	1 1/2"	3"	53.0
W21	6	18"	3/8"	1 1/2"	3"	63.6
W24	7	20 1/2"	3/8"	1 1/2"	3"	74.2

NOTES:
 1. BOLTS SHALL BE 3/4" DIA. A325N (U.N.O.)
 2. N = NUMBER OF BOLTS
 3. L = LENGTH OF PLATE
 4. T = THICKNESS OF PLATE
 5. D = DEPTH OF PLATE FROM TOP FLANGE OF BEAM
 6. S = BOLT SPACING
 7. SIMILAR AT CHANNEL SECTIONS OF SAME DEPTH

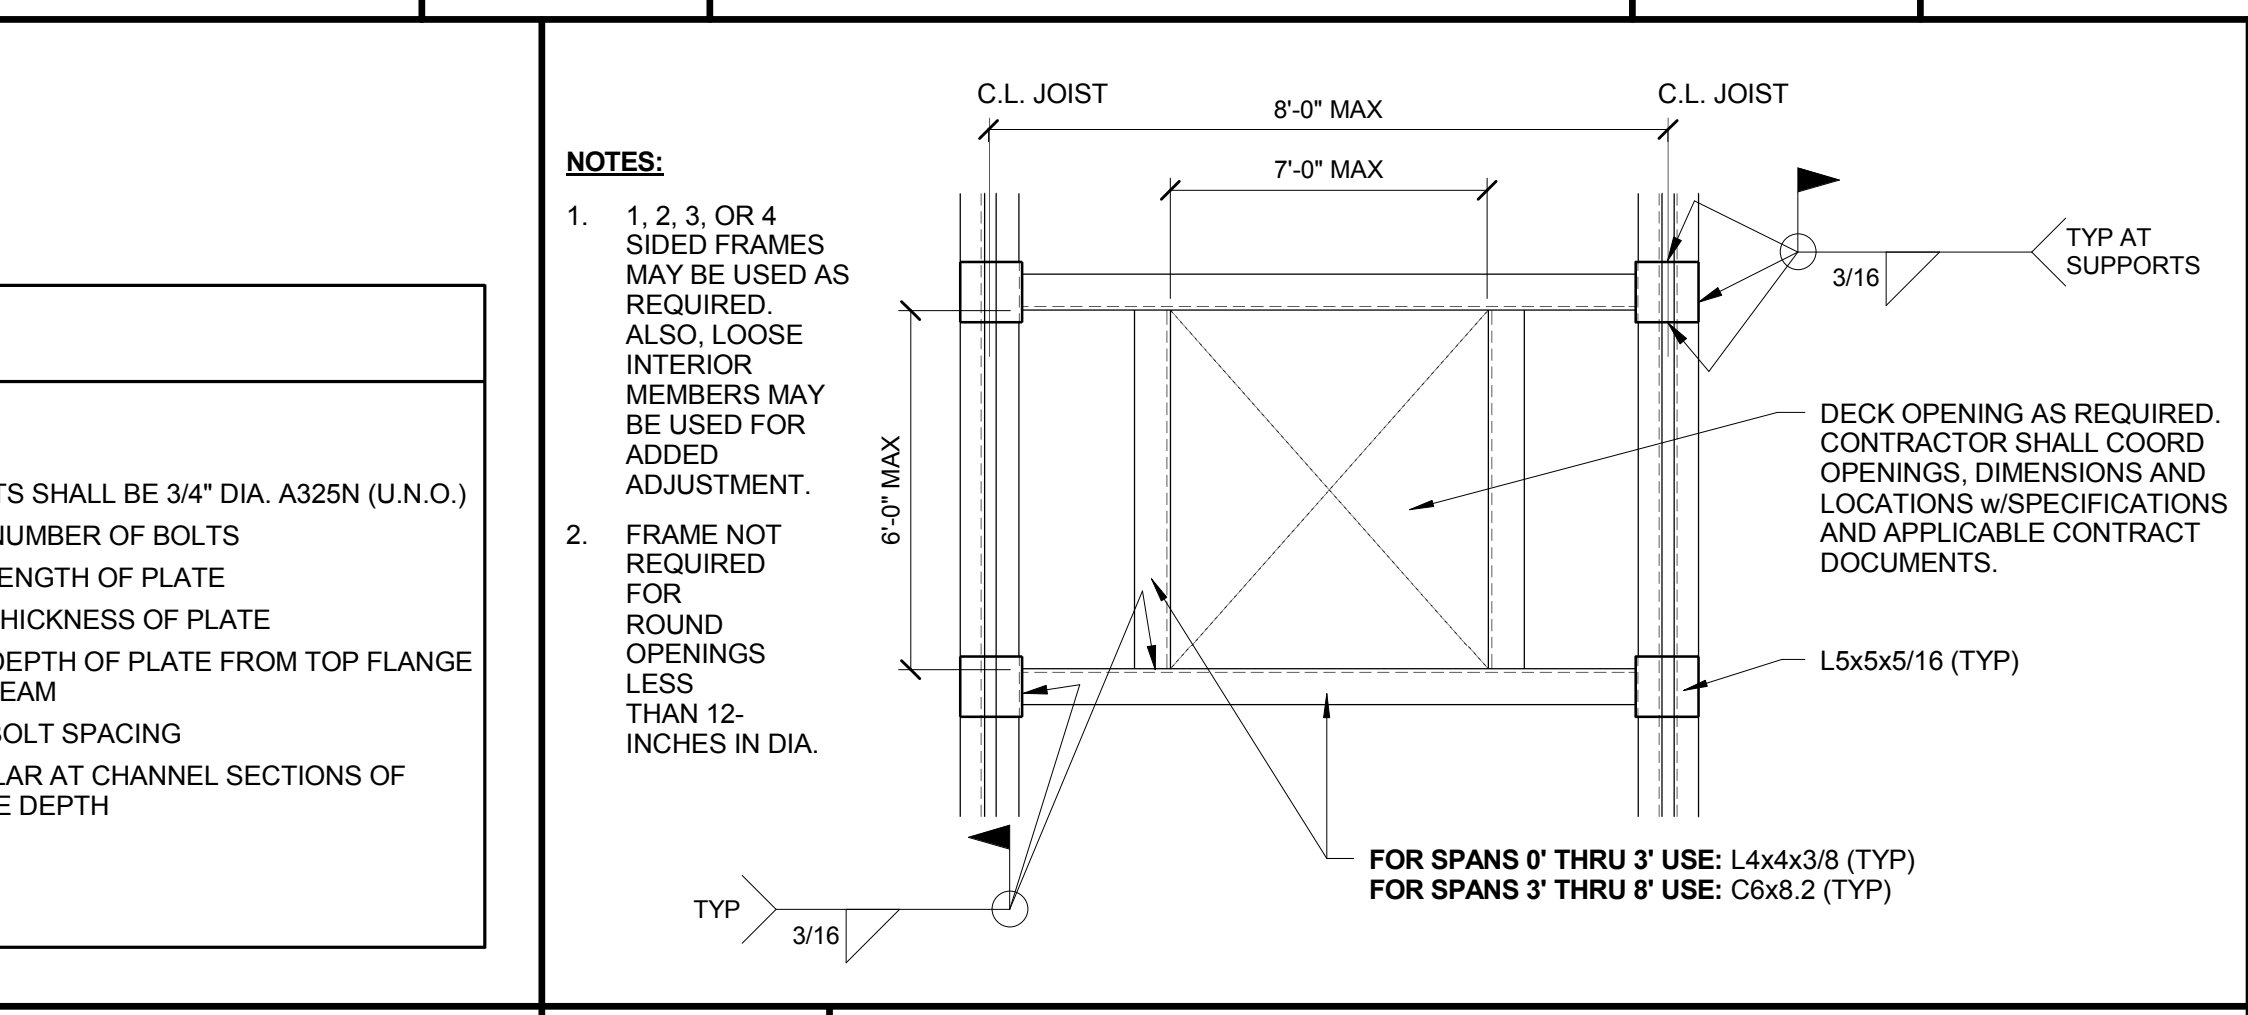

REVISIONS		
#	DATE	DESCRIPTION

DATE	08.02.2011
PROJECT #	030311
DRAWN BY:	PED
CHECKED BY:	WFF
DRAWING SCALE	As indicated

SHEET TITLE
AUDITORIUM
STRUCTURAL -
TYPICAL DETAILS

S001
COPYRIGHT 1985-2009
REPRODUCTION OR RELEASE OF
THIS DOCUMENT WITHOUT
AUTHORITY FROM
GAWRON ARCHITECTS IS PROHIBITED

90% REVIEW SET - 23 SEPTEMBER 2011 - NOT FOR CONSTRUCTION