


Proj North

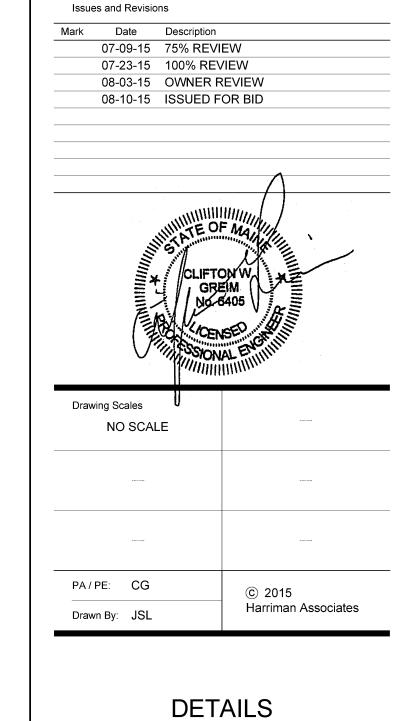

M30.1

RIGID GALVANIZED STEEL
BRANCH DUCT. REFER TO VAV
BOX SCHEDULE FOR VAV BOX
INLET DUCT SIZE


BRANCH DUCT. REFER TO VAV
BOX SCHEDULE FOR VAV BOX
INLET DUCT SIZE

WAIN DUCT

PROVIDE 45DEG OR
CONICAL BRANCH TAKE-OFF

TYPICAL VAV BOX CONNECTION WHERE RIGID DUCT IS REQUIRED

NOTE: DO NOT USE FLEXIBLE DUCT FOR BRANCH DUCT TO VAV BOXES

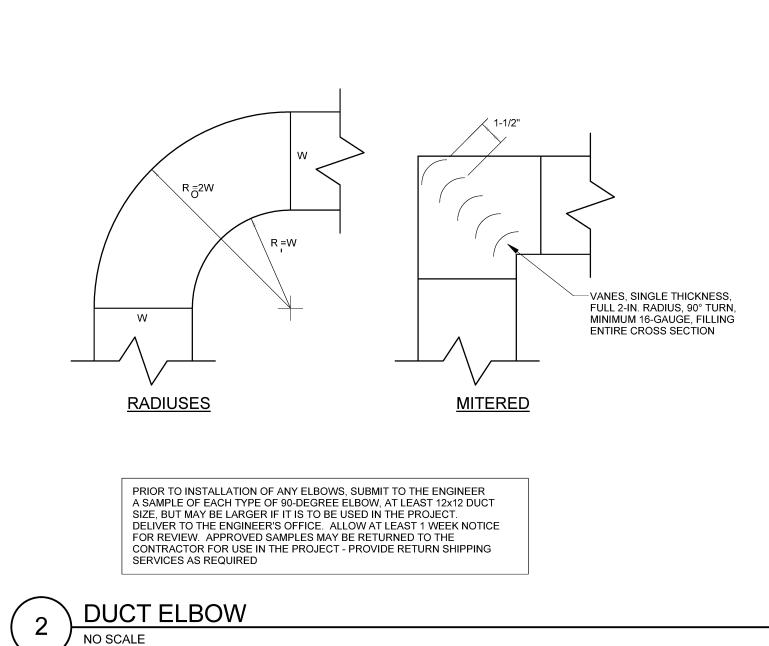

USE MITERED ONLY WHERE SPACE IS TOO TIGHT FOR RADIUS, OR WHERE INDICATED ON DRAWINGS.

HOT WATER RADIATION

NO SCALE