

**NOTES:**

1. SEE SHEET E-001 FOR LEGEND AND GENERAL NOTES.
2. ELEVATOR LOBBY SMOKE DETECTOR NEEDS TO BE WIRED TO THE ELEVATOR RECALL OF THE 2 NEW ELEVATORS. WIRING ASSOCIATED WITH ELEVATOR #3 TO BE PRICED AS ALTERNATE #6.


**KEYED NOTES:**

- ① EXTEND CIRCUIT FROM ELEVATOR #1 PIT.
- ② USE SAME CIRCUIT AS ORIGINAL BOOSTER PUMP. ALL WORK ASSOCIATED WITH THE INSTALLATION OF THE GAS BOOSTER PUMP TO BE PRICED AS ALTERNATE #8.
- ③ ALL WORK ASSOCIATED WITH THE INSTALLATION OF ELEVATOR #3 TO BE PRICED AS ALTERNATE #6.
- ④ PROVIDE 80A, 480V, 3 POLE CIRCUIT BREAKER WITH SHUNT TRIP ACCESSORY IN EMDP.

0	ISSUED FOR CONSTRUCTION	3-17-03
REV.	DESCRIPTION	DATE

**ISSUED FOR CONSTRUCTION**  
**3-17-03**

CURRENT ISSUE STATUS:

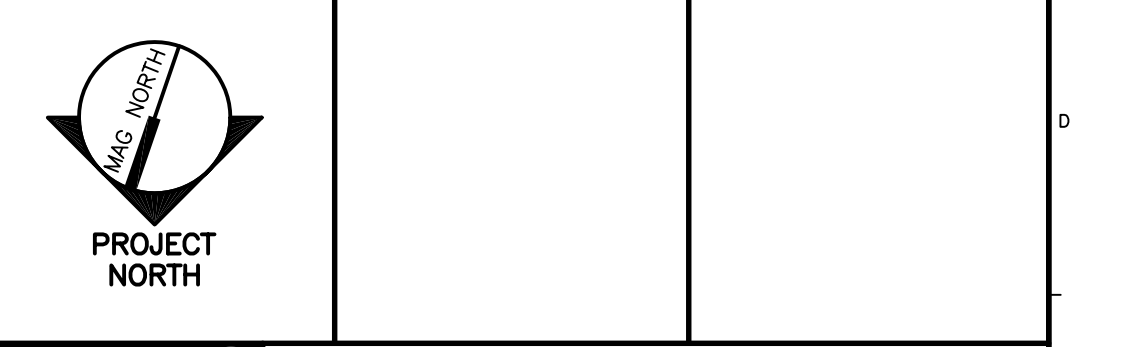

**SMRT** ARCHITECTURE ENGINEERING PLANNING  
 SMRT  
 144 Fore Street, P.O. Box 618  
 Portland, Maine 04104  
 tel. (207) 773-3846  
 fax. (207) 772-1070

**GLICKMAN LIBRARY**  
**UNIVERSITY OF SOUTHERN MAINE**  
 PORTLAND, MAINE

**BASEMENT**  
**POWER PLAN**

SHEET TITLE:	
SCALE: 1/8"=1'-0"	DATE:
PROJECT MANAGER: SLB	GRAPHIC SCALE: 0" 1"
JOB CAP/DRAWN: CTB/JAC	SHEET No.
A/E OF RECORD: JPP	EP100
SMRT CAD FILE: EP100-99092	
PROJECT No. 99092	

A1 BASEMENT FLOOR PLAN

1/8"=1'-0"