



1 ELECTRICAL POWER & SYSTEMS PLAN
SCALE: 1/8"=1'




3 ELECTRICAL DETAIL - 301, 301B, 301C, 301D, 301F
SCALE: 1/4"=1'

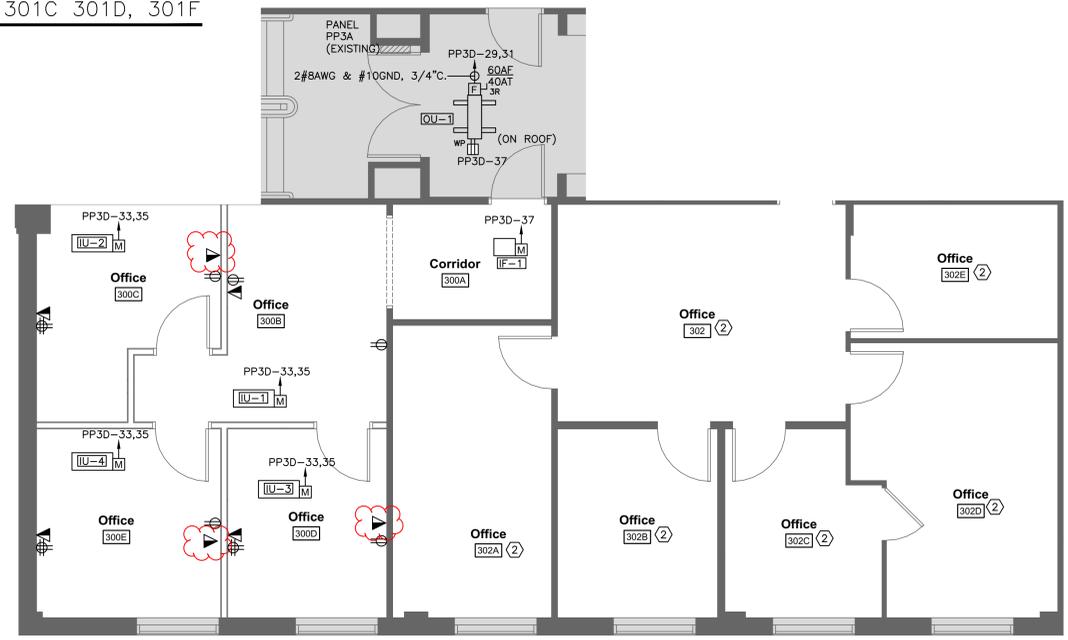

4 ELECTRICAL DETAIL - OFFICE SUITES 300 & 302
SCALE: 1/4"=1'

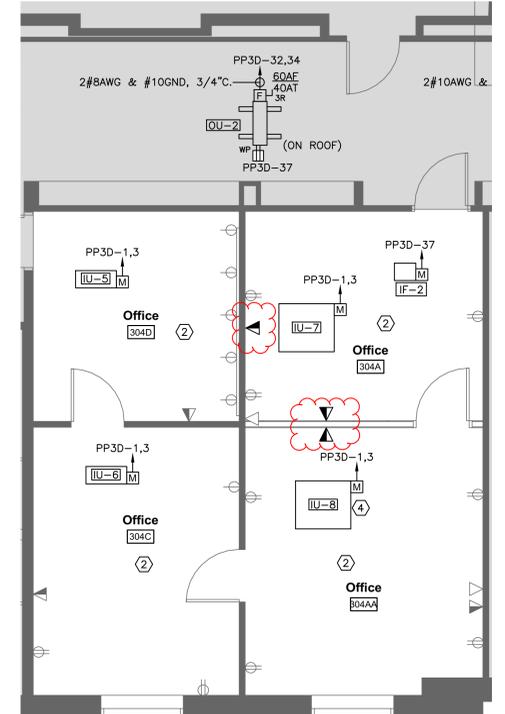

5 ELECTRICAL DETAIL - 304C, 304D, 304E
SCALE: 1/4"=1'

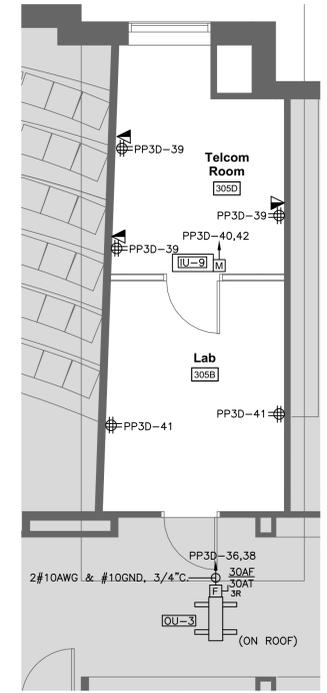

6 ADD ALT #1 - ELECTRICAL DETAIL - 305B, 305D
SCALE: 1/4"=1'

DIRECTORY	KVA LOAD			CCT #	BFR AMPS	PHASE	BFR AMPS	CCT #	KVA LOAD			DIRECTORY		
	A	B	C						A	B	C			
ROOM 305 IU-5,6,7	0.1			1	20	A	20	2	*	*		ITV 304		
AC ROOM UNIT 304E			*	5	15	C	20	6		*		SPARE		
RECEPTS ROOM 302	*			7	20	A	20	8	*			RTU #1		
RECEPTS RM 302	*			9	20	B	20	10		*		RTU RM 304		
ROOFTOP UNIT #1 RECEPTS			*	11	20	C	30	12		*		RTU-304 BLOWER		
RM 302 RECEPTS	*			13	20	A	20	14	*			RTU-305 HOOD		
RM 301A RECEPTS	*			15	20	B	20	16	*			HVAC #4 RECEPT		
RM 302 D-C RECEPTS			*	17	20	C	20	18		*		HVAC RTU #3		
WOMENS RM DOOR OPENER	*			19	20	A	20	20	*			HVAC RTU #4		
HVAC RTU #2		*		21		B		22	*					
		*		23	25	C	25	24		*				
		*		25		A		26	*					
CONTROLLER HV3 HV4	*			27	20	B	30	28	*					
			3.2	29		C		30		*				
RM 300 OU-1	3.2			31	40	A	40	32	3.2			ROOM 305 OU-2		
			0.1	33		B		34		3.2				
RM 300 IU-1,2,3,4			0.1	35	15	C	30	36		*		RM 305 OU-3		
IF-1	0.1			37	20	A	30	38	*			ROOM 305 IU-9		
TELECOM ROOM QUAD RECEPTS	1.2			39	20	B	15	40		*				
LAB QUAD RECEPTS			0.8	41	20	C	15	42		*				
SUBTOTAL	###	###	###						###	###	###	SUBTOTAL		
VOLTAGE: 208Y/120V			PHASE: 3			POLES: 4			TOTAL KVA A-PHASE			###	PANEL	PP3D
MAIN LUGS ONLY			BUS AMPS: 225A			TOTAL KVA B-PHASE			TOTAL KVA C-PHASE			###	LOCATION	CENTER STAIRWELL
MOUNTING: SURFACE			TOTAL KVA			TOTAL KVA			TOTAL KVA			###		
SHORT CIRCUIT RATING: 10KAC														
NOTES:														

2 ELECTRICAL PANEL SCHEDULES
SCALE: NOT TO SCALE

- NOTES:
- SEE E0.0 FOR LEGEND, ABBREVIATIONS AND GENERAL NOTES.
- KEYED NOTES:
- RETAIN DEVICES IN THIS AREA. REPLACE RECEPTACLES AND COVERPLATES IN PLACE. CONFIRM EQUIPMENT IN FIELD.
 - DEVICES AS SHOWN IN THIS AREA SHALL REMAIN AS SHOWN. REPLACE RECEPTACLES AND COVERPLATES, IN PLACE.
 - IT IS ASSUMED THAT EXISTING CLASSROOM RECEPTACLES AND THE OVERHEAD PROJECTOR ARE FED FROM PANEL PP3A IN STAIRWELL. CONFIRM CIRCUITS IN FIELD. REFEED NEW RECEPTACLES FROM EXISTING CIRCUITS.
 - REMOVE EXISTING ROOM UNIT AND WIRING. INSTALL NEW TO CIRCUIT SHOWN.
 - REUSE EXISTING BREAKER (PREVIOUSLY FEEDING AC ROOFTOP UNIT).
 - REMOVE EXISTING ROOFTOP UNIT WIRING.
 - FURNISH NEW GE TYPE THOB BREAKERS.

PD ARCHITECTS
49 DARTMOUTH STREET
PORTLAND, MAINE 04101
207-775-1059
www.pdarchitects.com

COPYRIGHT
PDT Architects
Reuse or reproduction of the contents of this document is not permitted without written permission of PDT Architects.

Payson Smith 3rd Floor Renovations
Falmouth St, Portland ME

1	Date	Revision 1
No.	Date	Description
Revision Schedule		

JOB NO. 17064
DRWN. CHK TDM
SCALE:
ISSUE FOR BIDDING 08/7/17
TITLE ELECTRICAL POWER & SYSTEMS PLAN - LEVEL 3
SHEET E100