



6/3/2013 9:46 AM I:\3801-3900\384210 USM FIRE ALARM SYSTEM UPGRADES\DESIGN\DWGS\BLDG\LUTHER BONNEY 6P002\BONNEY LUTHER FIRE ALARM UPGRADES\SHEETS\3842.13-FA103B THIRD FLOOR FIRE ALARM PLAN - SEG B.DWG KYLE MAHAR

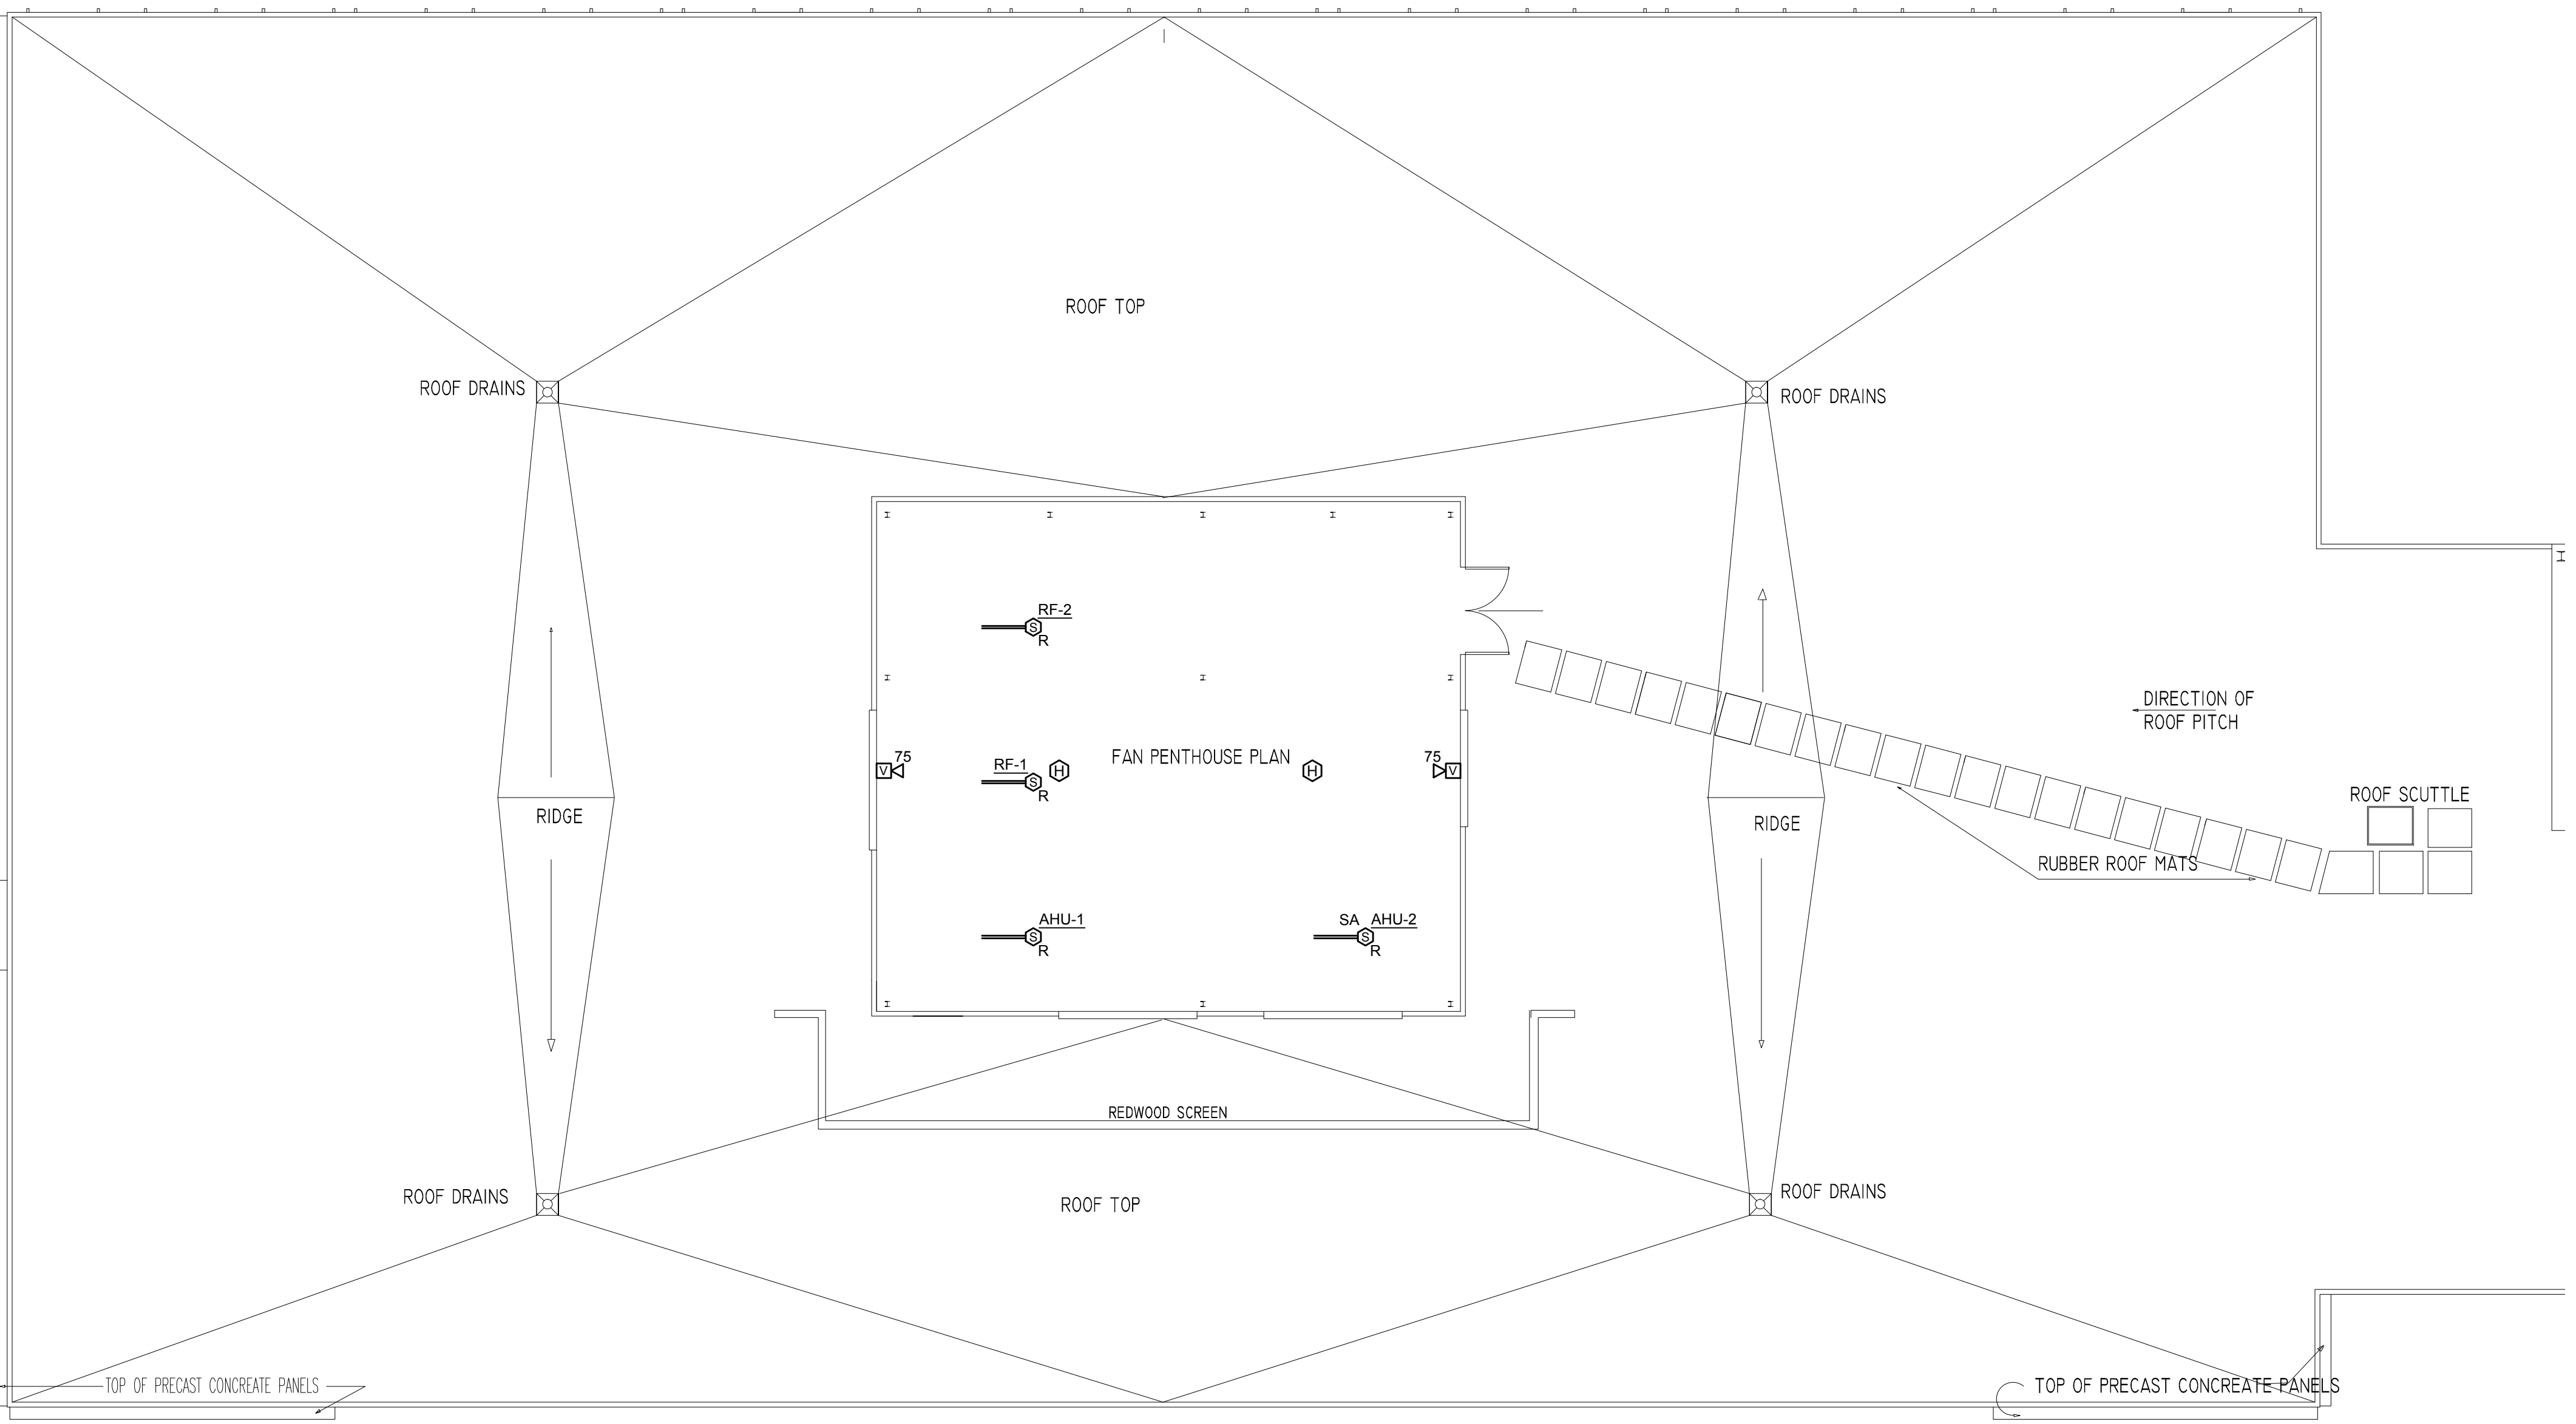

TECHNICAL NOTES:
 ① DUCT SMOKE DETECTORS ARE IS NOTED DIAGRAMMATICALLY IN THIS SPACE. REPLACE EXISTING DUCT SMOKE DETECTOR WITH A NEW DEVICE AND CONNECT TO NEW FIRE ALARM SYSTEM. CONTRACTOR SHALL FIELD VERIFY THE EXACT LOCATION OF EACH EXISTING DETECTOR. IF 120V POWER IS REQUIRED, CONNECT TO NEARBY RECEPTACLE CIRCUIT.

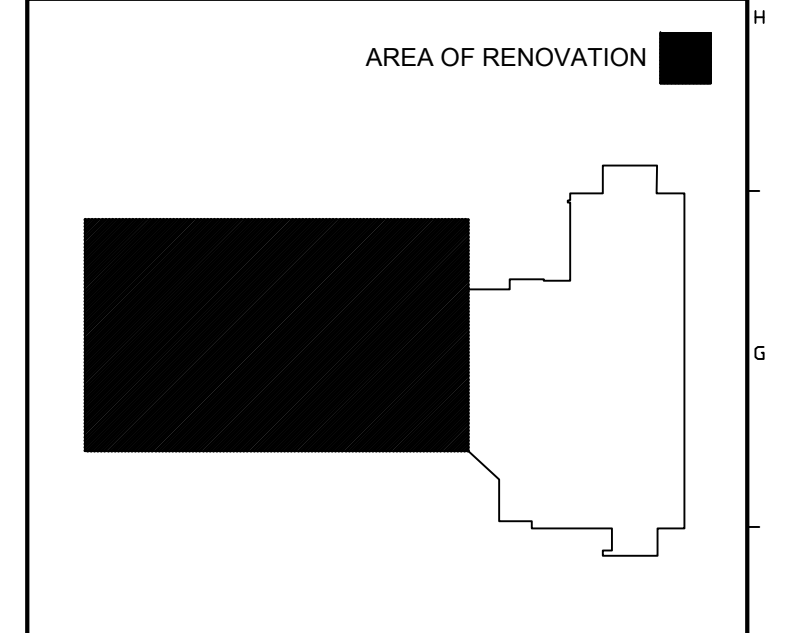

KEY PLAN

0	CONSTRUCTION DOCUMENTS	05.10.13
REV.	DESCRIPTION	DATE

CONSTRUCTION DOCUMENTS
05.10.13

CURRENT ISSUE STATUS:

PROJECT NORTH

P.C. 10.13

WBRC
ARCHITECTS • ENGINEERS
 www.wbrcae.com
 BANGOR, MAINE 207-947-4511
 PORTLAND, MAINE 207-638-4511
 SARASOTA, FLORIDA 941-556-0737

LUTHER BONNEY FIRE ALARM UPGRADES

PROJECT: PORTLAND, MAINE

THIRD FLOOR FIRE ALARM PLAN - SEG B

SHEET TITLE:

WBRC CAD FILE:	3842.13 - FA103B
PROJECT No.	3842.13
SCALE:	AS NOTED
PM:	SJL
DRAWN BY:	KRM
A/E OF RECORD:	SJL

GRAPHIC SCALE: 0" = 1"
 SHEET No. **FA103B**
 © COPYRIGHT 2013 WBRC

A1 **THIRD FLOOR FIRE ALARM PLAN - SEG B**

1/8" = 1'-0"