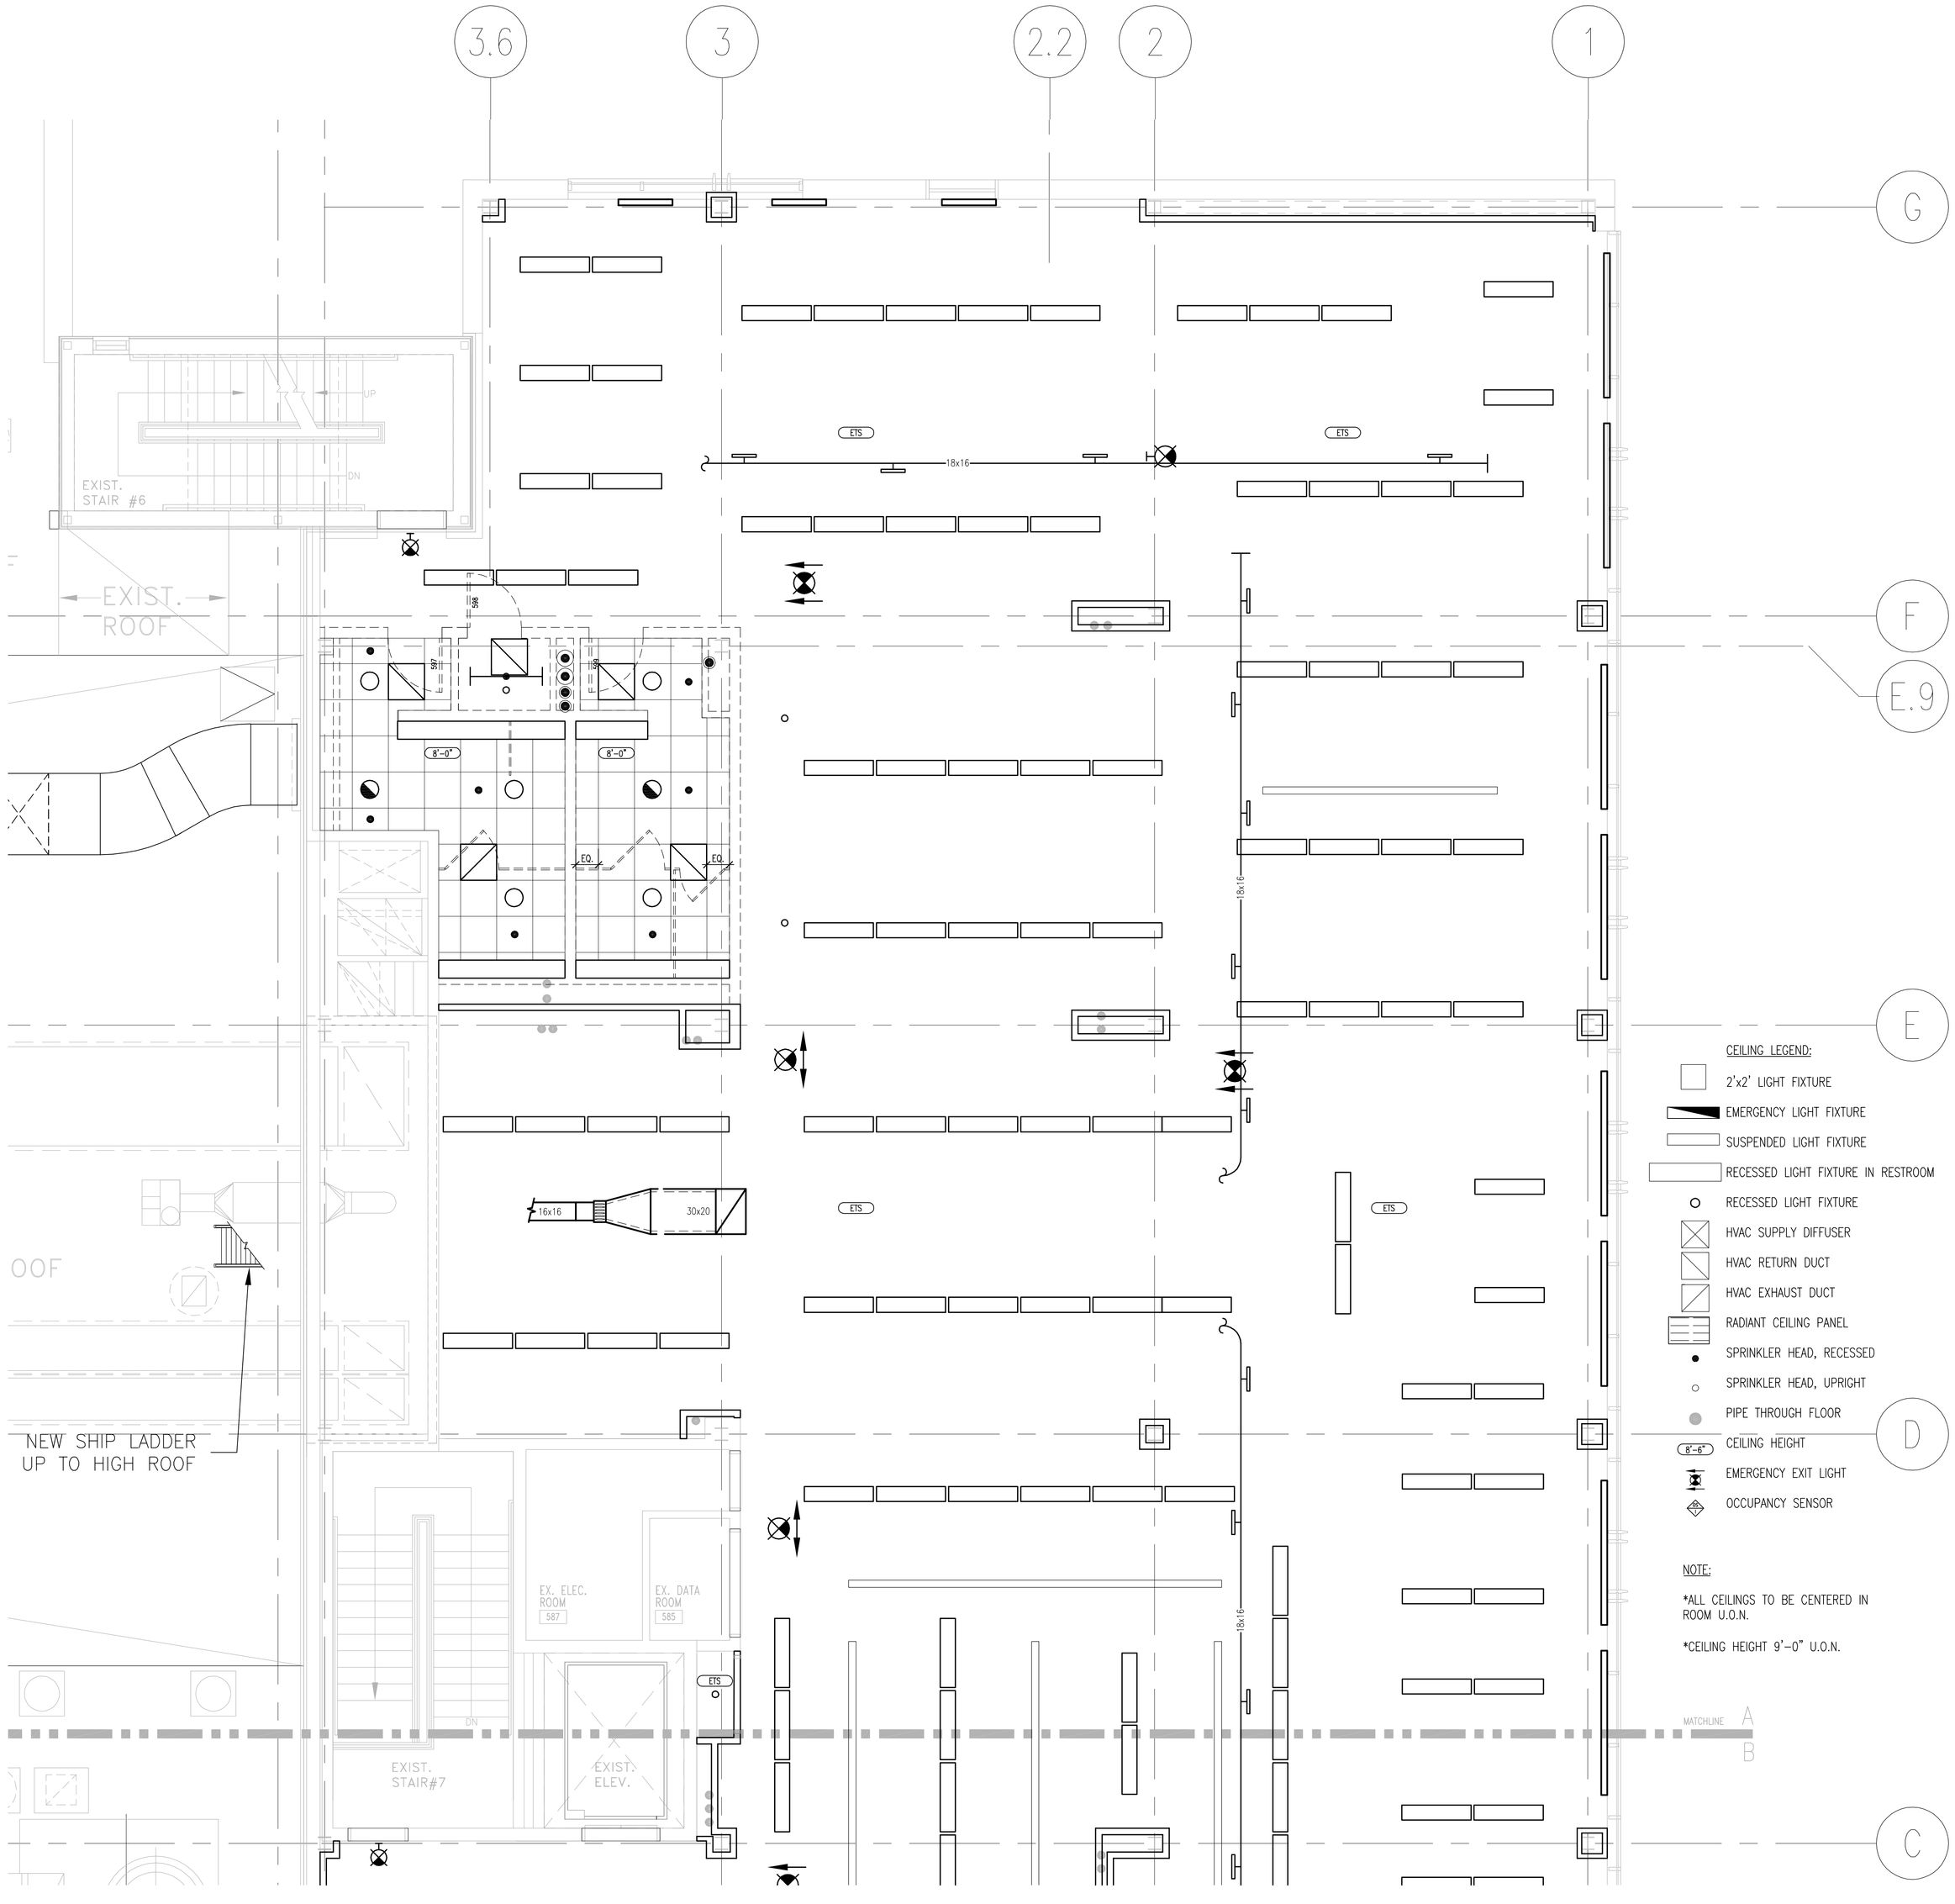

CEILING LEGEND:

- 2'x2' LIGHT FIXTURE
- EMERGENCY LIGHT FIXTURE
- SUSPENDED LIGHT FIXTURE
- RECESSED LIGHT FIXTURE IN RESTROOM
- RECESSED LIGHT FIXTURE
- HVAC SUPPLY DIFFUSER
- HVAC RETURN DUCT
- HVAC EXHAUST DUCT
- RADIANT CEILING PANEL
- SPRINKLER HEAD, RECESSED
- SPRINKLER HEAD, UPRIGHT
- PIPE THROUGH FLOOR
- 8'-6" CEILING HEIGHT
- EMERGENCY EXIT LIGHT
- OCCUPANCY SENSOR

NOTE:

*ALL CEILINGS TO BE CENTERED IN ROOM U.O.N.

*CEILING HEIGHT 9'-0" U.O.N.

KEYPLAN

PROJECT NORTH

TRUE NORTH

SMMA
SYMMES MAINI & MCKEE ASSOCIATES

1000 Massachusetts Avenue
Cambridge, Massachusetts 02138
617.547.5400 · Fax 617.354.5758

OWNER REVIEW

NAME	DATE

NO.	DATE	DESCRIPTION
	06.21.06	ISSUED FOR CONSTRUCTION
	05.03.06	SCOPE REVISION
	03.22.06	100% QC REVIEW
A	03.16.06	PROGRESS PRINT

ISSUE LOG

△ = CLOUDED CHANGE

UNIVERSITY OF SOUTHERN MAINE
70 FALMOUTH STREET
PORTLAND, MAINE

RESEARCH WING
PHASE III FIT-OUT

FIFTH FLOOR
REFLECTED
CEILING PLAN

SCALE	1/8" = 1'-0"
DRAWN BY	AJT
CHECKED BY	
PROJ. ARCH. / ENGR.	MD
PROJ. MGR.	RCH
JOB NO.	03049.10

© SYMMES, MAINI & MCKEE ASSOCIATES, INC. 2004

A6.05a