


GENERAL DRAWING NOTES  
1. ALL EXISTING T-SHAPES THAT ARE CONTROLLING EXISTING W/M BOXES AND HOT WATER CONTROL VALVES, SHALL REMAIN AS IS, IF NOT INDICATED TO BE RECONNECTED TO NEW T-SHAPES.

2ND FLOOR AIRFLOW SUMMARY

EXISTING W/M SUPPLY AIRFLOW	: 8400 CFM
EXISTING W/M RETURN AIRFLOW	: - CFM
EXISTING W/M RETURN AIRFLOW	: - CFM
W/M SUPPLY AIRFLOW	: 9440 CFM
W/M RETURN AIRFLOW	: 8500 CFM
W/M RETURN AIRFLOW	: - CFM

RESEARCH WING  
PHASE III FIT-OUT  
SECOND FLOOR  
PART B  
PLAN

SCALE: 1/4"=1'-0"  
DRAWN BY: FV  
CHECKED BY: PHOL ARCH / ENGR, GJI  
PROJ MGR: RCH  
JOB NO.: 03046.10  
© SWINER, MAIN & MOORE ASSOCIATES, INC. 2004

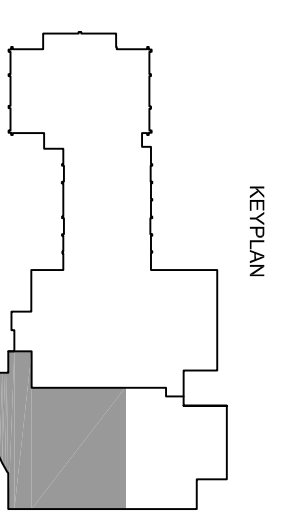

M1.02b

OWNER REVIEW

NAME	DATE

ISSUE LOG

NO.	DATE	DESCRIPTION
06.21.06	ISSUED FOR CONSTRUCTION	
05.03.06	SCOPE REVISION	
03.22.06	100% GC REVIEW	
A	03.16.06	PROGRESS PRINT

UNIVERSITY OF SOUTHERN MAINE  
770 FAULKNER STREET  
PORTLAND, MAINE