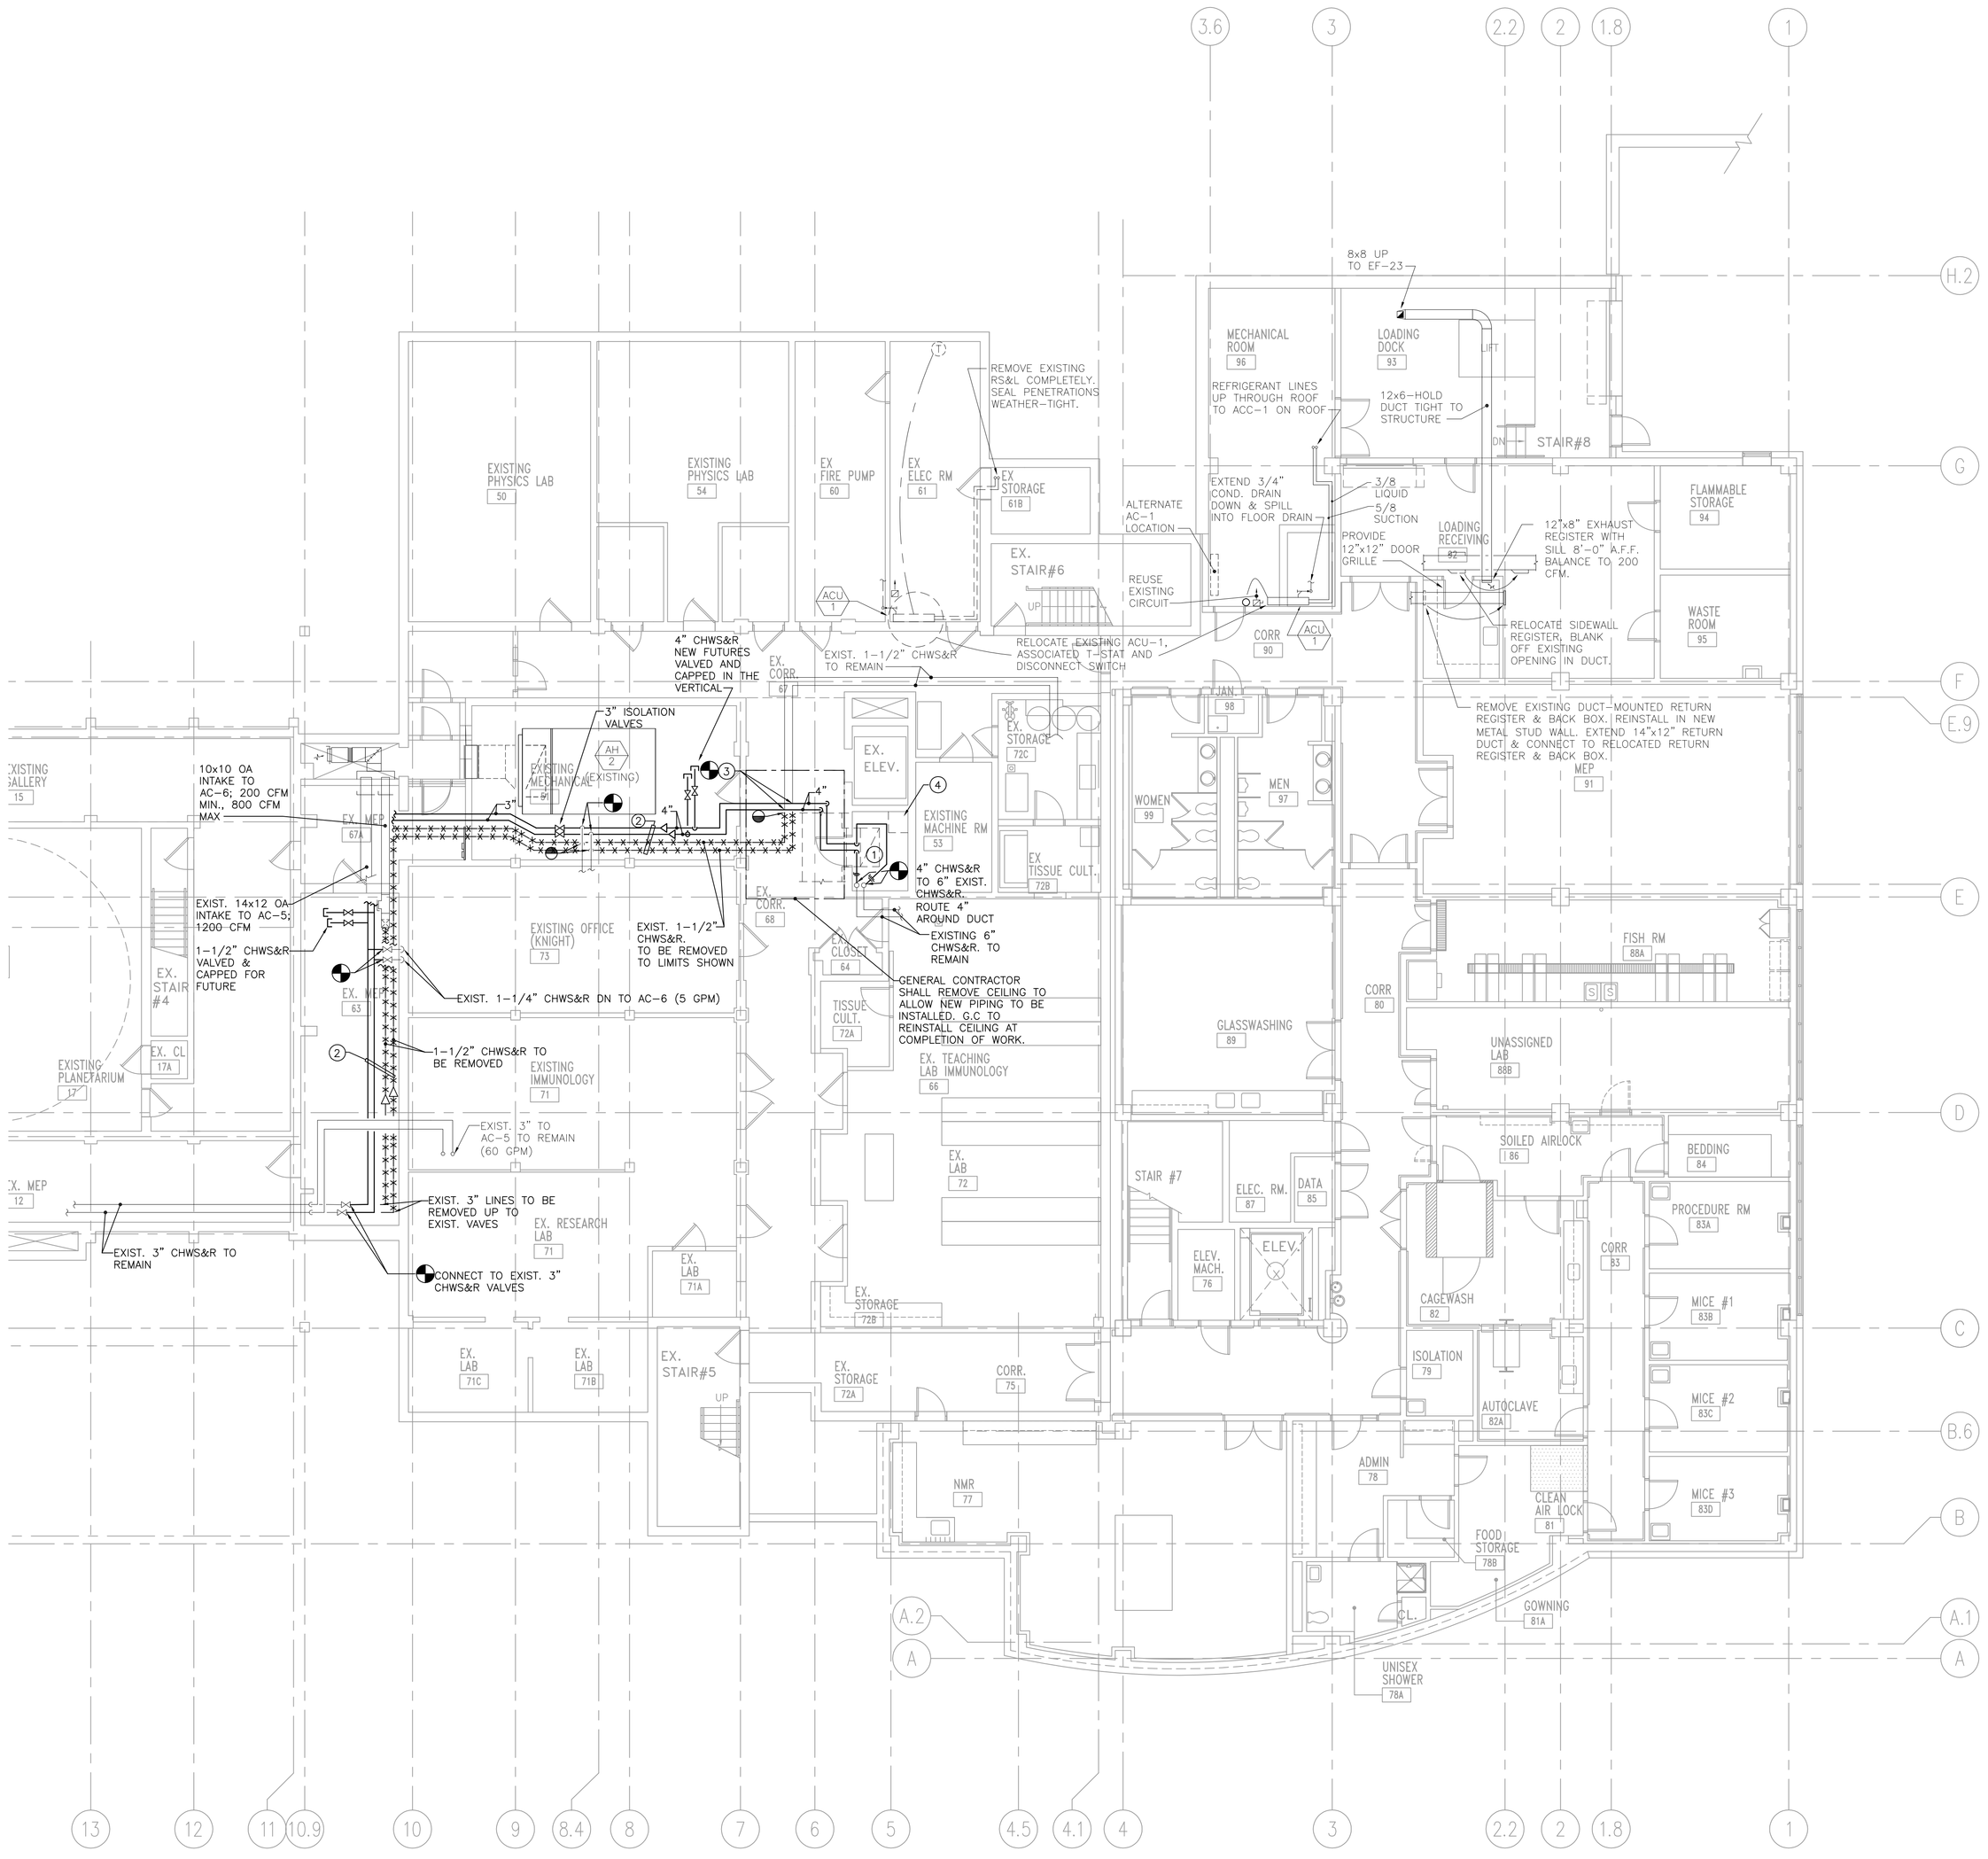

GENERAL DRAWING NOTES

1. REFER TO FLOW DIAGRAMS 4 & 5 ON DRAWING M3.01. FOR PIPING DETAILS.

KEYED DRAWING NOTES

1. EXISTING GENERAL EXHAUST DUCT TO BE PARTIALLY REMOVED TO FACILITATE NEW PIPING INSTALLATION; RE-INSTALL DUCT & INSULATION TO EXISTING STATE.
2. ROUTE NEW 3" CHWS&R IN SAME LOCATION AS EXISTING 1-1/2" CHWS&R THAT IS BEING REMOVED (SHOWN ADJACENT FOR CLARITY). SPECIFICALLY, WHEN IN EX. MEP RM. #63 IN FRONT OF ELECTRICAL EQUIPMENT.
3. CONNECT EXISTING 1-1/2" CHWS&R TO NEW 4"CHWS&R.
4. ROUTE PIPING TO AVOID CONFLICT WITH ELEVATOR EQUIPMENT.

SMMA
SYMMES MAINI & MCKEE ASSOCIATES
1000 Massachusetts Avenue
Cambridge, Massachusetts 02138
617.547.5400 Fax 617.354.5758

OWNER REVIEW

NAME	DATE

NO.	DATE	DESCRIPTION
	06.21.06	ISSUED FOR CONSTRUCTION

ISSUE LOG
△ = CLOUDED CHANGE

UNIVERSITY OF SOUTHERN MAINE
70 FALMOUTH STREET
PORTLAND, MAINE

RESEARCH WING
PHASE III FIT-OUT

BASEMENT
PART PLAN

SCALE	1/8"=1'-0"
DRAWN BY	FV
CHECKED BY	
PROJ. ARCH. / ENGR.	GI
PROJ. MGR.	RCH
JOB NO.	03049.10

© SYMMES, MAINI & MCKEE ASSOCIATES, INC. 2004

M2.02