NOTES:

1. DISCONNECT, REMOVE AND STORE WITH CARE ALL FIRE PROTECTION PIPING, COUPLING, SPRINKLER HEADS, SEISMIC RESTRAINTS, ETC. EXISTING MAINS, BRANCH PIPING AND SPRINKLER HEADS ARE SHOWN FOR REFERENCE.
2. COORDINATE INSTALLATION OF EXISTING/NEW FIRE PROTECTION PIPING WITH HVAC DUCTWORK, PLUMBING, PROCESS PIPING AND ELECTRICAL WORK. NEW SPRINKLER MAIN LOCATION SHOWN TO BE 11'-3" AFF ±.
3. PROVIDE AND INSTALL ADDITIONAL PIPING, OFFSETS, BRANCH LINES AND SPRINKLER HEADS AS REQUIRED TO COORDINATE W/NEW LAYOUT.
4. SUBMIT SHOP DRAWINGS FOR REVIEW AFTER COORDINATION WITH OTHER TRADES.
5. COORDINATE WITH ARCHITECTURAL PLANS FOR LOCATION OF SPRINKLER HEADS IN AREAS WITH CEILING. PROVIDE UPRIGHT SPRINKLER HEADS IN AREAS WITHOUT CEILINGS. COORDINATE LOCATION WITH ALL TRADES. NEW UPRIGHT SPRINKLER HEADS NOT SHOWN.

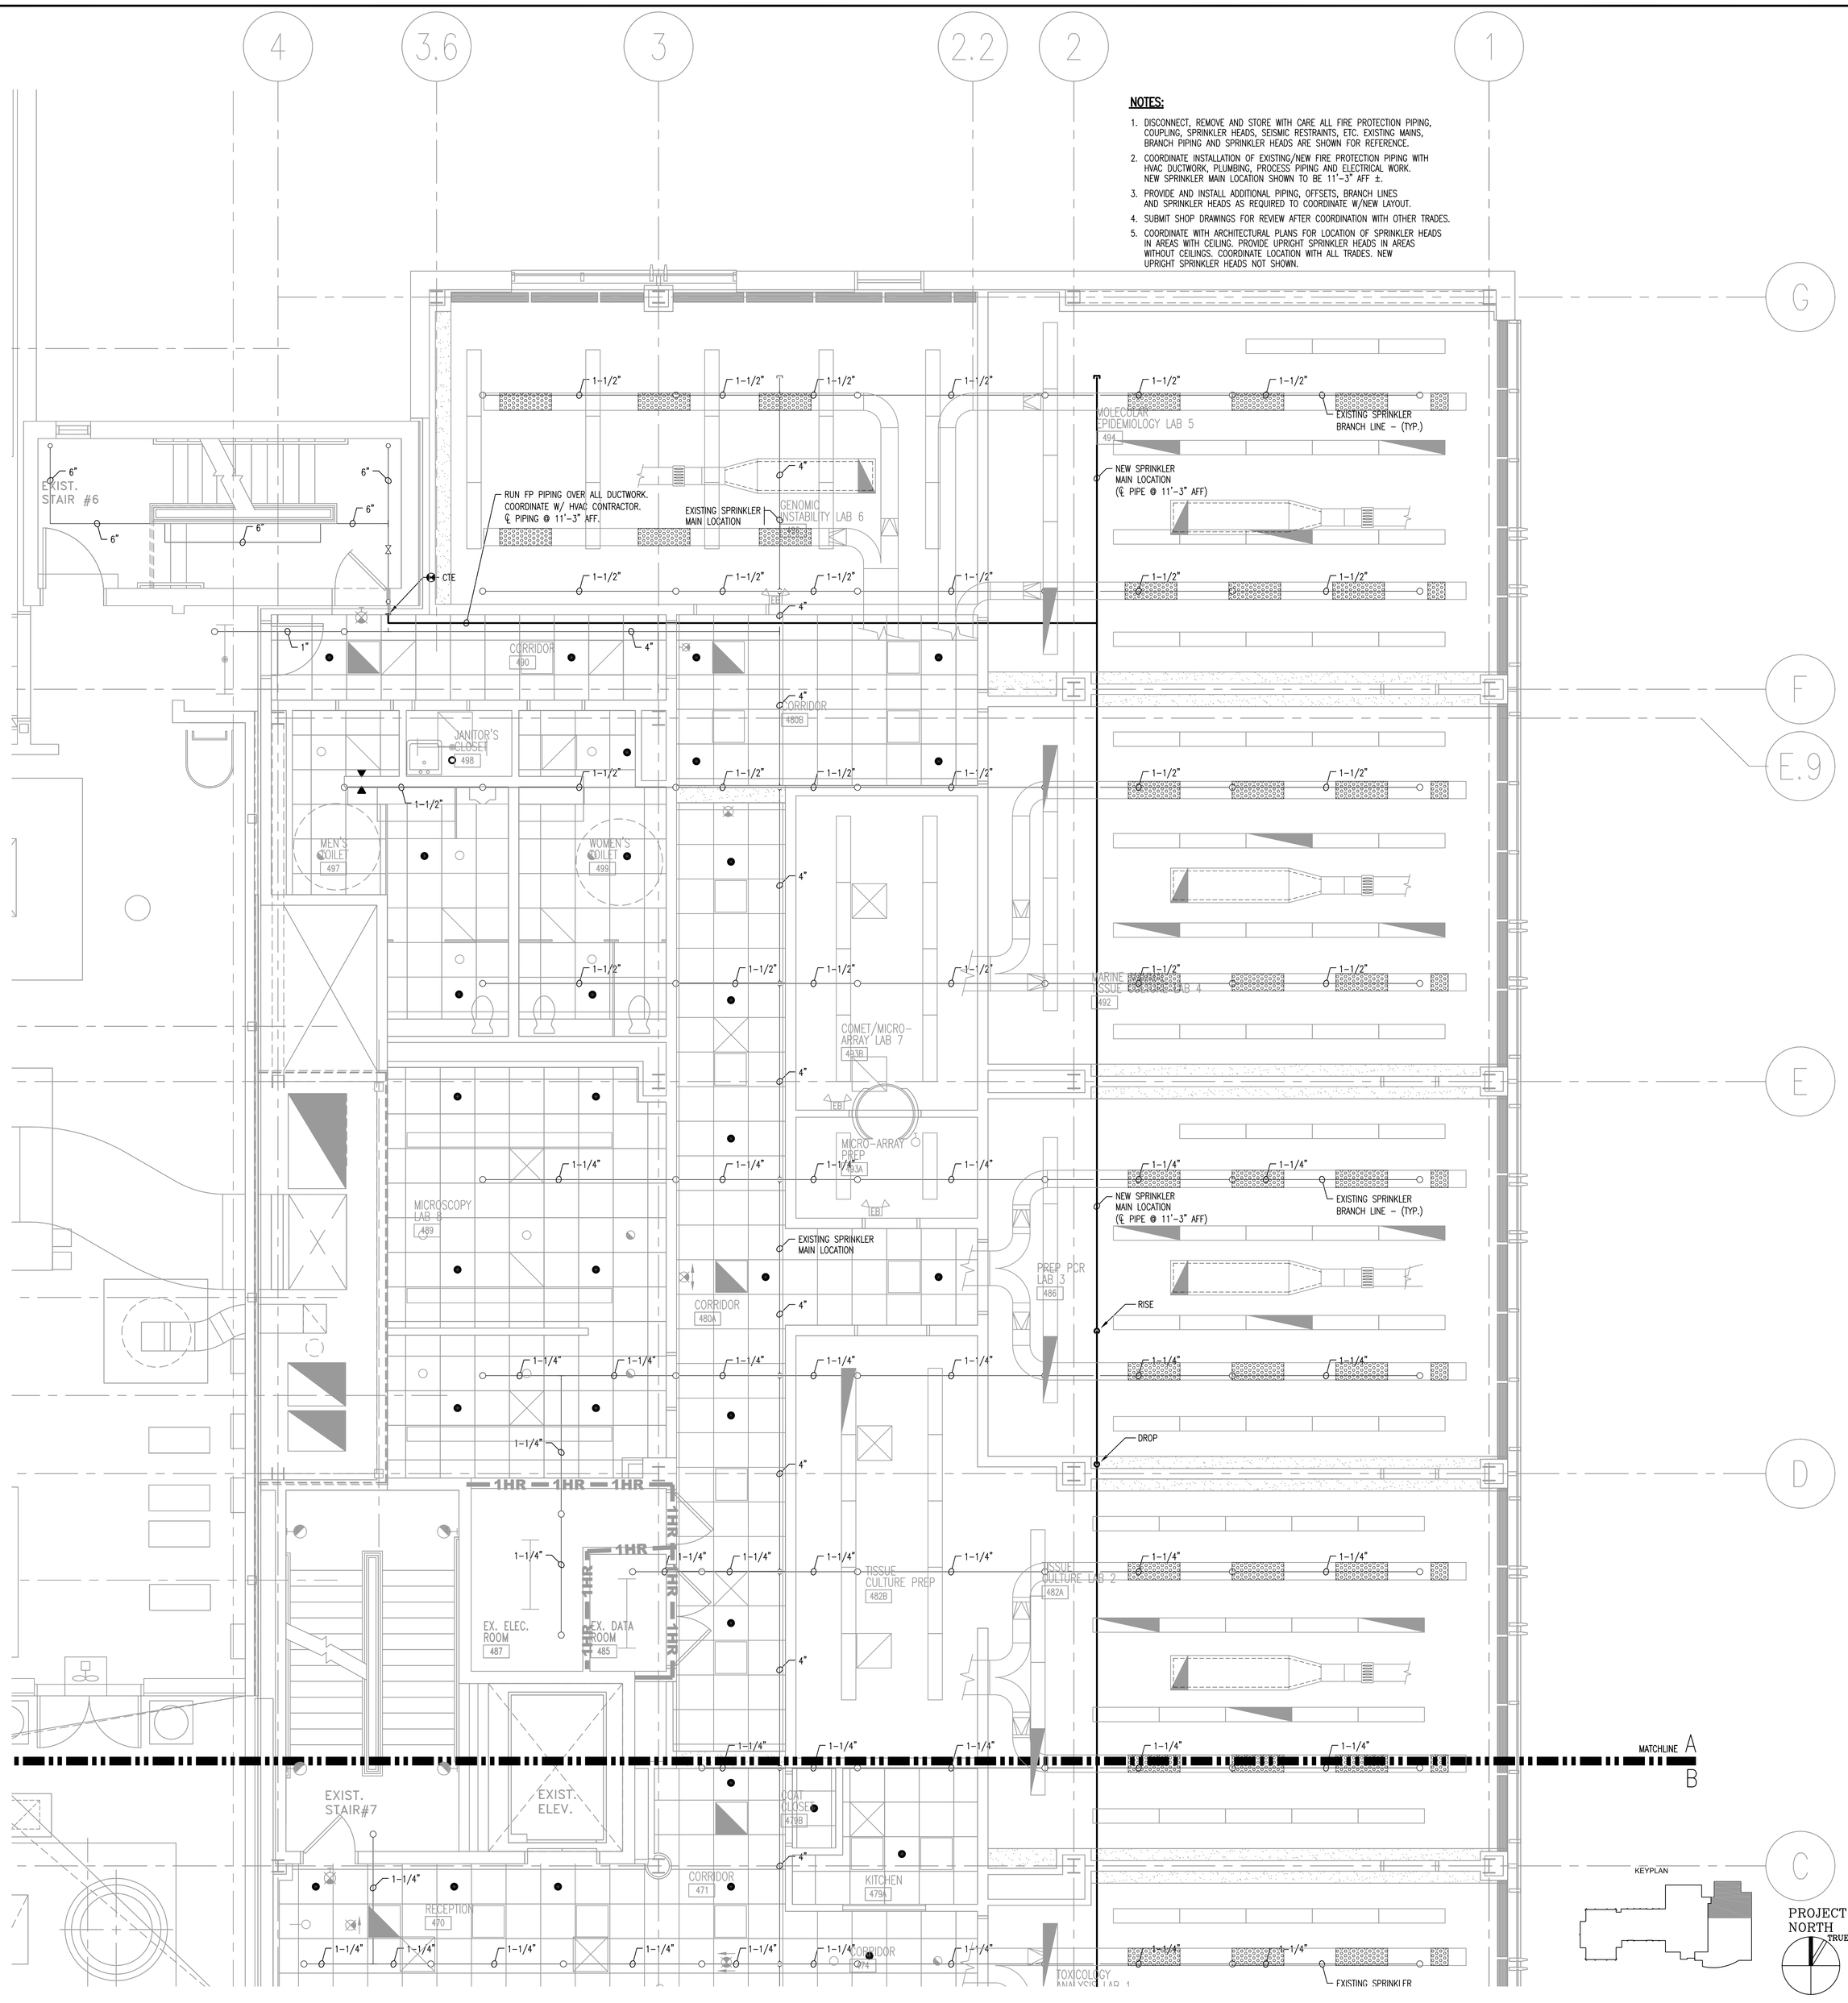

SMMA
SYMMES MAINI & MCKEE ASSOCIATES

1000 Massachusetts Avenue
Cambridge, Massachusetts 02138
617.547.5400 Fax 617.354.5758

OWNER REVIEW

NAME	DATE

NO.	DATE	DESCRIPTION
	06.21.06	ISSUED FOR CONSTRUCTION
	05.03.06	SCOPE REVISION
C	03.22.06	100% QC REVIEW
B	03.16.06	PROGRESS PRINT
A	03.08.06	80% PROGRESS PRINT

ISSUE LOG

△ = CLOUDED CHANGE

UNIVERSITY OF SOUTHERN MAINE
70 FALMOUTH STREET
PORTLAND, MAINE

RESEARCH WING
PHASE III FIT-OUT

FOURTH
FLOOR PLAN
PART A

SCALE	1/4"=1'-0"
DRAWN BY	MVR
CHECKED BY	
PROJ. ARCH. / ENGR.	MD/TGW
PROJ. MGR.	RCH
JOB NO.	03049.10

© SYMMES, MAINI & MCKEE ASSOCIATES, INC. 2004

FP1.04a