

FOUNDATION PLAN
SCALE: 1/8" = 1'-0"

PIER SCHEDULE


MARK	SECTION	REINFORCING	TES
P-1	2'-0" x 2'-0"	(4) #4 BARS	#1 AT 12" O.C.
P-2	2'-0" x 2'-0"	(4) #4 BARS	#1 AT 12" O.C.
P-3	2'-0" x 2'-0"	(6) #4 BARS	#1 AT 12" O.C.
P-4	1'-6" x 2'-0"	(6) #4 BARS	#1 AT 12" O.C.
P-5	1'-6" x 2'-0"	(6) #4 BARS	#1 AT 12" O.C.
P-6	1'-6" x 2'-0"	(6) #4 BARS	#1 AT 12" O.C.

FOOTING SCHEDULE

MARK	SIZE	THICKNESS	REINFORCING
F-1	4'-0" x 4'-0"	1'-0"	(3) #4 BARS
F-2	5'-6" x 5'-6"	1'-0"	(6) #4 BARS
F-3	6'-0" x 6'-0"	1'-0"	(6) #4 BARS
F-4	7'-0" x 7'-0"	1'-0"	(9) #4 BARS
F-5	8'-0" x 8'-0"	2'-0"	(9) #4 BARS
F-6	8'-6" x 8'-6"	2'-0"	(10) #4 BARS
F-7	9'-6" x 9'-6"	2'-0"	(10) #4 BARS
F-8	5'-0" x 5'-0"	1'-0"	(3) #4 BARS
F-9	12'-0" x 12'-0"	2'-6"	(6) #4 BARS

FOUNDATION NOTES

- ELEVATIONS:
a. FINISH FLOOR ELEVATION: 0'-0" (EXCEPT AS NOTED)
b. FINISH FLOOR ELEVATION: 0'-0" (EXCEPT AS NOTED)
- FOUNDATIONS ARE DESIGNED TO MEET THE RECOMMENDATIONS CONTAINED IN, DATED MAY 16, 2003:
a. ALL ELEVATIONS ON PLANS AND SCHEDULES UNLESS NOTED OTHERWISE
b. FINISH FLOOR ELEVATION: 0'-0" UNLESS OTHERWISE NOTED
c. STEP FOOTINGS SHALL BE 2" TO 4" WIDER UNDER ALL PILES, AND CENTER WALL
d. FOUNDATIONS UNDER WALLS SHALL BE 6" WIDER
e. NO FOOTING SHALL BE PLACED IN WATER OR OPEN FRESH WATER
f. THE FINISH OF THE EXISTING WALL SHALL BE PROTECTED BY PRESERVATION MEASURES TO BE 5" TO 6" MINIMUM BELOW ADJACENT GRADE
g. FOUNDATIONS SHALL BE DESIGNED TO RESIST ALL APPLIED LOADS AND DAMAGES TO MAINTAIN PROPER FUNCTION, BUT NOT LIMITED TO, ADJACENT BUILDINGS, WINDS, AND OTHER DAMAGES
- FOUNDATIONS TO BE ON UNDESIGNEDLY VIBRATED PROPOSED WORKING SOIL OR COMPACTED STRUCTURE, FILL WITH A SAFE, UNDESIGNEDLY VIBRATED SOIL AS DIRECTED BY THE OWNER. THE SOIL SHALL BE PROTECTED BY A NOTED AT THE ELEVATIONS INDICATED.
- CONCRETE OPERATIONS FOR ALL CONCRETE STRUCTURE AND SLAB REQUIREMENTS:
a. FOR ALL CONCRETE REINFORCING AND WELDED WIRE FABRIC, SEE SPECIFICATIONS.
b. REINFORCE AND SUPPORT REINFORCING BARS AS PER CAST-IN-PLACE MANUAL OF STANDARD PRACTICE
c. ALL REINFORCING AND WELDED WIRE FABRIC SHALL BE CONTINUOUS THROUGH COLUMN JOINTS FOR STANDARD COLUMN
d. CONCRETE PROTECTION FOR REINFORCING SHALL BE AS FOLLOWS (UNLESS OTHERWISE NOTED):
1. 1/2" CLEAR ALL AROUND REINFORCING
2. 2" CLEAR FOR VERTICAL WALLS
3. 2" CLEAR FOR VERTICAL WALLS
4. LAY SPACES SHALL BE A MINIMUM OF 36 BAR DIAMETERS UNLESS OTHERWISE NOTED
5. LAY SPACES SHALL BE A MINIMUM OF 36 BAR DIAMETERS UNLESS OTHERWISE NOTED
6. PLACE ANCHOR BARS IN CONCRETE WITH ANCHOR BOLT PLAN PREPARED BY THE ARCHITECT
7. ON ARCHITECTURAL, MECHANICAL, ELECTRICAL AND OTHER DRAWINGS, BRACE WALLS AND BARS AS NOTED ON ARCHITECTURAL AND MECHANICAL DRAWINGS
- TESTING:
a. FOR ALL CONCRETE AND SOIL, TESTING REQUIREMENTS SEE SPECIFICATIONS.
b. FINISH FLOOR ELEVATION: 0'-0" UNLESS OTHERWISE NOTED
c. GROUT CLEANED FOR ALL OTHER SURFACES EXPOSED TO VIEW
- FINISHES:
a. SEE FINISH SCHEDULE
b. SEE FINISH SCHEDULE
c. SEE FINISH SCHEDULE

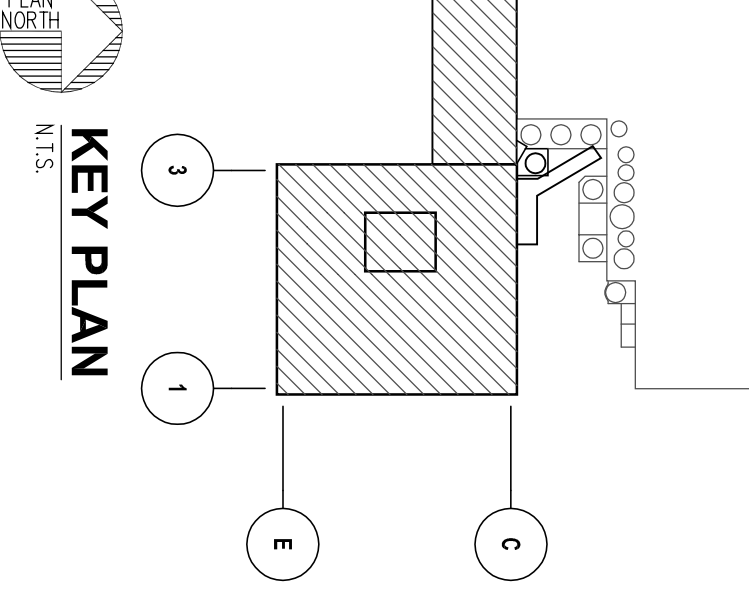

<p>FACILITIES DESIGN, INC. 3904 Ashd Drive Columbia, Pennsylvania 17512 Phone: (717) 285-9442 Fax: (717) 285-3102 Email: info@facilitiesdesign.com Web: www.facilitiesdesign.com CA Number: 20031818</p>		<p>Engineering Design Services Architectural Engineering Building Structural Foundation Fire Protection HVAC Mechanical Process Thermal Radiation Utility Water Wind Yield Zoning</p>				
<p>Oakhurst DAIRY 386 FOREST AVENUE PORTLAND, MAINE 04101</p>		<p>PROJECT NUMBER: 2003.1141.0</p> <p>DATE: AUGUST 29, 2003</p> <p>DRAWING NUMBER: F100</p> <p>REVISION: 0</p>				
<p>PROJECT: NEW MILK COOLER</p> <p>DESIGNED BY: KAS</p> <p>DRAWN BY: GLB</p> <p>CHECKED BY: R.A.C.</p> <p>PROJECT MANAGER: MSM</p> <p>SCALE:</p>		<p>REVISIONS:</p> <table border="1"> <tr> <td>0</td> <td>08-29-03</td> <td>ISSUED FOR BIDDING</td> </tr> </table>		0	08-29-03	ISSUED FOR BIDDING
0	08-29-03	ISSUED FOR BIDDING				