


# ELECTRICAL LEGEND

- LP-1,3 HOMERUN TO PNLBRD - ARROWS INDICATE NUMBER OF CIRCUITS. CROSS LINES INDICATE NUMBER OF CONDUCTORS OTHER THAN TWO
- CIRCUIT NUMBER(S)
- PANEL DESIGNATION
- WIRING CONCEALED IN WALL OR CEILING
- WIRING IN RACEWAY CONCEALED UNDER FLOOR
- MOTOR
- JUNCTION BOX
- DISCONNECT SWITCH
- NEW PANELBOARD
- EXISTING PANELBOARD

## 4 LEGEND

SCALE: NTS

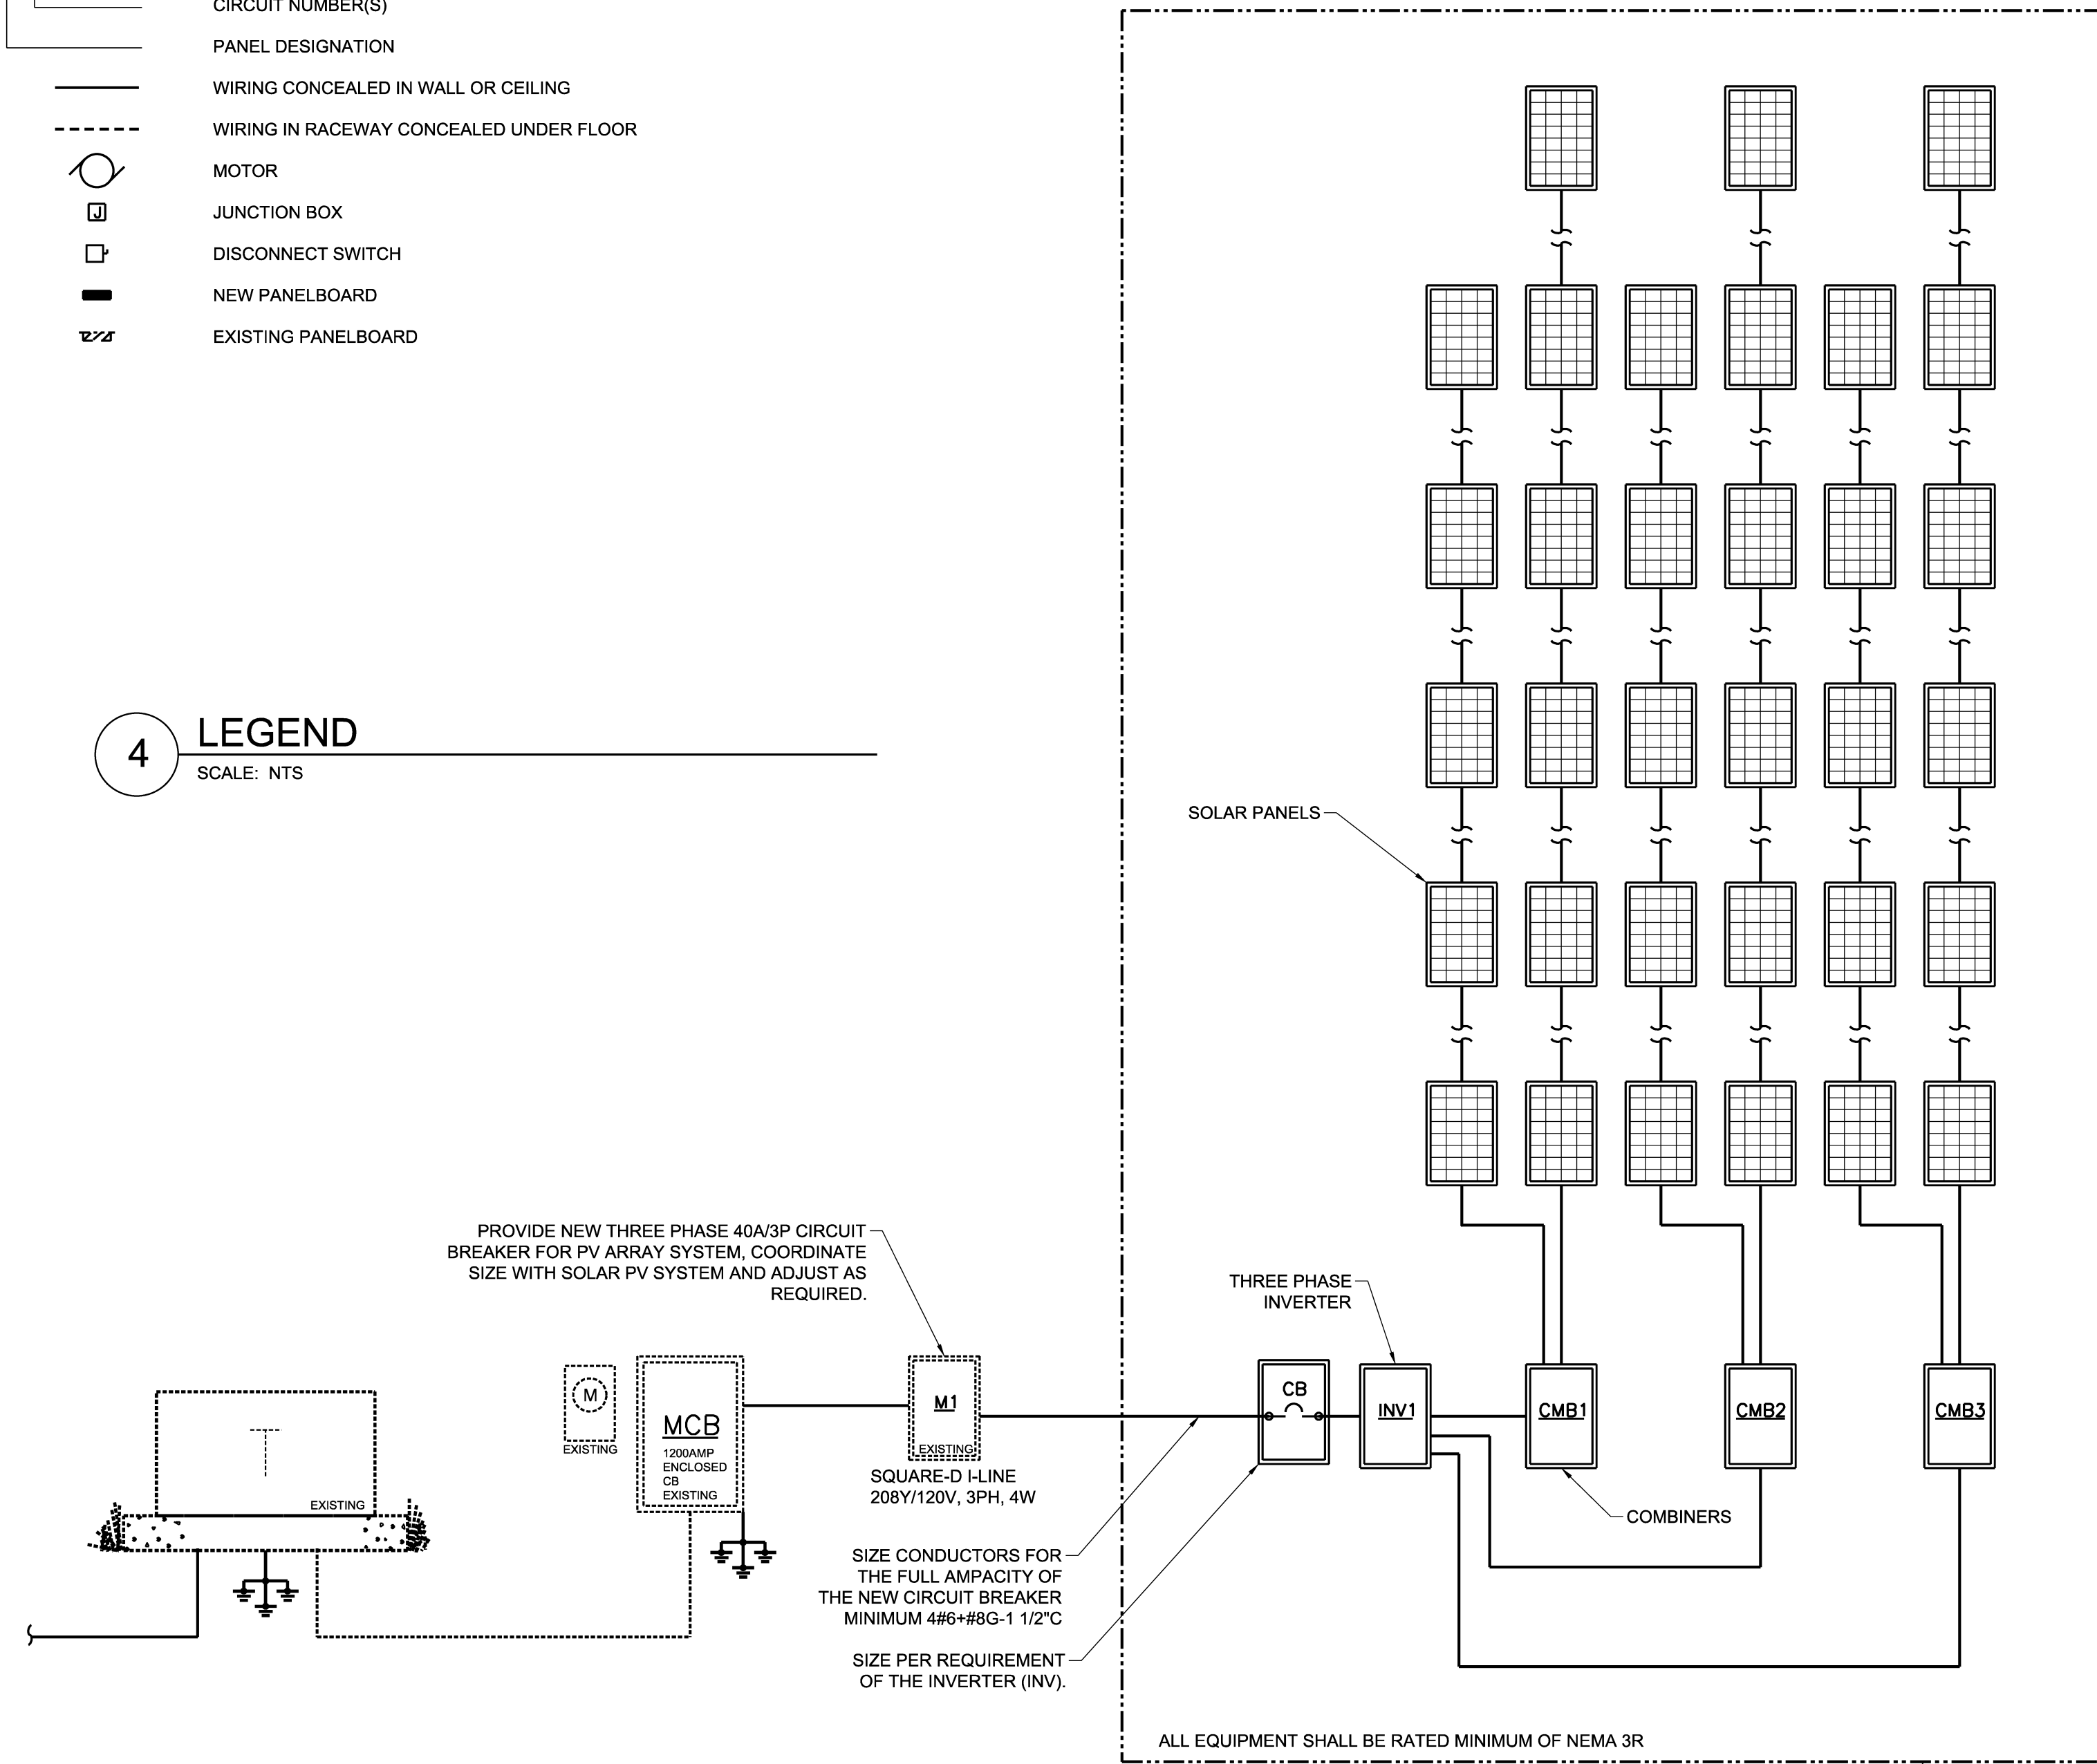

## 3 SINGLE LINE


SCALE: NTS

LOAD DESCRIPTION	AMP	W	DWG CRKT NO	W	D	WATT LOADS			W	D	W	D	AMP	LOAD DESCRIPTION
						PH A	PH B	PH C						
TUB 1 OF 1 - REMARKS:														
EXISTING CIRCUIT	150	3	1	1	0	0	0	0	2	2	3	175		EXISTING MCC
EXISTING CIRCUIT	125	3	7	7	0	0	0	0	8	8	3	140		PV ARRAY INVERTER
EXISTING CIRCUIT	150	3	13	13	0	0	0	0	14	14	3			SPACE
EXISTING CIRCUIT	600	3	19	19	0	0	0	0	20	20	3			SPACE
TOTAL AMPS: 0      TOTAL WATTS: 0														
REMARKS: EXISTING SQUARE-D I-LINE HCW M44-89237-1C. *- ADJUST CIRCUIT BREAKER TO SUIT INVERTER (SEE 264440).														

## 2 PANELBOARD SCHEDULE

SCALE: NTS

GENERAL NOTE:  
1. PROPERLY SEAL ALL PENETRATIONS IN ROOF AND PARTITIONS.

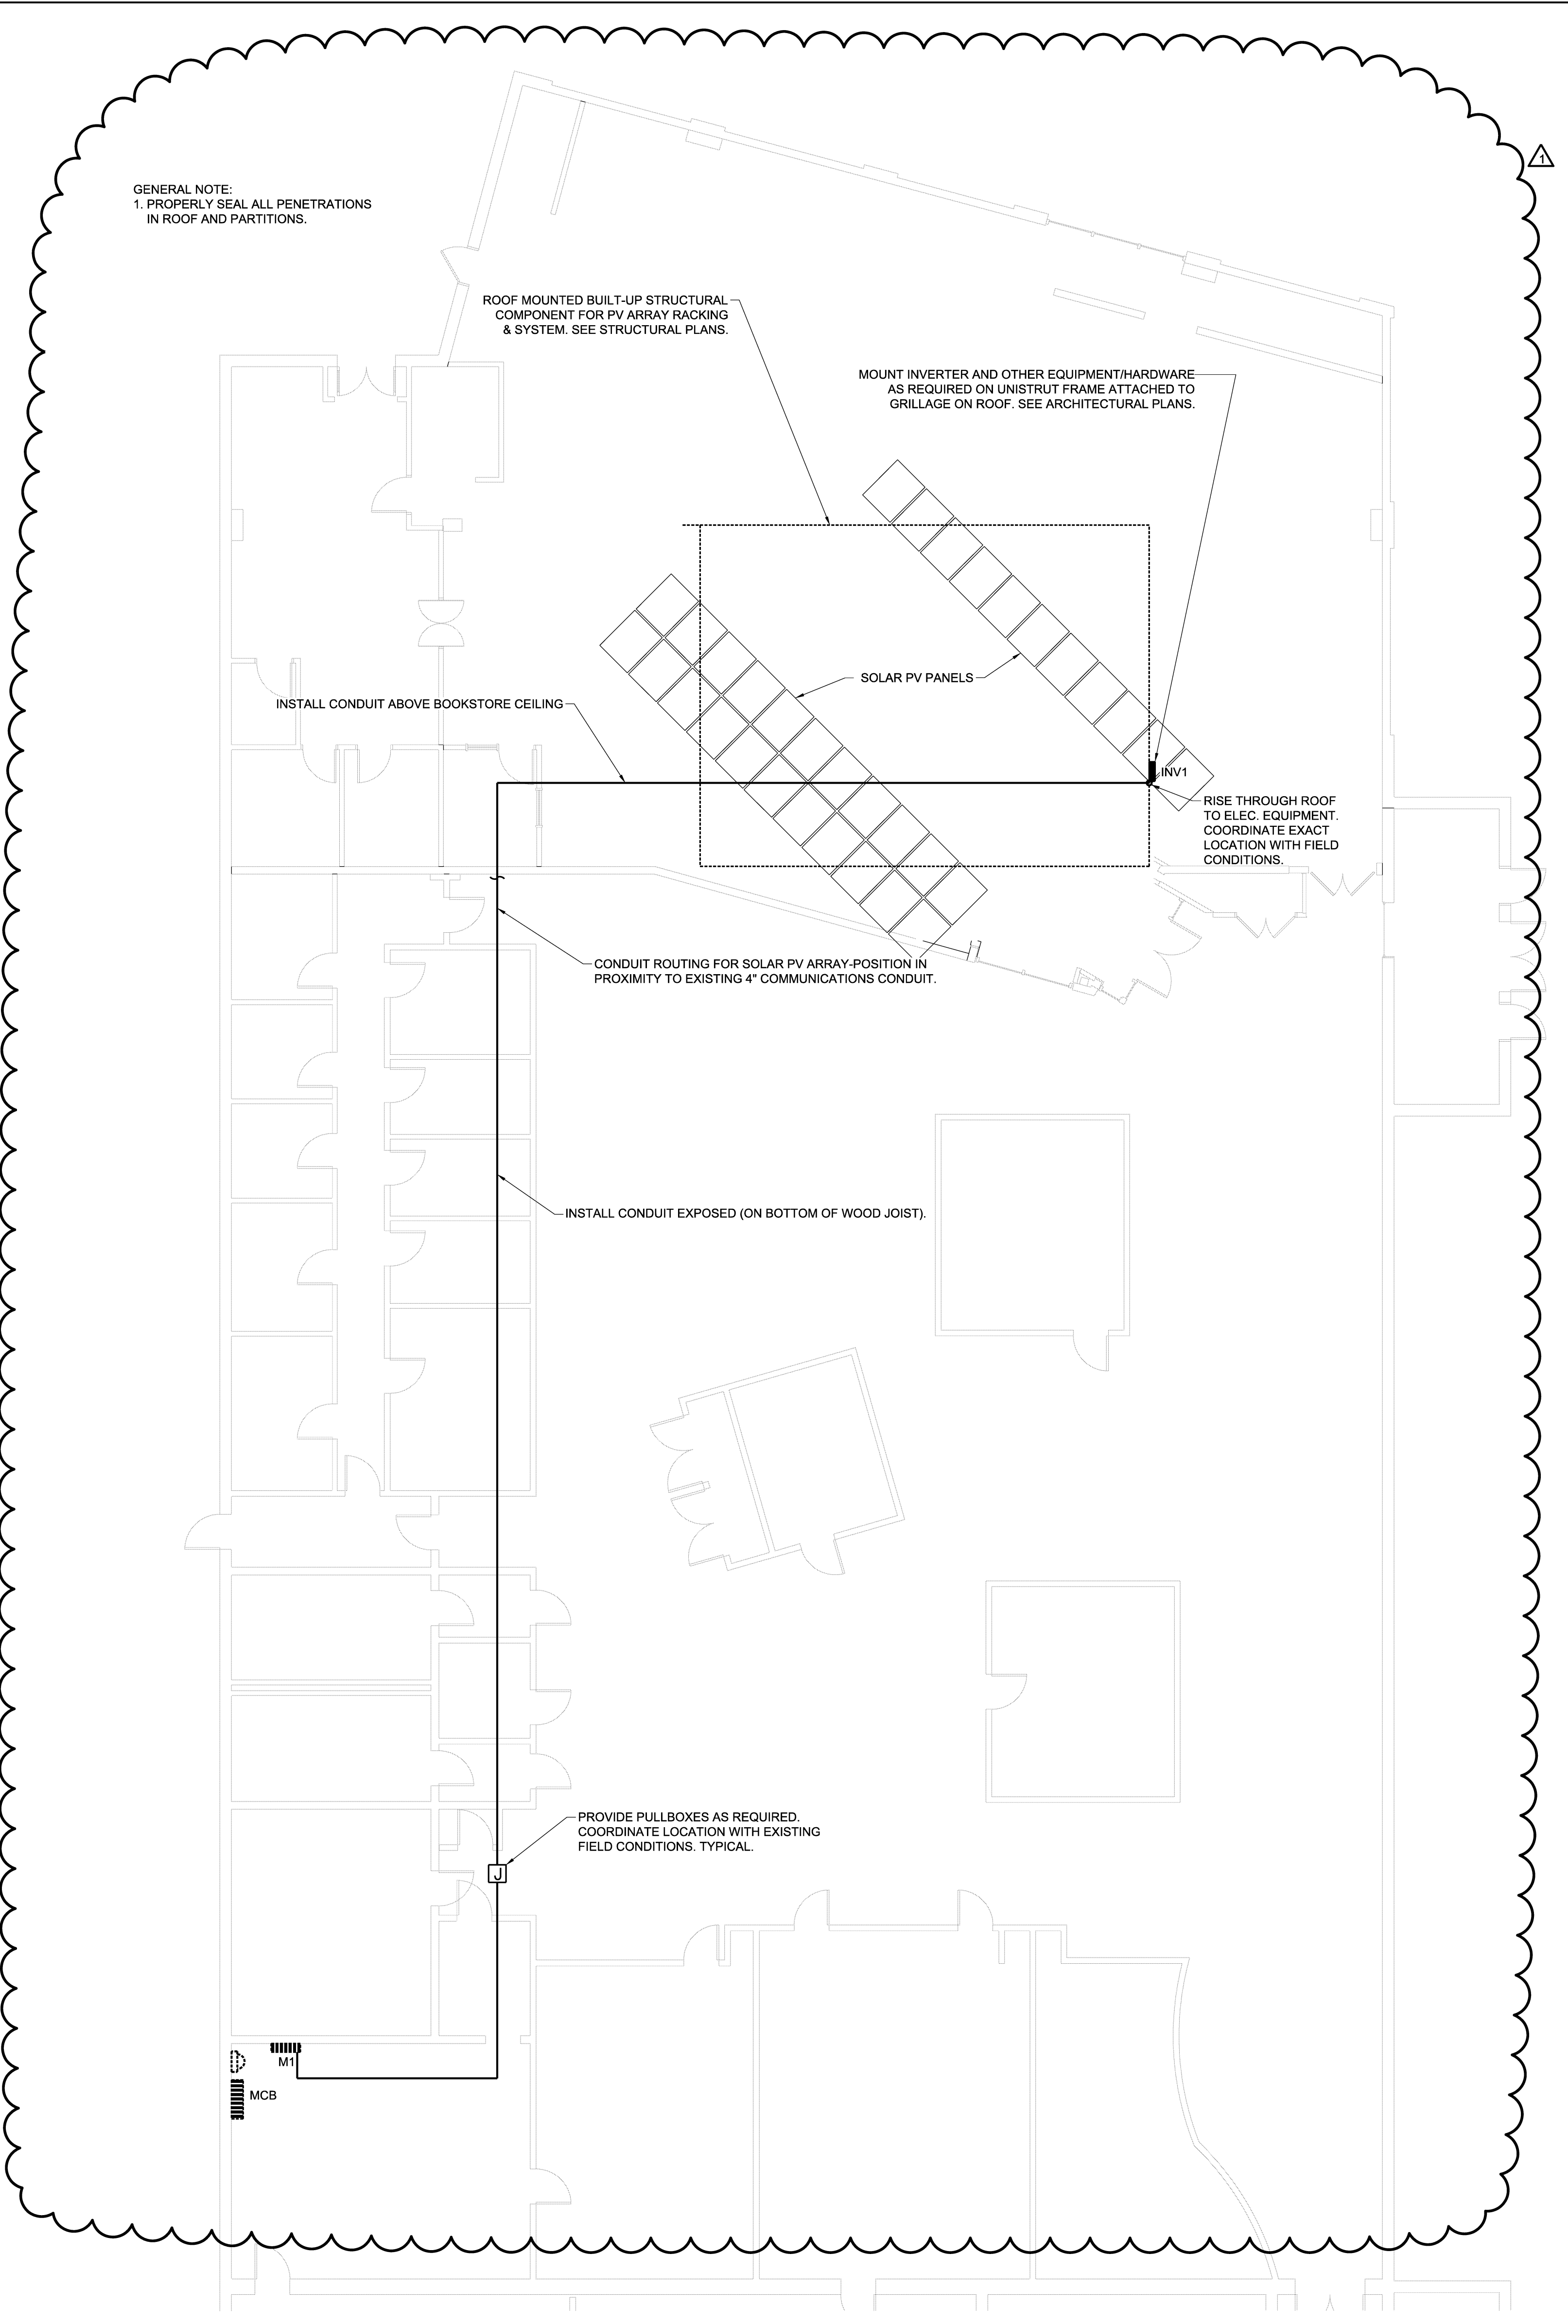

## 1 FLOOR PLAN


SCALE: 1/8" = 1'-0"



UNIVERSITY OF SOUTHERN MAINE  
WOODBURY CAMPUS CENTER  
EXTERIOR UPGRADES  
2014-011  
PHASE II - PV ARRAY  
PORTLAND, ME

Harriman Project No. 14352  
Key Plan  
North  
Proj North

Mark	Date	Description
-	08-22-14	OWNER REVIEW
-	08-29-14	ISSUED FOR BID
Δ	09-15-14	ADDENDUM #1

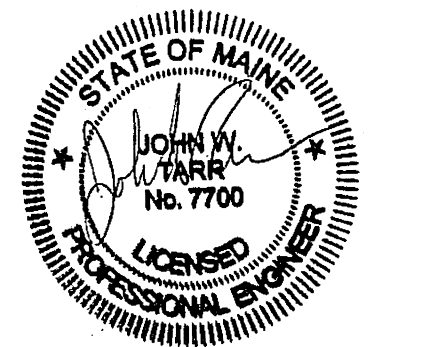

Drawing Scales

PA / PE: JWT  
Drawn By: PRA

© 2014  
Harriman Associates

## FLOOR PLAN AND DETAILS

E20.1