

# SPECIFICATIONS

## WOODBURY CAMPUS CENTER

University of Southern Maine, Portland Campus  
Portland, Maine

### **Bathroom Installation Project #2017-014**

Prepared For:

**University System of Maine**  
Facilities Management  
25 Bedford Street  
Portland, ME 04104

June 30, 2017

Prepared By:



**OAK POINT**  
ASSOCIATES

architecture  
engineering  
planning



**TABLE OF CONTENTS**

**DIVISION 00 - PROCUREMENT AND CONTRACTING REQUIREMENTS**

|             |   |
|-------------|---|
| 00 01 07    | PROFESSIONAL SEALS PAGE   |
| 00 01 15    | LIST OF DRAWINGS  |
| 00 11 13    | ADVERTISEMENT FOR BIDS  |
| 00 11 13.10 | NOTICE TO CONTRACTORS   |
| 00 21 13    | INSTRUCTIONS TO BIDDERS   |
| 00 41 13    | BID FORM  |
| 00 43 13    | BID SECURITY FORM   |
| 00 52 13    | CONSTRUCTION CONTRACT AGREEMENT                                   |
| 00 61 13.13 | PERFORMANCE BOND FORM   |
| 00 61 13.16 | PAYMENT BOND FORM   |
| 00 62 16    | ACORD CERTIFICATE OF INSURANCE 25-S                               |
| 00 62 16.10 | ACORD CERTIFICATE OF LIABILITY INSURANCE                          |
| 00 62 16.11 | COMMERCIAL GENERAL LIABILITY COVERAGE FORM                        |
| 00 62 16.12 | ADDITIONAL INSURED – SCHEDULED PERSON OR ORGANIZATION             |
| 00 62 16.13 | ADDITIONAL INSURED – COMPLETED OPERATIONS                         |
| 00 62 16.14 | DESIGNATED LOCATION(S) GENERAL AGGREGATE LIMIT                    |
| 00 62 73    | SCHEDULE OF VALUES  |
| 00 62 76    | APPLICATION AND CERTIFICATE FOR PAYMENT FORM                      |
| 00 62 76.13 | SALES TAX FORM  |
| 00 62 76.16 | CONSENT OF SURETY TO REDUCTION IN OR PARTIAL RELEASE OF RETAINAGE |
| 00 62 79    | STORED MATERIALS FORM   |
| 00 63 13    | REQUEST FOR INFORMATION (RFI)                                     |
| 00 63 33    | ARCHITECT’S SUPPLEMENTAL INSTRUCTIONS                             |
| 00 63 46    | CONSTRUCTION CHANGE DIRECTIVE FORM                                |
| 00 63 57    | WORK CHANGES PROPOSAL REQUEST                                     |
| 00 63 63    | CHANGE ORDER  |
| 00 65 16    | CERTIFICATE OF SUBSTANTIAL COMPLETION                             |
| 00 65 19    | CERTIFICATION OF COMPLETION                                       |
| 00 65 19.13 | CONTRACTOR’S AFFIDAVIT OF PAYMENT OF DEBTS AND CLAIMS             |
| 00 65 19.16 | CONTRACTOR’S AFFIDAVIT OF RELEASE OF LIENS                        |
| 00 65 19.17 | WAIVER OF LIEN  |
| 00 65 19.19 | CONSENT OF SURETY TO FINAL PAYMENT                                |
| 00 72 00    | GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION               |
| 00 73 00.01 | SUPPLEMENTARY GENERAL CONDITIONS                                  |
| 00 73 00.11 | SCHEDULE OF LIQUIDATED DAMAGES                                    |
| 00 73 46    | WAGE DETERMINATION SCHEDULE                                       |

**DIVISION 01 - GENERAL REQUIREMENTS**

|        |                                     |
|--------|-------------------------------------|
| 011000 | SUMMARY                             |
| 012600 | CONTRACT MODIFICATION PROCEDURES    |
| 012900 | PAYMENT PROCEDURES                  |
| 013100 | PROJECT MANAGEMENT AND COORDINATION |
| 013200 | CONSTRUCTION PROGRESS DOCUMENTATION |

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

|        |  |
|--------|--|
| 013300 | SUBMITTAL PROCEDURES                       |
| 014200 | REFERENCES                                 |
| 016000 | PRODUCT REQUIREMENTS                       |
| 017300 | EXECUTION                                  |
| 017419 | CONSTRUCTION WASTE MANAGEMENT AND DISPOSAL |
| 017700 | CLOSEOUT PROCEDURES                        |
| 017823 | OPERATION AND MAINTENANCE DATA             |
| 017839 | PROJECT RECORD DOCUMENTS                   |
| 017900 | DEMONSTRATION AND TRAINING                 |
| 019500 | TESTING, ADJUSTING, AND BALANCING          |

**DIVISION 02 - EXISTING CONDITIONS**

|        |                      |
|--------|----------------------|
| 024119 | SELECTIVE DEMOLITION |
|--------|----------------------|

**DIVISION 07 - THERMAL AND MOISTURE PROTECTION**

|        |                |
|--------|----------------|
| 079200 | JOINT SEALANTS |
|--------|----------------|

**DIVISION 08 - OPENINGS**

|        |                               |
|--------|-------------------------------|
| 081113 | HOLLOW METAL DOORS AND FRAMES |
| 081416 | FLUSH WOOD DOORS              |
| 087100 | DOOR HARDWARE                 |

**DIVISION 09 - FINISHES**

|        |                                |
|--------|--------------------------------|
| 092216 | NON-STRUCTURAL METAL FRAMING   |
| 092900 | GYPSUM BOARD                   |
| 093013 | CERAMIC TILING                 |
| 096513 | RESILIENT BASE AND ACCESSORIES |
| 096519 | RESILIENT TILE FLOORING        |
| 099123 | INTERIOR PAINTING              |

**DIVISION 10 - SPECIALTIES**

|        |                                       |
|--------|---------------------------------------|
| 102800 | TOILET, BATH, AND LAUNDRY ACCESSORIES |
|--------|---------------------------------------|

**DIVISION 22 - PLUMBING**

|           |  |
|-----------|--|
| 220517    | SLEEVES AND SLEEVE SEALS FOR PLUMBING PIPING           |
| 220518    | ESCUTCHEONS FOR PLUMBING PIPING                        |
| 220523.12 | BALL VALVES FOR PLUMBING PIPING                        |
| 220529    | HANGERS AND SUPPORTS FOR PLUMBING PIPING AND EQUIPMENT |
| 220553    | IDENTIFICATION FOR PLUMBING PIPING AND EQUIPMENT       |
| 220719    | PLUMBING PIPING INSULATION                             |
| 221116    | DOMESTIC WATER PIPING                                  |
| 221316    | SANITARY WASTE AND VENT PIPING                         |
| 221319    | SANITARY WASTE PIPING SPECIALTIES                      |
| 221319.13 | SANITARY DRAINS  |
| 224213.13 | COMMERCIAL WATER CLOSETS                               |
| 224216.13 | COMMERCIAL LAVATORIES                                  |

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

**DIVISION 23 - HEATING, VENTILATING, AND AIR CONDITIONING (HVAC)**

|        |  |
|--------|--|
| 230513 | COMMON MOTOR REQUIREMENTS FOR HVAC EQUIPMENT |
| 230593 | TESTING, ADJUSTING, AND BALANCING FOR HVAC   |
| 230713 | DUCT INSULATION                              |
| 233113 | METAL DUCTS                                  |
| 233423 | HVAC POWER VENTILATORS                       |

**DIVISION 26 - ELECTRICAL**

|        |  |
|--------|--|
| 260519 | LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES |
| 260526 | GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS       |
| 260529 | HANGERS AND SUPPORTS FOR ELECTRICAL SYSTEMS        |
| 260533 | RACEWAYS AND BOXES FOR ELECTRICAL SYSTEMS          |
| 260553 | IDENTIFICATION FOR ELECTRICAL SYSTEMS              |
| 262726 | WIRING DEVICES                                     |
| 265119 | LED INTERIOR LIGHTING                              |

**DIVISION 28 – ELECTRONIC SAFETY AND SECURITY**

|           |                                 |
|-----------|---------------------------------|
| 284621.13 | CONVENTIONAL FIRE-ALARM SYSTEMS |
|-----------|---------------------------------|

END OF TABLE OF CONTENTS




**Woodbury Campus Center Bathroom Installation  
University of Southern Maine**

Project #2017-014


Professional Seal Page




Jonathan McIntyre, Licensed Architect

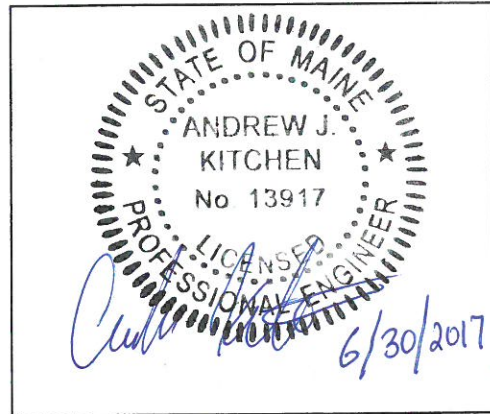



Andrew Kitchen, P.E., Mechanical Engineer

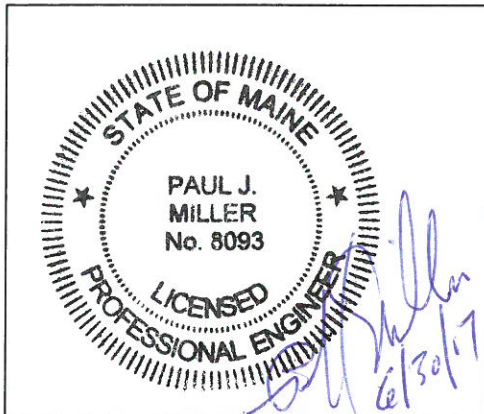

Paul J. Miller, P.E., Civil Engineer

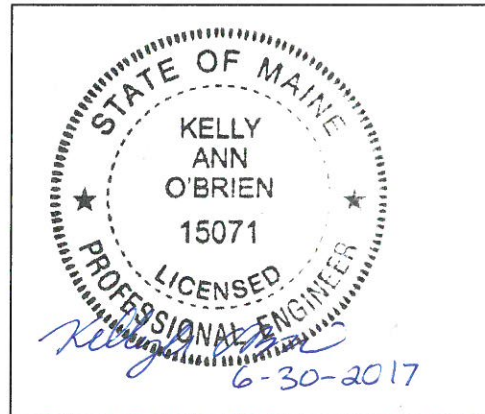

Kelly O'Brien, P.E., Electrical Engineer

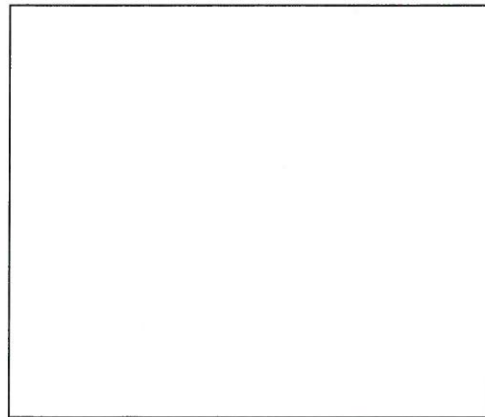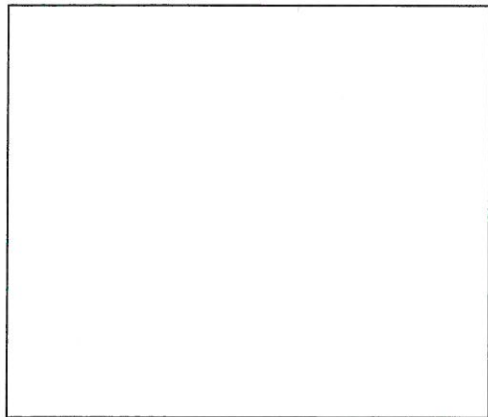





University of Maine

**USM PORTLAND**

**Woodbury Campus Center Bathroom Installation #2017-014**

**List of Drawings**

| <u>Sheet Number</u> | <u>Sheet Title</u>  |
|---------------------|---|
| G-001               | MAPS, LIST OF DRAWINGS, ABBREVIATIONS, LEGEND AND GENERAL NOTES |
| CS101               | SITE PLAN AND DETAILS   |
| AE001               | WALL TYPES, DETIALS AND MOUNTING HEIGHTS                        |
| AE101               | FLOOR PART PLANS AND INTERIOR ELEVATIONS                        |
| AE640               | FINISH SCHEDULE, DOOR SCHEUDLE AND DETAILS                      |
| M-001               | MECHANICAL LEGENDS, ABBREVIATIONS, SCHEDULES AND DETAILS        |
| MD101               | MECHANICAL REMOVALS PART PLANS                                  |
| M-101               | MECHANICAL AND SPRINKLER PART PLANS                             |
| P-001               | PLUMBING LEGENDS, ABBREVIATIONS, GENERAL NOTES AND DETAILS      |
| P-101               | PLUMBING PART PLANS   |
| E-001               | ELECTRICAL SYMBOLS, ABBREVIATIONS AND GENERAL NOTES             |
| E-101               | PARTIAL ELECTRICAL PLANS  |



**Notice to Contractors and Subcontractors**  
**Request for Bids**  
(Advertisement)

Sealed Bids in envelopes plainly marked for: **Woodbury Campus Center Bathroom Installation #2017-014**

addressed to:

**University of Southern Maine**  
c/o **David Carney**  
**Project Manager, Capital Planning**  
**25 Bedford Street, Portland, ME 04104**

Bids will be received until **2:00 PM, Wednesday, July 26, 2017**, at which time they will be opened and read aloud.

Sealed Bids may also be hand delivered to **25 Bedford Street, Portland, ME** on the **University of Southern Maine Portland** campus. Proposals received after the stated time will not be considered and will be returned unopened.

Proposals must be accompanied by a satisfactory Bid Bond, as prescribed in Section 00 43 13, for 5% of the Proposal (checks will not be accepted).

The University System reserves the right to waive all formalities and reject any and all proposals or to accept any proposal.

The successful bidder will be required to furnish a 100% Performance Bond and 100% Payment Bond to cover the execution of the contract which shall be in conformity with the form of Bonds contained in Sections 00 61 13.13 and 00 61 13.16 of the specifications and for the contract amount.

**Project Summary:** Provide labor, materials, equipment, supervision and services required to add a single-user toilet room by renovating an existing storage space. The new toilet room will include a water closet, lavatory, and a foot wash. The project includes architectural revisions to the existing space, new finishes, electrical work to support the renovation, and site work to connect to an existing sanitary line outside the building. The University of Southern Maine will be responsible for obtaining the required building permits. The scope of work shall include all associated work as indicated on the drawings and specs by Oak Point Associates. The Substantial Completion date for the project will be September 29, 2017.

**A MANDATORY pre-bid meeting and site walk-through will be held at 10:00 AM, Wednesday, July 12, 2017 at Woodbury Campus Center on the Portland Campus of the University of Southern Maine. Bidding contractors must attend to be considered and subcontractors are strongly encouraged to attend. No other tours will be given.**

Electronic copies of the Plans and Specifications may be obtained by prospective bidders on or about July 10, 2017 from:  
**David Carney, University of Southern Maine, david.carney@maine.edu.**

Contractors are responsible for acquiring the project plans and specifications from the above referenced designee. Any errors and/or omissions that result from obtaining plans and specs elsewhere may constitute grounds for a bid being considered non-responsive and rejected.

The documents may be examined at the following places:

AGC of Maine, 188 Whitten Road, Augusta ME 04332-5519, (207) 622-4741; [info@agcmaine.org](mailto:info@agcmaine.org)

McGraw-Hill Construction/Dodge, 224 Gorham Road, Scarborough, ME 04074, (207) 883-4856;

[Dodge.Docs@construction.com](mailto:Dodge.Docs@construction.com)

Construction Summary of NH, Maine & VT: [info@constructionsummary.com](mailto:info@constructionsummary.com) (800) 321-8856

University of Southern Maine Facilities Management, 25 Bedford St., Portland, ME (207) 780-4160

The University of Maine System in all its activities, subscribes and adheres to the provisions of the Civil Rights Act of 1964 as amended to date. General contractors, subcontractors, and product suppliers bidding on this project must subscribe and adhere to same. There shall be no discrimination in employment because of race, color, religion, sex, sexual orientation, including transgender status or gender expression, national origin or citizenship status, age, disability, genetic information, or veterans status in employment, education, and all other areas of the University.

**UNIVERSITY OF MAINE SYSTEM**

John Souther, Executive Director of facilities Management for  
The University of Maine System Board of Trustees



**NOTICE TO CONTRACTORS AND SUBCONTRACTORS  
REQUEST FOR BIDS  
(Advertisement)**

The University of **Southern Maine** is seeking bids for the following construction project:

**WOODBURY CAMPUS CENTER BATHROOM INSTALLATION #2017-014**

**Project Summary:** Provide labor, materials, equipment, supervision and services required to add a single-user toilet room by renovating an existing storage space. The new toilet room will include a water closet, lavatory, and a foot wash. The project includes architectural revisions to the existing space, new finishes, electrical work to support the renovation, and site work to connect to an existing sanitary line outside the building.

Bids will be received until **2:00 PM, Wednesday, July 26, 2017** at 25 Bedford St., Portland, ME at which time and place the Bids will be opened and read aloud.

**A Mandatory Pre-Bid meeting and site walk-through will be held at 10:00 AM on July 12, 2017 at Woodbury Campus Center, Portland, ME. Bidding contractors must attend to be considered and subcontractors are strongly encouraged to attend.**

Additional information may be obtained at:

<http://usm.maine.edu/facilities/current-projects>

UNIVERSITY OF MAINE SYSTEM

**John Souther,**  
for Board of Trustees



SECTION 00 21 13  
**Instructions to Bidders**

1. At the time of the opening of bids, each bidder will be presumed to have inspected the site and to have read and to be thoroughly familiar with the plans and contract documents, including all addenda. The failure or omission of any bidder to receive or examine any form, instrument, or document shall not relieve any bidder from any obligation in respect to the bid. The Owner reserves the right to accept or reject any or all bids as may best serve the interests of the University of Maine System.
2. Subject to the University System's right, reserved herein, to accept or reject any or all bids, the General Contractor will be selected on the basis of the sum of the lowest base bid, plus such of the alternates as the University System desires to use.
3. The University System is exempt from the payment of Federal Excise Taxes on articles not for resale and the Federal Transportation Tax on all shipments. The Contractor shall quote less these taxes. Upon application, exemption certificates will be furnished when required.
4. No proposal may be withdrawn during a period of thirty (30) calendar days immediately following the opening thereof.
5. No contract may be assigned, sublet or transferred without the written consent of the University of Maine System.
6. All individuals not residents of this State must comply with the provisions of 14 M.R.S.A. §704-A.
7. The successful bidder, or bidders, will be required to furnish 100% Contract Bonds to cover the execution of the contract, in accordance with Article 11 of the AIA Document A201 - 2007 of the General Conditions of the Contract for Construction and, the University Supplementary Conditions to the AIA General Conditions.
8. Contractors may be required to furnish a statement of their business experience, record of accomplishments, and financial responsibility, at the discretion of the University System.
9. The base bid shall be based on the materials, methods, equipment and products, as specified.
10. The Bidder shall submit his/her bid on the University provided Bid Form (00 41 13).
11. Any materials, methods, equipment and products not herein specified, but worthy of consideration by any General or Subcontractor, may be introduced by a separate letter attached to the regular bid. The Bidder shall state the cost comparison with the specified materials, methods, equipment and products, and the reason for the suggested substitution. It shall be understood by all bidders that the attached letter proposing substitutions shall not be used to determine the low bidder and that all bids are based on specified products.
12. Telegraphic or facsimile proposals will not be considered, but modification of proposals already submitted will be considered if received prior to the hour set for receipt of proposals. If the telegram or facsimile discloses the amount of the proposal, the proposal will be declared invalid. The bidder bears full responsibility to assure that the correction is delivered to the proper location and within the time required.
13. Where a bidder wishes a product to be considered an "approved equal" for bidding purposes, the product, along with all supporting documentation, shall be submitted to the architect for review a minimum of 10 calendar days prior to the bid opening date or the file bid due date, if file bids are required on the project. Products which are determined to be an "approved equal" for bidding purposes shall be listed in an addendum issued so as to be received by bidders no less than 72 hours prior to the bid date or the file bid due date if file bids are required.
14. Where the Proposal Form requires the tabulation of subcontractors other than "File Bidders," the Bidder shall list the name of the firm the bidder intends to use in the event the bidder receives the contract award.
15. Bidders may appeal the award decision by submitting a written protest to the University of Maine System Director of Facilities & General Services within five (5) business days of the date of the award notice (Notice of Award) with a copy of the protest to the successful bidder. The protest must contain a statement of the basis for the challenge.





**Bid Form**

BIDDER:

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

University of Maine, **UNIVERSITY OF SOUTHERN MAINE**  
c/o **David Carney**  
**Project Manager, Capital Planning**  
**P. O. Box 9300, 25 Bedford Street, Portland, ME 04104-9300**

Having carefully examined the form of contract, general conditions and plans and specifications contained therein for the **Woodbury Campus Center Bathroom Installation #2017-014**, as well as the premises and conditions affecting the work, we the undersigned propose to furnish all labor, equipment and materials necessary for and reasonably incidental to the construction and completion of this contract for the sum of \_\_\_\_\_ Dollars  
(\$ \_\_\_\_\_)

This proposal includes the cost of 100% Performance Bond plus 100% Payment Bond.

The receipt of the following addenda to plans and specifications is hereby acknowledged:

ADDENDUM # \_\_\_\_\_ DATED \_\_\_\_\_      ADDENDUM # \_\_\_\_\_ DATED \_\_\_\_\_

Any material or materials not specified in the bidding document but worthy of consideration may be introduced by the bidder by a separate letter attached to this Proposal. A cost comparison must be included giving the comparison with the Material specified and reason for suggested substitution. The basic bid shall be as specified.

The undersigned agrees, if this bid is accepted, to sign a contract and deliver it, along with the bonds and affidavits for all insurance specified within twelve (12) calendar days after the date of notification of such acceptance, except if the 12<sup>th</sup> day falls on a Saturday, Sunday or holiday, then the conditions will be fulfilled if the required documents are received before 12 o'clock noon on the day following the holiday, or the Monday following the Saturday or Sunday, and as a guarantee thereof, herewith submits a bid bond as required.

The undersigned agrees, if awarded the Contract, to complete the work on or before **September 29, 2017.** The undersigned also agrees, if awarded the Contract, that no more than 80% of contract amount will be sublet to other contractors.

Signed \_\_\_\_\_ Date \_\_\_\_\_

By \_\_\_\_\_

Address \_\_\_\_\_

NOTE: If bidder is a corporation, write State of Incorporation, and if partnership, give full names of all partners.



**Bid Security Form**

KNOW ALL BY THESE PRESENTS, THAT WE, the undersigned, as PRINCIPAL \_\_\_\_\_ and \_\_\_\_\_ as SURETY, are hereby held and firmly bound unto the Treasurer of the UNIVERSITY OF MAINE SYSTEM in the penal sum of \_\_\_\_\_ for the payment of which, well and truly to be made, we hereby jointly and severally bind ourselves, our heirs, executors, administrators, successors and assigns, signed this \_\_\_\_\_ day of \_\_\_\_\_, 20\_\_.

The condition of the above obligation is such that whereas the Principal has submitted to \_\_\_\_\_ a certain proposal, attached hereto and hereby made a part hereof, to enter into a contract in writing for the \_\_\_\_\_.

NOW THEREFORE,

- (a) If said proposal shall be rejected, or, in the alternate
- (b) If said proposal shall be accepted and the Principal shall execute and deliver a contract in the form of contract attached hereto (properly completed in accordance with said proposal) and shall furnish a bond for faithful performance of said contract, and for the payment of all persons performing labor or furnishing material in connection therewith, and shall in all other respects perform the agreement created by the acceptance of said proposal, then this obligation shall be void, otherwise the same shall remain in force and effect: It being expressly understood and agreed that the liability of the surety for any and all claims hereunder shall, in no event, exceed the penal amount of this obligation as herein stated.

The Surety, for value received, hereby stipulates and agrees that the obligation of said Surety and its bond shall be in no way impaired or affected by any extension of the time within which the principal may accept such proposal, further said Surety does hereby waive notice of any such extension.

In the event suit is brought upon this bond by the Treasurer of the UNIVERSITY OF MAINE SYSTEM, Surety shall pay reasonable attorneys' fees and costs incurred by the Treasurer of the UNIVERSITY OF MAINE SYSTEM in such suit.

IN WITNESS WHEREOF, the Principal and Surety have hereunto set their hands and seals, and such of them as are corporations have caused their corporate seals to be hereto affixed and these presents to be signed by their proper officers, the day and year first set above.

\_\_\_\_\_  
PRINCIPAL

By:

\_\_\_\_\_  
L.S.

\_\_\_\_\_  
SURETY

\_\_\_\_\_  
SURETY ADDRESS

By:

\_\_\_\_\_  
L.S.



**UNIVERSITY OF MAINE SYSTEM**

**Construction Contract Agreement**

THIS AGREEMENT is made and entered into the \_\_\_\_ day of \_\_\_\_\_ 20\_\_\_\_, by and between the Contractor \* Contractor and Address \* and the University of Maine System acting by and through the University of \* Campus and Address \*.

WITNESSETH: That the Owner and the Contractor for the considerations hereinafter named agree as follows:

ARTICLE 1. SCOPE OF THE WORK

The Contractor shall furnish all of the materials and perform all of the work described in the Contract Documents entitled \_\_\_\_\_, prepared \_\_\_\_\_, acting as and in these Contract Documents entitled the Architect and/or Engineer.

ARTICLE 2: START AND TIME OF COMPLETION

The date of the commencement of work shall be the date of this Agreement or the following date \_\_\_\_\_ and shall be substantially completed on or before \_\_\_\_\_ subject to adjustments as provided in the Contract Documents.

The Contractor and the Contractor’s surety, if any, shall be liable for and shall pay the Owner the following stipulated liquidated damages for each calendar day of delay after the date established for Substantial Completion until the Work is substantially complete: \_\_\_\_\_ Dollars \$\_\_\_\_\_ per calendar day.

ARTICLE 3: THE CONTRACT SUM

The Owner shall pay the Contractor for the performance of the Contract as follows \_\_\_\_\_ Dollars \$\_\_\_\_\_ subject to adjustments as provided in the Contract Documents

The Contract Sum is based upon the following alternatives and Unit Prices, if any, which are described in the Contract Documents and are hereby accepted by the Owner:

|                     |                     |                     |
|---------------------|---------------------|---------------------|
| Alternate (1) _____ | Alternate (2) _____ | Alternate (3) _____ |
| Unit Prices         |                     |                     |
| Item _____          | Price _____         |                     |
| Item _____          | Price _____         |                     |

Final payment shall be made after completion and acceptance of the work as provided in the Contract Documents.

ARTICLE 4: THE CONTRACT DOCUMENTS

The Contract Documents for this project, except for modifications issued after execution of this agreement, consist of:

- .1 This agreement.
- .2 AIA Document A201-2007, General Conditions of the Contract for Construction, as modified by University of Maine System 00 73 00.01 Supplementary Conditions to A201-2007.

- .3 The Specifications as outlined in the Project Manual (Name and date).
- .4 The Drawings as listed in the Project Manual.
- .5 The Addenda (List the addenda and dates issued).
- .6 Other documents if any (List any other documents that are intended to be part of the Contract)

ARTICLE 5: OWNER'S REPRESENTATIVES

The Owner's Representative on this project will be \_\_\_\_\_, who is authorized to sign contracts and other legal documents related to this project on behalf of the Owner.

The Owner's Project Manager on this project will be \_\_\_\_\_.

The Owner and the Contractor hereby agree to the full performance of the covenants herein.

IN WITNESS WHEREOF, the parties hereto have executed this Agreement in triplicate on the day and year first above written.

UNIVERSITY OF MAINE SYSTEM

\_\_\_\_\_

Company

\_\_\_\_\_

Company

By: \_\_\_\_\_

Signature Authority Name

Signature Authorities Title

University of Maine \* Location \*

By: \_\_\_\_\_

Title

\_\_\_\_\_

Witness

\_\_\_\_\_

Witness

**Performance Bond Form**

Bond No. \_\_\_\_\_

KNOW ALL BY THESE PRESENTS THAT (1)\_\_\_\_\_ (2)\_\_\_\_\_ of (3) \_\_\_\_\_ and State of \_\_\_\_\_, as PRINCIPAL, and (4) \_\_\_\_\_, a corporation duly organized under the laws of the State of \_\_\_\_\_ and having a usual place of business in \_\_\_\_\_, as SURETY, are held and firmly bound unto the University of Maine System in the sum of \_\_\_\_\_ Dollars (\$\_\_\_\_\_), to be paid said Treasurer of the University of Maine System, or successor in office, for which payment well and truly to be made, Principal and Surety bind themselves, their heirs, executors and administrators, successors and assigns, jointly and severally by these presents.

The condition of this obligation is such that if the Principal shall promptly and faithfully perform the Contract entered into on the (5)\_\_\_\_\_ day of \_\_\_\_\_, A.D., 20\_\_\_\_\_ for the construction of (6)\_\_\_\_\_ then this obligation shall be null and void; otherwise, it shall remain in full force and effect.

The Surety hereby waives notice of any alteration or extension of time made by the University of Maine System.

Signed and sealed this (5)\_\_\_\_\_ day of \_\_\_\_\_, 20\_\_\_\_\_.

WITNESSES:

SIGNATURES:

LS

LS

LS

Bonding Company Agent:

Company:

Street:

City, State, Zip:

Telephone:

- (1.) Correct name of Contractor
- (2.) A corporation, a partnership, or an individual, as the case may be.
- (3.) Contractor's address with City name
- (4.) Correct name of Surety
- (5.) Same date as that of contract.
- (6.) Name of Project as designated in contract.

If Contractor is partnership, all partners should execute bond. A Power of Attorney document, together with a statement that it still is in effect shall be provided by the person executing this bond. Bond must be countersigned by a Resident Maine Agent.

**\*\*DO NOT ALTER LANGUAGE\*\***





**Payment Bond Form**

Bond No. \_\_\_\_\_

KNOW ALL BY THESE PRESENTS THAT (1)\_\_\_\_\_ (2)\_\_\_\_\_ of \_\_\_\_\_ and State of \_\_\_\_\_, as Principal, and (3)\_\_\_\_\_, a corporation duly organized under the laws of the State of \_\_\_\_\_, and having a usual place of business in \_\_\_\_\_, as Surety, are held and firmly bound unto the University of Maine System in the sum of \_\_\_\_\_ Dollars (\$\_\_\_\_\_) for the use and benefit of claimants\* as herein below defined, for the payment whereof Principal and Surety bind themselves, their heirs, executors and administrators, successors and assigns, jointly and severally by these presents.

The condition of this obligation is such that if the Principal shall promptly satisfy all claims and demands incurred for all labor and materials, used or required by the Principal in connection with the work contemplated in the Contract entered into on the (4)\_\_\_\_\_ day of \_\_\_\_\_, A.D., 20\_\_\_\_\_, for the construction of (5)\_\_\_\_\_, and shall fully reimburse the obligee for all outlay and expense which said obligee may incur in making good any default of said principal, then this obligation shall be null and void; otherwise, it shall remain in full force and effect.

\*A Claimant is defined as one having a direct contract with the Principal or with a subcontractor of the Principal for labor, material, or both, used or reasonably required for use in the performance of the contract.

Signed and sealed this (6)\_\_\_\_\_ day of \_\_\_\_\_, 20\_\_\_\_\_.

WITNESS:

SIGNATURES”

|       |    |    |       |
|-------|----|----|-------|
| _____ | By | LS | _____ |
| _____ | By | LS | _____ |
| _____ | By | LS | _____ |

Bonding Company Agent:

Company: \_\_\_\_\_

Street: \_\_\_\_\_

City, State, Zip: \_\_\_\_\_

Telephone: \_\_\_\_\_

- (1.) Correct name of Contractor
- (2.) A corporation, a partnership, or an individual, as the case may be.
- (3.) Correct name of Surety
- (4.) Same date as that of contract.
- (5.) Name of Project as designated in contract.
- (6.) Same date as that of Contract.

If contractor is partnership, all partners should execute bond.

A Power of Attorney document, together with a statement that it still is in effect shall be provided by the person executing this bond.

Bond must be countersigned by a Resident Maine Agent.

**\*\*DO NOT ALTER LANGUAGE\*\***




**AIA® Document G715™ – 1991**
**Supplemental Attachment for ACORD Certificate of Insurance 25-S**
*(This document replaces AIA Document G705, Certificate of Insurance.)*
**PROJECT** (Name and address):

**INSURED** UNIVERSITY OF MAINE SYSTEM  
 16 Central Street, Bangor, ME 04401

|   | Yes                      | No                       | N/A                      |
|---|--------------------------|--------------------------|--------------------------|
| <b>A. General Liability</b>   |                          |                          |                          |
| 1. Does the General Aggregate apply to this Project only?   | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 2. Does this policy include coverage for:   |                          |                          |                          |
| a. Premises - Operations?   | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| b. Explosion, Collapse and Underground Hazards?   | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| c. Personal Injury Coverage?  | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| d. Products Coverage?   | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| e. Completed Operations?  | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| f. Contractual Coverage for the Insured's obligations in A201?  | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 3. If coverage is written on a claims-made basis, what is the:  |                          |                          |                          |
| a. Retroactive Date?  |                          |                          |                          |
| b. Extended Reporting Date?   |                          |                          |                          |
| <b>B. Worker's Compensation</b>   |                          |                          |                          |
| 1. If the Insured is exempt from Worker's Compensation statutes, does the Insured carry the equivalent Voluntary Compensation coverage?   | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| <b>C. Final Payment Information</b>   |                          |                          |                          |
| 1. Is this certificate being furnished in connection with the Contractor's request for final payment in accordance with the requirements of Sections 9.10.2 and 11.1.3 of AIA Document A201, General Conditions of the Contract for Construction? | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 2. If so, and if the policy period extends beyond termination of the Contract for Construction, is Completed Operations coverage for this Project continued for the balance of the policy period?   | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| <b>D. Termination Provisions</b>  |                          |                          |                          |
| 1. Has each policy shown on the certificate and this Supplement been endorsed to provide the holder with 30 days notice of cancellation and/or expiration? List below any policies which do not contain this notice.                              | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| <b>E. Other Provisions</b>  |                          |                          |                          |

 \_\_\_\_\_  
 Authorized Representative

 \_\_\_\_\_  
 Date of Issue



# ACORD™ CERTIFICATE OF LIABILITY INSURANCE

DATE (MM/DD/YY)

|                                    |   |
|------------------------------------|---|
| PRODUCER                           | THIS CERTIFICATE IS ISSUED AS A MATTER OF INFORMATION ONLY AND CONFERS NO RIGHTS UPON THE CERTIFICATE HOLDER. THIS CERTIFICATE DOES NOT AMEND, EXTEND OR ALTER THE COVERAGE AFFORDED BY THE POLICIES BELOW. |
| <b>INSURERS AFFORDING COVERAGE</b> |   |
| INSURED                            | INSURER A:  |
|                                    | INSURER B:  |
|                                    | INSURER C:  |
|                                    | INSURER D:  |
|                                    | INSURER E:  |

**COVERAGES**

THE POLICIES OF INSURANCE LISTED BELOW HAVE BEEN ISSUED TO THE INSURED NAMED ABOVE FOR THE POLICY PERIOD INDICATED. NOTWITHSTANDING ANY REQUIREMENT, TERM OR CONDITION OF ANY CONTRACT OR OTHER DOCUMENT WITH RESPECT TO WHICH THIS CERTIFICATE MAY BE ISSUED OR MAY PERTAIN, THE INSURANCE AFFORDED BY THE POLICIES DESCRIBED HEREIN IS SUBJECT TO ALL THE TERMS, EXCLUSIONS AND CONDITIONS OF SUCH POLICIES. AGGREGATE LIMITS SHOWN MAY HAVE BEEN REDUCED BY PAID CLAIMS.

| INSR LTR | TYPE OF INSURANCE  | POLICY NUMBER | POLICY EFFECTIVE DATE (MM/DD/YY) | POLICY EXPIRATION DATE (MM/DD/YY) | LIMITS   |  |                      |        |  |  |  |  |                    |  |  |  |    |  |                            |  |  |  |    |  |                             |  |  |  |    |
|----------|--|---------------|----------------------------------|-----------------------------------|--|--|----------------------|--------|--|--|--|--|--------------------|--|--|--|----|--|----------------------------|--|--|--|----|--|-----------------------------|--|--|--|----|
|          | <b>GENERAL LIABILITY</b><br><input type="checkbox"/> COMMERCIAL GENERAL LIABILITY<br><input type="checkbox"/> CLAIMS MADE <input type="checkbox"/> OCCUR<br><hr/> GEN'L AGGREGATE LIMIT APPLIES PER:<br><input type="checkbox"/> POLICY <input type="checkbox"/> PRO-JECT <input type="checkbox"/> LOC |               |                                  |                                   | EACH OCCURRENCE \$<br>FIRE DAMAGE (Any one fire) \$<br>MED EXP (Any one person) \$<br>PERSONAL & ADV INJURY \$<br>GENERAL AGGREGATE \$<br>PRODUCTS - COMP/OP AGG \$  |  |                      |        |  |  |  |  |                    |  |  |  |    |  |                            |  |  |  |    |  |                             |  |  |  |    |
|          | <b>AUTOMOBILE LIABILITY</b><br><input type="checkbox"/> ANY AUTO<br><input type="checkbox"/> ALL OWNED AUTOS<br><input type="checkbox"/> SCHEDULED AUTOS<br><input type="checkbox"/> HIRED AUTOS<br><input type="checkbox"/> NON-OWNED AUTOS   |               |                                  |                                   | COMBINED SINGLE LIMIT (Ea accident) \$<br>BODILY INJURY (Per person) \$<br>BODILY INJURY (Per accident) \$<br>PROPERTY DAMAGE (Per accident) \$  |  |                      |        |  |  |  |  |                    |  |  |  |    |  |                            |  |  |  |    |  |                             |  |  |  |    |
|          | <b>GARAGE LIABILITY</b><br><input type="checkbox"/> ANY AUTO   |               |                                  |                                   | AUTO ONLY - EA ACCIDENT \$<br>OTHER THAN EA ACC \$<br>AUTO ONLY: AGG \$  |  |                      |        |  |  |  |  |                    |  |  |  |    |  |                            |  |  |  |    |  |                             |  |  |  |    |
|          | <b>EXCESS LIABILITY</b><br><input type="checkbox"/> OCCUR <input type="checkbox"/> CLAIMS MADE<br><hr/> DEDUCTIBLE<br>RETENTION \$   |               |                                  |                                   | EACH OCCURRENCE \$<br>AGGREGATE \$<br>\$<br>\$<br>\$   |  |                      |        |  |  |  |  |                    |  |  |  |    |  |                            |  |  |  |    |  |                             |  |  |  |    |
|          | <b>WORKERS COMPENSATION AND EMPLOYERS' LIABILITY</b>   |               |                                  |                                   | <table style="width:100%; border-collapse: collapse;"> <tr> <td style="width:10%; border: none;"></td> <td style="width:10%; border: none;">WC STATU-TORY LIMITS</td> <td style="width:10%; border: none;">OTH-ER</td> <td style="width:10%; border: none;"></td> <td style="width:10%; border: none;"></td> <td style="width:10%; border: none;"></td> </tr> <tr> <td style="border: none;"></td> <td style="border: none;">E.L. EACH ACCIDENT</td> <td style="border: none;"></td> <td style="border: none;"></td> <td style="border: none;"></td> <td style="border: none;">\$</td> </tr> <tr> <td style="border: none;"></td> <td style="border: none;">E.L. DISEASE - EA EMPLOYEE</td> <td style="border: none;"></td> <td style="border: none;"></td> <td style="border: none;"></td> <td style="border: none;">\$</td> </tr> <tr> <td style="border: none;"></td> <td style="border: none;">E.L. DISEASE - POLICY LIMIT</td> <td style="border: none;"></td> <td style="border: none;"></td> <td style="border: none;"></td> <td style="border: none;">\$</td> </tr> </table> |  | WC STATU-TORY LIMITS | OTH-ER |  |  |  |  | E.L. EACH ACCIDENT |  |  |  | \$ |  | E.L. DISEASE - EA EMPLOYEE |  |  |  | \$ |  | E.L. DISEASE - POLICY LIMIT |  |  |  | \$ |
|          | WC STATU-TORY LIMITS   | OTH-ER        |                                  |                                   |  |  |                      |        |  |  |  |  |                    |  |  |  |    |  |                            |  |  |  |    |  |                             |  |  |  |    |
|          | E.L. EACH ACCIDENT   |               |                                  |                                   | \$   |  |                      |        |  |  |  |  |                    |  |  |  |    |  |                            |  |  |  |    |  |                             |  |  |  |    |
|          | E.L. DISEASE - EA EMPLOYEE   |               |                                  |                                   | \$   |  |                      |        |  |  |  |  |                    |  |  |  |    |  |                            |  |  |  |    |  |                             |  |  |  |    |
|          | E.L. DISEASE - POLICY LIMIT  |               |                                  |                                   | \$   |  |                      |        |  |  |  |  |                    |  |  |  |    |  |                            |  |  |  |    |  |                             |  |  |  |    |
|          | <b>OTHER</b>   |               |                                  |                                   |  |  |                      |        |  |  |  |  |                    |  |  |  |    |  |                            |  |  |  |    |  |                             |  |  |  |    |

DESCRIPTION OF OPERATIONS/LOCATIONS/VEHICLES/EXCLUSIONS ADDED BY ENDORSEMENT/SPECIAL PROVISIONS

|                           |   |  |
|---------------------------|---|--|
| <b>CERTIFICATE HOLDER</b> | ADDITIONAL INSURED; INSURER LETTER: _____ | <b>CANCELLATION</b>  |
|                           |   | SHOULD ANY OF THE ABOVE DESCRIBED POLICIES BE CANCELLED BEFORE THE EXPIRATION DATE THEREOF, THE ISSUING INSURER WILL ENDEAVOR TO MAIL _____ DAYS WRITTEN NOTICE TO THE CERTIFICATE HOLDER NAMED TO THE LEFT, BUT FAILURE TO DO SO SHALL IMPOSE NO OBLIGATION OR LIABILITY OF ANY KIND UPON THE INSURER, ITS AGENTS OR REPRESENTATIVES. |
|                           |   | AUTHORIZED REPRESENTATIVE  |

## **IMPORTANT**

If the certificate holder is an ADDITIONAL INSURED, the policy(ies) must be endorsed. A statement on this certificate does not confer rights to the certificate holder in lieu of such endorsement(s).

If SUBROGATION IS WAIVED, subject to the terms and conditions of the policy, certain policies may require an endorsement. A statement on this certificate does not confer rights to the certificate holder in lieu of such endorsement(s).

## **DISCLAIMER**

The Certificate of Insurance on the reverse side of this form does not constitute a contract between the issuing insurer(s), authorized representative or producer, and the certificate holder, nor does it affirmatively or negatively amend, extend or alter the coverage afforded by the policies listed thereon.

Sample

# COMMERCIAL GENERAL LIABILITY COVERAGE FORM

Various provisions in this policy restrict coverage. Read the entire policy carefully to determine rights, duties and what is and is not covered.

Throughout this policy the words "you" and "your" refer to the Named Insured shown in the Declarations, and any other person or organization qualifying as a Named Insured under this policy. The words "we", "us" and "our" refer to the company providing this insurance.

The word "insured" means any person or organization qualifying as such under Section II – Who Is An Insured.

Other words and phrases that appear in quotation marks have special meaning. Refer to Section V – Definitions.

## SECTION I – COVERAGES

### COVERAGE A BODILY INJURY AND PROPERTY DAMAGE LIABILITY

#### 1. Insuring Agreement

a. We will pay those sums that the insured becomes legally obligated to pay as damages because of "bodily injury" or "property damage" to which this insurance applies. We will have the right and duty to defend the insured against any "suit" seeking those damages. However, we will have no duty to defend the insured against any "suit" seeking damages for "bodily injury" or "property damage" to which this insurance does not apply. We may, at our discretion, investigate any "occurrence" and settle any claim or "suit" that may result. But:

- (1) The amount we will pay for damages is limited as described in Section III – Limits Of Insurance; and
- (2) Our right and duty to defend ends when we have used up the applicable limit of insurance in the payment of judgments or settlements under Coverages A or B or medical expenses under Coverage C.

No other obligation or liability to pay sums or perform acts or services is covered unless explicitly provided for under Supplementary Payments – Coverages A and B.

b. This insurance applies to "bodily injury" and "property damage" only if:

- (1) The "bodily injury" or "property damage" is caused by an "occurrence" that takes place in the "coverage territory";
- (2) The "bodily injury" or "property damage" occurs during the policy period; and
- (3) Prior to the policy period, no insured listed under Paragraph 1. of Section II – Who Is An Insured and no "employee" authorized by you to give or receive notice of an "occurrence" or claim, knew that the "bodily injury" or "property damage" had occurred, in whole or in part. If such a listed insured or authorized "employee" knew, prior to the policy period, that the "bodily injury" or "property damage" occurred, then any continuation, change or resumption of such "bodily injury" or "property damage" during or after the policy period will be deemed to have been known prior to the policy period.

c. "Bodily injury" or "property damage" which occurs during the policy period and was not, prior to the policy period, known to have occurred by any insured listed under Paragraph 1. of Section II – Who Is An Insured or any "employee" authorized by you to give or receive notice of an "occurrence" or claim, includes any continuation, change or resumption of that "bodily injury" or "property damage" after the end of the policy period.

d. "Bodily injury" or "property damage" will be deemed to have been known to have occurred at the earliest time when any insured listed under Paragraph 1. of Section II – Who Is An Insured or any "employee" authorized by you to give or receive notice of an "occurrence" or claim:

- (1) Reports all, or any part, of the "bodily injury" or "property damage" to us or any other insurer;
- (2) Receives a written or verbal demand or claim for damages because of the "bodily injury" or "property damage"; or
- (3) Becomes aware by any other means that "bodily injury" or "property damage" has occurred or has begun to occur.

- e. Damages because of "bodily injury" include damages claimed by any person or organization for care, loss of services or death resulting at any time from the "bodily injury".

## 2. Exclusions

This insurance does not apply to:

### a. Expected Or Intended Injury

"Bodily injury" or "property damage" expected or intended from the standpoint of the insured. This exclusion does not apply to "bodily injury" resulting from the use of reasonable force to protect persons or property.

### b. Contractual Liability

"Bodily injury" or "property damage" for which the insured is obligated to pay damages by reason of the assumption of liability in a contract or agreement. This exclusion does not apply to liability for damages:

- (1) That the insured would have in the absence of the contract or agreement; or
- (2) Assumed in a contract or agreement that is an "insured contract", provided the "bodily injury" or "property damage" occurs subsequent to the execution of the contract or agreement. Solely for the purposes of liability assumed in an "insured contract", reasonable attorney fees and necessary litigation expenses incurred by or for a party other than an insured are deemed to be damages because of "bodily injury" or "property damage", provided:
  - (a) Liability to such party for, or for the cost of, that party's defense has also been assumed in the same "insured contract"; and
  - (b) Such attorney fees and litigation expenses are for defense of that party against a civil or alternative dispute resolution proceeding in which damages to which this insurance applies are alleged.

### c. Liquor Liability

"Bodily injury" or "property damage" for which any insured may be held liable by reason of:

- (1) Causing or contributing to the intoxication of any person;
- (2) The furnishing of alcoholic beverages to a person under the legal drinking age or under the influence of alcohol; or
- (3) Any statute, ordinance or regulation relating to the sale, gift, distribution or use of alcoholic beverages.

This exclusion applies only if you are in the business of manufacturing, distributing, selling, serving or furnishing alcoholic beverages.

### d. Workers' Compensation And Similar Laws

Any obligation of the insured under a workers' compensation, disability benefits or unemployment compensation law or any similar law.

### e. Employer's Liability

"Bodily injury" to:

- (1) An "employee" of the insured arising out of and in the course of:
  - (a) Employment by the insured; or
  - (b) Performing duties related to the conduct of the insured's business; or
- (2) The spouse, child, parent, brother or sister of that "employee" as a consequence of Paragraph (1) above.

This exclusion applies:

- (1) Whether the insured may be liable as an employer or in any other capacity; and
- (2) To any obligation to share damages with or repay someone else who must pay damages because of the injury.

This exclusion does not apply to liability assumed by the insured under an "insured contract".



**f. Pollution**

- (1) "Bodily injury" or "property damage" arising out of the actual, alleged or threatened discharge, dispersal, seepage, migration, release or escape of "pollutants":
- (a) At or from any premises, site or location which is or was at any time owned or occupied by, or rented or loaned to, any insured. However, this subparagraph does not apply to:
    - (i) "Bodily injury" if sustained within a building and caused by smoke, fumes, vapor or soot produced by or originating from equipment that is used to heat, cool or dehumidify the building, or equipment that is used to heat water for personal use, by the building's occupants or their guests;
    - (ii) "Bodily injury" or "property damage" for which you may be held liable, if you are a contractor and the owner or lessee of such premises, site or location has been added to your policy as an additional insured with respect to your ongoing operations performed for that additional insured at that premises, site or location and such premises, site or location is not and never was owned or occupied by, or rented or loaned to, any insured, other than that additional insured; or
    - (iii) "Bodily injury" or "property damage" arising out of heat, smoke or fumes from a "hostile fire";
  - (b) At or from any premises, site or location which is or was at any time used by or for any insured or others for the handling, storage, disposal, processing or treatment of waste;
  - (c) Which are or were at any time transported, handled, stored, treated, disposed of, or processed as waste by or for:
    - (i) Any insured; or
    - (ii) Any person or organization for whom you may be legally responsible; or
  - (d) At or from any premises, site or location on which any insured or any contractors or subcontractors working directly or indirectly on any insured's behalf are performing operations if the "pollutants" are brought on or to the premises, site or location in connection with such operations by such insured, contractor or subcontractor. However, this subparagraph does not apply to:
    - (i) "Bodily injury" or "property damage" arising out of the escape of fuels, lubricants or other operating fluids which are needed to perform the normal electrical, hydraulic or mechanical functions necessary for the operation of "mobile equipment" or its parts, if such fuels, lubricants or other operating fluids escape from a vehicle part designed to hold, store or receive them. This exception does not apply if the "bodily injury" or "property damage" arises out of the intentional discharge, dispersal or release of the fuels, lubricants or other operating fluids, or if such fuels, lubricants or other operating fluids are brought on or to the premises, site or location with the intent that they be discharged, dispersed or released as part of the operations being performed by such insured, contractor or subcontractor;
    - (ii) "Bodily injury" or "property damage" sustained within a building and caused by the release of gases, fumes or vapors from materials brought into that building in connection with operations being performed by you or on your behalf by a contractor or subcontractor; or
    - (iii) "Bodily injury" or "property damage" arising out of heat, smoke or fumes from a "hostile fire".
  - (e) At or from any premises, site or location on which any insured or any contractors or subcontractors working directly or indirectly on any insured's behalf are performing operations if the operations are to test for, monitor, clean up, remove, contain, treat, detoxify or neutralize, or in any way respond to, or assess the effects of, "pollutants".

**(2)** Any loss, cost or expense arising out of any:

- (a)** Request, demand, order or statutory or regulatory requirement that any insured or others test for, monitor, clean up, remove, contain, treat, detoxify or neutralize, or in any way respond to, or assess the effects of, "pollutants"; or
- (b)** Claim or "suit" by or on behalf of a governmental authority for damages because of testing for, monitoring, cleaning up, removing, containing, treating, detoxifying or neutralizing, or in any way responding to, or assessing the effects of, "pollutants".

However, this paragraph does not apply to liability for damages because of "property damage" that the insured would have in the absence of such request, demand, order or statutory or regulatory requirement, or such claim or "suit" by or on behalf of a governmental authority.

**g. Aircraft, Auto Or Watercraft**

"Bodily injury" or "property damage" arising out of the ownership, maintenance, use or entrustment to others of any aircraft, "auto" or watercraft owned or operated by or rented or loaned to any insured. Use includes operation and "loading or unloading".

This exclusion applies even if the claims against any insured allege negligence or other wrongdoing in the supervision, hiring, employment, training or monitoring of others by that insured, if the "occurrence" which caused the "bodily injury" or "property damage" involved the ownership, maintenance, use or entrustment to others of any aircraft, "auto" or watercraft that is owned or operated by or rented or loaned to any insured.

This exclusion does not apply to:

- (1)** A watercraft while ashore on premises you own or rent;
- (2)** A watercraft you do not own that is:
  - (a)** Less than 26 feet long; and
  - (b)** Not being used to carry persons or property for a charge;
- (3)** Parking an "auto" on, or on the ways next to, premises you own or rent, provided the "auto" is not owned by or rented or loaned to you or the insured;
- (4)** Liability assumed under any "insured contract" for the ownership, maintenance or use of aircraft or watercraft; or

**(5)** "Bodily injury" or "property damage" arising out of:

- (a)** The operation of machinery or equipment that is attached to, or part of, a land vehicle that would qualify under the definition of "mobile equipment" if it were not subject to a compulsory or financial responsibility law or other motor vehicle insurance law in the state where it is licensed or principally garaged; or
- (b)** the operation of any of the machinery or equipment listed in Paragraph **f.(2)** or **f.(3)** of the definition of "mobile equipment".

**h. Mobile Equipment**

"Bodily injury" or "property damage" arising out of:

- (1)** The transportation of "mobile equipment" by an "auto" owned or operated by or rented or loaned to any insured; or
- (2)** The use of "mobile equipment" in, or while in practice for, or while being prepared for, any prearranged racing, speed, demolition, or stunting activity.

**i. War**

"Bodily injury" or "property damage", however caused, arising, directly or indirectly, out of:

- (1)** War, including undeclared or civil war;
- (2)** Warlike action by a military force, including action in hindering or defending against an actual or expected attack, by any government, sovereign or other authority using military personnel or other agents; or
- (3)** Insurrection, rebellion, revolution, usurped power, or action taken by governmental authority in hindering or defending against any of these.

**j. Damage To Property**

"Property damage" to:

- (1)** Property you own, rent, or occupy, including any costs or expenses incurred by you, or any other person, organization or entity, for repair, replacement, enhancement, restoration or maintenance of such property for any reason, including prevention of injury to a person or damage to another's property;
- (2)** Premises you sell, give away or abandon, if the "property damage" arises out of any part of those premises;
- (3)** Property loaned to you;
- (4)** Personal property in the care, custody or control of the insured;

- (5) That particular part of real property on which you or any contractors or subcontractors working directly or indirectly on your behalf are performing operations, if the "property damage" arises out of those operations; or
- (6) That particular part of any property that must be restored, repaired or replaced because "your work" was incorrectly performed on it.

Paragraphs (1), (3) and (4) of this exclusion do not apply to "property damage" (other than damage by fire) to premises, including the contents of such premises, rented to you for a period of 7 or fewer consecutive days. A separate limit of insurance applies to Damage To Premises Rented To You as described in Section III – Limits Of Insurance.

Paragraph (2) of this exclusion does not apply if the premises are "your work" and were never occupied, rented or held for rental by you.

Paragraphs (3), (4), (5) and (6) of this exclusion do not apply to liability assumed under a side-track agreement.

Paragraph (6) of this exclusion does not apply to "property damage" included in the "products-completed operations hazard".

#### k. Damage To Your Product

"Property damage" to "your product" arising out of it or any part of it.

#### l. Damage To Your Work

"Property damage" to "your work" arising out of it or any part of it and included in the "products-completed operations hazard".

This exclusion does not apply if the damaged work or the work out of which the damage arises was performed on your behalf by a subcontractor.

#### m. Damage To Impaired Property Or Property Not Physically Injured

"Property damage" to "impaired property" or property that has not been physically injured, arising out of:

- (1) A defect, deficiency, inadequacy or dangerous condition in "your product" or "your work"; or
- (2) A delay or failure by you or anyone acting on your behalf to perform a contract or agreement in accordance with its terms.

This exclusion does not apply to the loss of use of other property arising out of sudden and accidental physical injury to "your product" or "your work" after it has been put to its intended use.

#### n. Recall Of Products, Work Or Impaired Property

Damages claimed for any loss, cost or expense incurred by you or others for the loss of use, withdrawal, recall, inspection, repair, replacement, adjustment, removal or disposal of:

- (1) "Your product";
- (2) "Your work"; or
- (3) "Impaired property";

if such product, work, or property is withdrawn or recalled from the market or from use by any person or organization because of a known or suspected defect, deficiency, inadequacy or dangerous condition in it.

#### o. Personal And Advertising Injury

"Bodily injury" arising out of "personal and advertising injury".

#### p. Electronic Data

Damages arising out of the loss of, loss of use of, damage to, corruption of, inability to access, or inability to manipulate electronic data.

As used in this exclusion, electronic data means information, facts or programs stored as or on, created or used on, or transmitted to or from computer software, including systems and applications software, hard or floppy disks, CD-ROMS, tapes, drives, cells, data processing devices or any other media which are used with electronically controlled equipment.

Exclusions c. through n. do not apply to damage by fire to premises while rented to you or temporarily occupied by you with permission of the owner. A separate limit of insurance applies to this coverage as described in Section III – Limits Of Insurance.

### COVERAGE B PERSONAL AND ADVERTISING INJURY LIABILITY

#### 1. Insuring Agreement

- a. We will pay those sums that the insured becomes legally obligated to pay as damages because of "personal and advertising injury" to which this insurance applies. We will have the right and duty to defend the insured against any "suit" seeking those damages. However, we will have no duty to defend the insured against any "suit" seeking damages for "personal and advertising injury" to which this insurance does not apply. We may, at our discretion, investigate any offense and settle any claim or "suit" that may result. But:

- (1) The amount we will pay for damages is limited as described in Section III – Limits Of Insurance; and

- (2) Our right and duty to defend end when we have used up the applicable limit of insurance in the payment of judgments or settlements under Coverages **A** or **B** or medical expenses under Coverage **C**.

No other obligation or liability to pay sums or perform acts or services is covered unless explicitly provided for under Supplementary Payments – Coverages **A** and **B**.

- b. This insurance applies to "personal and advertising injury" caused by an offense arising out of your business but only if the offense was committed in the "coverage territory" during the policy period.

## 2. Exclusions

This insurance does not apply to:

### a. Knowing Violation Of Rights Of Another

"Personal and advertising injury" caused by or at the direction of the insured with the knowledge that the act would violate the rights of another and would inflict "personal and advertising injury".

### b. Material Published With Knowledge Of Falsity

"Personal and advertising injury" arising out of oral or written publication of material, if done by or at the direction of the insured with knowledge of its falsity.

### c. Material Published Prior To Policy Period

"Personal and advertising injury" arising out of oral or written publication of material whose first publication took place before the beginning of the policy period.

### d. Criminal Acts

"Personal and advertising injury" arising out of a criminal act committed by or at the direction of the insured.

### e. Contractual Liability

"Personal and advertising injury" for which the insured has assumed liability in a contract or agreement. This exclusion does not apply to liability for damages that the insured would have in the absence of the contract or agreement.

### f. Breach Of Contract

"Personal and advertising injury" arising out of a breach of contract, except an implied contract to use another's advertising idea in your "advertisement".

### g. Quality Or Performance Of Goods – Failure To Conform To Statements

"Personal and advertising injury" arising out of the failure of goods, products or services to conform with any statement of quality or performance made in your "advertisement".

### h. Wrong Description Of Prices

"Personal and advertising injury" arising out of the wrong description of the price of goods, products or services stated in your "advertisement".

### i. Infringement Of Copyright, Patent, Trademark Or Trade Secret

"Personal and advertising injury" arising out of the infringement of copyright, patent, trademark, trade secret or other intellectual property rights.

However, this exclusion does not apply to infringement, in your "advertisement", of copyright, trade dress or slogan.

### j. Insureds In Media And Internet Type Businesses

"Personal and advertising injury" committed by an insured whose business is:

- (1) Advertising, broadcasting, publishing or telecasting;
- (2) Designing or determining content of websites for others; or
- (3) An Internet search, access, content or service provider.

However, this exclusion does not apply to Paragraphs **14.a.**, **b.** and **c.** of "personal and advertising injury" under the Definitions Section.

For the purposes of this exclusion, the placing of frames, borders or links, or advertising, for you or others anywhere on the Internet, is not by itself, considered the business of advertising, broadcasting, publishing or telecasting.

### k. Electronic Chatrooms Or Bulletin Boards

"Personal and advertising injury" arising out of an electronic chatroom or bulletin board the insured hosts, owns, or over which the insured exercises control.

### l. Unauthorized Use Of Another's Name Or Product

"Personal and advertising injury" arising out of the unauthorized use of another's name or product in your e-mail address, domain name or metatag, or any other similar tactics to mislead another's potential customers.

**m. Pollution**

"Personal and advertising injury" arising out of the actual, alleged or threatened discharge, dispersal, seepage, migration, release or escape of "pollutants" at any time.

**n. Pollution-Related**

Any loss, cost or expense arising out of any:

- (1) Request, demand, order or statutory or regulatory requirement that any insured or others test for, monitor, clean up, remove, contain, treat, detoxify or neutralize, or in any way respond to, or assess the effects of, "pollutants"; or
- (2) Claim or suit by or on behalf of a governmental authority for damages because of testing for, monitoring, cleaning up, removing, containing, treating, detoxifying or neutralizing, or in any way responding to, or assessing the effects of, "pollutants".

**o. War**

"Personal and advertising injury", however caused, arising, directly or indirectly, out of:

- (1) War, including undeclared or civil war;
- (2) Warlike action by a military force, including action in hindering or defending against an actual or expected attack, by any government, sovereign or other authority using military personnel or other agents; or
- (3) Insurrection, rebellion, revolution, usurped power, or action taken by governmental authority in hindering or defending against any of these.

**COVERAGE C MEDICAL PAYMENTS****1. Insuring Agreement**

- a. We will pay medical expenses as described below for "bodily injury" caused by an accident:

- (1) On premises you own or rent;
- (2) On ways next to premises you own or rent; or
- (3) Because of your operations; provided that:
  - (1) The accident takes place in the "coverage territory" and during the policy period;
  - (2) The expenses are incurred and reported to us within one year of the date of the accident; and
  - (3) The injured person submits to examination, at our expense, by physicians of our choice as often as we reasonably require.

- b. We will make these payments regardless of fault. These payments will not exceed the applicable limit of insurance. We will pay reasonable expenses for:

- (1) First aid administered at the time of an accident;
- (2) Necessary medical, surgical, x-ray and dental services, including prosthetic devices; and
- (3) Necessary ambulance, hospital, professional nursing and funeral services.

**2. Exclusions**

We will not pay expenses for "bodily injury":

**a. Any Insured**

To any insured, except "volunteer workers".

**b. Hired Person**

To a person hired to do work for or on behalf of any insured or a tenant of any insured.

**c. Injury On Normally Occupied Premises**

To a person injured on that part of premises you own or rent that the person normally occupies.

**d. Workers Compensation And Similar Laws**

To a person, whether or not an "employee" of any insured, if benefits for the "bodily injury" are payable or must be provided under a workers' compensation or disability benefits law or a similar law.

**e. Athletics Activities**

To a person injured while practicing, instructing or participating in any physical exercises or games, sports, or athletic contests.

**f. Products-Completed Operations Hazard**

Included within the "products-completed operations hazard".

**g. Coverage A Exclusions**

Excluded under Coverage A.

**SUPPLEMENTARY PAYMENTS – COVERAGES A AND B**

1. We will pay, with respect to any claim we investigate or settle, or any "suit" against an insured we defend:
  - a. All expenses we incur.
  - b. Up to \$250 for cost of bail bonds required because of accidents or traffic law violations arising out of the use of any vehicle to which the Bodily Injury Liability Coverage applies. We do not have to furnish these bonds.

- c. The cost of bonds to release attachments, but only for bond amounts within the applicable limit of insurance. We do not have to furnish these bonds.
- d. All reasonable expenses incurred by the insured at our request to assist us in the investigation or defense of the claim or "suit", including actual loss of earnings up to \$250 a day because of time off from work.
- e. All costs taxed against the insured in the "suit".
- f. Prejudgment interest awarded against the insured on that part of the judgment we pay. If we make an offer to pay the applicable limit of insurance, we will not pay any prejudgment interest based on that period of time after the offer.
- g. All interest on the full amount of any judgment that accrues after entry of the judgment and before we have paid, offered to pay, or deposited in court the part of the judgment that is within the applicable limit of insurance.

These payments will not reduce the limits of insurance.

- 2. If we defend an insured against a "suit" and an indemnitee of the insured is also named as a party to the "suit", we will defend that indemnitee if all of the following conditions are met:
  - a. The "suit" against the indemnitee seeks damages for which the insured has assumed the liability of the indemnitee in a contract or agreement that is an "insured contract";
  - b. This insurance applies to such liability assumed by the insured;
  - c. The obligation to defend, or the cost of the defense of, that indemnitee, has also been assumed by the insured in the same "insured contract";
  - d. The allegations in the "suit" and the information we know about the "occurrence" are such that no conflict appears to exist between the interests of the insured and the interests of the indemnitee;
  - e. The indemnitee and the insured ask us to conduct and control the defense of that indemnitee against such "suit" and agree that we can assign the same counsel to defend the insured and the indemnitee; and
  - f. The indemnitee:
    - (1) Agrees in writing to:
      - (a) Cooperate with us in the investigation, settlement or defense of the "suit";

- (b) Immediately send us copies of any demands, notices, summonses or legal papers received in connection with the "suit";
  - (c) Notify any other insurer whose coverage is available to the indemnitee; and
  - (d) Cooperate with us with respect to coordinating other applicable insurance available to the indemnitee; and
- (2) Provides us with written authorization to:
    - (a) Obtain records and other information related to the "suit"; and
    - (b) Conduct and control the defense of the indemnitee in such "suit".

So long as the above conditions are met, attorneys' fees incurred by us in the defense of that indemnitee, necessary litigation expenses incurred by us and necessary litigation expenses incurred by the indemnitee at our request will be paid as Supplementary Payments. Notwithstanding the provisions of Paragraph **2.b.(2)** of Section I – Coverage A – Bodily Injury And Property Damage Liability, such payments will not be deemed to be damages for "bodily injury" and "property damage" and will not reduce the limits of insurance.

Our obligation to defend an insured's indemnitee and to pay for attorneys' fees and necessary litigation expenses as Supplementary Payments ends when:

- a. We have used up the applicable limit of insurance in the payment of judgments or settlements; or
- b. The conditions set forth above, or the terms of the agreement described in Paragraph f. above, are no longer met.

## SECTION II – WHO IS AN INSURED

- 1. If you are designated in the Declarations as:
  - a. An individual, you and your spouse are insureds, but only with respect to the conduct of a business of which you are the sole owner.
  - b. A partnership or joint venture, you are an insured. Your members, your partners, and their spouses are also insureds, but only with respect to the conduct of your business.
  - c. A limited liability company, you are an insured. Your members are also insureds, but only with respect to the conduct of your business. Your managers are insureds, but only with respect to their duties as your managers.

- d. An organization other than a partnership, joint venture or limited liability company, you are an insured. Your "executive officers" and directors are insureds, but only with respect to their duties as your officers or directors. Your stockholders are also insureds, but only with respect to their liability as stockholders.
  - e. A trust, you are an insured. Your trustees are also insureds, but only with respect to their duties as trustees.
2. Each of the following is also an insured:
- a. Your "volunteer workers" only while performing duties related to the conduct of your business, or your "employees", other than either your "executive officers" (if you are an organization other than a partnership, joint venture or limited liability company) or your managers (if you are a limited liability company), but only for acts within the scope of their employment by you or while performing duties related to the conduct of your business. However, none of these "employees" or "volunteer workers" are insureds for:
    - (1) "Bodily injury" or "personal and advertising injury":
      - (a) To you, to your partners or members (if you are a partnership or joint venture), to your members (if you are a limited liability company), to a co-"employee" while in the course of his or her employment or performing duties related to the conduct of your business, or to your other "volunteer workers" while performing duties related to the conduct of your business;
      - (b) To the spouse, child, parent, brother or sister of that co-"employee" or "volunteer worker" as a consequence of Paragraph (1)(a) above;
      - (c) For which there is any obligation to share damages with or repay someone else who must pay damages because of the injury described in Paragraphs (1)(a) or (b) above; or
      - (d) Arising out of his or her providing or failing to provide professional health care services.
    - (2) "Property damage" to property:
      - (a) Owned, occupied or used by,
        - (b) Rented to, in the care, custody or control of, or over which physical control is being exercised for any purpose by you, any of your "employees", "volunteer workers", any partner or member (if you are a partnership or joint venture), or any member (if you are a limited liability company).
      - b. Any person (other than your "employee" or "volunteer worker"), or any organization while acting as your real estate manager.
      - c. Any person or organization having proper temporary custody of your property if you die, but only:
        - (1) With respect to liability arising out of the maintenance or use of that property; and
        - (2) Until your legal representative has been appointed.
      - d. Your legal representative if you die, but only with respect to duties as such. That representative will have all your rights and duties under this Coverage Part.
  - 3. Any organization you newly acquire or form, other than a partnership, joint venture or limited liability company, and over which you maintain ownership or majority interest, will qualify as a Named Insured if there is no other similar insurance available to that organization. However:
    - a. Coverage under this provision is afforded only until the 90th day after you acquire or form the organization or the end of the policy period, whichever is earlier;
    - b. Coverage **A** does not apply to "bodily injury" or "property damage" that occurred before you acquired or formed the organization; and
    - c. Coverage **B** does not apply to "personal and advertising injury" arising out of an offense committed before you acquired or formed the organization.
- No person or organization is an insured with respect to the conduct of any current or past partnership, joint venture or limited liability company that is not shown as a Named Insured in the Declarations.

### SECTION III – LIMITS OF INSURANCE

- 1. The Limits of Insurance shown in the Declarations and the rules below fix the most we will pay regardless of the number of:
  - a. Insureds;
  - b. Claims made or "suits" brought; or
  - c. Persons or organizations making claims or bringing "suits".

2. The General Aggregate Limit is the most we will pay for the sum of:
  - a. Medical expenses under Coverage **C**;
  - b. Damages under Coverage **A**, except damages because of "bodily injury" or "property damage" included in the "products-completed operations hazard"; and
  - c. Damages under Coverage **B**.
3. The Products-Completed Operations Aggregate Limit is the most we will pay under Coverage **A** for damages because of "bodily injury" and "property damage" included in the "products-completed operations hazard".
4. Subject to 2. above, the Personal and Advertising Injury Limit is the most we will pay under Coverage **B** for the sum of all damages because of all "personal and advertising injury" sustained by any one person or organization.
5. Subject to 2. or 3. above, whichever applies, the Each Occurrence Limit is the most we will pay for the sum of:
  - a. Damages under Coverage **A**; and
  - b. Medical expenses under Coverage **C** because of all "bodily injury" and "property damage" arising out of any one "occurrence".
6. Subject to 5. above, the Damage To Premises Rented To You Limit is the most we will pay under Coverage **A** for damages because of "property damage" to any one premises, while rented to you, or in the case of damage by fire, while rented to you or temporarily occupied by you with permission of the owner.
7. Subject to 5. above, the Medical Expense Limit is the most we will pay under Coverage **C** for all medical expenses because of "bodily injury" sustained by any one person.

The Limits of Insurance of this Coverage Part apply separately to each consecutive annual period and to any remaining period of less than 12 months, starting with the beginning of the policy period shown in the Declarations, unless the policy period is extended after issuance for an additional period of less than 12 months. In that case, the additional period will be deemed part of the last preceding period for purposes of determining the Limits of Insurance.

#### **SECTION IV – COMMERCIAL GENERAL LIABILITY CONDITIONS**

##### **1. Bankruptcy**

Bankruptcy or insolvency of the insured or of the insured's estate will not relieve us of our obligations under this Coverage Part.

##### **2. Duties In The Event Of Occurrence, Offense, Claim Or Suit**

- a. You must see to it that we are notified as soon as practicable of an "occurrence" or an offense which may result in a claim. To the extent possible, notice should include:
  - (1) How, when and where the "occurrence" or offense took place;
  - (2) The names and addresses of any injured persons and witnesses; and
  - (3) The nature and location of any injury or damage arising out of the "occurrence" or offense.
- b. If a claim is made or "suit" is brought against any insured, you must:
  - (1) Immediately record the specifics of the claim or "suit" and the date received; and
  - (2) Notify us as soon as practicable.

You must see to it that we receive written notice of the claim or "suit" as soon as practicable.
- c. You and any other involved insured must:
  - (1) Immediately send us copies of any demands, notices, summonses or legal papers received in connection with the claim or "suit";
  - (2) Authorize us to obtain records and other information;
  - (3) Cooperate with us in the investigation or settlement of the claim or defense against the "suit"; and
  - (4) Assist us, upon our request, in the enforcement of any right against any person or organization which may be liable to the insured because of injury or damage to which this insurance may also apply.
- d. No insured will, except at that insured's own cost, voluntarily make a payment, assume any obligation, or incur any expense, other than for first aid, without our consent.

##### **3. Legal Action Against Us**

No person or organization has a right under this Coverage Part:

- a. To join us as a party or otherwise bring us into a "suit" asking for damages from an insured; or



- b.** To sue us on this Coverage Part unless all of its terms have been fully complied with.

A person or organization may sue us to recover on an agreed settlement or on a final judgment against an insured; but we will not be liable for damages that are not payable under the terms of this Coverage Part or that are in excess of the applicable limit of insurance. An agreed settlement means a settlement and release of liability signed by us, the insured and the claimant or the claimant's legal representative.

#### 4. Other Insurance

If other valid and collectible insurance is available to the insured for a loss we cover under Coverages **A** or **B** of this Coverage Part, our obligations are limited as follows:

##### a. Primary Insurance

This insurance is primary except when **b.** below applies. If this insurance is primary, our obligations are not affected unless any of the other insurance is also primary. Then, we will share with all that other insurance by the method described in **c.** below.

##### b. Excess Insurance

This insurance is excess over:

- (1) Any of the other insurance, whether primary, excess, contingent or on any other basis:
  - (a) That is Fire, Extended Coverage, Builder's Risk, Installation Risk or similar coverage for "your work";
  - (b) That is Fire insurance for premises rented to you or temporarily occupied by you with permission of the owner;
  - (c) That is insurance purchased by you to cover your liability as a tenant for "property damage" to premises rented to you or temporarily occupied by you with permission of the owner; or
  - (d) If the loss arises out of the maintenance or use of aircraft, "autos" or watercraft to the extent not subject to Exclusion **g.** of Section **I** – Coverage **A** – Bodily Injury And Property Damage Liability.
- (2) Any other primary insurance available to you covering liability for damages arising out of the premises or operations, or the products and completed operations, for which you have been added as an additional insured by attachment of an endorsement.

When this insurance is excess, we will have no duty under Coverages **A** or **B** to defend the insured against any "suit" if any other insurer has a duty to defend the insured against that "suit". If no other insurer defends, we will undertake to do so, but we will be entitled to the insured's rights against all those other insurers.

When this insurance is excess over other insurance, we will pay only our share of the amount of the loss, if any, that exceeds the sum of:

- (1) The total amount that all such other insurance would pay for the loss in the absence of this insurance; and
- (2) The total of all deductible and self-insured amounts under all that other insurance.

We will share the remaining loss, if any, with any other insurance that is not described in this Excess Insurance provision and was not bought specifically to apply in excess of the Limits of Insurance shown in the Declarations of this Coverage Part.

##### c. Method Of Sharing

If all of the other insurance permits contribution by equal shares, we will follow this method also. Under this approach each insurer contributes equal amounts until it has paid its applicable limit of insurance or none of the loss remains, whichever comes first.

If any of the other insurance does not permit contribution by equal shares, we will contribute by limits. Under this method, each insurer's share is based on the ratio of its applicable limit of insurance to the total applicable limits of insurance of all insurers.

#### 5. Premium Audit

- a. We will compute all premiums for this Coverage Part in accordance with our rules and rates.
- b. Premium shown in this Coverage Part as advance premium is a deposit premium only. At the close of each audit period we will compute the earned premium for that period and send notice to the first Named Insured. The due date for audit and retrospective premiums is the date shown as the due date on the bill. If the sum of the advance and audit premiums paid for the policy period is greater than the earned premium, we will return the excess to the first Named Insured.
- c. The first Named Insured must keep records of the information we need for premium computation, and send us copies at such times as we may request.

## 6. Representations

By accepting this policy, you agree:

- a. The statements in the Declarations are accurate and complete;
- b. Those statements are based upon representations you made to us; and
- c. We have issued this policy in reliance upon your representations.

## 7. Separation Of Insureds

Except with respect to the Limits of Insurance, and any rights or duties specifically assigned in this Coverage Part to the first Named Insured, this insurance applies:

- a. As if each Named Insured were the only Named Insured; and
- b. Separately to each insured against whom claim is made or "suit" is brought.

## 8. Transfer Of Rights Of Recovery Against Others To Us

If the insured has rights to recover all or part of any payment we have made under this Coverage Part, those rights are transferred to us. The insured must do nothing after loss to impair them. At our request, the insured will bring "suit" or transfer those rights to us and help us enforce them.

## 9. When We Do Not Renew

If we decide not to renew this Coverage Part, we will mail or deliver to the first Named Insured shown in the Declarations written notice of the non-renewal not less than 30 days before the expiration date.

If notice is mailed, proof of mailing will be sufficient proof of notice.

## SECTION V – DEFINITIONS

1. "Advertisement" means a notice that is broadcast or published to the general public or specific market segments about your goods, products or services for the purpose of attracting customers or supporters. For the purposes of this definition:
  - a. Notices that are published include material placed on the Internet or on similar electronic means of communication; and
  - b. Regarding web-sites, only that part of a web-site that is about your goods, products or services for the purposes of attracting customers or supporters is considered an advertisement.
2. "Auto" means:
  - a. A land motor vehicle, trailer or semitrailer designed for travel on public roads, including any attached machinery or equipment; or

- b. Any other land vehicle that is subject to a compulsory or financial responsibility law or other motor vehicle insurance law in the state where it is licensed or principally garaged.

However, "auto" does not include "mobile equipment".

3. "Bodily injury" means bodily injury, sickness or disease sustained by a person, including death resulting from any of these at any time.
4. "Coverage territory" means:
  - a. The United States of America (including its territories and possessions), Puerto Rico and Canada;
  - b. International waters or airspace, but only if the injury or damage occurs in the course of travel or transportation between any places included in a. above; or
  - c. All other parts of the world if the injury or damage arises out of:
    - (1) Goods or products made or sold by you in the territory described in a. above;
    - (2) The activities of a person whose home is in the territory described in a. above, but is away for a short time on your business; or
    - (3) "Personal and advertising injury" offenses that take place through the Internet or similar electronic means of communication provided the insured's responsibility to pay damages is determined in a "suit" on the merits, in the territory described in a. above or in a settlement we agree to.
5. "Employee" includes a "leased worker". "Employee" does not include a "temporary worker".
6. "Executive officer" means a person holding any of the officer positions created by your charter, constitution, by-laws or any other similar governing document.
7. "Hostile fire" means one which becomes uncontrollable or breaks out from where it was intended to be.
8. "Impaired property" means tangible property, other than "your product" or "your work", that cannot be used or is less useful because:
  - a. It incorporates "your product" or "your work" that is known or thought to be defective, deficient, inadequate or dangerous; or
  - b. You have failed to fulfill the terms of a contract or agreement;
 if such property can be restored to use by:
  - a. The repair, replacement, adjustment or removal of "your product" or "your work"; or

- b. Your fulfilling the terms of the contract or agreement.
9. "Insured contract" means:
- a. A contract for a lease of premises. However, that portion of the contract for a lease of premises that indemnifies any person or organization for damage by fire to premises while rented to you or temporarily occupied by you with permission of the owner is not an "insured contract";
  - b. A sidetrack agreement;
  - c. Any easement or license agreement, except in connection with construction or demolition operations on or within 50 feet of a railroad;
  - d. An obligation, as required by ordinance, to indemnify a municipality, except in connection with work for a municipality;
  - e. An elevator maintenance agreement;
  - f. That part of any other contract or agreement pertaining to your business (including an indemnification of a municipality in connection with work performed for a municipality) under which you assume the tort liability of another party to pay for "bodily injury" or "property damage" to a third person or organization. Tort liability means a liability that would be imposed by law in the absence of any contract or agreement.
- Paragraph f. does not include that part of any contract or agreement:
- (1) That indemnifies a railroad for "bodily injury" or "property damage" arising out of construction or demolition operations, within 50 feet of any railroad property and affecting any railroad bridge or trestle, tracks, roadbeds, tunnel, underpass or crossing;
  - (2) That indemnifies an architect, engineer or surveyor for injury or damage arising out of:
    - (a) Preparing, approving, or failing to prepare or approve, maps, shop drawings, opinions, reports, surveys, field orders, change orders or drawings and specifications; or
    - (b) Giving directions or instructions, or failing to give them, if that is the primary cause of the injury or damage; or
  - (3) Under which the insured, if an architect, engineer or surveyor, assumes liability for an injury or damage arising out of the insured's rendering or failure to render professional services, including those listed in (2) above and supervisory, inspection, architectural or engineering activities.
10. "Leased worker" means a person leased to you by a labor leasing firm under an agreement between you and the labor leasing firm, to perform duties related to the conduct of your business. "Leased worker" does not include a "temporary worker".
11. "Loading or unloading" means the handling of property:
- a. After it is moved from the place where it is accepted for movement into or onto an aircraft, watercraft or "auto";
  - b. While it is in or on an aircraft, watercraft or "auto"; or
  - c. While it is being moved from an aircraft, watercraft or "auto" to the place where it is finally delivered;
- but "loading or unloading" does not include the movement of property by means of a mechanical device, other than a hand truck, that is not attached to the aircraft, watercraft or "auto".
12. "Mobile equipment" means any of the following types of land vehicles, including any attached machinery or equipment:
- a. Bulldozers, farm machinery, forklifts and other vehicles designed for use principally off public roads;
  - b. Vehicles maintained for use solely on or next to premises you own or rent;
  - c. Vehicles that travel on crawler treads;
  - d. Vehicles, whether self-propelled or not, maintained primarily to provide mobility to permanently mounted:
    - (1) Power cranes, shovels, loaders, diggers or drills; or
    - (2) Road construction or resurfacing equipment such as graders, scrapers or rollers;
  - e. Vehicles not described in a., b., c. or d. above that are not self-propelled and are maintained primarily to provide mobility to permanently attached equipment of the following types:
    - (1) Air compressors, pumps and generators, including spraying, welding, building cleaning, geophysical exploration, lighting and well servicing equipment; or
    - (2) Cherry pickers and similar devices used to raise or lower workers;
  - f. Vehicles not described in a., b., c. or d. above maintained primarily for purposes other than the transportation of persons or cargo.
- However, self-propelled vehicles with the following types of permanently attached equipment are not "mobile equipment" but will be considered "autos":

- (1) Equipment designed primarily for:
  - (a) Snow removal;
  - (b) Road maintenance, but not construction or resurfacing; or
  - (c) Street cleaning;
- (2) Cherry pickers and similar devices mounted on automobile or truck chassis and used to raise or lower workers; and
- (3) Air compressors, pumps and generators, including spraying, welding, building cleaning, geophysical exploration, lighting and well servicing equipment.

However, "mobile equipment" does not include any land vehicles that are subject to a compulsory or financial responsibility law or other motor vehicle insurance law in the state where it is licensed or principally garaged. Land vehicles subject to a compulsory or financial responsibility law or other motor vehicle insurance law are considered "autos".

13. "Occurrence" means an accident, including continuous or repeated exposure to substantially the same general harmful conditions.
14. "Personal and advertising injury" means injury, including consequential "bodily injury", arising out of one or more of the following offenses:
  - a. False arrest, detention or imprisonment;
  - b. Malicious prosecution;
  - c. The wrongful eviction from, wrongful entry into, or invasion of the right of private occupancy of a room, dwelling or premises that a person occupies, committed by or on behalf of its owner, landlord or lessor;
  - d. Oral or written publication, in any manner, of material that slanders or libels a person or organization or disparages a person's or organization's goods, products or services;
  - e. Oral or written publication, in any manner, of material that violates a person's right of privacy;
  - f. The use of another's advertising idea in your "advertisement"; or
  - g. Infringing upon another's copyright, trade dress or slogan in your "advertisement".
15. "Pollutants" mean any solid, liquid, gaseous or thermal irritant or contaminant, including smoke, vapor, soot, fumes, acids, alkalis, chemicals and waste. Waste includes materials to be recycled, reconditioned or reclaimed.

16. "Products-completed operations hazard":

- a. Includes all "bodily injury" and "property damage" occurring away from premises you own or rent and arising out of "your product" or "your work" except:
  - (1) Products that are still in your physical possession; or
  - (2) Work that has not yet been completed or abandoned. However, "your work" will be deemed completed at the earliest of the following times:
    - (a) When all of the work called for in your contract has been completed.
    - (b) When all of the work to be done at the job site has been completed if your contract calls for work at more than one job site.
    - (c) When that part of the work done at a job site has been put to its intended use by any person or organization other than another contractor or subcontractor working on the same project.

Work that may need service, maintenance, correction, repair or replacement, but which is otherwise complete, will be treated as completed.

- b. Does not include "bodily injury" or "property damage" arising out of:
  - (1) The transportation of property, unless the injury or damage arises out of a condition in or on a vehicle not owned or operated by you, and that condition was created by the "loading or unloading" of that vehicle by any insured;
  - (2) The existence of tools, uninstalled equipment or abandoned or unused materials; or
  - (3) Products or operations for which the classification, listed in the Declarations or in a policy schedule, states that products-completed operations are subject to the General Aggregate Limit.

17. "Property damage" means:

- a. Physical injury to tangible property, including all resulting loss of use of that property. All such loss of use shall be deemed to occur at the time of the physical injury that caused it; or

- b.** Loss of use of tangible property that is not physically injured. All such loss of use shall be deemed to occur at the time of the "occurrence" that caused it.

For the purposes of this insurance, electronic data is not tangible property.

As used in this definition, electronic data means information, facts or programs stored as or on, created or used on, or transmitted to or from computer software, including systems and applications software, hard or floppy disks, CD-ROMS, tapes, drives, cells, data processing devices or any other media which are used with electronically controlled equipment.

- 18.** "Suit" means a civil proceeding in which damages because of "bodily injury", "property damage" or "personal and advertising injury" to which this insurance applies are alleged. "Suit" includes:
  - a.** An arbitration proceeding in which such damages are claimed and to which the insured must submit or does submit with our consent; or
  - b.** Any other alternative dispute resolution proceeding in which such damages are claimed and to which the insured submits with our consent.
- 19.** "Temporary worker" means a person who is furnished to you to substitute for a permanent "employee" on leave or to meet seasonal or short-term workload conditions.
- 20.** "Volunteer worker" means a person who is not your "employee", and who donates his or her work and acts at the direction of and within the scope of duties determined by you, and is not paid a fee, salary or other compensation by you or anyone else for their work performed for you.

**21.** "Your product":

**a.** Means:

- (1)** Any goods or products, other than real property, manufactured, sold, handled, distributed or disposed of by:
  - (a)** You;
  - (b)** Others trading under your name; or
  - (c)** A person or organization whose business or assets you have acquired; and
- (2)** Containers (other than vehicles), materials, parts or equipment furnished in connection with such goods or products.

**b.** Includes

- (1)** Warranties or representations made at any time with respect to the fitness, quality, durability, performance or use of "your product"; and
  - (2)** The providing of or failure to provide warnings or instructions.
- c.** Does not include vending machines or other property rented to or located for the use of others but not sold.

**22.** "Your work":

**a.** Means:

- (1)** Work or operations performed by you or on your behalf; and
- (2)** Materials, parts or equipment furnished in connection with such work or operations.

**b.** Includes

- (1)** Warranties or representations made at any time with respect to the fitness, quality, durability, performance or use of "your work", and
- (2)** The providing of or failure to provide warnings or instructions.



POLICY NUMBER:

COMMERCIAL GENERAL LIABILITY  
CG 20 10 07 04

THIS ENDORSEMENT CHANGES THE POLICY. PLEASE READ IT CAREFULLY.

**ADDITIONAL INSURED – OWNERS, LESSEES OR  
CONTRACTORS – SCHEDULED PERSON OR  
ORGANIZATION**

This endorsement modifies insurance provided under the following:

COMMERCIAL GENERAL LIABILITY COVERAGE PART

**SCHEDULE**

| Name Of Additional Insured Person(s)<br>Or Organization(s):   | Location(s) Of Covered Operations |
|---|-----------------------------------|
| <p>EXAMPLE</p>  |                                   |
| <p>Information required to complete this Schedule, if not shown above, will be shown in the Declarations.</p> |                                   |

**A. Section II – Who Is An Insured** is amended to include as an additional insured the person(s) or organization(s) shown in the Schedule, but only with respect to liability for "bodily injury", "property damage" or "personal and advertising injury" caused, in whole or in part, by:

1. Your acts or omissions; or
2. The acts or omissions of those acting on your behalf;

in the performance of your ongoing operations for the additional insured(s) at the location(s) designated above.

**B.** With respect to the insurance afforded to these additional insureds, the following additional exclusions apply:

This insurance does not apply to "bodily injury" or "property damage" occurring after:

1. All work, including materials, parts or equipment furnished in connection with such work, on the project (other than service, maintenance or repairs) to be performed by or on behalf of the additional insured(s) at the location of the covered operations has been completed; or
2. That portion of "your work" out of which the injury or damage arises has been put to its intended use by any person or organization other than another contractor or subcontractor engaged in performing operations for a principal as a part of the same project.





POLICY NUMBER:

COMMERCIAL GENERAL LIABILITY  
CG 20 37 07 04**THIS ENDORSEMENT CHANGES THE POLICY. PLEASE READ IT CAREFULLY.****ADDITIONAL INSURED – OWNERS, LESSEES OR  
CONTRACTORS – COMPLETED OPERATIONS**

This endorsement modifies insurance provided under the following:

COMMERCIAL GENERAL LIABILITY COVERAGE PART

**SCHEDULE**

| Name Of Additional Insured Person(s)<br>Or Organization(s):  | Location And Description Of Completed Operations |
|--|--|
|  |  |
| Information required to complete this Schedule, if not shown above, will be shown in the Declarations. |  |

**Section II – Who Is An Insured** is amended to include as an additional insured the person(s) or organization(s) shown in the Schedule, but only with respect to liability for "bodily injury" or "property damage" caused, in whole or in part, by "your work" at the location designated and described in the schedule of this endorsement performed for that additional insured and included in the "products-completed operations hazard".



POLICY NUMBER:

COMMERCIAL GENERAL LIABILITY  
CG 25 04 03 97

**THIS ENDORSEMENT CHANGES THE POLICY. PLEASE READ IT CAREFULLY.**

## **DESIGNATED LOCATION(S) GENERAL AGGREGATE LIMIT**

This endorsement modifies insurance provided under the following:

COMMERCIAL GENERAL LIABILITY COVERAGE PART

### **SCHEDULE**

|                                |
|--------------------------------|
| <b>Designated Location(s):</b> |
|                                |

(If no entry appears above, information required to complete this endorsement will be shown in the Declarations as applicable to this endorsement.)

- A.** For all sums which the insured becomes legally obligated to pay as damages caused by "occurrences" under **COVERAGE A (SECTION I)**, and for all medical expenses caused by accidents under **COVERAGE C (SECTION I)**, which can be attributed only to operations at a single designated "location" shown in the Schedule above:
1. A separate Designated Location General Aggregate Limit applies to each designated "location", and that limit is equal to the amount of the General Aggregate Limit shown in the Declarations.
  2. The Designated Location General Aggregate Limit is the most we will pay for the sum of all damages under **COVERAGE A**, except damages because of "bodily injury" or "property damage" included in the "products-completed operations hazard", and for medical expenses under **COVERAGE C** regardless of the number of:
    - a. Insureds;
    - b. Claims made or "suits" brought; or
    - c. Persons or organizations making claims or bringing "suits".
  3. Any payments made under **COVERAGE A** for damages or under **COVERAGE C** for medical expenses shall reduce the Designated Location General Aggregate Limit for that designated "location". Such payments shall not reduce the General Aggregate Limit shown in the Declarations nor shall they reduce any other Designated Location General Aggregate Limit for any other designated "location" shown in the Schedule above.
  4. The limits shown in the Declarations for Each Occurrence, Fire Damage and Medical Expense continue to apply. However, instead of being subject to the General Aggregate Limit shown in the Declarations, such limits will be subject to the applicable Designated Location General Aggregate Limit.

- B.** For all sums which the insured becomes legally obligated to pay as damages caused by "occurrences" under **COVERAGE A (SECTION I)**, and for all medical expenses caused by accidents under **COVERAGE C (SECTION I)**, which cannot be attributed only to operations at a single designated "location" shown in the Schedule above:
1. Any payments made under **COVERAGE A** for damages or under **COVERAGE C** for medical expenses shall reduce the amount available under the General Aggregate Limit or the Products-Completed Operations Aggregate Limit, whichever is applicable; and
  2. Such payments shall not reduce any Designated Location General Aggregate Limit.
- C.** When coverage for liability arising out of the "products-completed operations hazard" is provided, any payments for damages because of "bodily injury" or "property damage" included in the "products-completed operations hazard" will reduce the Products-Completed Operations Aggregate Limit, and not reduce the General Aggregate Limit nor the Designated Location General Aggregate Limit.
- D.** For the purposes of this endorsement, the **Definitions** Section is amended by the addition of the following definition:
- "Location" means premises involving the same or connecting lots, or premises whose connection is interrupted only by a street, roadway, waterway or right-of-way of a railroad.
- E.** The provisions of Limits Of Insurance (**SECTION III**) not otherwise modified by this endorsement shall continue to apply as stipulated.

Sample







# AIA® Document G702™ – 1992

## Application and Certificate for Payment

|  |  |                            |                         |
|--|--|----------------------------|-------------------------|
| <b>TO OWNER:</b> University of Maine System<br>16 Central Street, Bangor, ME<br>04401-5106 | <b>PROJECT:</b> University of Maine System Project | <b>APPLICATION NO:</b> 001 | <b>Distribution to:</b> |
|  |  | <b>PERIOD TO:</b>          | OWNER:                  |
| <b>FROM</b>  | <b>VIA</b>   | <b>CONTRACT FOR:</b>       | ARCHITECT:              |
| <b>CONTRACTOR:</b>   | <b>ARCHITECT:</b>                                  | <b>CONTRACT DATE:</b>      | CONTRACTOR:             |
|  |  | <b>PROJECT NOS: / /</b>    | FIELD:                  |
|  |  |                            | OTHER:                  |

### CONTRACTOR'S APPLICATION FOR PAYMENT

Application is made for payment, as shown below, in connection with the Contract. Continuation Sheet, AIA Document G703, is attached.

|  |    |      |
|--|----|------|
| 1. ORIGINAL CONTRACT SUM .....                                     | \$ | 0.00 |
| 2. NET CHANGE BY CHANGE ORDERS .....                               | \$ | 0.00 |
| 3. CONTRACT SUM TO DATE (Line 1 ± 2) .....                         | \$ | 0.00 |
| 4. TOTAL COMPLETED & STORED TO DATE (Column G on G703) .....       | \$ | 0.00 |
| 5. RETAINAGE:  |    |      |
| a. 0 % of Completed Work<br>(Column D + E on G703)                 | \$ | 0.00 |
| b. 0 % of Stored Material<br>(Column F on G703)                    | \$ | 0.00 |
| Total Retainage (Lines 5a + 5b or Total in Column I of G703) ..... | \$ | 0.00 |
| 6. TOTAL EARNED LESS RETAINAGE .....                               | \$ | 0.00 |
| (Line 4 Less Line 5 Total)   |    |      |
| 7. LESS PREVIOUS CERTIFICATES FOR PAYMENT .....                    | \$ | 0.00 |
| (Line 6 from prior Certificate)                                    |    |      |
| 8. CURRENT PAYMENT DUE .....                                       | \$ | 0.00 |
| 9. BALANCE TO FINISH, INCLUDING RETAINAGE .....                    | \$ | 0.00 |
| (Line 3 less Line 6)   |    |      |

| CHANGE ORDER SUMMARY                               | ADDITIONS | DEDUCTIONS |
|--|-----------|------------|
| Total changes approved in previous months by Owner | \$ 0.00   | \$ 0.00    |
| Total approved this Month                          | \$ 0.00   | \$ 0.00    |
| <b>TOTALS</b>                                      | \$ 0.00   | \$ 0.00    |
| NET CHANGES by Change Order                        | \$        | 0.00       |

The undersigned Contractor certifies that to the best of the Contractor's knowledge, information and belief the Work covered by this Application for Payment has been completed in accordance with the Contract Documents, that all amounts have been paid by the Contractor for Work for which previous Certificates for Payment were issued and payments received from the Owner, and that current payment shown herein is now due.

**CONTRACTOR:**

By: \_\_\_\_\_ Date: \_\_\_\_\_

State of: \_\_\_\_\_

County of: \_\_\_\_\_

Subscribed and sworn to before  
me this \_\_\_\_\_ day of \_\_\_\_\_

Notary Public:

My Commission expires: \_\_\_\_\_

### ARCHITECT'S CERTIFICATE FOR PAYMENT

In accordance with the Contract Documents, based on on-site observations and the data comprising this application, the Architect certifies to the Owner that to the best of the Architect's knowledge, information and belief the Work has progressed as indicated, the quality of the Work is in accordance with the Contract Documents, and the Contractor is entitled to payment of the AMOUNT CERTIFIED.

AMOUNT CERTIFIED ..... \$ 0.00

*(Attach explanation if amount certified differs from the amount applied. Initial all figures on this Application and on the Continuation Sheet that are changed to conform with the amount certified.)*

**ARCHITECT:**

By: \_\_\_\_\_ Date: \_\_\_\_\_

This Certificate is not negotiable. The AMOUNT CERTIFIED is payable only to the Contractor named herein. Issuance, payment and acceptance of payment are without prejudice to any rights of the Owner or Contractor under this Contract.





**Sales Tax Form**

Date \_\_\_\_\_

TO: \_\_\_\_\_  
Vendor Name

\_\_\_\_\_  
Vendor Address

\_\_\_\_\_  
Vendor City State Zip

I hereby certify under penalties of perjury, that:

I am engaged in the performance of a construction contract on a project for the University of Maine System which is a Sales Tax exempt organization under the Maine Sales and Use Tax Law, Section 1760, subsection 2 and 16;

This Project is titled: \_\_\_\_\_  
Project Title

This project is located at: \_\_\_\_\_  
Campus Name or Town

This certificate is issued to cover purchases of materials that will be permanently incorporated into the real property belonging to the exempt organization or government agency indicated above.

Signed: \_\_\_\_\_  
Authorized Signature

FIRM \_\_\_\_\_  
\_\_\_\_\_





# AIA<sup>®</sup> Document G707A<sup>™</sup> – 1994

## Consent of Surety to Reduction in or Partial Release of Retainage

**PROJECT:** *(Name and address)*  
University of Maine System  
Project

**ARCHITECT'S PROJECT NUMBER:**

OWNER:

ARCHITECT:

**CONTRACT FOR:**

CONTRACTOR:

**TO OWNER:** *(Name and address)*  
University of Maine System  
16 Central Street  
Bangor, ME 04401-5106

**CONTRACT DATED:**

SURETY:

OTHER:

In accordance with the provisions of the Contract between the Owner and the Contractor as indicated above, the  
*(Insert name and address of Surety)*

on bond of  
*(Insert name and address of Contractor)*

, SURETY,

hereby approves the reduction in or partial release of retainage to the Contractor as follows:

, CONTRACTOR,

The Surety agrees that such reduction in or partial release of retainage to the Contractor shall not relieve the Surety of any of its obligations to  
*(Insert name and address of Owner)*

as set forth in said Surety's bond.

, OWNER,

IN WITNESS WHEREOF, the Surety has hereunto set its hand on this date:  
*(Insert in writing the month followed by the numeric date and year.)*

\_\_\_\_\_  
*(Surety)*

\_\_\_\_\_  
*(Signature of authorized representative)*

Attest:  
(Seal):

\_\_\_\_\_  
*(Printed name and title)*



**STORED MATERIALS**

University of Maine \* Location \*  
 \* Campus Address \*

Project Title: \_\_\_\_\_  
 Location: \_\_\_\_\_  
 Contractor: \_\_\_\_\_

Materials and/or equipment (hereinafter "Materials") that have not yet been incorporated into the work may be delivered and suitably stored, at the site or some other location agreed upon by the Owner. The Materials listed below have been estimated at 100% of the cost and will be stored at \_\_\_\_\_. The Owner will reimburse the Contractor based upon the prices included on the Schedule of Values Form, 00 62 73(AIA G703), less the cost of installation. The Contractor must complete sufficient copies of this Stored Materials Form, 00 62 79, to accompany the Application for Payment. The Contractor shall secure the signature of its bonding company on all forms and shall also provide a Power of Attorney from the bonding company.

**SCHEDULE**

| Qty          | Material/Equipment | Item in AIA G703 |            | Unit Wholesale Price | Extended Wholesale Price |
|--------------|--------------------|------------------|------------|----------------------|--------------------------|
|              |                    | Item No          | Unit Price |                      |                          |
|              |                    |                  |            |                      |                          |
|              |                    |                  |            |                      |                          |
|              |                    |                  |            |                      |                          |
|              |                    |                  |            |                      |                          |
|              |                    |                  |            |                      |                          |
|              |                    |                  |            |                      |                          |
|              |                    |                  |            |                      |                          |
|              |                    |                  |            |                      |                          |
|              |                    |                  |            |                      |                          |
| <b>Total</b> |                    |                  |            |                      |                          |

Surety \_\_\_\_\_  
**Power of Attorney Must be Attached**

By: \_\_\_\_\_  
 Attorney-in-Fact

Date: \_\_\_\_\_

**BILL OF SALE**

The Contractor, \_\_\_\_\_, (will store/has stored) certain Materials (at the site of this project/at an approved warehouse/at bonded warehouse) and will be paid in accordance with the provisions of the General Conditions of the Contract for Construction. In consideration of the sum of \$\_\_\_\_\_ paid to the contractor by the Owner, and, in compliance with the provisions of the Contract, and, with the intention to be legally bound, the Contractor does hereby grant, bargain, sell and deliver unto the Owner, its successors and assigns, all and singular, the Materials described in the schedule above. The Contractor agrees that:

1. Contractor has good title to the Materials, free and clear of all liens and encumbrances, and title is granted to the Owner;
2. The Materials will be used only in the construction of the above referenced project, under the provisions of the Contract, and will not be diverted elsewhere without the prior written consent of the Owner;
3. The Materials have been delivered to and are at the places approved for storage, and they are clearly marked and identified as the property of the Owner and are stored in a safe and secure manner to protect from damage or loss;

4. The Contractor will pay all expenses in connection with the sale, delivery, storage, protection and insurance of Materials granted to the Owner.
5. The Contractor will remain responsible for the Materials, which will remain under its custody and control for all losses, and will fully indemnify the Owner for the cost of the Materials should the Materials be lost or damaged or stolen, regardless of exclusions in insurance policies required under this document. The contractor has insured the Materials against loss or damage by fire (with extended coverage), theft and burglary, with loss payable to the Owner;
6. The Contractor agrees that the quantities of Materials set forth in the Schedule of Values Form represents the maximum quantities for which it may be entitled to payment under the provisions of the contract;
7. The following information is included with this form:
  - (1) An Application for Payment;
  - (2) An invoice or copy of an invoice for Materials stored;
  - (3) Evidence of payment, or when payment has not been made, a letter on the Contractor's letterhead authorizing payment to be made jointly to the Contractor and the Supplier;
  - (4) Photographs showing the stored Materials and its location;
  - (5) a fire and theft insurance policy rider for the stored Materials.
  - (6) a warehouseman's receipt acknowledging that the Materials being stored at the warehouse are being held for the benefit of the Contractor or/or University.

Witness:

\_\_\_\_\_

By: \_\_\_\_\_ (SEAL)  
Principal/Contractor-Individual

Witness:

\_\_\_\_\_  
Principal/Contractor-Individual

\_\_\_\_\_

\_\_\_\_\_ (SEAL)

\_\_\_\_\_

\_\_\_\_\_ (SEAL)

\_\_\_\_\_

\_\_\_\_\_ (SEAL)

\_\_\_\_\_

\_\_\_\_\_ (SEAL)

Attest:

\_\_\_\_\_  
Principal/Contractor-Corporation

\_\_\_\_\_

Secretary

By: \_\_\_\_\_  
President

# AIA<sup>®</sup> Document G716™ – 2004

## **Request for Information (“RFI”)**

**TO:**

**FROM:**

**PROJECT:**

University of Maine System Project

**ISSUE DATE:**

**RFI No.** 001

**PROJECT NUMBERS:** /

**REQUESTED REPLY DATE:**

**COPIES TO:**

**RFI DESCRIPTION:** *(Fully describe the question or type of information requested.)*

**REFERENCES/ATTACHMENTS:** *(List specific documents researched when seeking the information requested.)*

**SPECIFICATIONS:**

**DRAWINGS:**

**OTHER:**

**SENDER’S RECOMMENDATION:** *(If RFI concerns a site or construction condition, the sender may provide a recommended solution, including cost and/or schedule considerations.)*

**RECEIVER’S REPLY:** *(Provide answer to RFI, including cost and/or schedule considerations.)*

**BY**

**DATE**

**COPIES TO**

**Note:** This reply is not an authorization to proceed with work involving additional cost, time or both. If any reply requires a change to the Contract Documents, a Change Order, Construction Change Directive or a Minor Change in the work must be executed in accordance with the Contract Documents.






**AIA Document G710™ – 1992**
**Architect's Supplemental Instructions**

**PROJECT** *(Name and address):*  
University of Maine System Project

**ARCHITECT'S SUPPLEMENTAL  
INSTRUCTION NO:**

OWNER:

ARCHITECT:

CONSULTANT:

CONTRACTOR:

FIELD:

OTHER:

**OWNER** *(Name and address):*  
University of Maine System  
16 Central Street  
Bangor, ME 04401-5106

**DATE OF ISSUANCE:**

**CONTRACT FOR:**

**FROM ARCHITECT** *(Name and  
address):*

**CONTRACT DATE:**

**TO CONTRACTOR** *(Name and  
address):*

**ARCHITECT'S PROJECT NUMBER:**

The Work shall be carried out in accordance with the following supplemental instructions issued in accordance with the Contract Documents without change in Contract Sum or Contract Time. Proceeding with the Work in accordance with these instructions indicates your acknowledgment that there will be no change in the Contract Sum or Contract Time.

**DESCRIPTION:**

**ATTACHMENTS:**

*(Here insert listing of documents that support description.)*

**ISSUED BY THE ARCHITECT:**

\_\_\_\_\_  
*(Signature)*

\_\_\_\_\_  
*(Printed name and title)*







# AIA<sup>®</sup> Document G709<sup>™</sup> – 2001

## **Work Changes Proposal Request**

**PROJECT** *(Name and address):*  
University of Maine  
System Project

**OWNER** *(Name and address):*

**FROM ARCHITECT** *(Name and address):*

**PROPOSAL REQUEST NUMBER:**

**DATE OF ISSUANCE:**

**CONTRACT FOR:**

**CONTRACT DATE:**

**ARCHITECT'S PROJECT NUMBER:**

OWNER:

ARCHITECT:

CONSULTANT:

CONTRACTOR:

FIELD:

OTHER:

**TO CONTRACTOR** *(Name and address):*

Please submit an itemized proposal for changes in the Contract Sum and Contract Time for proposed modifications to the Contract Documents described herein. Within ( ) days, the Contractor must submit this proposal or notify the Architect, in writing, of the date on which proposal submission is anticipated.

**THIS IS NOT A CHANGE ORDER, A CONSTRUCTION CHANGE DIRECTIVE OR A DIRECTION TO PROCEED WITH THE WORK DESCRIBED IN THE PROPOSED MODIFICATIONS.**

**DESCRIPTION** *(Insert a written description of the Work):*

**ATTACHMENTS** *(List attached documents that support description):*

**REQUESTED BY THE ARCHITECT:**

\_\_\_\_\_  
*(Signature)*

\_\_\_\_\_  
*(Printed name and title)*





# AIA Document G701™ – 2001

## Change Order

|  |   |   |
|--|---|---|
| <b>PROJECT</b> <i>(Name and address):</i><br>University of Maine | <b>CHANGE ORDER NUMBER:</b><br><b>DATE:</b> | <b>OWNER:</b> <input type="checkbox"/>      |
| System Project   |   | <b>ARCHITECT:</b> <input type="checkbox"/>  |
| <b>TO CONTRACTOR</b> <i>(Name and address):</i>                  | <b>ARCHITECT'S PROJECT NUMBER:</b>          | <b>CONTRACTOR:</b> <input type="checkbox"/> |
|  | <b>CONTRACT DATE:</b>                       | <b>FIELD:</b> <input type="checkbox"/>      |
|  | <b>CONTRACT FOR:</b>                        | <b>OTHER:</b> <input type="checkbox"/>      |

### THE CONTRACT IS CHANGED AS FOLLOWS:

*(Include, where applicable, any undisputed amount attributable to previously executed Construction Change Directives)*

|  |    |      |
|--|----|------|
| The original Contract Sum was  | \$ | 0.00 |
| The net change by previously authorized Change Orders                    | \$ | 0.00 |
| The Contract Sum prior to this Change Order was                          | \$ | 0.00 |
| The Contract Sum will be increased by this Change Order in the amount of | \$ | 0.00 |
| The new Contract Sum including this Change Order will be                 | \$ | 0.00 |

The Contract Time will be increased by Zero (0) days.

The date of Substantial Completion as of the date of this Change Order therefore is

**NOTE:** This Change Order does not include changes in the Contract Sum, Contract Time or Guaranteed Maximum Price which have been authorized by Construction Change Directive until the cost and time have been agreed upon by both the Owner and Contractor, in which case a Change Order is executed to supersede the Construction Change Directive.

**NOT VALID UNTIL SIGNED BY THE ARCHITECT, CONTRACTOR AND OWNER.**

|  |   |  |
|--|---|--|
| _____<br><b>ARCHITECT</b> <i>(Firm name)</i> | _____<br><b>CONTRACTOR</b> <i>(Firm name)</i> | _____<br><b>OWNER</b> <i>(Firm name)</i> |
| _____<br><b>ADDRESS</b>                      | _____<br><b>ADDRESS</b>                       | _____<br><b>ADDRESS</b>                  |
| _____<br><b>BY</b> <i>(Signature)</i>        | _____<br><b>BY</b> <i>(Signature)</i>         | _____<br><b>BY</b> <i>(Signature)</i>    |
| _____<br><i>(Typed name)</i>                 | _____<br><i>(Typed name)</i>                  | _____<br><i>(Typed name)</i>             |
| _____<br><b>DATE</b>                         | _____<br><b>DATE</b>                          | _____<br><b>DATE</b>                     |






**AIA<sup>®</sup> Document G704<sup>™</sup> – 2000**
**Certificate of Substantial Completion**

**PROJECT:**  
(Name and address):  
University of Maine System Project

**PROJECT NUMBER:** /  
**CONTRACT FOR:** General Construction  
**CONTRACT DATE:**

OWNER: ARCHITECT: CONTRACTOR: FIELD: OTHER: 

**TO OWNER:**  
(Name and address):  
University of Maine System  
16 Central Street  
Bangor, ME 04401-5106

**TO CONTRACTOR:**  
(Name and address):

**PROJECT OR PORTION OF THE PROJECT DESIGNATED FOR PARTIAL OCCUPANCY OR USE SHALL INCLUDE:**

The Work performed under this Contract has been reviewed and found, to the Architect's best knowledge, information and belief, to be substantially complete. Substantial Completion is the stage in the progress of the Work when the Work or designated portion is sufficiently complete in accordance with the Contract Documents so that the Owner can occupy or utilize the Work for its intended use. The date of Substantial Completion of the Project or portion designated above is the date of issuance established by this Certificate, which is also the date of commencement of applicable warranties required by the Contract Documents, except as stated below:

**Warranty**

**Date of Commencement**

\_\_\_\_\_  
ARCHITECT

\_\_\_\_\_  
BY

\_\_\_\_\_  
DATE OF ISSUANCE

A list of items to be completed or corrected is attached hereto. The failure to include any items on such list does not alter the responsibility of the Contractor to complete all Work in accordance with the Contract Documents. Unless otherwise agreed to in writing, the date of commencement of warranties for items on the attached list will be the date of issuance of the final Certificate of Payment or the date of final payment.

**Cost estimate of Work that is incomplete or defective: \$0.00**

The Contractor will complete or correct the Work on the list of items attached hereto within Zero (0) days from the above date of Substantial Completion.

\_\_\_\_\_  
CONTRACTOR

\_\_\_\_\_  
BY

\_\_\_\_\_  
DATE

The Owner accepts the Work or designated portion as substantially complete and will assume full possession at \_\_\_\_\_ (time) on \_\_\_\_\_ (date).

\_\_\_\_\_  
OWNER

\_\_\_\_\_  
BY

\_\_\_\_\_  
DATE

The responsibilities of the Owner and Contractor for security, maintenance, heat, utilities, damage to the Work and insurance shall be as follows:

(Note: Owner's and Contractor's legal and insurance counsel should determine and review insurance requirements and coverage.)



**University of Maine System  
Certificate of Completion  
(Final)**

CONTRACT DATED:

PROJECT NAME:

SUBSTANTIAL COMPLETION DATE:

FINAL COMPLETION is defined, in accordance with Article 9 of the General Conditions, as the date certified by the Architect when all the Work of the Project is fully complete, the Close-Out requirements of Paragraph 9.10 of the General Conditions have been completed, including the Close-Out Meeting and approval of Close-Out by the Architect, in accordance with Subparagraph 9.10.2, and the Contract fully performed in accordance with the Contract Documents, and the Contractor entitled to final payment.

The CONTRACTOR certifies that the Work is fully completed and was completed on or before \_\_\_\_\_, 20\_\_\_\_\_, and submits herewith:

- Application for Final Payment (AIA G702, or equal)
- Affidavit of Payments (AIA G706, or equal)
- Consent of Surety (AIA G707, or equal)
- Release of Liens (AIA G706A, or equal)
- Waiver of Lien

CONTRACTOR:

By: \_\_\_\_\_ Date: \_\_\_\_\_

The Architect has inspected the Work and has determined that the Date of Final Completion was \_\_\_\_\_, 20\_\_\_\_\_.

ARCHITECT:

By: \_\_\_\_\_ Date: \_\_\_\_\_

The OWNER hereby accepts the Work as fully complete and will make final payment.

By: \_\_\_\_\_  
Campus Signature Authority  
Title  
University of  
Date: \_\_\_\_\_



# AIA<sup>®</sup> Document G706<sup>™</sup> – 1994

## Contractor's Affidavit of Payment of Debts and Claims

|  |   |                                      |
|--|---|--------------------------------------|
| <b>PROJECT:</b> <i>(Name and address)</i><br>University of Maine System<br>Project | <b>ARCHITECT'S PROJECT NUMBER:</b>        | OWNER: <input type="checkbox"/>      |
| <b>TO OWNER:</b> <i>(Name and address)</i>   | <b>CONTRACT FOR:</b> General Construction | ARCHITECT: <input type="checkbox"/>  |
|  | <b>CONTRACT DATED:</b>                    | CONTRACTOR: <input type="checkbox"/> |
|  |   | SURETY: <input type="checkbox"/>     |
|  |   | OTHER: <input type="checkbox"/>      |

**STATE OF:**  
**COUNTY OF:**

The undersigned hereby certifies that, except as listed below, payment has been made in full and all obligations have otherwise been satisfied for all materials and equipment furnished, for all work, labor, and services performed, and for all known indebtedness and claims against the Contractor for damages arising in any manner in connection with the performance of the Contract referenced above for which the Owner or Owner's property might in any way be held responsible or encumbered.

**EXCEPTIONS:**

**SUPPORTING DOCUMENTS ATTACHED HERETO:**

- Consent of Surety to Final Payment. Whenever Surety is involved, Consent of Surety is required. AIA Document G707, Consent of Surety, may be used for this purpose
- Indicate Attachment  Yes  No

**CONTRACTOR:** *(Name and address)*

*The following supporting documents should be attached hereto if required by the Owner:*

- Contractor's Release or Waiver of Liens, conditional upon receipt of final payment.
- Separate Releases or Waivers of Liens from Subcontractors and material and equipment suppliers, to the extent required by the Owner, accompanied by a list thereof.
- Contractor's Affidavit of Release of Liens (AIA Document G706A).

BY: \_\_\_\_\_  
*(Signature of authorized representative)*

\_\_\_\_\_  
*(Printed name and title)*

Subscribed and sworn to before me on this date:

Notary Public:  
My Commission Expires:



# AIA<sup>®</sup> Document G706A<sup>™</sup> – 1994

## Contractor's Affidavit of Release of Liens

|  |  |                                      |
|--|--|--------------------------------------|
| <b>PROJECT:</b> <i>(Name and address)</i><br>University of Maine System Project2                                       | <b>ARCHITECT'S PROJECT NUMBER:</b>           | OWNER: <input type="checkbox"/>      |
|  | <b>CONTRACT FOR:</b> General<br>Construction | ARCHITECT: <input type="checkbox"/>  |
| <b>TO OWNER:</b> <i>(Name and address)</i><br>University of Maine System<br>16 Central Street<br>Bangor, ME 04401-5106 | <b>CONTRACT DATED:</b>                       | CONTRACTOR: <input type="checkbox"/> |
|  |  | SURETY: <input type="checkbox"/>     |
|  |  | OTHER: <input type="checkbox"/>      |

**STATE OF:** Maine  
**COUNTY OF:**

The undersigned hereby certifies that to the best of the undersigned's knowledge, information and belief, except as listed below, the Releases or Waivers of Lien attached hereto include the Contractor, all Subcontractors, all suppliers of materials and equipment, and all performers of Work, labor or services who have or may have liens or encumbrances or the right to assert liens or encumbrances against any property of the Owner arising in any manner out of the performance of the Contract referenced above.

**EXCEPTIONS:**

**SUPPORTING DOCUMENTS ATTACHED HERETO:**

1. Contractor's Release or Waiver of Liens, conditional upon receipt of final payment.
2. Separate Releases or Waivers of Liens from Subcontractors and material and equipment suppliers, to the extent required by the Owner, accompanied by a list thereof.

**CONTRACTOR:** *(Name and address)*

BY:

\_\_\_\_\_  
*(Signature of authorized representative)*

\_\_\_\_\_  
*(Printed name and title)*

Subscribed and sworn to before me on this date:

Notary Public:

My Commission Expires:





**WAIVER OF LIEN**

**Date:**  
**State of Maine**  
**County of**

**TO:** Office of Facilities  
University of Maine System  
16 Central Street  
Bangor, ME 04401

**SUBJECT**

Project Name

Project Location

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

Upon receipt of the sum of \_\_\_\_\_ (being the balance due us under the existing contract or subcontract agreement for work on the Subject Project) the undersigned agrees that it will waive and release the University of Maine System from any and all lien or claim or right to lien on the Subject Project under the Statutes of the State of Maine relating to liens for labor, materials and/or subcontracts furnished for the Subject Project on premises belonging to the University of Maine System.

Signed:

\_\_\_\_\_  
Authorized Signature

Title

\_\_\_\_\_

Firm Name:

\_\_\_\_\_

**NOTARY**

Subscribed and sworn to before me this \_\_\_\_\_ day of \_\_\_\_\_, 20\_\_\_\_.

\_\_\_\_\_  
Signature Notary Public



# AIA<sup>®</sup> Document G707<sup>™</sup> – 1994

## Consent Of Surety to Final Payment

|  |                                    |                                      |
|--|------------------------------------|--------------------------------------|
| <b>PROJECT:</b> <i>(Name and address)</i><br>University of Maine System Project  | <b>ARCHITECT'S PROJECT NUMBER:</b> | OWNER: <input type="checkbox"/>      |
|  | <b>CONTRACT FOR:</b>               | ARCHITECT: <input type="checkbox"/>  |
| <b>TO OWNER:</b> <i>(Name and address)</i><br>University of Maine System<br>16 Central Street<br>Bangor, ME 04401-5106 | <b>CONTRACT DATED:</b>             | CONTRACTOR: <input type="checkbox"/> |
|  |                                    | SURETY: <input type="checkbox"/>     |
|  |                                    | OTHER: <input type="checkbox"/>      |

In accordance with the provisions of the Contract between the Owner and the Contractor as indicated above, the  
*(Insert name and address of Surety)*

on bond of  
*(Insert name and address of Contractor)*

, SURETY,

hereby approves of the final payment to the Contractor, and agrees that final payment to the Contractor shall not relieve the Surety  
of any of its obligations to  
*(Insert name and address of Owner)*

, CONTRACTOR,

as set forth in said Surety's bond.

, OWNER,

IN WITNESS WHEREOF, the Surety has hereunto set its hand on this date:  
*(Insert in writing the month followed by the numeric date and year.)*

\_\_\_\_\_  
*(Surety)*

\_\_\_\_\_  
*(Signature of authorized representative)*

Attest:  
*(Seal):*

\_\_\_\_\_  
*(Printed name and title)*





# AIA<sup>®</sup> Document A201<sup>™</sup> – 2007

## General Conditions of the Contract for Construction

### for the following PROJECT:

*(Name and location or address)*

University of Maine System Project

### THE OWNER:

*(Name, legal status and address)*

University of Maine System  
16 Central Street  
Bangor, ME 04401-5106

### THE ARCHITECT:

*(Name, legal status and address)*

### TABLE OF ARTICLES

- |    |  |
|----|--|
| 1  | GENERAL PROVISIONS                               |
| 2  | OWNER  |
| 3  | CONTRACTOR                                       |
| 4  | ARCHITECT  |
| 5  | SUBCONTRACTORS                                   |
| 6  | CONSTRUCTION BY OWNER OR BY SEPARATE CONTRACTORS |
| 7  | CHANGES IN THE WORK                              |
| 8  | TIME   |
| 9  | PAYMENTS AND COMPLETION                          |
| 10 | PROTECTION OF PERSONS AND PROPERTY               |
| 11 | INSURANCE AND BONDS                              |
| 12 | UNCOVERING AND CORRECTION OF WORK                |
| 13 | MISCELLANEOUS PROVISIONS                         |
| 14 | TERMINATION OR SUSPENSION OF THE CONTRACT        |
| 15 | CLAIMS AND DISPUTES                              |

### ADDITIONS AND DELETIONS:

The author of this document has added information needed for its completion. The author may also have revised the text of the original AIA standard form. An *Additions and Deletions Report* that notes added information as well as revisions to the standard form text is available from the author and should be reviewed. A vertical line in the left margin of this document indicates where the author has added necessary information and where the author has added to or deleted from the original AIA text.

This document has important legal consequences. Consultation with an attorney is encouraged with respect to its completion or modification.

Init.

AIA Document A201<sup>™</sup> – 2007. Copyright © 1911, 1915, 1918, 1925, 1937, 1951, 1958, 1961, 1963, 1966, 1970, 1976, 1987, 1997 and 2007 by The American Institute of Architects. All rights reserved. **WARNING: This AIA<sup>®</sup> Document is protected by U.S. Copyright Law and International Treaties. Unauthorized reproduction or distribution of this AIA<sup>®</sup> Document, or any portion of it, may result in severe civil and criminal penalties, and will be prosecuted to the maximum extent possible under the law.** This document was produced by AIA software at 11:09:38 on 05/24/2010 under Order No.0553161408\_1 which expires on 07/03/2010, and is not for resale.

User Notes:

(895711814)

**INDEX**

(Numbers and Topics in Bold are Section Headings)

**Acceptance of Nonconforming Work**9.6.6, 9.9.3, **12.3**

Acceptance of Work

9.6.6, 9.8.2, 9.9.3, 9.10.1, 9.10.3, **12.3****Access to Work****3.16**, 6.2.1, **12.1**

Accident Prevention

10

Acts and Omissions

3.2, 3.3.2, 3.12.8, 3.18, 4.2.3, 8.3.1, 9.5.1, 10.2.5,  
10.2.8, 13.4.2, 13.7.1, 14.1, 15.2

Addenda

1.1.1, 3.11.1

Additional Costs, Claims for

3.7.4, 3.7.5, 6.1.1, 7.3.7.5, 10.3, 15.1.4

**Additional Inspections and Testing**9.4.2, 9.8.3, 12.2.1, **13.5**

Additional Insured

11.1.4

**Additional Time, Claims for**3.2.4, 3.7.4, 3.7.5, 3.10.2, 8.3.2, **15.1.5****Administration of the Contract**3.1.3, **4.2**, 9.4, 9.5

Advertisement or Invitation to Bid

1.1.1

Aesthetic Effect

4.2.13

**Allowances****3.8**, 7.3.8

All-risk Insurance

11.3.1, 11.3.1.1

**Applications for Payment**4.2.5, 7.3.9, 9.2, **9.3**, 9.4, 9.5.1, 9.6.3, 9.7.1, 9.10,  
11.1.3

Approvals

2.1.1, 2.2.2, 2.4, 3.1.3, 3.10.2, 3.12.8, 3.12.9, 3.12.10,  
4.2.7, 9.3.2, 13.5.1**Arbitration**8.3.1, 11.3.10, 13.1.1, 15.3.2, **15.4****ARCHITECT****4****Architect**, Definition of**4.1.1**

Architect, Extent of Authority

2.4.1, 3.12.7, 4.1, 4.2, 5.2, 6.3.1, 7.1.2, 7.3.7, 7.4,  
9.2.1, 9.3.1, 9.4, 9.5, 9.6.3, 9.8, 9.10.1, 9.10.3, 12.1,  
12.2.1, 13.5.1, 13.5.2, 14.2.2, 14.2.4, 15.1.3, 15.2.1

Architect, Limitations of Authority and Responsibility

2.1.1, 3.12.4, 3.12.8, 3.12.10, 4.1.2, 4.2.1, 4.2.2, 4.2.3,  
4.2.6, 4.2.7, 4.2.10, 4.2.12, 4.2.13, 5.2.1, 7.4.1, 9.4.2,  
9.5.3, 9.6.4, 15.1.3, 15.2

Architect's Additional Services and Expenses

2.4.1, 11.3.1.1, 12.2.1, 13.5.2, 13.5.3, 14.2.4

Architect's Administration of the Contract

3.1.3, 4.2, 3.7.4, 15.2, 9.4.1, 9.5

Architect's Approvals

2.4.1, 3.1.3, 3.5.1, 3.10.2, 4.2.7

Architect's Authority to Reject Work

3.5.1, 4.2.6, 12.1.2, 12.2.1

Architect's Copyright

1.1.7, 1.5

Architect's Decisions

3.7.4, 4.2.6, 4.2.7, 4.2.11, 4.2.12, 4.2.13, 4.2.14, 6.3.1,  
7.3.7, 7.3.9, 8.1.3, 8.3.1, 9.2.1, 9.4.1, 9.5, 9.8.4, 9.9.1,  
13.5.2, 15.2, 15.3

Architect's Inspections

3.7.4, 4.2.2, 4.2.9, 9.4.2, 9.8.3, 9.9.2, 9.10.1, 13.5

Architect's Instructions

3.2.4, 3.3.1, 4.2.6, 4.2.7, 13.5.2

Architect's Interpretations

4.2.11, 4.2.12

Architect's Project Representative

4.2.10

Architect's Relationship with Contractor

1.1.2, 1.5, 3.1.3, 3.2.2, 3.2.3, 3.2.4, 3.3.1, 3.4.2, 3.5.1,  
3.7.4, 3.7.5, 3.9.2, 3.9.3, 3.10, 3.11, 3.12, 3.16, 3.18,  
4.1.2, 4.1.3, 4.2, 5.2, 6.2.2, 7, 8.3.1, 9.2, 9.3, 9.4, 9.5,  
9.7, 9.8, 9.9, 10.2.6, 10.3, 11.3.7, 12, 13.4.2, 13.5, 15.2

Architect's Relationship with Subcontractors

1.1.2, 4.2.3, 4.2.4, 4.2.6, 9.6.3, 9.6.4, 11.3.7

Architect's Representations

9.4.2, 9.5.1, 9.10.1

Architect's Site Visits

3.7.4, 4.2.2, 4.2.9, 9.4.2, 9.5.1, 9.9.2, 9.10.1, 13.5

Asbestos

10.3.1

Attorneys' Fees

3.18.1, 9.10.2, 10.3.3

Award of Separate Contracts

6.1.1, 6.1.2

**Award of Subcontracts and Other Contracts for Portions of the Work****5.2****Basic Definitions****1.1**

Bidding Requirements

1.1.1, 5.2.1, 11.4.1

Binding Dispute Resolution

9.7.1, 11.3.9, 11.3.10, 13.1.1, 15.2.5, 15.2.6.1, 15.3.1,  
15.3.2, 15.4.1**Boiler and Machinery Insurance****11.3.2**

Bonds, Lien

7.3.7.4, 9.10.2, 9.10.3

**Bonds, Performance, and Payment**7.3.7.4, 9.6.7, 9.10.3, 11.3.9, **11.4**

Init.

AIA Document A201™ – 2007. Copyright © 1911, 1915, 1918, 1925, 1937, 1951, 1958, 1961, 1963, 1966, 1970, 1976, 1987, 1997 and 2007 by The American Institute of Architects. All rights reserved. **WARNING: This AIA® Document is protected by U.S. Copyright Law and International Treaties. Unauthorized reproduction or distribution of this AIA® Document, or any portion of it, may result in severe civil and criminal penalties, and will be prosecuted to the maximum extent possible under the law.** This document was produced by AIA software at 11:09:38 on 05/24/2010 under Order No.0553161408\_1 which expires on 07/03/2010, and is not for resale.

User Notes:

(895711814)

Building Permit

3.7.1

### Capitalization

#### 1.3

Certificate of Substantial Completion

9.8.3, 9.8.4, 9.8.5

### Certificates for Payment

4.2.1, 4.2.5, 4.2.9, 9.3.3, 9.4, 9.5, 9.6.1, 9.6.6, 9.7.1,

9.10.1, 9.10.3, 14.1.1.3, 14.2.4, 15.1.3

Certificates of Inspection, Testing or Approval

13.5.4

Certificates of Insurance

9.10.2, 11.1.3

### Change Orders

1.1.1, 2.4.1, 3.4.2, 3.7.4, 3.8.2.3, 3.11.1, 3.12.8, 4.2.8,

5.2.3, 7.1.2, 7.1.3, 7.2, 7.3.2, 7.3.6, 7.3.9, 7.3.10, 8.3.1,

9.3.1.1, 9.10.3, 10.3.2, 11.3.1.2, 11.3.4, 11.3.9, 12.1.2,

15.1.3

Change Orders, Definition of

#### 7.2.1

### CHANGES IN THE WORK

2.2.1, 3.11, 4.2.8, 7, 7.2.1, 7.3.1, 7.4, 7.4.1, 8.3.1,

9.3.1.1, 11.3.9

Claims, Definition of

#### 15.1.1

### CLAIMS AND DISPUTES

3.2.4, 6.1.1, 6.3.1, 7.3.9, 9.3.3, 9.10.4, 10.3.3, 15, 15.4

Claims and Timely Assertion of Claims

15.4.1

Claims for Additional Cost

3.2.4, 3.7.4, 6.1.1, 7.3.9, 10.3.2, 15.1.4

Claims for Additional Time

3.2.4, 3.7.46.1.1, 8.3.2, 10.3.2, 15.1.5

Concealed or Unknown Conditions, Claims for

#### 3.7.4

Claims for Damages

3.2.4, 3.18, 6.1.1, 8.3.3, 9.5.1, 9.6.7, 10.3.3, 11.1.1,

11.3.5, 11.3.7, 14.1.3, 14.2.4, 15.1.6

Claims Subject to Arbitration

15.3.1, 15.4.1

### Cleaning Up

#### 3.15, 6.3

Commencement of the Work, Conditions Relating to

2.2.1, 3.2.2, 3.4.1, 3.7.1, 3.10.1, 3.12.6, 5.2.1, 5.2.3,

6.2.2, 8.1.2, 8.2.2, 8.3.1, 11.1, 11.3.1, 11.3.6, 11.4.1,

15.1.4

Commencement of the Work, Definition of

#### 8.1.2

Communications Facilitating Contract

Administration

3.9.1, 4.2.4

Completion, Conditions Relating to

3.4.1, 3.11, 3.15, 4.2.2, 4.2.9, 8.2, 9.4.2, 9.8, 9.9.1,

9.10, 12.2, 13.7, 14.1.2

### COMPLETION, PAYMENTS AND

9

Completion, Substantial

4.2.9, 8.1.1, 8.1.3, 8.2.3, 9.4.2, 9.8, 9.9.1, 9.10.3, 12.2,

13.7

Compliance with Laws

1.6.1, 3.2.3, 3.6, 3.7, 3.12.10, 3.13, 4.1.1, 9.6.4, 10.2.2,

11.1, 11.3, 13.1, 13.4, 13.5.1, 13.5.2, 13.6, 14.1.1,

14.2.1.3, 15.2.8, 15.4.2, 15.4.3

Concealed or Unknown Conditions

3.7.4, 4.2.8, 8.3.1, 10.3

Conditions of the Contract

1.1.1, 6.1.1, 6.1.4

Consent, Written

3.4.2, 3.7.4, 3.12.8, 3.14.2, 4.1.2, 9.3.2, 9.8.5, 9.9.1,

9.10.2, 9.10.3, 11.3.1, 13.2, 13.4.2, 15.4.4.2

### Consolidation or Joinder

#### 15.4.4

### CONSTRUCTION BY OWNER OR BY

### SEPARATE CONTRACTORS

1.1.4, 6

Construction Change Directive, Definition of

#### 7.3.1

Construction Change Directives

1.1.1, 3.4.2, 3.12.8, 4.2.8, 7.1.1, 7.1.2, 7.1.3, 7.3,

9.3.1.1

Construction Schedules, Contractor's

3.10, 3.12.1, 3.12.2, 6.1.3, 15.1.5.2

Contingent Assignment of Subcontracts

5.4, 14.2.2.2

Continuing Contract Performance

#### 15.1.3

Contract, Definition of

#### 1.1.2

### CONTRACT, TERMINATION OR

### SUSPENSION OF THE

5.4.1.1, 11.3.9, 14

Contract Administration

3.1.3, 4, 9.4, 9.5

Contract Award and Execution, Conditions Relating

to

3.7.1, 3.10, 5.2, 6.1, 11.1.3, 11.3.6, 11.4.1

Contract Documents, The

#### 1.1.1

Contract Documents, Copies Furnished and Use of

1.5.2, 2.2.5, 5.3

Contract Documents, Definition of

#### 1.1.1

Contract Sum

3.7.4, 3.8, 5.2.3, 7.2, 7.3, 7.4, 9.1, 9.4.2, 9.5.1.4, 9.6.7,

9.7, 10.3.2, 11.3.1, 14.2.4, 14.3.2, 15.1.4, 15.2.5

Contract Sum, Definition of

#### 9.1

Contract Time

3.7.4, 3.7.5, 3.10.2, 5.2.3, 7.2.1.3, 7.3.1, 7.3.5, 7.4,

8.1.1, 8.2.1, 8.3.1, 9.5.1, 9.7.1, 10.3.2, 12.1.1, 14.3.2,

15.1.5.1, 15.2.5

Contract Time, Definition of

#### 8.1.1

Init.

AIA Document A201™ – 2007. Copyright © 1911, 1915, 1918, 1925, 1937, 1951, 1958, 1961, 1963, 1966, 1970, 1976, 1987, 1997 and 2007 by The American Institute of Architects. All rights reserved. **WARNING: This AIA® Document is protected by U.S. Copyright Law and International Treaties. Unauthorized reproduction or distribution of this AIA® Document, or any portion of it, may result in severe civil and criminal penalties, and will be prosecuted to the maximum extent possible under the law.** This document was produced by AIA software at 11:09:38 on 05/24/2010 under Order No.0553161408\_1 which expires on 07/03/2010, and is not for resale.

User Notes:

(895711814)

**CONTRACTOR****3****Contractor**, Definition of**3.1, 6.1.2****Contractor's Construction Schedules****3.10, 3.12.1, 3.12.2, 6.1.3, 15.1.5.2**

Contractor's Employees

3.3.2, 3.4.3, 3.8.1, 3.9, 3.18.2, 4.2.3, 4.2.6, 10.2, 10.3, 11.1.1, 11.3.7, 14.1, 14.2.1.1,

**Contractor's Liability Insurance****11.1**

Contractor's Relationship with Separate Contractors and Owner's Forces

3.12.5, 3.14.2, 4.2.4, 6, 11.3.7, 12.1.2, 12.2.4

Contractor's Relationship with Subcontractors

1.2.2, 3.3.2, 3.18.1, 3.18.2, 5, 9.6.2, 9.6.7, 9.10.2, 11.3.1.2, 11.3.7, 11.3.8

Contractor's Relationship with the Architect

1.1.2, 1.5, 3.1.3, 3.2.2, 3.2.3, 3.2.4, 3.3.1, 3.4.2, 3.5.1, 3.7.4, 3.10, 3.11, 3.12, 3.16, 3.18, 4.1.3, 4.2, 5.2, 6.2.2, 7, 8.3.1, 9.2, 9.3, 9.4, 9.5, 9.7, 9.8, 9.9, 10.2.6, 10.3, 11.3.7, 12, 13.5, 15.1.2, 15.2.1

Contractor's Representations

3.2.1, 3.2.2, 3.5.1, 3.12.6, 6.2.2, 8.2.1, 9.3.3, 9.8.2

Contractor's Responsibility for Those Performing the Work

3.3.2, 3.18, 5.3.1, 6.1.3, 6.2, 9.5.1, 10.2.8

Contractor's Review of Contract Documents

3.2

Contractor's Right to Stop the Work

9.7

Contractor's Right to Terminate the Contract

14.1, 15.1.6

Contractor's Submittals

3.10, 3.11, 3.12.4, 4.2.7, 5.2.1, 5.2.3, 9.2, 9.3, 9.8.2, 9.8.3, 9.9.1, 9.10.2, 9.10.3, 11.1.3, 11.4.2

Contractor's Superintendent

3.9, 10.2.6

Contractor's Supervision and Construction

Procedures

1.2.2, 3.3, 3.4, 3.12.10, 4.2.2, 4.2.7, 6.1.3, 6.2.4, 7.1.3, 7.3.5, 7.3.7, 8.2, 10, 12, 14, 15.1.3

Contractual Liability Insurance

11.1.1.8, 11.2

Coordination and Correlation

1.2, 3.2.1, 3.3.1, 3.10, 3.12.6, 6.1.3, 6.2.1

Copies Furnished of Drawings and Specifications

1.5, 2.2.5, 3.11

Copyrights

1.5, 3.17

Correction of Work

2.3, 2.4, 3.7.3, 9.4.2, 9.8.2, 9.8.3, 9.9.1, 12.1.2, 12.2

**Correlation and Intent of the Contract Documents****1.2****Cost**, Definition of**7.3.7**

Costs

2.4.1, 3.2.4, 3.7.3, 3.8.2, 3.15.2, 5.4.2, 6.1.1, 6.2.3, 7.3.3.3, 7.3.7, 7.3.8, 7.3.9, 9.10.2, 10.3.2, 10.3.6, 11.3, 12.1.2, 12.2.1, 12.2.4, 13.5, 14

**Cutting and Patching****3.14, 6.2.5**

Damage to Construction of Owner or Separate

Contractors

3.14.2, 6.2.4, 10.2.1.2, 10.2.5, 10.4, 11.1.1, 11.3, 12.2.4

Damage to the Work

3.14.2, 9.9.1, 10.2.1.2, 10.2.5, 10.4.1, 11.3.1, 12.2.4

Damages, Claims for

3.2.4, 3.18, 6.1.1, 8.3.3, 9.5.1, 9.6.7, 10.3.3, 11.1.1, 11.3.5, 11.3.7, 14.1.3, 14.2.4, 15.1.6

Damages for Delay

6.1.1, 8.3.3, 9.5.1.6, 9.7, 10.3.2

**Date of Commencement of the Work**, Definition of**8.1.2****Date of Substantial Completion**, Definition of**8.1.3****Day**, Definition of**8.1.4**

Decisions of the Architect

3.7.4, 4.2.6, 4.2.7, 4.2.11, 4.2.12, 4.2.13, 15.2, 6.3, 7.3.7, 7.3.9, 8.1.3, 8.3.1, 9.2.1, 9.4, 9.5.1, 9.8.4, 9.9.1, 13.5.2, 14.2.2, 14.2.4, 15.1, 15.2

**Decisions to Withhold Certification**

9.4.1, 9.5, 9.7, 14.1.1.3

Defective or Nonconforming Work, Acceptance, Rejection and Correction of

2.3.1, 2.4.1, 3.5.1, 4.2.6, 6.2.5, 9.5.1, 9.5.2, 9.6.6, 9.8.2, 9.9.3, 9.10.4, 12.2.1

**Defective Work**, Definition of**3.5.1**

Definitions

1.1, 2.1.1, 3.1.1, 3.5.1, 3.12.1, 3.12.2, 3.12.3, 4.1.1, 15.1.1, 5.1, 6.1.2, 7.2.1, 7.3.1, 8.1, 9.1, 9.8.1

**Delays and Extensions of Time**

3.2, 3.7.4, 5.2.3, 7.2.1, 7.3.1, 7.4.1, 8.3, 9.5.1, 9.7.1, 10.3.2, 10.4.1, 14.3.2, 15.1.5, 15.2.5

Disputes

6.3.1, 7.3.9, 15.1, 15.2

**Documents and Samples at the Site****3.11****Drawings**, Definition of**1.1.5**

Drawings and Specifications, Use and Ownership of

3.11

Effective Date of Insurance

8.2.2, 11.1.2

**Emergencies****10.4, 14.1.1.2, 15.1.4**

Employees, Contractor's

3.3.2, 3.4.3, 3.8.1, 3.9, 3.18.2, 4.2.3, 4.2.6, 10.2,

10.3.3, 11.1.1, 11.3.7, 14.1, 14.2.1.1

Init.

AIA Document A201™ – 2007. Copyright © 1911, 1915, 1918, 1925, 1937, 1951, 1958, 1961, 1963, 1966, 1970, 1976, 1987, 1997 and 2007 by The American Institute of Architects. All rights reserved. **WARNING: This AIA® Document is protected by U.S. Copyright Law and International Treaties. Unauthorized reproduction or distribution of this AIA® Document, or any portion of it, may result in severe civil and criminal penalties, and will be prosecuted to the maximum extent possible under the law.** This document was produced by AIA software at 11:09:38 on 05/24/2010 under Order No.0553161408\_1 which expires on 07/03/2010, and is not for resale.

User Notes:

(895711814)



Equipment, Labor, Materials or  
 1.1.3, 1.1.6, 3.4, 3.5.1, 3.8.2, 3.8.3, 3.12, 3.13.1,  
 3.15.1, 4.2.6, 4.2.7, 5.2.1, 6.2.1, 7.3.7, 9.3.2, 9.3.3,  
 9.5.1.3, 9.10.2, 10.2.1, 10.2.4, 14.2.1.1, 14.2.1.2

Execution and Progress of the Work  
 1.1.3, 1.2.1, 1.2.2, 2.2.3, 2.2.5, 3.1, 3.3.1, 3.4.1, 3.5.1,  
 3.7.1, 3.10.1, 3.12, 3.14, 4.2, 6.2.2, 7.1.3, 7.3.5, 8.2,  
 9.5.1, 9.9.1, 10.2, 10.3, 12.2, 14.2, 14.3.1, 15.1.3

Extensions of Time  
 3.2.4, 3.7.4, 5.2.3, 7.2.1, 7.3, 7.4.1, 9.5.1, 9.7.1, 10.3.2,  
 10.4.1, 14.3, 15.1.5, 15.2.5

**Failure of Payment**  
 9.5.1.3, 9.7, 9.10.2, 13.6, 14.1.1.3, 14.2.1.2

Faulty Work  
 (See Defective or Nonconforming Work)

**Final Completion and Final Payment**  
 4.2.1, 4.2.9, 9.8.2, 9.10, 11.1.2, 11.1.3, 11.3.1, 11.3.5,  
 12.3.1, 14.2.4, 14.4.3

Financial Arrangements, Owner's  
 2.2.1, 13.2.2, 14.1.1.4

Fire and Extended Coverage Insurance  
 11.3.1.1

**GENERAL PROVISIONS**

**1**

**Governing Law**  
**13.1**  
 Guarantees (See Warranty)

**Hazardous Materials**  
 10.2.4, 10.3

Identification of Subcontractors and Suppliers  
 5.2.1

**Indemnification**  
 3.17.1, 3.18, 9.10.2, 10.3.3, 10.3.5, 10.3.6, 11.3.1.2,  
 11.3.7

**Information and Services Required of the Owner**  
 2.1.2, 2.2, 3.2.2, 3.12.4, 3.12.10, 6.1.3, 6.1.4, 6.2.5,  
 9.6.1, 9.6.4, 9.9.2, 9.10.3, 10.3.3, 11.2, 11.4, 13.5.1,  
 13.5.2, 14.1.1.4, 14.1.4, 15.1.3

**Initial Decision**  
**15.2**

**Initial Decision Maker, Definition of**  
 1.1.8

Initial Decision Maker, Decisions  
 14.2.2, 14.2.4, 15.2.1, 15.2.2, 15.2.3, 15.2.4, 15.2.5

Initial Decision Maker, Extent of Authority  
 14.2.2, 14.2.4, 15.1.3, 15.2.1, 15.2.2, 15.2.3, 15.2.4,  
 15.2.5

**Injury or Damage to Person or Property**  
**10.2.8, 10.4.1**

Inspections  
 3.1.3, 3.3.3, 3.7.1, 4.2.2, 4.2.6, 4.2.9, 9.4.2, 9.8.3,  
 9.9.2, 9.10.1, 12.2.1, 13.5

Instructions to Bidders  
 1.1.1

Instructions to the Contractor  
 3.2.4, 3.3.1, 3.8.1, 5.2.1, 7, 8.2.2, 12, 13.5.2

**Instruments of Service, Definition of**  
**1.1.7**  
 Insurance  
 3.18.1, 6.1.1, 7.3.7, 9.3.2, 9.8.4, 9.9.1, 9.10.2, 11

**Insurance, Boiler and Machinery**  
**11.3.2**

**Insurance, Contractor's Liability**  
**11.1**  
 Insurance, Effective Date of  
 8.2.2, 11.1.2

**Insurance, Loss of Use**  
**11.3.3**

**Insurance, Owner's Liability**  
**11.2**

**Insurance, Property**  
 10.2.5, 11.3

Insurance, Stored Materials  
 9.3.2, 11.4.1.4

**INSURANCE AND BONDS**

**11**  
 Insurance Companies, Consent to Partial Occupancy  
 9.9.1, 11.4.1.5

Insurance Companies, Settlement with  
 11.4.10

Intent of the Contract Documents  
 1.2.1, 4.2.7, 4.2.12, 4.2.13, 7.4

**Interest**  
**13.6**

**Interpretation**  
 1.2.3, 1.4, 4.1.1, 5.1, 6.1.2, 15.1.1

Interpretations, Written  
 4.2.11, 4.2.12, 15.1.4

Judgment on Final Award  
 15.4.2

**Labor and Materials, Equipment**  
 1.1.3, 1.1.6, 3.4, 3.5.1, 3.8.2, 3.8.3, 3.12, 3.13, 3.15.1,  
 4.2.6, 4.2.7, 5.2.1, 6.2.1, 7.3.7, 9.3.2, 9.3.3, 9.5.1.3,  
 9.10.2, 10.2.1, 10.2.4, 14.2.1.1, 14.2.1.2

Labor Disputes  
 8.3.1

Laws and Regulations  
 1.5, 3.2.3, 3.6, 3.7, 3.12.10, 3.13.1, 4.1.1, 9.6.4, 9.9.1,  
 10.2.2, 11.1.1, 11.3, 13.1.1, 13.4, 13.5.1, 13.5.2,  
 13.6.1, 14, 15.2.8, 15.4

Liens  
 2.1.2, 9.3.3, 9.10.2, 9.10.4, 15.2.8

Limitations, Statutes of  
 12.2.5, 13.7, 15.4.1.1

Limitations of Liability  
 2.3.1, 3.2.2, 3.5.1, 3.12.10, 3.17.1, 3.18.1, 4.2.6, 4.2.7,  
 4.2.12, 6.2.2, 9.4.2, 9.6.4, 9.6.7, 10.2.5, 10.3.3, 11.1.2,  
 11.2, 11.3.7, 12.2.5, 13.4.2

Limitations of Time  
 2.1.2, 2.2, 2.4, 3.2.2, 3.10, 3.11, 3.12.5, 3.15.1, 4.2.7,  
 5.2, 5.3.1, 5.4.1, 6.2.4, 7.3, 7.4, 8.2, 9.2.1, 9.3.1, 9.3.3,  
 9.4.1, 9.5, 9.6, 9.7.1, 9.8, 9.9, 9.10, 11.1.3, 11.3.1.5,  
 11.3.6, 11.3.10, 12.2, 13.5, 13.7, 14, 15

Init.

AIA Document A201™ – 2007. Copyright © 1911, 1915, 1918, 1925, 1937, 1951, 1958, 1961, 1963, 1966, 1970, 1976, 1987, 1997 and 2007 by The American Institute of Architects. All rights reserved. **WARNING: This AIA® Document is protected by U.S. Copyright Law and International Treaties. Unauthorized reproduction or distribution of this AIA® Document, or any portion of it, may result in severe civil and criminal penalties, and will be prosecuted to the maximum extent possible under the law.** This document was produced by AIA software at 11:09:38 on 05/24/2010 under Order No.0553161408\_1 which expires on 07/03/2010, and is not for resale.

User Notes:

(895711814)

**Loss of Use Insurance****11.3.3****Material Suppliers**

1.5, 3.12.1, 4.2.4, 4.2.6, 5.2.1, 9.3, 9.4.2, 9.6, 9.10.5

**Materials, Hazardous****10.2.4, 10.3****Materials, Labor, Equipment and**

1.1.3, 1.1.6, 1.5.1, 3.4.1, 3.5.1, 3.8.2, 3.8.3, 3.12, 3.13.1, 3.15.1, 4.2.6, 4.2.7, 5.2.1, 6.2.1, 7.3.7, 9.3.2, 9.3.3, 9.5.1.3, 9.10.2, 10.2.1.2, 10.2.4, 14.2.1.1, 14.2.1.2

**Means, Methods, Techniques, Sequences and****Procedures of Construction**

3.3.1, 3.12.10, 4.2.2, 4.2.7, 9.4.2

**Mechanic's Lien**

2.1.2, 15.2.8

**Mediation**

8.3.1, 10.3.5, 10.3.6, 15.2.1, 15.2.5, 15.2.6, 15.3, 15.4.1

**Minor Changes in the Work**

1.1.1, 3.12.8, 4.2.8, 7.1, 7.4

**MISCELLANEOUS PROVISIONS****13****Modifications, Definition of****1.1.1****Modifications to the Contract**

1.1.1, 1.1.2, 3.11, 4.1.2, 4.2.1, 5.2.3, 7, 8.3.1, 9.7.1, 10.3.2, 11.3.1

**Mutual Responsibility****6.2****Nonconforming Work, Acceptance of****9.6.6, 9.9.3, 12.3****Nonconforming Work, Rejection and Correction of**

2.3.1, 2.4.1, 3.5.1, 4.2.6, 6.2.4, 9.5.1, 9.8.2, 9.9.3, 9.10.4, 12.2.1

**Notice**

2.2.1, 2.3.1, 2.4.1, 3.2.4, 3.3.1, 3.7.2, 3.12.9, 5.2.1, 9.7.1, 9.10, 10.2.2, 11.1.3, 11.4.6, 12.2.2.1, 13.3, 13.5.1, 13.5.2, 14.1, 14.2, 15.2.8, 15.4.1

**Notice, Written**

2.3.1, 2.4.1, 3.3.1, 3.9.2, 3.12.9, 3.12.10, 5.2.1, 9.7.1, 9.10, 10.2.2, 10.3, 11.1.3, 11.3.6, 12.2.2.1, 13.3, 14, 15.2.8, 15.4.1

**Notice of Claims**

3.7.4, 4.5, 10.2.8, 15.1.2, 15.4

**Notice of Testing and Inspections**

13.5.1, 13.5.2

**Observations, Contractor's**

3.2, 3.7.4

**Occupancy**

2.2.2, 9.6.6, 9.8, 11.3.1.5

**Orders, Written**

1.1.1, 2.3, 3.9.2, 7, 8.2.2, 11.3.9, 12.1, 12.2.2.1, 13.5.2, 14.3.1

**OWNER**

2

**Owner, Definition of****2.1.1****Owner, Information and Services Required of the**

2.1.2, 2.2, 3.2.2, 3.12.10, 6.1.3, 6.1.4, 6.2.5, 9.3.2, 9.6.1, 9.6.4, 9.9.2, 9.10.3, 10.3.3, 11.2, 11.3, 13.5.1, 13.5.2, 14.1.1.4, 14.1.4, 15.1.3

**Owner's Authority**

1.5, 2.1.1, 2.3.1, 2.4.1, 3.4.2, 3.8.1, 3.12.10, 3.14.2, 4.1.2, 4.1.3, 4.2.4, 4.2.9, 5.2.1, 5.2.4, 5.4.1, 6.1, 6.3.1, 7.2.1, 7.3.1, 8.2.2, 8.3.1, 9.3.1, 9.3.2, 9.5.1, 9.6.4, 9.9.1, 9.10.2, 10.3.2, 11.1.3, 11.3.3, 11.3.10, 12.2.2, 12.3.1, 13.2.2, 14.3, 14.4, 15.2.7

**Owner's Financial Capability**

2.2.1, 13.2.2, 14.1.1.4

**Owner's Liability Insurance****11.2****Owner's Loss of Use Insurance****11.3.3****Owner's Relationship with Subcontractors**

1.1.2, 5.2, 5.3, 5.4, 9.6.4, 9.10.2, 14.2.2

**Owner's Right to Carry Out the Work**

2.4, 14.2.2

**Owner's Right to Clean Up****6.3****Owner's Right to Perform Construction and to Award Separate Contracts****6.1****Owner's Right to Stop the Work****2.3****Owner's Right to Suspend the Work**

14.3

**Owner's Right to Terminate the Contract**

14.2

**Ownership and Use of Drawings, Specifications and Other Instruments of Service**

1.1.1, 1.1.6, 1.1.7, 1.5, 2.2.5, 3.2.2, 3.11.1, 3.17.1, 4.2.12, 5.3.1

**Partial Occupancy or Use**

9.6.6, 9.9, 11.3.1.5

**Patching, Cutting and**

3.14, 6.2.5

**Patents**

3.17

**Payment, Applications for**

4.2.5, 7.3.9, 9.2.1, 9.3, 9.4, 9.5, 9.6.3, 9.7.1, 9.8.5, 9.10.1, 14.2.3, 14.2.4, 14.4.3

**Payment, Certificates for**

4.2.5, 4.2.9, 9.3.3, 9.4, 9.5, 9.6.1, 9.6.6, 9.7.1, 9.10.1, 9.10.3, 13.7, 14.1.1.3, 14.2.4

**Payment, Failure of**

9.5.1.3, 9.7, 9.10.2, 13.6, 14.1.1.3, 14.2.1.2

**Payment, Final**

4.2.1, 4.2.9, 9.8.2, 9.10, 11.1.2, 11.1.3, 11.4.1, 11.4.5, 12.3.1, 13.7, 14.2.4, 14.4.3

**Payment Bond, Performance Bond and**

7.3.7.4, 9.6.7, 9.10.3, 11.4.9, 11.4

Init.

AIA Document A201™ – 2007. Copyright © 1911, 1915, 1918, 1925, 1937, 1951, 1958, 1961, 1963, 1966, 1970, 1976, 1987, 1997 and 2007 by The American Institute of Architects. All rights reserved. **WARNING: This AIA® Document is protected by U.S. Copyright Law and International Treaties. Unauthorized reproduction or distribution of this AIA® Document, or any portion of it, may result in severe civil and criminal penalties, and will be prosecuted to the maximum extent possible under the law.** This document was produced by AIA software at 11:09:38 on 05/24/2010 under Order No.0553161408\_1 which expires on 07/03/2010, and is not for resale.

User Notes:

(895711814)

**Payments, Progress**

9.3, 9.6, 9.8.5, 9.10.3, 13.6, 14.2.3, 15.1.3

**PAYMENTS AND COMPLETION**

9

**Payments to Subcontractors**

5.4.2, 9.5.1.3, 9.6.2, 9.6.3, 9.6.4, 9.6.7, 11.4.8, 14.2.1.2

**PCB**

10.3.1

**Performance Bond and Payment Bond**

7.3.7.4, 9.6.7, 9.10.3, 11.4.9, 11.4

**Permits, Fees, Notices and Compliance with Laws**

2.2.2, 3.7, 3.13, 7.3.7.4, 10.2.2

**PERSONS AND PROPERTY, PROTECTION OF**

10

**Polychlorinated Biphenyl**

10.3.1

**Product Data, Definition of**

3.12.2

**Product Data and Samples, Shop Drawings**

3.11, 3.12, 4.2.7

**Progress and Completion**

4.2.2, 8.2, 9.8, 9.9.1, 14.1.4, 15.1.3

**Progress Payments**

9.3, 9.6, 9.8.5, 9.10.3, 13.6, 14.2.3, 15.1.3

**Project, Definition of the**

1.1.4

**Project Representatives**

4.2.10

**Property Insurance**

10.2.5, 11.3

**PROTECTION OF PERSONS AND PROPERTY**

10

**Regulations and Laws**

1.5, 3.2.3, 3.6, 3.7, 3.12.10, 3.13, 4.1.1, 9.6.4, 9.9.1, 10.2.2, 11.1, 11.4, 13.1, 13.4, 13.5.1, 13.5.2, 13.6, 14, 15.2.8, 15.4

**Rejection of Work**

3.5.1, 4.2.6, 12.2.1

**Releases and Waivers of Liens**

9.10.2

**Representations**

3.2.1, 3.5.1, 3.12.6, 6.2.2, 8.2.1, 9.3.3, 9.4.2, 9.5.1, 9.8.2, 9.10.1

**Representatives**

2.1.1, 3.1.1, 3.9, 4.1.1, 4.2.1, 4.2.2, 4.2.10, 5.1.1, 5.1.2, 13.2.1

**Responsibility for Those Performing the Work**

3.3.2, 3.18, 4.2.3, 5.3.1, 6.1.3, 6.2, 6.3, 9.5.1, 10

**Retainage**

9.3.1, 9.6.2, 9.8.5, 9.9.1, 9.10.2, 9.10.3

**Review of Contract Documents and Field****Conditions by Contractor**

3.2, 3.12.7, 6.1.3

**Review of Contractor's Submittals by Owner and Architect**

3.10.1, 3.10.2, 3.11, 3.12, 4.2, 5.2, 6.1.3, 9.2, 9.8.2

**Review of Shop Drawings, Product Data and Samples by Contractor**

3.12

**Rights and Remedies**

1.1.2, 2.3, 2.4, 3.5.1, 3.7.4, 3.15.2, 4.2.6, 4.5, 5.3, 5.4, 6.1, 6.3, 7.3.1, 8.3, 9.5.1, 9.7, 10.2.5, 10.3, 12.2.2, 12.2.4, 13.4, 14, 15.4

**Royalties, Patents and Copyrights**

3.17

**Rules and Notices for Arbitration**

15.4.1

**Safety of Persons and Property**

10.2, 10.4

**Safety Precautions and Programs**

3.3.1, 4.2.2, 4.2.7, 5.3.1, 10.1, 10.2, 10.4

**Samples, Definition of**

3.12.3

**Samples, Shop Drawings, Product Data and**

3.11, 3.12, 4.2.7

**Samples at the Site, Documents and**

3.11

**Schedule of Values**

9.2, 9.3.1

**Schedules, Construction**

3.10, 3.12.1, 3.12.2, 6.1.3, 15.1.5.2

**Separate Contracts and Contractors**

1.1.4, 3.12.5, 3.14.2, 4.2.4, 4.2.7, 6, 8.3.1, 11.4.7, 12.1.2

**Shop Drawings, Definition of**

3.12.1

**Shop Drawings, Product Data and Samples**

3.11, 3.12, 4.2.7

**Site, Use of**

3.13, 6.1.1, 6.2.1

**Site Inspections**

3.2.2, 3.3.3, 3.7.1, 3.7.4, 4.2, 9.4.2, 9.10.1, 13.5

**Site Visits, Architect's**

3.7.4, 4.2.2, 4.2.9, 9.4.2, 9.5.1, 9.9.2, 9.10.1, 13.5

**Special Inspections and Testing**

4.2.6, 12.2.1, 13.5

**Specifications, Definition of the**

1.1.6

**Specifications, The**

1.1.1, 1.1.6, 1.2.2, 1.5, 3.11, 3.12.10, 3.17, 4.2.14

**Statute of Limitations**

13.7, 15.4.1.1

**Stopping the Work**

2.3, 9.7, 10.3, 14.1

**Stored Materials**

6.2.1, 9.3.2, 10.2.1.2, 10.2.4, 11.4.1.4

**Subcontractor, Definition of**

5.1.1

**SUBCONTRACTORS**

5

**Subcontractors, Work by**

1.2.2, 3.3.2, 3.12.1, 4.2.3, 5.2.3, 5.3, 5.4, 9.3.1.2, 9.6.7

Init.

AIA Document A201™ – 2007. Copyright © 1911, 1915, 1918, 1925, 1937, 1951, 1958, 1961, 1963, 1966, 1970, 1976, 1987, 1997 and 2007 by The American Institute of Architects. All rights reserved. **WARNING: This AIA® Document is protected by U.S. Copyright Law and International Treaties. Unauthorized reproduction or distribution of this AIA® Document, or any portion of it, may result in severe civil and criminal penalties, and will be prosecuted to the maximum extent possible under the law.** This document was produced by AIA software at 11:09:38 on 05/24/2010 under Order No.0553161408\_1 which expires on 07/03/2010, and is not for resale.

User Notes:

(895711814)

**Subcontractual Relations**

5.3, 5.4, 9.3.1.2, 9.6, 9.10, 10.2.1, 11.4.7, 11.4.8, 14.1, 14.2.1

**Submittals**

3.10, 3.11, 3.12, 4.2.7, 5.2.1, 5.2.3, 7.3.7, 9.2, 9.3, 9.8, 9.9.1, 9.10.2, 9.10.3, 11.1.3

**Submittal Schedule**

3.10.2, 3.12.5, 4.2.7

**Subrogation, Waivers of**

6.1.1, 11.4.5, 11.3.7

**Substantial Completion**

4.2.9, 8.1.1, 8.1.3, 8.2.3, 9.4.2, 9.8, 9.9.1, 9.10.3, 12.2, 13.7

**Substantial Completion, Definition of****9.8.1****Substitution of Subcontractors**

5.2.3, 5.2.4

**Substitution of Architect**

4.1.3

**Substitutions of Materials**

3.4.2, 3.5.1, 7.3.8

**Sub-subcontractor, Definition of****5.1.2****Subsurface Conditions**

3.7.4

**Successors and Assigns****13.2****Superintendent**

3.9, 10.2.6

**Supervision and Construction Procedures**

1.2.2, 3.3, 3.4, 3.12.10, 4.2.2, 4.2.7, 6.1.3, 6.2.4, 7.1.3, 7.3.7, 8.2, 8.3.1, 9.4.2, 10, 12, 14, 15.1.3

**Surety**

5.4.1.2, 9.8.5, 9.10.2, 9.10.3, 14.2.2, 15.2.7

**Surety, Consent of**

9.10.2, 9.10.3

**Surveys**

2.2.3

**Suspension by the Owner for Convenience****14.3****Suspension of the Work**

5.4.2, 14.3

**Suspension or Termination of the Contract**

5.4.1.1, 11.4.9, 14

**Taxes**

3.6, 3.8.2.1, 7.3.7.4

**Termination by the Contractor**

14.1, 15.1.6

**Termination by the Owner for Cause**

5.4.1.1, 14.2, 15.1.6

**Termination by the Owner for Convenience****14.4****Termination of the Architect**

4.1.3

**Termination of the Contractor**

14.2.2

**TERMINATION OR SUSPENSION OF THE****CONTRACT****14****Tests and Inspections**

3.1.3, 3.3.3, 4.2.2, 4.2.6, 4.2.9, 9.4.2, 9.8.3, 9.9.2, 9.10.1, 10.3.2, 11.4.1.1, 12.2.1, 13.5

**TIME****8****Time, Delays and Extensions of**

3.2.4, 3.7.4, 5.2.3, 7.2.1, 7.3.1, 7.4.1, 8.3, 9.5.1, 9.7.1, 10.3.2, 10.4.1, 14.3.2, 15.1.5, 15.2.5

**Time Limits**

2.1.2, 2.2, 2.4, 3.2.2, 3.10, 3.11, 3.12.5, 3.15.1, 4.2, 4.4, 4.5, 5.2, 5.3, 5.4, 6.2.4, 7.3, 7.4, 8.2, 9.2, 9.3.1, 9.3.3, 9.4.1, 9.5, 9.6, 9.7, 9.8, 9.9, 9.10, 11.1.3, 11.4.1.5, 11.4.6, 11.4.10, 12.2, 13.5, 13.7, 14, 15.1.2, 15.4

**Time Limits on Claims**

3.7.4, 10.2.8, 13.7, 15.1.2

**Title to Work**

9.3.2, 9.3.3

**Transmission of Data in Digital Form****1.6****UNCOVERING AND CORRECTION OF WORK****12****Uncovering of Work****12.1****Unforeseen Conditions, Concealed or Unknown**

3.7.4, 8.3.1, 10.3

**Unit Prices**

7.3.3.2, 7.3.4

**Use of Documents**

1.1.1, 1.5, 2.2.5, 3.12.6, 5.3

**Use of Site**

3.13, 6.1.1, 6.2.1

**Values, Schedule of**

9.2, 9.3.1

**Waiver of Claims by the Architect**

13.4.2

**Waiver of Claims by the Contractor**

9.10.5, 11.4.7, 13.4.2, 15.1.6

**Waiver of Claims by the Owner**

9.9.3, 9.10.3, 9.10.4, 11.4.3, 11.4.5, 11.4.7, 12.2.2.1, 13.4.2, 14.2.4, 15.1.6

**Waiver of Consequential Damages**

14.2.4, 15.1.6

**Waiver of Liens**

9.10.2, 9.10.4

**Waivers of Subrogation**

6.1.1, 11.4.5, 11.3.7

**Warranty**

3.5, 4.2.9, 9.3.3, 9.8.4, 9.9.1, 9.10.4, 12.2.2, 13.7.1

**Weather Delays**

15.1.5.2

**Work, Definition of**

1.1.3

Init.

AIA Document A201™ – 2007. Copyright © 1911, 1915, 1918, 1925, 1937, 1951, 1958, 1961, 1963, 1966, 1970, 1976, 1987, 1997 and 2007 by The American Institute of Architects. All rights reserved. **WARNING: This AIA® Document is protected by U.S. Copyright Law and International Treaties. Unauthorized reproduction or distribution of this AIA® Document, or any portion of it, may result in severe civil and criminal penalties, and will be prosecuted to the maximum extent possible under the law.** This document was produced by AIA software at 11:09:38 on 05/24/2010 under Order No.0553161408\_1 which expires on 07/03/2010, and is not for resale.

User Notes:

(895711814)

Written Consent

1.5.2, 3.4.2, 3.7.4, 3.12.8, 3.14.2, 4.1.2, 9.3.2, 9.8.5,  
9.9.1, 9.10.2, 9.10.3, 11.4.1, 13.2, 13.4.2, 15.4.4.2

Written Interpretations

4.2.11, 4.2.12

Written Notice

2.3, 2.4, 3.3.1, 3.9, 3.12.9, 3.12.10, 5.2.1, 8.2.2, 9.7,  
9.10, 10.2.2, 10.3, 11.1.3, 11.4.6, 12.2.2, 12.2.4, 13.3,  
14, 15.4.1

Written Orders

1.1.1, 2.3, 3.9, 7, 8.2.2, 11.4.9, 12.1, 12.2, 13.5.2,  
14.3.1, 15.1.2

Init.

User Notes:

(895711814)

**ARTICLE 1 GENERAL PROVISIONS****§ 1.1 BASIC DEFINITIONS****§ 1.1.1 THE CONTRACT DOCUMENTS**

The Contract Documents are enumerated in the Agreement between the Owner and Contractor (hereinafter the Agreement) and consist of the Agreement, Conditions of the Contract (General, Supplementary and other Conditions), Drawings, Specifications, Addenda issued prior to execution of the Contract, other documents listed in the Agreement and Modifications issued after execution of the Contract. A Modification is (1) a written amendment to the Contract signed by both parties, (2) a Change Order, (3) a Construction Change Directive or (4) a written order for a minor change in the Work issued by the Architect. Unless specifically enumerated in the Agreement, the Contract Documents do not include the advertisement or invitation to bid, Instructions to Bidders, sample forms, other information furnished by the Owner in anticipation of receiving bids or proposals, the Contractor's bid or proposal, or portions of Addenda relating to bidding requirements.

**§ 1.1.2 THE CONTRACT**

The Contract Documents form the Contract for Construction. The Contract represents the entire and integrated agreement between the parties hereto and supersedes prior negotiations, representations or agreements, either written or oral. The Contract may be amended or modified only by a Modification. The Contract Documents shall not be construed to create a contractual relationship of any kind (1) between the Contractor and the Architect or the Architect's consultants, (2) between the Owner and a Subcontractor or a Sub-subcontractor, (3) between the Owner and the Architect or the Architect's consultants or (4) between any persons or entities other than the Owner and the Contractor. The Architect shall, however, be entitled to performance and enforcement of obligations under the Contract intended to facilitate performance of the Architect's duties.

**§ 1.1.3 THE WORK**

The term "Work" means the construction and services required by the Contract Documents, whether completed or partially completed, and includes all other labor, materials, equipment and services provided or to be provided by the Contractor to fulfill the Contractor's obligations. The Work may constitute the whole or a part of the Project.

**§ 1.1.4 THE PROJECT**

The Project is the total construction of which the Work performed under the Contract Documents may be the whole or a part and which may include construction by the Owner and by separate contractors.

**§ 1.1.5 THE DRAWINGS**

The Drawings are the graphic and pictorial portions of the Contract Documents showing the design, location and dimensions of the Work, generally including plans, elevations, sections, details, schedules and diagrams.

**§ 1.1.6 THE SPECIFICATIONS**

The Specifications are that portion of the Contract Documents consisting of the written requirements for materials, equipment, systems, standards and workmanship for the Work, and performance of related services.

**§ 1.1.7 INSTRUMENTS OF SERVICE**

Instruments of Service are representations, in any medium of expression now known or later developed, of the tangible and intangible creative work performed by the Architect and the Architect's consultants under their respective professional services agreements. Instruments of Service may include, without limitation, studies, surveys, models, sketches, drawings, specifications, and other similar materials.

**§ 1.1.8 INITIAL DECISION MAKER**

The Initial Decision Maker is the person identified in the Agreement to render initial decisions on Claims in accordance with Section 15.2 and certify termination of the Agreement under Section 14.2.2.

**§ 1.2 CORRELATION AND INTENT OF THE CONTRACT DOCUMENTS**

**§ 1.2.1** The intent of the Contract Documents is to include all items necessary for the proper execution and completion of the Work by the Contractor. The Contract Documents are complementary, and what is required by one shall be as binding as if required by all; performance by the Contractor shall be required only to the extent consistent with the Contract Documents and reasonably inferable from them as being necessary to produce the indicated results.

§ 1.2.2 Organization of the Specifications into divisions, sections and articles, and arrangement of Drawings shall not control the Contractor in dividing the Work among Subcontractors or in establishing the extent of Work to be performed by any trade.

§ 1.2.3 Unless otherwise stated in the Contract Documents, words that have well-known technical or construction industry meanings are used in the Contract Documents in accordance with such recognized meanings.

### § 1.3 CAPITALIZATION

Terms capitalized in these General Conditions include those that are (1) specifically defined, (2) the titles of numbered articles or (3) the titles of other documents published by the American Institute of Architects.

### § 1.4 INTERPRETATION

In the interest of brevity the Contract Documents frequently omit modifying words such as "all" and "any" and articles such as "the" and "an," but the fact that a modifier or an article is absent from one statement and appears in another is not intended to affect the interpretation of either statement.

### § 1.5 OWNERSHIP AND USE OF DRAWINGS, SPECIFICATIONS AND OTHER INSTRUMENTS OF SERVICE

§ 1.5.1 The Architect and the Architect's consultants shall be deemed the authors and owners of their respective Instruments of Service, including the Drawings and Specifications, and will retain all common law, statutory and other reserved rights, including copyrights. The Contractor, Subcontractors, Sub-subcontractors, and material or equipment suppliers shall not own or claim a copyright in the Instruments of Service. Submittal or distribution to meet official regulatory requirements or for other purposes in connection with this Project is not to be construed as publication in derogation of the Architect's or Architect's consultants' reserved rights.

§ 1.5.2 The Contractor, Subcontractors, Sub-subcontractors and material or equipment suppliers are authorized to use and reproduce the Instruments of Service provided to them solely and exclusively for execution of the Work. All copies made under this authorization shall bear the copyright notice, if any, shown on the Instruments of Service. The Contractor, Subcontractors, Sub-subcontractors, and material or equipment suppliers may not use the Instruments of Service on other projects or for additions to this Project outside the scope of the Work without the specific written consent of the Owner, Architect and the Architect's consultants.

### § 1.6 TRANSMISSION OF DATA IN DIGITAL FORM

If the parties intend to transmit Instruments of Service or any other information or documentation in digital form, they shall endeavor to establish necessary protocols governing such transmissions, unless otherwise already provided in the Agreement or the Contract Documents.

## ARTICLE 2 OWNER

### § 2.1 GENERAL

§ 2.1.1 The Owner is the person or entity identified as such in the Agreement and is referred to throughout the Contract Documents as if singular in number. The Owner shall designate in writing a representative who shall have express authority to bind the Owner with respect to all matters requiring the Owner's approval or authorization. Except as otherwise provided in Section 4.2.1, the Architect does not have such authority. The term "Owner" means the Owner or the Owner's authorized representative.

§ 2.1.2 The Owner shall furnish to the Contractor within fifteen days after receipt of a written request, information necessary and relevant for the Contractor to evaluate, give notice of or enforce mechanic's lien rights. Such information shall include a correct statement of the record legal title to the property on which the Project is located, usually referred to as the site, and the Owner's interest therein.

### § 2.2 INFORMATION AND SERVICES REQUIRED OF THE OWNER

§ 2.2.1 Prior to commencement of the Work, the Contractor may request in writing that the Owner provide reasonable evidence that the Owner has made financial arrangements to fulfill the Owner's obligations under the Contract. Thereafter, the Contractor may only request such evidence if (1) the Owner fails to make payments to the Contractor as the Contract Documents require; (2) a change in the Work materially changes the Contract Sum; or (3) the Contractor identifies in writing a reasonable concern regarding the Owner's ability to make payment when due. The Owner shall furnish such evidence as a condition precedent to commencement or continuation of the Work or the

portion of the Work affected by a material change. After the Owner furnishes the evidence, the Owner shall not materially vary such financial arrangements without prior notice to the Contractor.

§ 2.2.2 Except for permits and fees that are the responsibility of the Contractor under the Contract Documents, including those required under Section 3.7.1, the Owner shall secure and pay for necessary approvals, easements, assessments and charges required for construction, use or occupancy of permanent structures or for permanent changes in existing facilities.

§ 2.2.3 The Owner shall furnish surveys describing physical characteristics, legal limitations and utility locations for the site of the Project, and a legal description of the site. The Contractor shall be entitled to rely on the accuracy of information furnished by the Owner but shall exercise proper precautions relating to the safe performance of the Work.

§ 2.2.4 The Owner shall furnish information or services required of the Owner by the Contract Documents with reasonable promptness. The Owner shall also furnish any other information or services under the Owner's control and relevant to the Contractor's performance of the Work with reasonable promptness after receiving the Contractor's written request for such information or services.

§ 2.2.5 Unless otherwise provided in the Contract Documents, the Owner shall furnish to the Contractor one copy of the Contract Documents for purposes of making reproductions pursuant to Section 1.5.2.

### § 2.3 OWNER'S RIGHT TO STOP THE WORK

If the Contractor fails to correct Work that is not in accordance with the requirements of the Contract Documents as required by Section 12.2 or repeatedly fails to carry out Work in accordance with the Contract Documents, the Owner may issue a written order to the Contractor to stop the Work, or any portion thereof, until the cause for such order has been eliminated; however, the right of the Owner to stop the Work shall not give rise to a duty on the part of the Owner to exercise this right for the benefit of the Contractor or any other person or entity, except to the extent required by Section 6.1.3.

### § 2.4 OWNER'S RIGHT TO CARRY OUT THE WORK

If the Contractor defaults or neglects to carry out the Work in accordance with the Contract Documents and fails within a ten-day period after receipt of written notice from the Owner to commence and continue correction of such default or neglect with diligence and promptness, the Owner may, without prejudice to other remedies the Owner may have, correct such deficiencies. In such case an appropriate Change Order shall be issued deducting from payments then or thereafter due the Contractor the reasonable cost of correcting such deficiencies, including Owner's expenses and compensation for the Architect's additional services made necessary by such default, neglect or failure. Such action by the Owner and amounts charged to the Contractor are both subject to prior approval of the Architect. If payments then or thereafter due the Contractor are not sufficient to cover such amounts, the Contractor shall pay the difference to the Owner.

## ARTICLE 3 CONTRACTOR

### § 3.1 GENERAL

§ 3.1.1 The Contractor is the person or entity identified as such in the Agreement and is referred to throughout the Contract Documents as if singular in number. The Contractor shall be lawfully licensed, if required in the jurisdiction where the Project is located. The Contractor shall designate in writing a representative who shall have express authority to bind the Contractor with respect to all matters under this Contract. The term "Contractor" means the Contractor or the Contractor's authorized representative.

§ 3.1.2 The Contractor shall perform the Work in accordance with the Contract Documents.

§ 3.1.3 The Contractor shall not be relieved of obligations to perform the Work in accordance with the Contract Documents either by activities or duties of the Architect in the Architect's administration of the Contract, or by tests, inspections or approvals required or performed by persons or entities other than the Contractor.



### § 3.2 REVIEW OF CONTRACT DOCUMENTS AND FIELD CONDITIONS BY CONTRACTOR

§ 3.2.1 Execution of the Contract by the Contractor is a representation that the Contractor has visited the site, become generally familiar with local conditions under which the Work is to be performed and correlated personal observations with requirements of the Contract Documents.

§ 3.2.2 Because the Contract Documents are complementary, the Contractor shall, before starting each portion of the Work, carefully study and compare the various Contract Documents relative to that portion of the Work, as well as the information furnished by the Owner pursuant to Section 2.2.3, shall take field measurements of any existing conditions related to that portion of the Work, and shall observe any conditions at the site affecting it. These obligations are for the purpose of facilitating coordination and construction by the Contractor and are not for the purpose of discovering errors, omissions, or inconsistencies in the Contract Documents; however, the Contractor shall promptly report to the Architect any errors, inconsistencies or omissions discovered by or made known to the Contractor as a request for information in such form as the Architect may require. It is recognized that the Contractor's review is made in the Contractor's capacity as a contractor and not as a licensed design professional, unless otherwise specifically provided in the Contract Documents.

§ 3.2.3 The Contractor is not required to ascertain that the Contract Documents are in accordance with applicable laws, statutes, ordinances, codes, rules and regulations, or lawful orders of public authorities, but the Contractor shall promptly report to the Architect any nonconformity discovered by or made known to the Contractor as a request for information in such form as the Architect may require.

§ 3.2.4 If the Contractor believes that additional cost or time is involved because of clarifications or instructions the Architect issues in response to the Contractor's notices or requests for information pursuant to Sections 3.2.2 or 3.2.3, the Contractor shall make Claims as provided in Article 15. If the Contractor fails to perform the obligations of Sections 3.2.2 or 3.2.3, the Contractor shall pay such costs and damages to the Owner as would have been avoided if the Contractor had performed such obligations. If the Contractor performs those obligations, the Contractor shall not be liable to the Owner or Architect for damages resulting from errors, inconsistencies or omissions in the Contract Documents, for differences between field measurements or conditions and the Contract Documents, or for nonconformities of the Contract Documents to applicable laws, statutes, ordinances, codes, rules and regulations, and lawful orders of public authorities.

### § 3.3 SUPERVISION AND CONSTRUCTION PROCEDURES

§ 3.3.1 The Contractor shall supervise and direct the Work, using the Contractor's best skill and attention. The Contractor shall be solely responsible for, and have control over, construction means, methods, techniques, sequences and procedures and for coordinating all portions of the Work under the Contract, unless the Contract Documents give other specific instructions concerning these matters. If the Contract Documents give specific instructions concerning construction means, methods, techniques, sequences or procedures, the Contractor shall evaluate the jobsite safety thereof and, except as stated below, shall be fully and solely responsible for the jobsite safety of such means, methods, techniques, sequences or procedures. If the Contractor determines that such means, methods, techniques, sequences or procedures may not be safe, the Contractor shall give timely written notice to the Owner and Architect and shall not proceed with that portion of the Work without further written instructions from the Architect. If the Contractor is then instructed to proceed with the required means, methods, techniques, sequences or procedures without acceptance of changes proposed by the Contractor, the Owner shall be solely responsible for any loss or damage arising solely from those Owner-required means, methods, techniques, sequences or procedures.

§ 3.3.2 The Contractor shall be responsible to the Owner for acts and omissions of the Contractor's employees, Subcontractors and their agents and employees, and other persons or entities performing portions of the Work for, or on behalf of, the Contractor or any of its Subcontractors.

§ 3.3.3 The Contractor shall be responsible for inspection of portions of Work already performed to determine that such portions are in proper condition to receive subsequent Work.

### § 3.4 LABOR AND MATERIALS

§ 3.4.1 Unless otherwise provided in the Contract Documents, the Contractor shall provide and pay for labor, materials, equipment, tools, construction equipment and machinery, water, heat, utilities, transportation, and other facilities and services necessary for proper execution and completion of the Work, whether temporary or permanent and whether or not incorporated or to be incorporated in the Work.

Init.

§ 3.4.2 Except in the case of minor changes in the Work authorized by the Architect in accordance with Sections 3.12.8 or 7.4, the Contractor may make substitutions only with the consent of the Owner, after evaluation by the Architect and in accordance with a Change Order or Construction Change Directive.

§ 3.4.3 The Contractor shall enforce strict discipline and good order among the Contractor's employees and other persons carrying out the Work. The Contractor shall not permit employment of unfit persons or persons not properly skilled in tasks assigned to them.

### § 3.5 WARRANTY

The Contractor warrants to the Owner and Architect that materials and equipment furnished under the Contract will be of good quality and new unless the Contract Documents require or permit otherwise. The Contractor further warrants that the Work will conform to the requirements of the Contract Documents and will be free from defects, except for those inherent in the quality of the Work the Contract Documents require or permit. Work, materials, or equipment not conforming to these requirements may be considered defective. The Contractor's warranty excludes remedy for damage or defect caused by abuse, alterations to the Work not executed by the Contractor, improper or insufficient maintenance, improper operation, or normal wear and tear and normal usage. If required by the Architect, the Contractor shall furnish satisfactory evidence as to the kind and quality of materials and equipment.

### § 3.6 TAXES

The Contractor shall pay sales, consumer, use and similar taxes for the Work provided by the Contractor that are legally enacted when bids are received or negotiations concluded, whether or not yet effective or merely scheduled to go into effect.

### § 3.7 PERMITS, FEES, NOTICES, AND COMPLIANCE WITH LAWS

§ 3.7.1 Unless otherwise provided in the Contract Documents, the Contractor shall secure and pay for the building permit as well as for other permits, fees, licenses, and inspections by government agencies necessary for proper execution and completion of the Work that are customarily secured after execution of the Contract and legally required at the time bids are received or negotiations concluded.

§ 3.7.2 The Contractor shall comply with and give notices required by applicable laws, statutes, ordinances, codes, rules and regulations, and lawful orders of public authorities applicable to performance of the Work.

§ 3.7.3 If the Contractor performs Work knowing it to be contrary to applicable laws, statutes, ordinances, codes, rules and regulations, or lawful orders of public authorities, the Contractor shall assume appropriate responsibility for such Work and shall bear the costs attributable to correction.

§ 3.7.4 **Concealed or Unknown Conditions.** If the Contractor encounters conditions at the site that are (1) subsurface or otherwise concealed physical conditions that differ materially from those indicated in the Contract Documents or (2) unknown physical conditions of an unusual nature, that differ materially from those ordinarily found to exist and generally recognized as inherent in construction activities of the character provided for in the Contract Documents, the Contractor shall promptly provide notice to the Owner and the Architect before conditions are disturbed and in no event later than 21 days after first observance of the conditions. The Architect will promptly investigate such conditions and, if the Architect determines that they differ materially and cause an increase or decrease in the Contractor's cost of, or time required for, performance of any part of the Work, will recommend an equitable adjustment in the Contract Sum or Contract Time, or both. If the Architect determines that the conditions at the site are not materially different from those indicated in the Contract Documents and that no change in the terms of the Contract is justified, the Architect shall promptly notify the Owner and Contractor in writing, stating the reasons. If either party disputes the Architect's determination or recommendation, that party may proceed as provided in Article 15.

§ 3.7.5 If, in the course of the Work, the Contractor encounters human remains or recognizes the existence of burial markers, archaeological sites or wetlands not indicated in the Contract Documents, the Contractor shall immediately suspend any operations that would affect them and shall notify the Owner and Architect. Upon receipt of such notice, the Owner shall promptly take any action necessary to obtain governmental authorization required to resume the operations. The Contractor shall continue to suspend such operations until otherwise instructed by the Owner but shall continue with all other operations that do not affect those remains or features. Requests for adjustments in the Contract Sum and Contract Time arising from the existence of such remains or features may be made as provided in Article 15.

Init.

AIA Document A201™ – 2007. Copyright © 1911, 1915, 1918, 1925, 1937, 1951, 1958, 1961, 1963, 1966, 1970, 1976, 1987, 1997 and 2007 by The American Institute of Architects. All rights reserved. **WARNING: This AIA® Document is protected by U.S. Copyright Law and International Treaties. Unauthorized reproduction or distribution of this AIA® Document, or any portion of it, may result in severe civil and criminal penalties, and will be prosecuted to the maximum extent possible under the law.** This document was produced by AIA software at 11:09:38 on 05/24/2010 under Order No.0553161408\_1 which expires on 07/03/2010, and is not for resale.

User Notes:

(895711814)

### § 3.8 ALLOWANCES

§ 3.8.1 The Contractor shall include in the Contract Sum all allowances stated in the Contract Documents. Items covered by allowances shall be supplied for such amounts and by such persons or entities as the Owner may direct, but the Contractor shall not be required to employ persons or entities to whom the Contractor has reasonable objection.

§ 3.8.2 Unless otherwise provided in the Contract Documents,

- .1 allowances shall cover the cost to the Contractor of materials and equipment delivered at the site and all required taxes, less applicable trade discounts;
- .2 Contractor's costs for unloading and handling at the site, labor, installation costs, overhead, profit and other expenses contemplated for stated allowance amounts shall be included in the Contract Sum but not in the allowances; and
- .3 whenever costs are more than or less than allowances, the Contract Sum shall be adjusted accordingly by Change Order. The amount of the Change Order shall reflect (1) the difference between actual costs and the allowances under Section 3.8.2.1 and (2) changes in Contractor's costs under Section 3.8.2.2.

§ 3.8.3 Materials and equipment under an allowance shall be selected by the Owner with reasonable promptness.

### § 3.9 SUPERINTENDENT

§ 3.9.1 The Contractor shall employ a competent superintendent and necessary assistants who shall be in attendance at the Project site during performance of the Work. The superintendent shall represent the Contractor, and communications given to the superintendent shall be as binding as if given to the Contractor.

§ 3.9.2 The Contractor, as soon as practicable after award of the Contract, shall furnish in writing to the Owner through the Architect the name and qualifications of a proposed superintendent. The Architect may reply within 14 days to the Contractor in writing stating (1) whether the Owner or the Architect has reasonable objection to the proposed superintendent or (2) that the Architect requires additional time to review. Failure of the Architect to reply within the 14 day period shall constitute notice of no reasonable objection.

§ 3.9.3 The Contractor shall not employ a proposed superintendent to whom the Owner or Architect has made reasonable and timely objection. The Contractor shall not change the superintendent without the Owner's consent, which shall not unreasonably be withheld or delayed.

### § 3.10 CONTRACTOR'S CONSTRUCTION SCHEDULES

§ 3.10.1 The Contractor, promptly after being awarded the Contract, shall prepare and submit for the Owner's and Architect's information a Contractor's construction schedule for the Work. The schedule shall not exceed time limits current under the Contract Documents, shall be revised at appropriate intervals as required by the conditions of the Work and Project, shall be related to the entire Project to the extent required by the Contract Documents, and shall provide for expeditious and practicable execution of the Work.

§ 3.10.2 The Contractor shall prepare a submittal schedule, promptly after being awarded the Contract and thereafter as necessary to maintain a current submittal schedule, and shall submit the schedule(s) for the Architect's approval. The Architect's approval shall not unreasonably be delayed or withheld. The submittal schedule shall (1) be coordinated with the Contractor's construction schedule, and (2) allow the Architect reasonable time to review submittals. If the Contractor fails to submit a submittal schedule, the Contractor shall not be entitled to any increase in Contract Sum or extension of Contract Time based on the time required for review of submittals.

§ 3.10.3 The Contractor shall perform the Work in general accordance with the most recent schedules submitted to the Owner and Architect.

### § 3.11 DOCUMENTS AND SAMPLES AT THE SITE

The Contractor shall maintain at the site for the Owner one copy of the Drawings, Specifications, Addenda, Change Orders and other Modifications, in good order and marked currently to indicate field changes and selections made during construction, and one copy of approved Shop Drawings, Product Data, Samples and similar required submittals. These shall be available to the Architect and shall be delivered to the Architect for submittal to the Owner upon completion of the Work as a record of the Work as constructed.

Init.

**§ 3.12 SHOP DRAWINGS, PRODUCT DATA AND SAMPLES**

**§ 3.12.1** Shop Drawings are drawings, diagrams, schedules and other data specially prepared for the Work by the Contractor or a Subcontractor, Sub-subcontractor, manufacturer, supplier or distributor to illustrate some portion of the Work.

**§ 3.12.2** Product Data are illustrations, standard schedules, performance charts, instructions, brochures, diagrams and other information furnished by the Contractor to illustrate materials or equipment for some portion of the Work.

**§ 3.12.3** Samples are physical examples that illustrate materials, equipment or workmanship and establish standards by which the Work will be judged.

**§ 3.12.4** Shop Drawings, Product Data, Samples and similar submittals are not Contract Documents. Their purpose is to demonstrate the way by which the Contractor proposes to conform to the information given and the design concept expressed in the Contract Documents for those portions of the Work for which the Contract Documents require submittals. Review by the Architect is subject to the limitations of Section 4.2.7. Informational submittals upon which the Architect is not expected to take responsive action may be so identified in the Contract Documents. Submittals that are not required by the Contract Documents may be returned by the Architect without action.

**§ 3.12.5** The Contractor shall review for compliance with the Contract Documents, approve and submit to the Architect Shop Drawings, Product Data, Samples and similar submittals required by the Contract Documents in accordance with the submittal schedule approved by the Architect or, in the absence of an approved submittal schedule, with reasonable promptness and in such sequence as to cause no delay in the Work or in the activities of the Owner or of separate contractors.

**§ 3.12.6** By submitting Shop Drawings, Product Data, Samples and similar submittals, the Contractor represents to the Owner and Architect that the Contractor has (1) reviewed and approved them, (2) determined and verified materials, field measurements and field construction criteria related thereto, or will do so and (3) checked and coordinated the information contained within such submittals with the requirements of the Work and of the Contract Documents.

**§ 3.12.7** The Contractor shall perform no portion of the Work for which the Contract Documents require submittal and review of Shop Drawings, Product Data, Samples or similar submittals until the respective submittal has been approved by the Architect.

**§ 3.12.8** The Work shall be in accordance with approved submittals except that the Contractor shall not be relieved of responsibility for deviations from requirements of the Contract Documents by the Architect's approval of Shop Drawings, Product Data, Samples or similar submittals unless the Contractor has specifically informed the Architect in writing of such deviation at the time of submittal and (1) the Architect has given written approval to the specific deviation as a minor change in the Work, or (2) a Change Order or Construction Change Directive has been issued authorizing the deviation. The Contractor shall not be relieved of responsibility for errors or omissions in Shop Drawings, Product Data, Samples or similar submittals by the Architect's approval thereof.

**§ 3.12.9** The Contractor shall direct specific attention, in writing or on resubmitted Shop Drawings, Product Data, Samples or similar submittals, to revisions other than those requested by the Architect on previous submittals. In the absence of such written notice, the Architect's approval of a resubmission shall not apply to such revisions.

**§ 3.12.10** The Contractor shall not be required to provide professional services that constitute the practice of architecture or engineering unless such services are specifically required by the Contract Documents for a portion of the Work or unless the Contractor needs to provide such services in order to carry out the Contractor's responsibilities for construction means, methods, techniques, sequences and procedures. The Contractor shall not be required to provide professional services in violation of applicable law. If professional design services or certifications by a design professional related to systems, materials or equipment are specifically required of the Contractor by the Contract Documents, the Owner and the Architect will specify all performance and design criteria that such services must satisfy. The Contractor shall cause such services or certifications to be provided by a properly licensed design professional, whose signature and seal shall appear on all drawings, calculations, specifications, certifications, Shop Drawings and other submittals prepared by such professional. Shop Drawings and other submittals related to the Work designed or certified by such professional, if prepared by others, shall bear such professional's written approval when submitted to the Architect. The Owner and the Architect shall be entitled to rely upon the adequacy, accuracy and

Init.

AIA Document A201™ – 2007. Copyright © 1911, 1915, 1918, 1925, 1937, 1951, 1958, 1961, 1963, 1966, 1970, 1976, 1987, 1997 and 2007 by The American Institute of Architects. All rights reserved. **WARNING: This AIA® Document is protected by U.S. Copyright Law and International Treaties. Unauthorized reproduction or distribution of this AIA® Document, or any portion of it, may result in severe civil and criminal penalties, and will be prosecuted to the maximum extent possible under the law.** This document was produced by AIA software at 11:09:38 on 05/24/2010 under Order No.0553161408\_1 which expires on 07/03/2010, and is not for resale.

User Notes:

(895711814)

completeness of the services, certifications and approvals performed or provided by such design professionals, provided the Owner and Architect have specified to the Contractor all performance and design criteria that such services must satisfy. Pursuant to this Section 3.12.10, the Architect will review, approve or take other appropriate action on submittals only for the limited purpose of checking for conformance with information given and the design concept expressed in the Contract Documents. The Contractor shall not be responsible for the adequacy of the performance and design criteria specified in the Contract Documents.

### § 3.13 USE OF SITE

The Contractor shall confine operations at the site to areas permitted by applicable laws, statutes, ordinances, codes, rules and regulations, and lawful orders of public authorities and the Contract Documents and shall not unreasonably encumber the site with materials or equipment.

### § 3.14 CUTTING AND PATCHING

§ 3.14.1 The Contractor shall be responsible for cutting, fitting or patching required to complete the Work or to make its parts fit together properly. All areas requiring cutting, fitting and patching shall be restored to the condition existing prior to the cutting, fitting and patching, unless otherwise required by the Contract Documents.

§ 3.14.2 The Contractor shall not damage or endanger a portion of the Work or fully or partially completed construction of the Owner or separate contractors by cutting, patching or otherwise altering such construction, or by excavation. The Contractor shall not cut or otherwise alter such construction by the Owner or a separate contractor except with written consent of the Owner and of such separate contractor; such consent shall not be unreasonably withheld. The Contractor shall not unreasonably withhold from the Owner or a separate contractor the Contractor's consent to cutting or otherwise altering the Work.

### § 3.15 CLEANING UP

§ 3.15.1 The Contractor shall keep the premises and surrounding area free from accumulation of waste materials or rubbish caused by operations under the Contract. At completion of the Work, the Contractor shall remove waste materials, rubbish, the Contractor's tools, construction equipment, machinery and surplus materials from and about the Project.

§ 3.15.2 If the Contractor fails to clean up as provided in the Contract Documents, the Owner may do so and Owner shall be entitled to reimbursement from the Contractor.

### § 3.16 ACCESS TO WORK

The Contractor shall provide the Owner and Architect access to the Work in preparation and progress wherever located.

### § 3.17 ROYALTIES, PATENTS AND COPYRIGHTS

The Contractor shall pay all royalties and license fees. The Contractor shall defend suits or claims for infringement of copyrights and patent rights and shall hold the Owner and Architect harmless from loss on account thereof, but shall not be responsible for such defense or loss when a particular design, process or product of a particular manufacturer or manufacturers is required by the Contract Documents, or where the copyright violations are contained in Drawings, Specifications or other documents prepared by the Owner or Architect. However, if the Contractor has reason to believe that the required design, process or product is an infringement of a copyright or a patent, the Contractor shall be responsible for such loss unless such information is promptly furnished to the Architect.

### § 3.18 INDEMNIFICATION

§ 3.18.1 To the fullest extent permitted by law the Contractor shall indemnify and hold harmless the Owner, Architect, Architect's consultants, and agents and employees of any of them from and against claims, damages, losses and expenses, including but not limited to attorneys' fees, arising out of or resulting from performance of the Work, provided that such claim, damage, loss or expense is attributable to bodily injury, sickness, disease or death, or to injury to or destruction of tangible property (other than the Work itself), but only to the extent caused by the negligent acts or omissions of the Contractor, a Subcontractor, anyone directly or indirectly employed by them or anyone for whose acts they may be liable, regardless of whether or not such claim, damage, loss or expense is caused in part by a party indemnified hereunder. Such obligation shall not be construed to negate, abridge, or reduce other rights or obligations of indemnity which would otherwise exist as to a party or person described in this Section 3.18.

Init.

§ 3.18.2 In claims against any person or entity indemnified under this Section 3.18 by an employee of the Contractor, a Subcontractor, anyone directly or indirectly employed by them or anyone for whose acts they may be liable, the indemnification obligation under Section 3.18.1 shall not be limited by a limitation on amount or type of damages, compensation or benefits payable by or for the Contractor or a Subcontractor under workers' compensation acts, disability benefit acts or other employee benefit acts.

#### ARTICLE 4 ARCHITECT

##### § 4.1 GENERAL

§ 4.1.1 The Owner shall retain an architect lawfully licensed to practice architecture or an entity lawfully practicing architecture in the jurisdiction where the Project is located. That person or entity is identified as the Architect in the Agreement and is referred to throughout the Contract Documents as if singular in number.

§ 4.1.2 Duties, responsibilities and limitations of authority of the Architect as set forth in the Contract Documents shall not be restricted, modified or extended without written consent of the Owner, Contractor and Architect. Consent shall not be unreasonably withheld.

§ 4.1.3 If the employment of the Architect is terminated, the Owner shall employ a successor architect as to whom the Contractor has no reasonable objection and whose status under the Contract Documents shall be that of the Architect.

##### § 4.2 ADMINISTRATION OF THE CONTRACT

§ 4.2.1 The Architect will provide administration of the Contract as described in the Contract Documents and will be an Owner's representative during construction until the date the Architect issues the final Certificate For Payment. The Architect will have authority to act on behalf of the Owner only to the extent provided in the Contract Documents.

§ 4.2.2 The Architect will visit the site at intervals appropriate to the stage of construction, or as otherwise agreed with the Owner, to become generally familiar with the progress and quality of the portion of the Work completed, and to determine in general if the Work observed is being performed in a manner indicating that the Work, when fully completed, will be in accordance with the Contract Documents. However, the Architect will not be required to make exhaustive or continuous on-site inspections to check the quality or quantity of the Work. The Architect will not have control over, charge of, or responsibility for, the construction means, methods, techniques, sequences or procedures, or for the safety precautions and programs in connection with the Work, since these are solely the Contractor's rights and responsibilities under the Contract Documents, except as provided in Section 3.3.1.

§ 4.2.3 On the basis of the site visits, the Architect will keep the Owner reasonably informed about the progress and quality of the portion of the Work completed, and report to the Owner (1) known deviations from the Contract Documents and from the most recent construction schedule submitted by the Contractor, and (2) defects and deficiencies observed in the Work. The Architect will not be responsible for the Contractor's failure to perform the Work in accordance with the requirements of the Contract Documents. The Architect will not have control over or charge of and will not be responsible for acts or omissions of the Contractor, Subcontractors, or their agents or employees, or any other persons or entities performing portions of the Work.

##### § 4.2.4 COMMUNICATIONS FACILITATING CONTRACT ADMINISTRATION

Except as otherwise provided in the Contract Documents or when direct communications have been specially authorized, the Owner and Contractor shall endeavor to communicate with each other through the Architect about matters arising out of or relating to the Contract. Communications by and with the Architect's consultants shall be through the Architect. Communications by and with Subcontractors and material suppliers shall be through the Contractor. Communications by and with separate contractors shall be through the Owner.

§ 4.2.5 Based on the Architect's evaluations of the Contractor's Applications for Payment, the Architect will review and certify the amounts due the Contractor and will issue Certificates for Payment in such amounts.

§ 4.2.6 The Architect has authority to reject Work that does not conform to the Contract Documents. Whenever the Architect considers it necessary or advisable, the Architect will have authority to require inspection or testing of the Work in accordance with Sections 13.5.2 and 13.5.3, whether or not such Work is fabricated, installed or completed. However, neither this authority of the Architect nor a decision made in good faith either to exercise or not to exercise such authority shall give rise to a duty or responsibility of the Architect to the Contractor, Subcontractors, material and equipment suppliers, their agents or employees, or other persons or entities performing portions of the Work.

Init.

§ 4.2.7 The Architect will review and approve, or take other appropriate action upon, the Contractor's submittals such as Shop Drawings, Product Data and Samples, but only for the limited purpose of checking for conformance with information given and the design concept expressed in the Contract Documents. The Architect's action will be taken in accordance with the submittal schedule approved by the Architect or, in the absence of an approved submittal schedule, with reasonable promptness while allowing sufficient time in the Architect's professional judgment to permit adequate review. Review of such submittals is not conducted for the purpose of determining the accuracy and completeness of other details such as dimensions and quantities, or for substantiating instructions for installation or performance of equipment or systems, all of which remain the responsibility of the Contractor as required by the Contract Documents. The Architect's review of the Contractor's submittals shall not relieve the Contractor of the obligations under Sections 3.3, 3.5 and 3.12. The Architect's review shall not constitute approval of safety precautions or, unless otherwise specifically stated by the Architect, of any construction means, methods, techniques, sequences or procedures. The Architect's approval of a specific item shall not indicate approval of an assembly of which the item is a component.

§ 4.2.8 The Architect will prepare Change Orders and Construction Change Directives, and may authorize minor changes in the Work as provided in Section 7.4. The Architect will investigate and make determinations and recommendations regarding concealed and unknown conditions as provided in Section 3.7.4.

§ 4.2.9 The Architect will conduct inspections to determine the date or dates of Substantial Completion and the date of final completion; issue Certificates of Substantial Completion pursuant to Section 9.8; receive and forward to the Owner, for the Owner's review and records, written warranties and related documents required by the Contract and assembled by the Contractor pursuant to Section 9.10; and issue a final Certificate for Payment pursuant to Section 9.10.

§ 4.2.10 If the Owner and Architect agree, the Architect will provide one or more project representatives to assist in carrying out the Architect's responsibilities at the site. The duties, responsibilities and limitations of authority of such project representatives shall be as set forth in an exhibit to be incorporated in the Contract Documents.

§ 4.2.11 The Architect will interpret and decide matters concerning performance under, and requirements of, the Contract Documents on written request of either the Owner or Contractor. The Architect's response to such requests will be made in writing within any time limits agreed upon or otherwise with reasonable promptness.

§ 4.2.12 Interpretations and decisions of the Architect will be consistent with the intent of, and reasonably inferable from, the Contract Documents and will be in writing or in the form of drawings. When making such interpretations and decisions, the Architect will endeavor to secure faithful performance by both Owner and Contractor, will not show partiality to either and will not be liable for results of interpretations or decisions rendered in good faith.

§ 4.2.13 The Architect's decisions on matters relating to aesthetic effect will be final if consistent with the intent expressed in the Contract Documents.

§ 4.2.14 The Architect will review and respond to requests for information about the Contract Documents. The Architect's response to such requests will be made in writing within any time limits agreed upon or otherwise with reasonable promptness. If appropriate, the Architect will prepare and issue supplemental Drawings and Specifications in response to the requests for information.

## ARTICLE 5 SUBCONTRACTORS

### § 5.1 DEFINITIONS

§ 5.1.1 A Subcontractor is a person or entity who has a direct contract with the Contractor to perform a portion of the Work at the site. The term "Subcontractor" is referred to throughout the Contract Documents as if singular in number and means a Subcontractor or an authorized representative of the Subcontractor. The term "Subcontractor" does not include a separate contractor or subcontractors of a separate contractor.

§ 5.1.2 A Sub-subcontractor is a person or entity who has a direct or indirect contract with a Subcontractor to perform a portion of the Work at the site. The term "Sub-subcontractor" is referred to throughout the Contract Documents as if singular in number and means a Sub-subcontractor or an authorized representative of the Sub-subcontractor.

Init.

## § 5.2 AWARD OF SUBCONTRACTS AND OTHER CONTRACTS FOR PORTIONS OF THE WORK

§ 5.2.1 Unless otherwise stated in the Contract Documents or the bidding requirements, the Contractor, as soon as practicable after award of the Contract, shall furnish in writing to the Owner through the Architect the names of persons or entities (including those who are to furnish materials or equipment fabricated to a special design) proposed for each principal portion of the Work. The Architect may reply within 14 days to the Contractor in writing stating (1) whether the Owner or the Architect has reasonable objection to any such proposed person or entity or (2) that the Architect requires additional time for review. Failure of the Owner or Architect to reply within the 14 day period shall constitute notice of no reasonable objection.

§ 5.2.2 The Contractor shall not contract with a proposed person or entity to whom the Owner or Architect has made reasonable and timely objection. The Contractor shall not be required to contract with anyone to whom the Contractor has made reasonable objection.

§ 5.2.3 If the Owner or Architect has reasonable objection to a person or entity proposed by the Contractor, the Contractor shall propose another to whom the Owner or Architect has no reasonable objection. If the proposed but rejected Subcontractor was reasonably capable of performing the Work, the Contract Sum and Contract Time shall be increased or decreased by the difference, if any, occasioned by such change, and an appropriate Change Order shall be issued before commencement of the substitute Subcontractor's Work. However, no increase in the Contract Sum or Contract Time shall be allowed for such change unless the Contractor has acted promptly and responsively in submitting names as required.

§ 5.2.4 The Contractor shall not substitute a Subcontractor, person or entity previously selected if the Owner or Architect makes reasonable objection to such substitution.

## § 5.3 SUBCONTRACTUAL RELATIONS

By appropriate agreement, written where legally required for validity, the Contractor shall require each Subcontractor, to the extent of the Work to be performed by the Subcontractor, to be bound to the Contractor by terms of the Contract Documents, and to assume toward the Contractor all the obligations and responsibilities, including the responsibility for safety of the Subcontractor's Work, which the Contractor, by these Documents, assumes toward the Owner and Architect. Each subcontract agreement shall preserve and protect the rights of the Owner and Architect under the Contract Documents with respect to the Work to be performed by the Subcontractor so that subcontracting thereof will not prejudice such rights, and shall allow to the Subcontractor, unless specifically provided otherwise in the subcontract agreement, the benefit of all rights, remedies and redress against the Contractor that the Contractor, by the Contract Documents, has against the Owner. Where appropriate, the Contractor shall require each Subcontractor to enter into similar agreements with Sub-subcontractors. The Contractor shall make available to each proposed Subcontractor, prior to the execution of the subcontract agreement, copies of the Contract Documents to which the Subcontractor will be bound, and, upon written request of the Subcontractor, identify to the Subcontractor terms and conditions of the proposed subcontract agreement that may be at variance with the Contract Documents. Subcontractors will similarly make copies of applicable portions of such documents available to their respective proposed Sub-subcontractors.

## § 5.4 CONTINGENT ASSIGNMENT OF SUBCONTRACTS

§ 5.4.1 Each subcontract agreement for a portion of the Work is assigned by the Contractor to the Owner, provided that

- .1 assignment is effective only after termination of the Contract by the Owner for cause pursuant to Section 14.2 and only for those subcontract agreements that the Owner accepts by notifying the Subcontractor and Contractor in writing; and
- .2 assignment is subject to the prior rights of the surety, if any, obligated under bond relating to the Contract.

When the Owner accepts the assignment of a subcontract agreement, the Owner assumes the Contractor's rights and obligations under the subcontract.

§ 5.4.2 Upon such assignment, if the Work has been suspended for more than 30 days, the Subcontractor's compensation shall be equitably adjusted for increases in cost resulting from the suspension.

§ 5.4.3 Upon such assignment to the Owner under this Section 5.4, the Owner may further assign the subcontract to a successor contractor or other entity. If the Owner assigns the subcontract to a successor contractor or other entity, the

Init.



Owner shall nevertheless remain legally responsible for all of the successor contractor's obligations under the subcontract.

## **ARTICLE 6 CONSTRUCTION BY OWNER OR BY SEPARATE CONTRACTORS**

### **§ 6.1 OWNER'S RIGHT TO PERFORM CONSTRUCTION AND TO AWARD SEPARATE CONTRACTS**

**§ 6.1.1** The Owner reserves the right to perform construction or operations related to the Project with the Owner's own forces, and to award separate contracts in connection with other portions of the Project or other construction or operations on the site under Conditions of the Contract identical or substantially similar to these including those portions related to insurance and waiver of subrogation. If the Contractor claims that delay or additional cost is involved because of such action by the Owner, the Contractor shall make such Claim as provided in Article 15.

**§ 6.1.2** When separate contracts are awarded for different portions of the Project or other construction or operations on the site, the term "Contractor" in the Contract Documents in each case shall mean the Contractor who executes each separate Owner-Contractor Agreement.

**§ 6.1.3** The Owner shall provide for coordination of the activities of the Owner's own forces and of each separate contractor with the Work of the Contractor, who shall cooperate with them. The Contractor shall participate with other separate contractors and the Owner in reviewing their construction schedules. The Contractor shall make any revisions to the construction schedule deemed necessary after a joint review and mutual agreement. The construction schedules shall then constitute the schedules to be used by the Contractor, separate contractors and the Owner until subsequently revised.

**§ 6.1.4** Unless otherwise provided in the Contract Documents, when the Owner performs construction or operations related to the Project with the Owner's own forces, the Owner shall be deemed to be subject to the same obligations and to have the same rights that apply to the Contractor under the Conditions of the Contract, including, without excluding others, those stated in Article 3, this Article 6 and Articles 10, 11 and 12.

### **§ 6.2 MUTUAL RESPONSIBILITY**

**§ 6.2.1** The Contractor shall afford the Owner and separate contractors reasonable opportunity for introduction and storage of their materials and equipment and performance of their activities, and shall connect and coordinate the Contractor's construction and operations with theirs as required by the Contract Documents.

**§ 6.2.2** If part of the Contractor's Work depends for proper execution or results upon construction or operations by the Owner or a separate contractor, the Contractor shall, prior to proceeding with that portion of the Work, promptly report to the Architect apparent discrepancies or defects in such other construction that would render it unsuitable for such proper execution and results. Failure of the Contractor so to report shall constitute an acknowledgment that the Owner's or separate contractor's completed or partially completed construction is fit and proper to receive the Contractor's Work, except as to defects not then reasonably discoverable.

**§ 6.2.3** The Contractor shall reimburse the Owner for costs the Owner incurs that are payable to a separate contractor because of the Contractor's delays, improperly timed activities or defective construction. The Owner shall be responsible to the Contractor for costs the Contractor incurs because of a separate contractor's delays, improperly timed activities, damage to the Work or defective construction.

**§ 6.2.4** The Contractor shall promptly remedy damage the Contractor wrongfully causes to completed or partially completed construction or to property of the Owner or separate contractors as provided in Section 10.2.5.

**§ 6.2.5** The Owner and each separate contractor shall have the same responsibilities for cutting and patching as are described for the Contractor in Section 3.14.

### **§ 6.3 OWNER'S RIGHT TO CLEAN UP**

If a dispute arises among the Contractor, separate contractors and the Owner as to the responsibility under their respective contracts for maintaining the premises and surrounding area free from waste materials and rubbish, the Owner may clean up and the Architect will allocate the cost among those responsible.

**ARTICLE 7 CHANGES IN THE WORK****§ 7.1 GENERAL**

§ 7.1.1 Changes in the Work may be accomplished after execution of the Contract, and without invalidating the Contract, by Change Order, Construction Change Directive or order for a minor change in the Work, subject to the limitations stated in this Article 7 and elsewhere in the Contract Documents.

§ 7.1.2 A Change Order shall be based upon agreement among the Owner, Contractor and Architect; a Construction Change Directive requires agreement by the Owner and Architect and may or may not be agreed to by the Contractor; an order for a minor change in the Work may be issued by the Architect alone.

§ 7.1.3 Changes in the Work shall be performed under applicable provisions of the Contract Documents, and the Contractor shall proceed promptly, unless otherwise provided in the Change Order, Construction Change Directive or order for a minor change in the Work.

**§ 7.2 CHANGE ORDERS**

§ 7.2.1 A Change Order is a written instrument prepared by the Architect and signed by the Owner, Contractor and Architect stating their agreement upon all of the following:

- .1 The change in the Work;
- .2 The amount of the adjustment, if any, in the Contract Sum; and
- .3 The extent of the adjustment, if any, in the Contract Time.

**§ 7.3 CONSTRUCTION CHANGE DIRECTIVES**

§ 7.3.1 A Construction Change Directive is a written order prepared by the Architect and signed by the Owner and Architect, directing a change in the Work prior to agreement on adjustment, if any, in the Contract Sum or Contract Time, or both. The Owner may by Construction Change Directive, without invalidating the Contract, order changes in the Work within the general scope of the Contract consisting of additions, deletions or other revisions, the Contract Sum and Contract Time being adjusted accordingly.

§ 7.3.2 A Construction Change Directive shall be used in the absence of total agreement on the terms of a Change Order.

§ 7.3.3 If the Construction Change Directive provides for an adjustment to the Contract Sum, the adjustment shall be based on one of the following methods:

- .1 Mutual acceptance of a lump sum properly itemized and supported by sufficient substantiating data to permit evaluation;
- .2 Unit prices stated in the Contract Documents or subsequently agreed upon;
- .3 Cost to be determined in a manner agreed upon by the parties and a mutually acceptable fixed or percentage fee; or
- .4 As provided in Section 7.3.7.

§ 7.3.4 If unit prices are stated in the Contract Documents or subsequently agreed upon, and if quantities originally contemplated are materially changed in a proposed Change Order or Construction Change Directive so that application of such unit prices to quantities of Work proposed will cause substantial inequity to the Owner or Contractor, the applicable unit prices shall be equitably adjusted.

§ 7.3.5 Upon receipt of a Construction Change Directive, the Contractor shall promptly proceed with the change in the Work involved and advise the Architect of the Contractor's agreement or disagreement with the method, if any, provided in the Construction Change Directive for determining the proposed adjustment in the Contract Sum or Contract Time.

§ 7.3.6 A Construction Change Directive signed by the Contractor indicates the Contractor's agreement therewith, including adjustment in Contract Sum and Contract Time or the method for determining them. Such agreement shall be effective immediately and shall be recorded as a Change Order.

§ 7.3.7 If the Contractor does not respond promptly or disagrees with the method for adjustment in the Contract Sum, the Architect shall determine the method and the adjustment on the basis of reasonable expenditures and savings of those performing the Work attributable to the change, including, in case of an increase in the Contract Sum, an amount

Init.

for overhead and profit as set forth in the Agreement, or if no such amount is set forth in the Agreement, a reasonable amount. In such case, and also under Section 7.3.3.3, the Contractor shall keep and present, in such form as the Architect may prescribe, an itemized accounting together with appropriate supporting data. Unless otherwise provided in the Contract Documents, costs for the purposes of this Section 7.3.7 shall be limited to the following:

- .1 Costs of labor, including social security, old age and unemployment insurance, fringe benefits required by agreement or custom, and workers' compensation insurance;
- .2 Costs of materials, supplies and equipment, including cost of transportation, whether incorporated or consumed;
- .3 Rental costs of machinery and equipment, exclusive of hand tools, whether rented from the Contractor or others;
- .4 Costs of premiums for all bonds and insurance, permit fees, and sales, use or similar taxes related to the Work; and
- .5 Additional costs of supervision and field office personnel directly attributable to the change.

§ 7.3.8 The amount of credit to be allowed by the Contractor to the Owner for a deletion or change that results in a net decrease in the Contract Sum shall be actual net cost as confirmed by the Architect. When both additions and credits covering related Work or substitutions are involved in a change, the allowance for overhead and profit shall be figured on the basis of net increase, if any, with respect to that change.

§ 7.3.9 Pending final determination of the total cost of a Construction Change Directive to the Owner, the Contractor may request payment for Work completed under the Construction Change Directive in Applications for Payment. The Architect will make an interim determination for purposes of monthly certification for payment for those costs and certify for payment the amount that the Architect determines, in the Architect's professional judgment, to be reasonably justified. The Architect's interim determination of cost shall adjust the Contract Sum on the same basis as a Change Order, subject to the right of either party to disagree and assert a Claim in accordance with Article 15.

§ 7.3.10 When the Owner and Contractor agree with a determination made by the Architect concerning the adjustments in the Contract Sum and Contract Time, or otherwise reach agreement upon the adjustments, such agreement shall be effective immediately and the Architect will prepare a Change Order. Change Orders may be issued for all or any part of a Construction Change Directive.

#### § 7.4 MINOR CHANGES IN THE WORK

The Architect has authority to order minor changes in the Work not involving adjustment in the Contract Sum or extension of the Contract Time and not inconsistent with the intent of the Contract Documents. Such changes will be effected by written order signed by the Architect and shall be binding on the Owner and Contractor.

### ARTICLE 8 TIME

#### § 8.1 DEFINITIONS

§ 8.1.1 Unless otherwise provided, Contract Time is the period of time, including authorized adjustments, allotted in the Contract Documents for Substantial Completion of the Work.

§ 8.1.2 The date of commencement of the Work is the date established in the Agreement.

§ 8.1.3 The date of Substantial Completion is the date certified by the Architect in accordance with Section 9.8.

§ 8.1.4 The term "day" as used in the Contract Documents shall mean calendar day unless otherwise specifically defined.

#### § 8.2 PROGRESS AND COMPLETION

§ 8.2.1 Time limits stated in the Contract Documents are of the essence of the Contract. By executing the Agreement the Contractor confirms that the Contract Time is a reasonable period for performing the Work.

§ 8.2.2 The Contractor shall not knowingly, except by agreement or instruction of the Owner in writing, prematurely commence operations on the site or elsewhere prior to the effective date of insurance required by Article 11 to be furnished by the Contractor and Owner. The date of commencement of the Work shall not be changed by the effective date of such insurance.

Init.

§ 8.2.3 The Contractor shall proceed expeditiously with adequate forces and shall achieve Substantial Completion within the Contract Time.

### § 8.3 DELAYS AND EXTENSIONS OF TIME

§ 8.3.1 If the Contractor is delayed at any time in the commencement or progress of the Work by an act or neglect of the Owner or Architect, or of an employee of either, or of a separate contractor employed by the Owner; or by changes ordered in the Work; or by labor disputes, fire, unusual delay in deliveries, unavoidable casualties or other causes beyond the Contractor's control; or by delay authorized by the Owner pending mediation and arbitration; or by other causes that the Architect determines may justify delay, then the Contract Time shall be extended by Change Order for such reasonable time as the Architect may determine.

§ 8.3.2 Claims relating to time shall be made in accordance with applicable provisions of Article 15.

§ 8.3.3 This Section 8.3 does not preclude recovery of damages for delay by either party under other provisions of the Contract Documents.

## ARTICLE 9 PAYMENTS AND COMPLETION

### § 9.1 CONTRACT SUM

The Contract Sum is stated in the Agreement and, including authorized adjustments, is the total amount payable by the Owner to the Contractor for performance of the Work under the Contract Documents.

### § 9.2 SCHEDULE OF VALUES

Where the Contract is based on a stipulated sum or Guaranteed Maximum Price, the Contractor shall submit to the Architect, before the first Application for Payment, a schedule of values allocating the entire Contract Sum to the various portions of the Work and prepared in such form and supported by such data to substantiate its accuracy as the Architect may require. This schedule, unless objected to by the Architect, shall be used as a basis for reviewing the Contractor's Applications for Payment.

### § 9.3 APPLICATIONS FOR PAYMENT

§ 9.3.1 At least ten days before the date established for each progress payment, the Contractor shall submit to the Architect an itemized Application for Payment prepared in accordance with the schedule of values, if required under Section 9.2., for completed portions of the Work. Such application shall be notarized, if required, and supported by such data substantiating the Contractor's right to payment as the Owner or Architect may require, such as copies of requisitions from Subcontractors and material suppliers, and shall reflect retainage if provided for in the Contract Documents.

§ 9.3.1.1 As provided in Section 7.3.9, such applications may include requests for payment on account of changes in the Work that have been properly authorized by Construction Change Directives, or by interim determinations of the Architect, but not yet included in Change Orders.

§ 9.3.1.2 Applications for Payment shall not include requests for payment for portions of the Work for which the Contractor does not intend to pay a Subcontractor or material supplier, unless such Work has been performed by others whom the Contractor intends to pay.

§ 9.3.2 Unless otherwise provided in the Contract Documents, payments shall be made on account of materials and equipment delivered and suitably stored at the site for subsequent incorporation in the Work. If approved in advance by the Owner, payment may similarly be made for materials and equipment suitably stored off the site at a location agreed upon in writing. Payment for materials and equipment stored on or off the site shall be conditioned upon compliance by the Contractor with procedures satisfactory to the Owner to establish the Owner's title to such materials and equipment or otherwise protect the Owner's interest, and shall include the costs of applicable insurance, storage and transportation to the site for such materials and equipment stored off the site.

§ 9.3.3 The Contractor warrants that title to all Work covered by an Application for Payment will pass to the Owner no later than the time of payment. The Contractor further warrants that upon submittal of an Application for Payment all Work for which Certificates for Payment have been previously issued and payments received from the Owner shall, to the best of the Contractor's knowledge, information and belief, be free and clear of liens, claims, security interests or

Init.

encumbrances in favor of the Contractor, Subcontractors, material suppliers, or other persons or entities making a claim by reason of having provided labor, materials and equipment relating to the Work.

#### § 9.4 CERTIFICATES FOR PAYMENT

§ 9.4.1 The Architect will, within seven days after receipt of the Contractor's Application for Payment, either issue to the Owner a Certificate for Payment, with a copy to the Contractor, for such amount as the Architect determines is properly due, or notify the Contractor and Owner in writing of the Architect's reasons for withholding certification in whole or in part as provided in Section 9.5.1.

§ 9.4.2 The issuance of a Certificate for Payment will constitute a representation by the Architect to the Owner, based on the Architect's evaluation of the Work and the data comprising the Application for Payment, that, to the best of the Architect's knowledge, information and belief, the Work has progressed to the point indicated and that the quality of the Work is in accordance with the Contract Documents. The foregoing representations are subject to an evaluation of the Work for conformance with the Contract Documents upon Substantial Completion, to results of subsequent tests and inspections, to correction of minor deviations from the Contract Documents prior to completion and to specific qualifications expressed by the Architect. The issuance of a Certificate for Payment will further constitute a representation that the Contractor is entitled to payment in the amount certified. However, the issuance of a Certificate for Payment will not be a representation that the Architect has (1) made exhaustive or continuous on-site inspections to check the quality or quantity of the Work, (2) reviewed construction means, methods, techniques, sequences or procedures, (3) reviewed copies of requisitions received from Subcontractors and material suppliers and other data requested by the Owner to substantiate the Contractor's right to payment, or (4) made examination to ascertain how or for what purpose the Contractor has used money previously paid on account of the Contract Sum.

#### § 9.5 DECISIONS TO WITHHOLD CERTIFICATION

§ 9.5.1 The Architect may withhold a Certificate for Payment in whole or in part, to the extent reasonably necessary to protect the Owner, if in the Architect's opinion the representations to the Owner required by Section 9.4.2 cannot be made. If the Architect is unable to certify payment in the amount of the Application, the Architect will notify the Contractor and Owner as provided in Section 9.4.1. If the Contractor and Architect cannot agree on a revised amount, the Architect will promptly issue a Certificate for Payment for the amount for which the Architect is able to make such representations to the Owner. The Architect may also withhold a Certificate for Payment or, because of subsequently discovered evidence, may nullify the whole or a part of a Certificate for Payment previously issued, to such extent as may be necessary in the Architect's opinion to protect the Owner from loss for which the Contractor is responsible, including loss resulting from acts and omissions described in Section 3.3.2, because of

- .1 defective Work not remedied;
- .2 third party claims filed or reasonable evidence indicating probable filing of such claims unless security acceptable to the Owner is provided by the Contractor;
- .3 failure of the Contractor to make payments properly to Subcontractors or for labor, materials or equipment;
- .4 reasonable evidence that the Work cannot be completed for the unpaid balance of the Contract Sum;
- .5 damage to the Owner or a separate contractor;
- .6 reasonable evidence that the Work will not be completed within the Contract Time, and that the unpaid balance would not be adequate to cover actual or liquidated damages for the anticipated delay; or
- .7 repeated failure to carry out the Work in accordance with the Contract Documents.

§ 9.5.2 When the above reasons for withholding certification are removed, certification will be made for amounts previously withheld.

§ 9.5.3 If the Architect withholds certification for payment under Section 9.5.1.3, the Owner may, at its sole option, issue joint checks to the Contractor and to any Subcontractor or material or equipment suppliers to whom the Contractor failed to make payment for Work properly performed or material or equipment suitably delivered. If the Owner makes payments by joint check, the Owner shall notify the Architect and the Architect will reflect such payment on the next Certificate for Payment.

#### § 9.6 PROGRESS PAYMENTS

§ 9.6.1 After the Architect has issued a Certificate for Payment, the Owner shall make payment in the manner and within the time provided in the Contract Documents, and shall so notify the Architect.

Init.

AIA Document A201™ – 2007. Copyright © 1911, 1915, 1918, 1925, 1937, 1951, 1958, 1961, 1963, 1966, 1970, 1976, 1987, 1997 and 2007 by The American Institute of Architects. All rights reserved. **WARNING: This AIA® Document is protected by U.S. Copyright Law and International Treaties. Unauthorized reproduction or distribution of this AIA® Document, or any portion of it, may result in severe civil and criminal penalties, and will be prosecuted to the maximum extent possible under the law.** This document was produced by AIA software at 11:09:38 on 05/24/2010 under Order No.0553161408\_1 which expires on 07/03/2010, and is not for resale.

User Notes:

(895711814)

§ 9.6.2 The Contractor shall pay each Subcontractor no later than seven days after receipt of payment from the Owner the amount to which the Subcontractor is entitled, reflecting percentages actually retained from payments to the Contractor on account of the Subcontractor's portion of the Work. The Contractor shall, by appropriate agreement with each Subcontractor, require each Subcontractor to make payments to Sub-subcontractors in a similar manner.

§ 9.6.3 The Architect will, on request, furnish to a Subcontractor, if practicable, information regarding percentages of completion or amounts applied for by the Contractor and action taken thereon by the Architect and Owner on account of portions of the Work done by such Subcontractor.

§ 9.6.4 The Owner has the right to request written evidence from the Contractor that the Contractor has properly paid Subcontractors and material and equipment suppliers amounts paid by the Owner to the Contractor for subcontracted Work. If the Contractor fails to furnish such evidence within seven days, the Owner shall have the right to contact Subcontractors to ascertain whether they have been properly paid. Neither the Owner nor Architect shall have an obligation to pay or to see to the payment of money to a Subcontractor, except as may otherwise be required by law.

§ 9.6.5 Contractor payments to material and equipment suppliers shall be treated in a manner similar to that provided in Sections 9.6.2, 9.6.3 and 9.6.4.

§ 9.6.6 A Certificate for Payment, a progress payment, or partial or entire use or occupancy of the Project by the Owner shall not constitute acceptance of Work not in accordance with the Contract Documents.

§ 9.6.7 Unless the Contractor provides the Owner with a payment bond in the full penal sum of the Contract Sum, payments received by the Contractor for Work properly performed by Subcontractors and suppliers shall be held by the Contractor for those Subcontractors or suppliers who performed Work or furnished materials, or both, under contract with the Contractor for which payment was made by the Owner. Nothing contained herein shall require money to be placed in a separate account and not commingled with money of the Contractor, shall create any fiduciary liability or tort liability on the part of the Contractor for breach of trust or shall entitle any person or entity to an award of punitive damages against the Contractor for breach of the requirements of this provision.

#### § 9.7 FAILURE OF PAYMENT

If the Architect does not issue a Certificate for Payment, through no fault of the Contractor, within seven days after receipt of the Contractor's Application for Payment, or if the Owner does not pay the Contractor within seven days after the date established in the Contract Documents the amount certified by the Architect or awarded by binding dispute resolution, then the Contractor may, upon seven additional days' written notice to the Owner and Architect, stop the Work until payment of the amount owing has been received. The Contract Time shall be extended appropriately and the Contract Sum shall be increased by the amount of the Contractor's reasonable costs of shut-down, delay and start-up, plus interest as provided for in the Contract Documents.

#### § 9.8 SUBSTANTIAL COMPLETION

§ 9.8.1 Substantial Completion is the stage in the progress of the Work when the Work or designated portion thereof is sufficiently complete in accordance with the Contract Documents so that the Owner can occupy or utilize the Work for its intended use.

§ 9.8.2 When the Contractor considers that the Work, or a portion thereof which the Owner agrees to accept separately, is substantially complete, the Contractor shall prepare and submit to the Architect a comprehensive list of items to be completed or corrected prior to final payment. Failure to include an item on such list does not alter the responsibility of the Contractor to complete all Work in accordance with the Contract Documents.

§ 9.8.3 Upon receipt of the Contractor's list, the Architect will make an inspection to determine whether the Work or designated portion thereof is substantially complete. If the Architect's inspection discloses any item, whether or not included on the Contractor's list, which is not sufficiently complete in accordance with the Contract Documents so that the Owner can occupy or utilize the Work or designated portion thereof for its intended use, the Contractor shall, before issuance of the Certificate of Substantial Completion, complete or correct such item upon notification by the Architect. In such case, the Contractor shall then submit a request for another inspection by the Architect to determine Substantial Completion.

Init.

/

§ 9.8.4 When the Work or designated portion thereof is substantially complete, the Architect will prepare a Certificate of Substantial Completion that shall establish the date of Substantial Completion, shall establish responsibilities of the Owner and Contractor for security, maintenance, heat, utilities, damage to the Work and insurance, and shall fix the time within which the Contractor shall finish all items on the list accompanying the Certificate. Warranties required by the Contract Documents shall commence on the date of Substantial Completion of the Work or designated portion thereof unless otherwise provided in the Certificate of Substantial Completion.

§ 9.8.5 The Certificate of Substantial Completion shall be submitted to the Owner and Contractor for their written acceptance of responsibilities assigned to them in such Certificate. Upon such acceptance and consent of surety, if any, the Owner shall make payment of retainage applying to such Work or designated portion thereof. Such payment shall be adjusted for Work that is incomplete or not in accordance with the requirements of the Contract Documents.

#### § 9.9 PARTIAL OCCUPANCY OR USE

§ 9.9.1 The Owner may occupy or use any completed or partially completed portion of the Work at any stage when such portion is designated by separate agreement with the Contractor, provided such occupancy or use is consented to by the insurer as required under Section 11.3.1.5 and authorized by public authorities having jurisdiction over the Project. Such partial occupancy or use may commence whether or not the portion is substantially complete, provided the Owner and Contractor have accepted in writing the responsibilities assigned to each of them for payments, retainage, if any, security, maintenance, heat, utilities, damage to the Work and insurance, and have agreed in writing concerning the period for correction of the Work and commencement of warranties required by the Contract Documents. When the Contractor considers a portion substantially complete, the Contractor shall prepare and submit a list to the Architect as provided under Section 9.8.2. Consent of the Contractor to partial occupancy or use shall not be unreasonably withheld. The stage of the progress of the Work shall be determined by written agreement between the Owner and Contractor or, if no agreement is reached, by decision of the Architect.

§ 9.9.2 Immediately prior to such partial occupancy or use, the Owner, Contractor and Architect shall jointly inspect the area to be occupied or portion of the Work to be used in order to determine and record the condition of the Work.

§ 9.9.3 Unless otherwise agreed upon, partial occupancy or use of a portion or portions of the Work shall not constitute acceptance of Work not complying with the requirements of the Contract Documents.

#### § 9.10 FINAL COMPLETION AND FINAL PAYMENT

§ 9.10.1 Upon receipt of the Contractor's written notice that the Work is ready for final inspection and acceptance and upon receipt of a final Application for Payment, the Architect will promptly make such inspection and, when the Architect finds the Work acceptable under the Contract Documents and the Contract fully performed, the Architect will promptly issue a final Certificate for Payment stating that to the best of the Architect's knowledge, information and belief, and on the basis of the Architect's on-site visits and inspections, the Work has been completed in accordance with terms and conditions of the Contract Documents and that the entire balance found to be due the Contractor and noted in the final Certificate is due and payable. The Architect's final Certificate for Payment will constitute a further representation that conditions listed in Section 9.10.2 as precedent to the Contractor's being entitled to final payment have been fulfilled.

§ 9.10.2 Neither final payment nor any remaining retained percentage shall become due until the Contractor submits to the Architect (1) an affidavit that payrolls, bills for materials and equipment, and other indebtedness connected with the Work for which the Owner or the Owner's property might be responsible or encumbered (less amounts withheld by Owner) have been paid or otherwise satisfied, (2) a certificate evidencing that insurance required by the Contract Documents to remain in force after final payment is currently in effect and will not be canceled or allowed to expire until at least 30 days' prior written notice has been given to the Owner, (3) a written statement that the Contractor knows of no substantial reason that the insurance will not be renewable to cover the period required by the Contract Documents, (4) consent of surety, if any, to final payment and (5), if required by the Owner, other data establishing payment or satisfaction of obligations, such as receipts, releases and waivers of liens, claims, security interests or encumbrances arising out of the Contract, to the extent and in such form as may be designated by the Owner. If a Subcontractor refuses to furnish a release or waiver required by the Owner, the Contractor may furnish a bond satisfactory to the Owner to indemnify the Owner against such lien. If such lien remains unsatisfied after payments are made, the Contractor shall refund to the Owner all money that the Owner may be compelled to pay in discharging such lien, including all costs and reasonable attorneys' fees.

§ 9.10.3 If, after Substantial Completion of the Work, final completion thereof is materially delayed through no fault of the Contractor or by issuance of Change Orders affecting final completion, and the Architect so confirms, the Owner shall, upon application by the Contractor and certification by the Architect, and without terminating the Contract, make payment of the balance due for that portion of the Work fully completed and accepted. If the remaining balance for Work not fully completed or corrected is less than retainage stipulated in the Contract Documents, and if bonds have been furnished, the written consent of surety to payment of the balance due for that portion of the Work fully completed and accepted shall be submitted by the Contractor to the Architect prior to certification of such payment. Such payment shall be made under terms and conditions governing final payment, except that it shall not constitute a waiver of claims.

§ 9.10.4 The making of final payment shall constitute a waiver of Claims by the Owner except those arising from

- .1 liens, Claims, security interests or encumbrances arising out of the Contract and unsettled;
- .2 failure of the Work to comply with the requirements of the Contract Documents; or
- .3 terms of special warranties required by the Contract Documents.

§ 9.10.5 Acceptance of final payment by the Contractor, a Subcontractor or material supplier shall constitute a waiver of claims by that payee except those previously made in writing and identified by that payee as unsettled at the time of final Application for Payment.

## ARTICLE 10 PROTECTION OF PERSONS AND PROPERTY

### § 10.1 SAFETY PRECAUTIONS AND PROGRAMS

The Contractor shall be responsible for initiating, maintaining and supervising all safety precautions and programs in connection with the performance of the Contract.

### § 10.2 SAFETY OF PERSONS AND PROPERTY

§ 10.2.1 The Contractor shall take reasonable precautions for safety of, and shall provide reasonable protection to prevent damage, injury or loss to

- .1 employees on the Work and other persons who may be affected thereby;
- .2 the Work and materials and equipment to be incorporated therein, whether in storage on or off the site, under care, custody or control of the Contractor or the Contractor's Subcontractors or Sub-subcontractors; and
- .3 other property at the site or adjacent thereto, such as trees, shrubs, lawns, walks, pavements, roadways, structures and utilities not designated for removal, relocation or replacement in the course of construction.

§ 10.2.2 The Contractor shall comply with and give notices required by applicable laws, statutes, ordinances, codes, rules and regulations, and lawful orders of public authorities bearing on safety of persons or property or their protection from damage, injury or loss.

§ 10.2.3 The Contractor shall erect and maintain, as required by existing conditions and performance of the Contract, reasonable safeguards for safety and protection, including posting danger signs and other warnings against hazards, promulgating safety regulations and notifying owners and users of adjacent sites and utilities.

§ 10.2.4 When use or storage of explosives or other hazardous materials or equipment or unusual methods are necessary for execution of the Work, the Contractor shall exercise utmost care and carry on such activities under supervision of properly qualified personnel.

§ 10.2.5 The Contractor shall promptly remedy damage and loss (other than damage or loss insured under property insurance required by the Contract Documents) to property referred to in Sections 10.2.1.2 and 10.2.1.3 caused in whole or in part by the Contractor, a Subcontractor, a Sub-subcontractor, or anyone directly or indirectly employed by any of them, or by anyone for whose acts they may be liable and for which the Contractor is responsible under Sections 10.2.1.2 and 10.2.1.3, except damage or loss attributable to acts or omissions of the Owner or Architect or anyone directly or indirectly employed by either of them, or by anyone for whose acts either of them may be liable, and not attributable to the fault or negligence of the Contractor. The foregoing obligations of the Contractor are in addition to the Contractor's obligations under Section 3.18.

Init.



§ 10.2.6 The Contractor shall designate a responsible member of the Contractor's organization at the site whose duty shall be the prevention of accidents. This person shall be the Contractor's superintendent unless otherwise designated by the Contractor in writing to the Owner and Architect.

§ 10.2.7 The Contractor shall not permit any part of the construction or site to be loaded so as to cause damage or create an unsafe condition.

**§ 10.2.8 INJURY OR DAMAGE TO PERSON OR PROPERTY**

If either party suffers injury or damage to person or property because of an act or omission of the other party, or of others for whose acts such party is legally responsible, written notice of such injury or damage, whether or not insured, shall be given to the other party within a reasonable time not exceeding 21 days after discovery. The notice shall provide sufficient detail to enable the other party to investigate the matter.

**§ 10.3 HAZARDOUS MATERIALS**

§ 10.3.1 The Contractor is responsible for compliance with any requirements included in the Contract Documents regarding hazardous materials. If the Contractor encounters a hazardous material or substance not addressed in the Contract Documents and if reasonable precautions will be inadequate to prevent foreseeable bodily injury or death to persons resulting from a material or substance, including but not limited to asbestos or polychlorinated biphenyl (PCB), encountered on the site by the Contractor, the Contractor shall, upon recognizing the condition, immediately stop Work in the affected area and report the condition to the Owner and Architect in writing.

§ 10.3.2 Upon receipt of the Contractor's written notice, the Owner shall obtain the services of a licensed laboratory to verify the presence or absence of the material or substance reported by the Contractor and, in the event such material or substance is found to be present, to cause it to be rendered harmless. Unless otherwise required by the Contract Documents, the Owner shall furnish in writing to the Contractor and Architect the names and qualifications of persons or entities who are to perform tests verifying the presence or absence of such material or substance or who are to perform the task of removal or safe containment of such material or substance. The Contractor and the Architect will promptly reply to the Owner in writing stating whether or not either has reasonable objection to the persons or entities proposed by the Owner. If either the Contractor or Architect has an objection to a person or entity proposed by the Owner, the Owner shall propose another to whom the Contractor and the Architect have no reasonable objection. When the material or substance has been rendered harmless, Work in the affected area shall resume upon written agreement of the Owner and Contractor. By Change Order, the Contract Time shall be extended appropriately and the Contract Sum shall be increased in the amount of the Contractor's reasonable additional costs of shut-down, delay and start-up.

§ 10.3.3 To the fullest extent permitted by law, the Owner shall indemnify and hold harmless the Contractor, Subcontractors, Architect, Architect's consultants and agents and employees of any of them from and against claims, damages, losses and expenses, including but not limited to attorneys' fees, arising out of or resulting from performance of the Work in the affected area if in fact the material or substance presents the risk of bodily injury or death as described in Section 10.3.1 and has not been rendered harmless, provided that such claim, damage, loss or expense is attributable to bodily injury, sickness, disease or death, or to injury to or destruction of tangible property (other than the Work itself), except to the extent that such damage, loss or expense is due to the fault or negligence of the party seeking indemnity.

§ 10.3.4 The Owner shall not be responsible under this Section 10.3 for materials or substances the Contractor brings to the site unless such materials or substances are required by the Contract Documents. The Owner shall be responsible for materials or substances required by the Contract Documents, except to the extent of the Contractor's fault or negligence in the use and handling of such materials or substances.

§ 10.3.5 The Contractor shall indemnify the Owner for the cost and expense the Owner incurs (1) for remediation of a material or substance the Contractor brings to the site and negligently handles, or (2) where the Contractor fails to perform its obligations under Section 10.3.1, except to the extent that the cost and expense are due to the Owner's fault or negligence.

§ 10.3.6 If, without negligence on the part of the Contractor, the Contractor is held liable by a government agency for the cost of remediation of a hazardous material or substance solely by reason of performing Work as required by the Contract Documents, the Owner shall indemnify the Contractor for all cost and expense thereby incurred.

Init.

**§ 10.4 EMERGENCIES**

In an emergency affecting safety of persons or property, the Contractor shall act, at the Contractor's discretion, to prevent threatened damage, injury or loss. Additional compensation or extension of time claimed by the Contractor on account of an emergency shall be determined as provided in Article 15 and Article 7.

**ARTICLE 11 INSURANCE AND BONDS****§ 11.1 CONTRACTOR'S LIABILITY INSURANCE**

§ 11.1.1 The Contractor shall purchase from and maintain in a company or companies lawfully authorized to do business in the jurisdiction in which the Project is located such insurance as will protect the Contractor from claims set forth below which may arise out of or result from the Contractor's operations and completed operations under the Contract and for which the Contractor may be legally liable, whether such operations be by the Contractor or by a Subcontractor or by anyone directly or indirectly employed by any of them, or by anyone for whose acts any of them may be liable:

- .1 Claims under workers' compensation, disability benefit and other similar employee benefit acts that are applicable to the Work to be performed;
- .2 Claims for damages because of bodily injury, occupational sickness or disease, or death of the Contractor's employees;
- .3 Claims for damages because of bodily injury, sickness or disease, or death of any person other than the Contractor's employees;
- .4 Claims for damages insured by usual personal injury liability coverage;
- .5 Claims for damages, other than to the Work itself, because of injury to or destruction of tangible property, including loss of use resulting therefrom;
- .6 Claims for damages because of bodily injury, death of a person or property damage arising out of ownership, maintenance or use of a motor vehicle;
- .7 Claims for bodily injury or property damage arising out of completed operations; and
- .8 Claims involving contractual liability insurance applicable to the Contractor's obligations under Section 3.18.

§ 11.1.2 The insurance required by Section 11.1.1 shall be written for not less than limits of liability specified in the Contract Documents or required by law, whichever coverage is greater. Coverages, whether written on an occurrence or claims-made basis, shall be maintained without interruption from the date of commencement of the Work until the date of final payment and termination of any coverage required to be maintained after final payment, and, with respect to the Contractor's completed operations coverage, until the expiration of the period for correction of Work or for such other period for maintenance of completed operations coverage as specified in the Contract Documents.

§ 11.1.3 Certificates of insurance acceptable to the Owner shall be filed with the Owner prior to commencement of the Work and thereafter upon renewal or replacement of each required policy of insurance. These certificates and the insurance policies required by this Section 11.1 shall contain a provision that coverages afforded under the policies will not be canceled or allowed to expire until at least 30 days' prior written notice has been given to the Owner. An additional certificate evidencing continuation of liability coverage, including coverage for completed operations, shall be submitted with the final Application for Payment as required by Section 9.10.2 and thereafter upon renewal or replacement of such coverage until the expiration of the time required by Section 11.1.2. Information concerning reduction of coverage on account of revised limits or claims paid under the General Aggregate, or both, shall be furnished by the Contractor with reasonable promptness.

§ 11.1.4 The Contractor shall cause the commercial liability coverage required by the Contract Documents to include (1) the Owner, the Architect and the Architect's Consultants as additional insureds for claims caused in whole or in part by the Contractor's negligent acts or omissions during the Contractor's operations; and (2) the Owner as an additional insured for claims caused in whole or in part by the Contractor's negligent acts or omissions during the Contractor's completed operations.

**§ 11.2 OWNER'S LIABILITY INSURANCE**

The Owner shall be responsible for purchasing and maintaining the Owner's usual liability insurance.

Init.

### § 11.3 PROPERTY INSURANCE

§ 11.3.1 Unless otherwise provided, the Owner shall purchase and maintain, in a company or companies lawfully authorized to do business in the jurisdiction in which the Project is located, property insurance written on a builder's risk "all-risk" or equivalent policy form in the amount of the initial Contract Sum, plus value of subsequent Contract Modifications and cost of materials supplied or installed by others, comprising total value for the entire Project at the site on a replacement cost basis without optional deductibles. Such property insurance shall be maintained, unless otherwise provided in the Contract Documents or otherwise agreed in writing by all persons and entities who are beneficiaries of such insurance, until final payment has been made as provided in Section 9.10 or until no person or entity other than the Owner has an insurable interest in the property required by this Section 11.3 to be covered, whichever is later. This insurance shall include interests of the Owner, the Contractor, Subcontractors and Sub-subcontractors in the Project.

§ 11.3.1.1 Property insurance shall be on an "all-risk" or equivalent policy form and shall include, without limitation, insurance against the perils of fire (with extended coverage) and physical loss or damage including, without duplication of coverage, theft, vandalism, malicious mischief, collapse, earthquake, flood, windstorm, falsework, testing and startup, temporary buildings and debris removal including demolition occasioned by enforcement of any applicable legal requirements, and shall cover reasonable compensation for Architect's and Contractor's services and expenses required as a result of such insured loss.

§ 11.3.1.2 If the Owner does not intend to purchase such property insurance required by the Contract and with all of the coverages in the amount described above, the Owner shall so inform the Contractor in writing prior to commencement of the Work. The Contractor may then effect insurance that will protect the interests of the Contractor, Subcontractors and Sub-subcontractors in the Work, and by appropriate Change Order the cost thereof shall be charged to the Owner. If the Contractor is damaged by the failure or neglect of the Owner to purchase or maintain insurance as described above, without so notifying the Contractor in writing, then the Owner shall bear all reasonable costs properly attributable thereto.

§ 11.3.1.3 If the property insurance requires deductibles, the Owner shall pay costs not covered because of such deductibles.

§ 11.3.1.4 This property insurance shall cover portions of the Work stored off the site, and also portions of the Work in transit.

§ 11.3.1.5 Partial occupancy or use in accordance with Section 9.9 shall not commence until the insurance company or companies providing property insurance have consented to such partial occupancy or use by endorsement or otherwise. The Owner and the Contractor shall take reasonable steps to obtain consent of the insurance company or companies and shall, without mutual written consent, take no action with respect to partial occupancy or use that would cause cancellation, lapse or reduction of insurance.

### § 11.3.2 BOILER AND MACHINERY INSURANCE

The Owner shall purchase and maintain boiler and machinery insurance required by the Contract Documents or by law, which shall specifically cover such insured objects during installation and until final acceptance by the Owner; this insurance shall include interests of the Owner, Contractor, Subcontractors and Sub-subcontractors in the Work, and the Owner and Contractor shall be named insureds.

### § 11.3.3 LOSS OF USE INSURANCE

The Owner, at the Owner's option, may purchase and maintain such insurance as will insure the Owner against loss of use of the Owner's property due to fire or other hazards, however caused. The Owner waives all rights of action against the Contractor for loss of use of the Owner's property, including consequential losses due to fire or other hazards however caused.

§ 11.3.4 If the Contractor requests in writing that insurance for risks other than those described herein or other special causes of loss be included in the property insurance policy, the Owner shall, if possible, include such insurance, and the cost thereof shall be charged to the Contractor by appropriate Change Order.

§ 11.3.5 If during the Project construction period the Owner insures properties, real or personal or both, at or adjacent to the site by property insurance under policies separate from those insuring the Project, or if after final payment

Init.

property insurance is to be provided on the completed Project through a policy or policies other than those insuring the Project during the construction period, the Owner shall waive all rights in accordance with the terms of Section 11.3.7 for damages caused by fire or other causes of loss covered by this separate property insurance. All separate policies shall provide this waiver of subrogation by endorsement or otherwise.

§ 11.3.6 Before an exposure to loss may occur, the Owner shall file with the Contractor a copy of each policy that includes insurance coverages required by this Section 11.3. Each policy shall contain all generally applicable conditions, definitions, exclusions and endorsements related to this Project. Each policy shall contain a provision that the policy will not be canceled or allowed to expire, and that its limits will not be reduced, until at least 30 days' prior written notice has been given to the Contractor.

#### § 11.3.7 WAIVERS OF SUBROGATION

The Owner and Contractor waive all rights against (1) each other and any of their subcontractors, sub-subcontractors, agents and employees, each of the other, and (2) the Architect, Architect's consultants, separate contractors described in Article 6, if any, and any of their subcontractors, sub-subcontractors, agents and employees, for damages caused by fire or other causes of loss to the extent covered by property insurance obtained pursuant to this Section 11.3 or other property insurance applicable to the Work, except such rights as they have to proceeds of such insurance held by the Owner as fiduciary. The Owner or Contractor, as appropriate, shall require of the Architect, Architect's consultants, separate contractors described in Article 6, if any, and the subcontractors, sub-subcontractors, agents and employees of any of them, by appropriate agreements, written where legally required for validity, similar waivers each in favor of other parties enumerated herein. The policies shall provide such waivers of subrogation by endorsement or otherwise. A waiver of subrogation shall be effective as to a person or entity even though that person or entity would otherwise have a duty of indemnification, contractual or otherwise, did not pay the insurance premium directly or indirectly, and whether or not the person or entity had an insurable interest in the property damaged.

§ 11.3.8 A loss insured under the Owner's property insurance shall be adjusted by the Owner as fiduciary and made payable to the Owner as fiduciary for the insureds, as their interests may appear, subject to requirements of any applicable mortgagee clause and of Section 11.3.10. The Contractor shall pay Subcontractors their just shares of insurance proceeds received by the Contractor, and by appropriate agreements, written where legally required for validity, shall require Subcontractors to make payments to their Sub-subcontractors in similar manner.

§ 11.3.9 If required in writing by a party in interest, the Owner as fiduciary shall, upon occurrence of an insured loss, give bond for proper performance of the Owner's duties. The cost of required bonds shall be charged against proceeds received as fiduciary. The Owner shall deposit in a separate account proceeds so received, which the Owner shall distribute in accordance with such agreement as the parties in interest may reach, or as determined in accordance with the method of binding dispute resolution selected in the Agreement between the Owner and Contractor. If after such loss no other special agreement is made and unless the Owner terminates the Contract for convenience, replacement of damaged property shall be performed by the Contractor after notification of a Change in the Work in accordance with Article 7.

§ 11.3.10 The Owner as fiduciary shall have power to adjust and settle a loss with insurers unless one of the parties in interest shall object in writing within five days after occurrence of loss to the Owner's exercise of this power; if such objection is made, the dispute shall be resolved in the manner selected by the Owner and Contractor as the method of binding dispute resolution in the Agreement. If the Owner and Contractor have selected arbitration as the method of binding dispute resolution, the Owner as fiduciary shall make settlement with insurers or, in the case of a dispute over distribution of insurance proceeds, in accordance with the directions of the arbitrators.

#### § 11.4 PERFORMANCE BOND AND PAYMENT BOND

§ 11.4.1 The Owner shall have the right to require the Contractor to furnish bonds covering faithful performance of the Contract and payment of obligations arising thereunder as stipulated in bidding requirements or specifically required in the Contract Documents on the date of execution of the Contract.

§ 11.4.2 Upon the request of any person or entity appearing to be a potential beneficiary of bonds covering payment of obligations arising under the Contract, the Contractor shall promptly furnish a copy of the bonds or shall authorize a copy to be furnished.

Init.

**ARTICLE 12 UNCOVERING AND CORRECTION OF WORK****§ 12.1 UNCOVERING OF WORK**

**§ 12.1.1** If a portion of the Work is covered contrary to the Architect's request or to requirements specifically expressed in the Contract Documents, it must, if requested in writing by the Architect, be uncovered for the Architect's examination and be replaced at the Contractor's expense without change in the Contract Time.

**§ 12.1.2** If a portion of the Work has been covered that the Architect has not specifically requested to examine prior to its being covered, the Architect may request to see such Work and it shall be uncovered by the Contractor. If such Work is in accordance with the Contract Documents, costs of uncovering and replacement shall, by appropriate Change Order, be at the Owner's expense. If such Work is not in accordance with the Contract Documents, such costs and the cost of correction shall be at the Contractor's expense unless the condition was caused by the Owner or a separate contractor in which event the Owner shall be responsible for payment of such costs.

**§ 12.2 CORRECTION OF WORK****§ 12.2.1 BEFORE OR AFTER SUBSTANTIAL COMPLETION**

The Contractor shall promptly correct Work rejected by the Architect or failing to conform to the requirements of the Contract Documents, whether discovered before or after Substantial Completion and whether or not fabricated, installed or completed. Costs of correcting such rejected Work, including additional testing and inspections, the cost of uncovering and replacement, and compensation for the Architect's services and expenses made necessary thereby, shall be at the Contractor's expense.

**§ 12.2.2 AFTER SUBSTANTIAL COMPLETION**

**§ 12.2.2.1** In addition to the Contractor's obligations under Section 3.5, if, within one year after the date of Substantial Completion of the Work or designated portion thereof or after the date for commencement of warranties established under Section 9.9.1, or by terms of an applicable special warranty required by the Contract Documents, any of the Work is found to be not in accordance with the requirements of the Contract Documents, the Contractor shall correct it promptly after receipt of written notice from the Owner to do so unless the Owner has previously given the Contractor a written acceptance of such condition. The Owner shall give such notice promptly after discovery of the condition. During the one-year period for correction of Work, if the Owner fails to notify the Contractor and give the Contractor an opportunity to make the correction, the Owner waives the rights to require correction by the Contractor and to make a claim for breach of warranty. If the Contractor fails to correct nonconforming Work within a reasonable time during that period after receipt of notice from the Owner or Architect, the Owner may correct it in accordance with Section 2.4.

**§ 12.2.2.2** The one-year period for correction of Work shall be extended with respect to portions of Work first performed after Substantial Completion by the period of time between Substantial Completion and the actual completion of that portion of the Work.

**§ 12.2.2.3** The one-year period for correction of Work shall not be extended by corrective Work performed by the Contractor pursuant to this Section 12.2.

**§ 12.2.3** The Contractor shall remove from the site portions of the Work that are not in accordance with the requirements of the Contract Documents and are neither corrected by the Contractor nor accepted by the Owner.

**§ 12.2.4** The Contractor shall bear the cost of correcting destroyed or damaged construction, whether completed or partially completed, of the Owner or separate contractors caused by the Contractor's correction or removal of Work that is not in accordance with the requirements of the Contract Documents.

**§ 12.2.5** Nothing contained in this Section 12.2 shall be construed to establish a period of limitation with respect to other obligations the Contractor has under the Contract Documents. Establishment of the one-year period for correction of Work as described in Section 12.2.2 relates only to the specific obligation of the Contractor to correct the Work, and has no relationship to the time within which the obligation to comply with the Contract Documents may be sought to be enforced, nor to the time within which proceedings may be commenced to establish the Contractor's liability with respect to the Contractor's obligations other than specifically to correct the Work.

Init.

**§ 12.3 ACCEPTANCE OF NONCONFORMING WORK**

If the Owner prefers to accept Work that is not in accordance with the requirements of the Contract Documents, the Owner may do so instead of requiring its removal and correction, in which case the Contract Sum will be reduced as appropriate and equitable. Such adjustment shall be effected whether or not final payment has been made.

**ARTICLE 13 MISCELLANEOUS PROVISIONS****§ 13.1 GOVERNING LAW**

The Contract shall be governed by the law of the place where the Project is located except that, if the parties have selected arbitration as the method of binding dispute resolution, the Federal Arbitration Act shall govern Section 15.4.

**§ 13.2 SUCCESSORS AND ASSIGNS**

**§ 13.2.1** The Owner and Contractor respectively bind themselves, their partners, successors, assigns and legal representatives to covenants, agreements and obligations contained in the Contract Documents. Except as provided in Section 13.2.2, neither party to the Contract shall assign the Contract as a whole without written consent of the other. If either party attempts to make such an assignment without such consent, that party shall nevertheless remain legally responsible for all obligations under the Contract.

**§ 13.2.2** The Owner may, without consent of the Contractor, assign the Contract to a lender providing construction financing for the Project, if the lender assumes the Owner's rights and obligations under the Contract Documents. The Contractor shall execute all consents reasonably required to facilitate such assignment.

**§ 13.3 WRITTEN NOTICE**

Written notice shall be deemed to have been duly served if delivered in person to the individual, to a member of the firm or entity, or to an officer of the corporation for which it was intended; or if delivered at, or sent by registered or certified mail or by courier service providing proof of delivery to, the last business address known to the party giving notice.

**§ 13.4 RIGHTS AND REMEDIES**

**§ 13.4.1** Duties and obligations imposed by the Contract Documents and rights and remedies available thereunder shall be in addition to and not a limitation of duties, obligations, rights and remedies otherwise imposed or available by law.

**§ 13.4.2** No action or failure to act by the Owner, Architect or Contractor shall constitute a waiver of a right or duty afforded them under the Contract, nor shall such action or failure to act constitute approval of or acquiescence in a breach there under, except as may be specifically agreed in writing.

**§ 13.5 TESTS AND INSPECTIONS**

**§ 13.5.1** Tests, inspections and approvals of portions of the Work shall be made as required by the Contract Documents and by applicable laws, statutes, ordinances, codes, rules and regulations or lawful orders of public authorities. Unless otherwise provided, the Contractor shall make arrangements for such tests, inspections and approvals with an independent testing laboratory or entity acceptable to the Owner, or with the appropriate public authority, and shall bear all related costs of tests, inspections and approvals. The Contractor shall give the Architect timely notice of when and where tests and inspections are to be made so that the Architect may be present for such procedures. The Owner shall bear costs of (1) tests, inspections or approvals that do not become requirements until after bids are received or negotiations concluded, and (2) tests, inspections or approvals where building codes or applicable laws or regulations prohibit the Owner from delegating their cost to the Contractor.

**§ 13.5.2** If the Architect, Owner or public authorities having jurisdiction determine that portions of the Work require additional testing, inspection or approval not included under Section 13.5.1, the Architect will, upon written authorization from the Owner, instruct the Contractor to make arrangements for such additional testing, inspection or approval by an entity acceptable to the Owner, and the Contractor shall give timely notice to the Architect of when and where tests and inspections are to be made so that the Architect may be present for such procedures. Such costs, except as provided in Section 13.5.3, shall be at the Owner's expense.

**§ 13.5.3** If such procedures for testing, inspection or approval under Sections 13.5.1 and 13.5.2 reveal failure of the portions of the Work to comply with requirements established by the Contract Documents, all costs made necessary by

Init.

AIA Document A201™ – 2007. Copyright © 1911, 1915, 1918, 1925, 1937, 1951, 1958, 1961, 1963, 1966, 1970, 1976, 1987, 1997 and 2007 by The American Institute of Architects. All rights reserved. **WARNING: This AIA® Document is protected by U.S. Copyright Law and International Treaties. Unauthorized reproduction or distribution of this AIA® Document, or any portion of it, may result in severe civil and criminal penalties, and will be prosecuted to the maximum extent possible under the law.** This document was produced by AIA software at 11:09:38 on 05/24/2010 under Order No.0553161408\_1 which expires on 07/03/2010, and is not for resale.

User Notes:

(895711814)

such failure including those of repeated procedures and compensation for the Architect's services and expenses shall be at the Contractor's expense.

§ 13.5.4 Required certificates of testing, inspection or approval shall, unless otherwise required by the Contract Documents, be secured by the Contractor and promptly delivered to the Architect.

§ 13.5.5 If the Architect is to observe tests, inspections or approvals required by the Contract Documents, the Architect will do so promptly and, where practicable, at the normal place of testing.

§ 13.5.6 Tests or inspections conducted pursuant to the Contract Documents shall be made promptly to avoid unreasonable delay in the Work.

#### § 13.6 INTEREST

Payments due and unpaid under the Contract Documents shall bear interest from the date payment is due at such rate as the parties may agree upon in writing or, in the absence thereof, at the legal rate prevailing from time to time at the place where the Project is located.

#### § 13.7 TIME LIMITS ON CLAIMS

The Owner and Contractor shall commence all claims and causes of action, whether in contract, tort, breach of warranty or otherwise, against the other arising out of or related to the Contract in accordance with the requirements of the final dispute resolution method selected in the Agreement within the time period specified by applicable law, but in any case not more than 10 years after the date of Substantial Completion of the Work. The Owner and Contractor waive all claims and causes of action not commenced in accordance with this Section 13.7.

### ARTICLE 14 TERMINATION OR SUSPENSION OF THE CONTRACT

#### § 14.1 TERMINATION BY THE CONTRACTOR

§ 14.1.1 The Contractor may terminate the Contract if the Work is stopped for a period of 30 consecutive days through no act or fault of the Contractor or a Subcontractor, Sub-subcontractor or their agents or employees or any other persons or entities performing portions of the Work under direct or indirect contract with the Contractor, for any of the following reasons:

- .1 Issuance of an order of a court or other public authority having jurisdiction that requires all Work to be stopped;
- .2 An act of government, such as a declaration of national emergency that requires all Work to be stopped;
- .3 Because the Architect has not issued a Certificate for Payment and has not notified the Contractor of the reason for withholding certification as provided in Section 9.4.1, or because the Owner has not made payment on a Certificate for Payment within the time stated in the Contract Documents; or
- .4 The Owner has failed to furnish to the Contractor promptly, upon the Contractor's request, reasonable evidence as required by Section 2.2.1.

§ 14.1.2 The Contractor may terminate the Contract if, through no act or fault of the Contractor or a Subcontractor, Sub-subcontractor or their agents or employees or any other persons or entities performing portions of the Work under direct or indirect contract with the Contractor, repeated suspensions, delays or interruptions of the entire Work by the Owner as described in Section 14.3 constitute in the aggregate more than 100 percent of the total number of days scheduled for completion, or 120 days in any 365-day period, whichever is less.

§ 14.1.3 If one of the reasons described in Section 14.1.1 or 14.1.2 exists, the Contractor may, upon seven days' written notice to the Owner and Architect, terminate the Contract and recover from the Owner payment for Work executed, including reasonable overhead and profit, costs incurred by reason of such termination, and damages.

§ 14.1.4 If the Work is stopped for a period of 60 consecutive days through no act or fault of the Contractor or a Subcontractor or their agents or employees or any other persons performing portions of the Work under contract with the Contractor because the Owner has repeatedly failed to fulfill the Owner's obligations under the Contract Documents with respect to matters important to the progress of the Work, the Contractor may, upon seven additional days' written notice to the Owner and the Architect, terminate the Contract and recover from the Owner as provided in Section 14.1.3.

Init.

/

**§ 14.2 TERMINATION BY THE OWNER FOR CAUSE****§ 14.2.1** The Owner may terminate the Contract if the Contractor

- .1 repeatedly refuses or fails to supply enough properly skilled workers or proper materials;
- .2 fails to make payment to Subcontractors for materials or labor in accordance with the respective agreements between the Contractor and the Subcontractors;
- .3 repeatedly disregards applicable laws, statutes, ordinances, codes, rules and regulations, or lawful orders of a public authority; or
- .4 otherwise is guilty of substantial breach of a provision of the Contract Documents.

**§ 14.2.2** When any of the above reasons exist, the Owner, upon certification by the Initial Decision Maker that sufficient cause exists to justify such action, may without prejudice to any other rights or remedies of the Owner and after giving the Contractor and the Contractor's surety, if any, seven days' written notice, terminate employment of the Contractor and may, subject to any prior rights of the surety:

- .1 Exclude the Contractor from the site and take possession of all materials, equipment, tools, and construction equipment and machinery thereon owned by the Contractor;
- .2 Accept assignment of subcontracts pursuant to Section 5.4; and
- .3 Finish the Work by whatever reasonable method the Owner may deem expedient. Upon written request of the Contractor, the Owner shall furnish to the Contractor a detailed accounting of the costs incurred by the Owner in finishing the Work.

**§ 14.2.3** When the Owner terminates the Contract for one of the reasons stated in Section 14.2.1, the Contractor shall not be entitled to receive further payment until the Work is finished.

**§ 14.2.4** If the unpaid balance of the Contract Sum exceeds costs of finishing the Work, including compensation for the Architect's services and expenses made necessary thereby, and other damages incurred by the Owner and not expressly waived, such excess shall be paid to the Contractor. If such costs and damages exceed the unpaid balance, the Contractor shall pay the difference to the Owner. The amount to be paid to the Contractor or Owner, as the case may be, shall be certified by the Initial Decision Maker, upon application, and this obligation for payment shall survive termination of the Contract.

**§ 14.3 SUSPENSION BY THE OWNER FOR CONVENIENCE**

**§ 14.3.1** The Owner may, without cause, order the Contractor in writing to suspend, delay or interrupt the Work in whole or in part for such period of time as the Owner may determine.

**§ 14.3.2** The Contract Sum and Contract Time shall be adjusted for increases in the cost and time caused by suspension, delay or interruption as described in Section 14.3.1. Adjustment of the Contract Sum shall include profit. No adjustment shall be made to the extent

- .1 that performance is, was or would have been so suspended, delayed or interrupted by another cause for which the Contractor is responsible; or
- .2 that an equitable adjustment is made or denied under another provision of the Contract.

**§ 14.4 TERMINATION BY THE OWNER FOR CONVENIENCE**

**§ 14.4.1** The Owner may, at any time, terminate the Contract for the Owner's convenience and without cause.

**§ 14.4.2** Upon receipt of written notice from the Owner of such termination for the Owner's convenience, the Contractor shall

- .1 cease operations as directed by the Owner in the notice;
- .2 take actions necessary, or that the Owner may direct, for the protection and preservation of the Work; and
- .3 except for Work directed to be performed prior to the effective date of termination stated in the notice, terminate all existing subcontracts and purchase orders and enter into no further subcontracts and purchase orders.

**§ 14.4.3** In case of such termination for the Owner's convenience, the Contractor shall be entitled to receive payment for Work executed, and costs incurred by reason of such termination, along with reasonable overhead and profit on the Work not executed.

Init.



**ARTICLE 15 CLAIMS AND DISPUTES****§ 15.1 CLAIMS****§ 15.1.1 DEFINITION**

A Claim is a demand or assertion by one of the parties seeking, as a matter of right, payment of money, or other relief with respect to the terms of the Contract. The term "Claim" also includes other disputes and matters in question between the Owner and Contractor arising out of or relating to the Contract. The responsibility to substantiate Claims shall rest with the party making the Claim.

**§ 15.1.2 NOTICE OF CLAIMS**

Claims by either the Owner or Contractor must be initiated by written notice to the other party and to the Initial Decision Maker with a copy sent to the Architect, if the Architect is not serving as the Initial Decision Maker. Claims by either party must be initiated within 21 days after occurrence of the event giving rise to such Claim or within 21 days after the claimant first recognizes the condition giving rise to the Claim, whichever is later.

**§ 15.1.3 CONTINUING CONTRACT PERFORMANCE**

Pending final resolution of a Claim, except as otherwise agreed in writing or as provided in Section 9.7 and Article 14, the Contractor shall proceed diligently with performance of the Contract and the Owner shall continue to make payments in accordance with the Contract Documents. The Architect will prepare Change Orders and issue Certificates for Payment in accordance with the decisions of the Initial Decision Maker.

**§ 15.1.4 CLAIMS FOR ADDITIONAL COST**

If the Contractor wishes to make a Claim for an increase in the Contract Sum, written notice as provided herein shall be given before proceeding to execute the Work. Prior notice is not required for Claims relating to an emergency endangering life or property arising under Section 10.4.

**§ 15.1.5 CLAIMS FOR ADDITIONAL TIME**

**§ 15.1.5.1** If the Contractor wishes to make a Claim for an increase in the Contract Time, written notice as provided herein shall be given. The Contractor's Claim shall include an estimate of cost and of probable effect of delay on progress of the Work. In the case of a continuing delay, only one Claim is necessary.

**§ 15.1.5.2** If adverse weather conditions are the basis for a Claim for additional time, such Claim shall be documented by data substantiating that weather conditions were abnormal for the period of time, could not have been reasonably anticipated and had an adverse effect on the scheduled construction.

**§ 15.1.6 CLAIMS FOR CONSEQUENTIAL DAMAGES**

The Contractor and Owner waive Claims against each other for consequential damages arising out of or relating to this Contract. This mutual waiver includes

- .1 damages incurred by the Owner for rental expenses, for losses of use, income, profit, financing, business and reputation, and for loss of management or employee productivity or of the services of such persons; and
- .2 damages incurred by the Contractor for principal office expenses including the compensation of personnel stationed there, for losses of financing, business and reputation, and for loss of profit except anticipated profit arising directly from the Work.

This mutual waiver is applicable, without limitation, to all consequential damages due to either party's termination in accordance with Article 14. Nothing contained in this Section 15.1.6 shall be deemed to preclude an award of liquidated damages, when applicable, in accordance with the requirements of the Contract Documents.

**§ 15.2 INITIAL DECISION**

**§ 15.2.1** Claims, excluding those arising under Sections 10.3, 10.4, 11.3.9, and 11.3.10, shall be referred to the Initial Decision Maker for initial decision. The Architect will serve as the Initial Decision Maker, unless otherwise indicated in the Agreement. Except for those Claims excluded by this Section 15.2.1, an initial decision shall be required as a condition precedent to mediation of any Claim arising prior to the date final payment is due, unless 30 days have passed after the Claim has been referred to the Initial Decision Maker with no decision having been rendered. Unless the Initial Decision Maker and all affected parties agree, the Initial Decision Maker will not decide disputes between the Contractor and persons or entities other than the Owner.

Init.

§ 15.2.2 The Initial Decision Maker will review Claims and within ten days of the receipt of a Claim take one or more of the following actions: (1) request additional supporting data from the claimant or a response with supporting data from the other party, (2) reject the Claim in whole or in part, (3) approve the Claim, (4) suggest a compromise, or (5) advise the parties that the Initial Decision Maker is unable to resolve the Claim if the Initial Decision Maker lacks sufficient information to evaluate the merits of the Claim or if the Initial Decision Maker concludes that, in the Initial Decision Maker's sole discretion, it would be inappropriate for the Initial Decision Maker to resolve the Claim.

§ 15.2.3 In evaluating Claims, the Initial Decision Maker may, but shall not be obligated to, consult with or seek information from either party or from persons with special knowledge or expertise who may assist the Initial Decision Maker in rendering a decision. The Initial Decision Maker may request the Owner to authorize retention of such persons at the Owner's expense.

§ 15.2.4 If the Initial Decision Maker requests a party to provide a response to a Claim or to furnish additional supporting data, such party shall respond, within ten days after receipt of such request, and shall either (1) provide a response on the requested supporting data, (2) advise the Initial Decision Maker when the response or supporting data will be furnished or (3) advise the Initial Decision Maker that no supporting data will be furnished. Upon receipt of the response or supporting data, if any, the Initial Decision Maker will either reject or approve the Claim in whole or in part.

§ 15.2.5 The Initial Decision Maker will render an initial decision approving or rejecting the Claim, or indicating that the Initial Decision Maker is unable to resolve the Claim. This initial decision shall (1) be in writing; (2) state the reasons therefor; and (3) notify the parties and the Architect, if the Architect is not serving as the Initial Decision Maker, of any change in the Contract Sum or Contract Time or both. The initial decision shall be final and binding on the parties but subject to mediation and, if the parties fail to resolve their dispute through mediation, to binding dispute resolution.

§ 15.2.6 Either party may file for mediation of an initial decision at any time, subject to the terms of Section 15.2.6.1.

§ 15.2.6.1 Either party may, within 30 days from the date of an initial decision, demand in writing that the other party file for mediation within 60 days of the initial decision. If such a demand is made and the party receiving the demand fails to file for mediation within the time required, then both parties waive their rights to mediate or pursue binding dispute resolution proceedings with respect to the initial decision.

§ 15.2.7 In the event of a Claim against the Contractor, the Owner may, but is not obligated to, notify the surety, if any, of the nature and amount of the Claim. If the Claim relates to a possibility of a Contractor's default, the Owner may, but is not obligated to, notify the surety and request the surety's assistance in resolving the controversy.

§ 15.2.8 If a Claim relates to or is the subject of a mechanic's lien, the party asserting such Claim may proceed in accordance with applicable law to comply with the lien notice or filing deadlines.

### § 15.3 MEDIATION

§ 15.3.1 Claims, disputes, or other matters in controversy arising out of or related to the Contract except those waived as provided for in Sections 9.10.4, 9.10.5, and 15.1.6 shall be subject to mediation as a condition precedent to binding dispute resolution.

§ 15.3.2 The parties shall endeavor to resolve their Claims by mediation which, unless the parties mutually agree otherwise, shall be administered by the American Arbitration Association in accordance with its Construction Industry Mediation Procedures in effect on the date of the Agreement. A request for mediation shall be made in writing, delivered to the other party to the Contract, and filed with the person or entity administering the mediation. The request may be made concurrently with the filing of binding dispute resolution proceedings but, in such event, mediation shall proceed in advance of binding dispute resolution proceedings, which shall be stayed pending mediation for a period of 60 days from the date of filing, unless stayed for a longer period by agreement of the parties or court order. If an arbitration is stayed pursuant to this Section 15.3.2, the parties may nonetheless proceed to the selection of the arbitrator(s) and agree upon a schedule for later proceedings.

Init.

§ 15.3.3 The parties shall share the mediator's fee and any filing fees equally. The mediation shall be held in the place where the Project is located, unless another location is mutually agreed upon. Agreements reached in mediation shall be enforceable as settlement agreements in any court having jurisdiction thereof.

#### § 15.4 ARBITRATION

§ 15.4.1 If the parties have selected arbitration as the method for binding dispute resolution in the Agreement, any Claim subject to, but not resolved by, mediation shall be subject to arbitration which, unless the parties mutually agree otherwise, shall be administered by the American Arbitration Association in accordance with its Construction Industry Arbitration Rules in effect on the date of the Agreement. A demand for arbitration shall be made in writing, delivered to the other party to the Contract, and filed with the person or entity administering the arbitration. The party filing a notice of demand for arbitration must assert in the demand all Claims then known to that party on which arbitration is permitted to be demanded.

§ 15.4.1.1 A demand for arbitration shall be made no earlier than concurrently with the filing of a request for mediation, but in no event shall it be made after the date when the institution of legal or equitable proceedings based on the Claim would be barred by the applicable statute of limitations. For statute of limitations purposes, receipt of a written demand for arbitration by the person or entity administering the arbitration shall constitute the institution of legal or equitable proceedings based on the Claim.

§ 15.4.2 The award rendered by the arbitrator or arbitrators shall be final, and judgment may be entered upon it in accordance with applicable law in any court having jurisdiction thereof.

§ 15.4.3 The foregoing agreement to arbitrate and other agreements to arbitrate with an additional person or entity duly consented to by parties to the Agreement shall be specifically enforceable under applicable law in any court having jurisdiction thereof.

#### § 15.4.4 CONSOLIDATION OR JOINDER

§ 15.4.4.1 Either party, at its sole discretion, may consolidate an arbitration conducted under this Agreement with any other arbitration to which it is a party provided that (1) the arbitration agreement governing the other arbitration permits consolidation, (2) the arbitrations to be consolidated substantially involve common questions of law or fact, and (3) the arbitrations employ materially similar procedural rules and methods for selecting arbitrator(s).

§ 15.4.4.2 Either party, at its sole discretion, may include by joinder persons or entities substantially involved in a common question of law or fact whose presence is required if complete relief is to be accorded in arbitration, provided that the party sought to be joined consents in writing to such joinder. Consent to arbitration involving an additional person or entity shall not constitute consent to arbitration of any claim, dispute or other matter in question not described in the written consent.

§ 15.4.4.3 The Owner and Contractor grant to any person or entity made a party to an arbitration conducted under this Section 15.4, whether by joinder or consolidation, the same rights of joinder and consolidation as the Owner and Contractor under this Agreement.



**University of Maine System  
Supplementary Conditions  
To**

**AIA A201 2007 General Conditions of the Contract for Construction**

**§ 1.1.8** Add the following:

The Architect is the Initial Decision Maker for this Agreement.

**§1.2.2** Add the following:

Where the Procurement Requirements include provisions that portions of the Work be File Bid in accordance with the requirements of the Maine Bid Depository System, the subcontracts for these portions of the work will cover the same scope of work as defined by the Procurement Requirements and the File Bid and shall have the same contract amount as listed in the successful bid.

**§ 1.5.1** Add the following:

The provisions of this section shall not be deemed to modify the contract between the University of Maine System (the Owner) and the Architect under B102 2007 and B201 2007 and the University of Maine Supplementary Requirements to those documents regarding the Instruments of Service.

**§ 1.5.2** Add the following:

The provisions of this section shall not be deemed to modify the contract between the University of Maine System (the Owner) and the Architect under B102 2007 and B201 2007 and the University of Maine Supplementary Requirements to those documents regarding the Instruments of Service.

**§ 2.1.1.1** Insert the following:

**§ 2.1.1.1** For the purpose of this Contract, the Owner is defined as: University of Maine System; 16 Central Street; Bangor, Maine 04401 acting through its duly authorized agent.

**§2.2.1** Delete in its entirety

**§3.4.2.1** Insert the following:

**§ 3.4.2.1** After the Contract has been executed, the Owner and Architect may consider a formal request for substitution of products in place of those specified. The Owner shall deduct from the next payment made from the Contract Sum amounts paid to the Architect to evaluate the Contractor's proposed substitutions and to make agreed-upon changes in the Drawings and Specifications made necessary by the Owner's acceptance of the substitutions.

By making requests for substitutions, the Contractor:

.1 Represents that the Contractor has personally investigated the proposed substitute product and determined it is equal or superior in all respects to that specified;

.2 Represents that the Contractor will provide the same warranty for the substitution that the Contractor would for that specified;

.3 Certifies that the cost data presented is complete and includes all related costs, and waives all claims for additional costs related to the substitution which subsequently become apparent; and

.4 Will coordinate the installation of the accepted substitute, making such changes as may be required for the Work to be completed in all respects.

**§3.4.4** Insert the following:

**§ 3.4.4** If a wage scale prepared by the State of Maine Department of Labor, Bureau of Labor Standards, is included in the Contract Documents, such wage scale represents the minimum wages that must be paid in each category of labor employed on the project.

The provisions of Title 26 MRSA Chapter 15 Preference to Maine Workers and Contractors, apply to this project, including but not limited to:

**§ 1310. Wage and benefits rates to be kept posted**

A clearly legible statement of all fair minimum wage and benefits rates to be paid the several classes of laborers, workers and mechanics employed on the construction on the public work must be kept posted in a prominent and easily accessible place at the site by each contractor and subcontractor subject to sections 1304 to 1313.

**§ 1311. Wage and benefit record of contractor**

The contractor and each subcontractor in charge of the construction of a public work shall keep an accurate record showing the names and occupation of all laborers, workers and mechanics employed by them and all independent contractors working under contract with them in connection with the construction on the public works. The record must also show for all laborers, workers, mechanics and independent contractors the hours worked, the title of the job, the hourly rate or other method of remuneration and the actual wages or other compensation paid to each of the laborers, workers, mechanics and independent contractors. A copy of such a record must be kept at the job site and must be open at all reasonable hours to the inspection of the Bureau of Labor Standards and the public authority that let the contract and its officers and agents. It is not necessary to preserve those records for a period longer than 3 years after the termination of the contract. A copy of each such record must also be filed monthly with the public authority that let the contract. The filed record is a public record pursuant to Title 1, chapter 13, except that the public authority letting a contract shall adopt rules to protect the privacy of personal information

contained in the records filed with the public authority under this section, such as Social Security numbers and taxpayer identification numbers. The rules may not prevent the disclosure of information regarding the classification of workers or independent contractors and the remuneration they receive. Such rules are routine technical rules as defined by Title 5, chapter 375, subchapter 2-A.

**§ 3.4.5** Insert the following:

**§ 3.4.5** If a wage scale prepared by the U.S. Department of Labor pursuant to the provision of the Davis-Bacon Act is included in the Contract Documents, such wage scale represents the minimum wages that must be paid in each category of labor on the project. The requirements and responsibilities within the Davis-Bacon Act apply to this project.

**§ 3.4.6** Insert the following:

**§ 3.4.6 EQUAL EMPLOYMENT OPPORTUNITY**

During the performance of this contract, the contractor agrees as follows:

**§ 3.4.6.1** The contractor will not discriminate against any employee or applicant for employment because of race, color, religion, sex, sexual orientation, including transgender status or gender expression, national origin or citizenship status, ancestry, age, disability, genetic information, or veterans status. Such action shall include, but not be limited to, the following: employment, upgrading, demotions, transfers, recruitment or recruitment advertising; layoffs or terminations; rates of pay or other forms of compensation; and selection for training, including apprenticeship.

**§ 3.4.6.2** The contractor will, in all solicitations or advertisements for employees placed by or on behalf of the contractor, state that all qualified applicants will receive consideration for employment without regard to race, color, religion, sex, sexual orientation, including transgender status or gender expression, national origin or citizenship status, ancestry, age, disability, genetic information, or veterans status.

**§ 3.4.6.3** The contractor will send to each labor union or representative of the workers with which there is a collective or bargaining agreement in place, or other contract or understanding, whereby labor is being furnished for the performances of his contract, a notice, as set forth in Attachment A attached hereto, to be provided by the contracting department or agency, advising the said labor union or workers' representative of the contractor's commitment under the provisions of the contract, and shall post copies of the notice in conspicuous places available to employees and to applicants for employment.

**§3.4.6.4** The contractor will cause the foregoing provisions to be inserted in all contracts for any work covered by this agreement so that such provisions will be binding upon each subcontractor.

**§ 3.4.6.5** Contractors and subcontractors with contracts in excess of \$50,000 will also pursue in good faith affirmative action programs.

**§ 3.4.7** Insert the following:

**§ 3.4.7** The Contractor and all sub-contractors shall adhere to H.P. 960-L.D 1314 and **Sec 6. 26 MRSA §1043, sub-§11, ¶E**, regarding definition of “Independent Contractor”.

§ 3.6.1 Insert the following:

§ 3.6.1 The University of Maine System is exempt from payment of taxes under the Maine Sales and Use Tax Law Title 36 Section 1760 for taxes on materials that are permanently incorporated into the real property belonging to the University of Maine System. The University of Maine System is also exempt from the payment of Federal Excise Taxes on articles not for resale and from the Federal Transportation Tax on all shipments; exemption certificates for these taxes will be furnished when required. All quotations shall be less these taxes. The contractor shall pay all other taxes that have been or are legally enacted.

§ 3.7.4 Replace the existing § 3.7.4 with the following:

**§ 3.7.4 Concealed or Unknown Conditions.** If the Contractor encounters conditions at the site that are (1) subsurface or otherwise concealed physical conditions that differ materially from those indicated in the Contract Documents or (2) unknown physical conditions of an unusual nature, that differ materially from those ordinarily found to exist and generally recognized as inherent in construction activities of the character provided for in the Contract Documents, the Contractor shall promptly provide notice to the Owner and the Architect before conditions are disturbed. The Architect will promptly investigate such conditions and, if the Architect determines that they differ materially and cause an increase or decrease in the Contractor's cost of, or time required for, performance of any part of the Work, will recommend an equitable adjustment in the Contract Sum or Contract Time, or both. If the Architect determines that the conditions at the site are not materially different from those indicated in the Contract Documents and that no change in the terms of the Contract is justified, the Architect shall promptly notify the Owner and Contractor in writing, stating the reasons. If either party disputes the Architect's determination or recommendation, that party may proceed as provided in Article 15.

§3.10.1.1 Insert the following:

§ 3.10.1.1 The Contractor shall provide an updated Construction Schedule with each Application for Payment reflecting actual construction progress and activities.

§ 3.12.11 Insert the following:

§ 3.12.11 The Architect's review of the Contractor's submittals will be limited to examination of an initial submission and two (2) resubmittals. The Architects review of additional submittals will be made only with the consent of the Owner after notification by the Architect. The Owner shall deduct from the next payment made from the Contract Sum amounts paid to the Architect for evaluation of such additional submittals.

§ 3.15.3 Insert the following:

**§ 3.15.3 Waste Management** The University is committed to a resource management strategy which reduces to a minimum the production of waste material while reusing, recycling or composting as much as possible of the remaining



materials. Contractor should strive to identify opportunities to reduce, reuse, or recycle waste from renovations or new construction, and will submit a construction waste management plan for the project.

**§ 4.1.1** Replace the existing § 4.1.1 with the following:

**§ 4.1.1** The Architect is a person or entity lawfully licensed to practice in the State of Maine. That person or entity is identified in the Agreement and is referred throughout the Contract Documents as if singular in number. Whenever the prime professional designer for the Work is an Engineer, the term Architect, wherever used in these documents shall have the term Engineer substituted for the term Architect. The Engineer shall be lawfully licensed to practice engineering in the State of Maine or an entity lawfully practicing engineering identified as such in the Agreement.

**§ 4.2.1** Replace the existing § 4.2.1 with the following:

**§ 4.2.1** The Architect will provide administration of the Contract as described in the Contract Documents, and will be an Owner's representative during construction until the date the final payment is due, and from time to time during the period for correction of Work described in § 12.2, and until the date the Architect issues the final Certificate for Payment. The Architect will have authority to act on behalf of the Owner only to the extent provided in the Contract Documents.

**§ 4.2.2** Replace the existing § 4.2.2 with the following:

**§ 4.2.2** The Architect will visit the site at intervals appropriate to the stage of construction, or as otherwise agreed with the Owner, to become generally familiar with the progress and quality of the portion of the Work completed, endeavor to guard the Owner against defects and deficiencies in the Work, and to determine in general if the Work observed is being performed in a manner indicating that the Work, when fully completed, will be in accordance with the Contract Documents. However, the Architect will not be required to make exhaustive or continuous on-site inspections to check the quality or quantity of the Work. The Architect will not have control over, charge of, or responsibility for, the construction means, methods, techniques, sequences or procedures, or for the safety precautions and programs in connection with the Work, since these are solely the Contractor's rights and responsibilities under the Contract Documents, except as provided in Section 3.3.1.

**§ 4.2.2.1** The Contractor shall reimburse the Owner for compensation paid to the Architect for additional site visits made necessary by the fault, neglect as determined solely by the Owner, or request of the Contractor. The reimbursement shall be deducted from the next payment made from the Contract Sum following the Owner's payment to the Architect.

**§ 4.2.3** Delete the word "reasonably" from the first sentence.

**§ 4.2.10** Replace the existing § 4.2.10 with the following:

**§ 4.2.10** If the Owner and Architect agree, the Architect will provide one or more

project representatives to assist in carrying out the Architect's responsibilities at the site. The duties, responsibilities and limitations of authority of such project representatives shall be as set forth in the contract between the Architect, AIA B102 and B201-2007 and Supplemental Requirements to be incorporated in the Contract Documents and attached hereto as Exhibit A.

**§ 5.2.1** Add the following:

**§ 5.2.1.1** The Contractor shall provide Owner a list of all subcontractors and independent contractors on the job site and a record of the entity to whom that subcontractor or independent contractor is directly contracted and by whom that subcontractor or independent contractor is insured for workers' compensation purposes. The list shall be presented at the preconstruction meeting and, when changes occur, at each requisition meeting as necessary. Information from this list will be placed on Owner's web site and updated as needed as required by 26 MRSA §1302-A.

**§ 5.2.1.2** Where the use of the Maine Bid Depository was required by the Procurement Requirements, Subcontractors included in the Contractor's Proposal shall be the Subcontractors for the defined Work unless a change has been approved by the Owner.

**§ 7.1.4** Insert the following:

**§ 7.1.4** The combined overhead and profit included in the total cost to the Owner of a change in the Work shall be based on a previously agreed upon unit pricing or on the following schedule allowing for appropriate allowances for contract duration:

- .1** For the Contractor, for Work performed by the Contractor's own forces, 20% of the cost.
- .2** For the Contractor, for Work performed by the Contractor's Subcontractors, 10% of the amount due the Subcontractors.
- .3** For each Subcontractor involved, for Work performed by the Subcontractor's own forces, 20% of the cost.
- .4** For each Subcontractor involved, for Work performed by the Subcontractor's Sub-subcontractors, 10% of the amount due the Sub-subcontractor.
- .5** Costs to which overhead and profit is to be applied shall be limited to the following:
  - .1** Costs of labor, including social security, old age and unemployment insurance, fringe benefits required by agreement or custom, and workers' compensation insurance;
  - .2** Costs of materials, supplies and equipment, including cost of transportation, whether incorporated or consumed;
  - .3** Rental costs of machinery and equipment, exclusive of hand tools, whether rented from the Contractor or others;

**.4** Costs of premiums for all bonds, insurance, permit fees, and sales, use or similar taxes related to the Work; and

**§ 7.1.5** When there is only an extension of Contract Time, the contractor delay claim is limited to additional costs related to supervision and field office personnel, which may be included in the overhead and profit calculation.

**§ 7.1.6** In order to facilitate checking of quotations, all proposals, except those so minor that their propriety can be seen by inspection, shall be accompanied by complete itemization of costs including labor, materials and Subcontracts. Labor and materials shall be itemized in the manner prescribed above. Where major cost items are Subcontracts, they are to be itemized also. In no case will a change be approved without such itemization.

**§ 9.3.1.3** Insert the following:

**§ 9.3.1.3** The provisions of Title 5 M.R.S.A § 1746, as amended, pertain to this project. The University shall retain five percent (5%) of each payment due the Contractor as part of the security for the fulfillment of the Contract Agreement by the Contractor, the Contractor shall not withhold a greater percentage from subcontractors. The University may, if deemed expedient by the University, cause the Contractor to be paid temporarily or permanently from time to time during the progress of the work, such portion of the amount retained as the University deems prudent or desirable.

**§ 9.5.1** The word “shall” will be substituted for the word “may” in all places in § 9.5.1.

**§ 9.5.1.1** Replace with the following:

**§ 9.5.1.1** Defective Work, i.e. Work that does not conform to the requirements of the contract, shall include, but not be limited to, non-conforming Work, disputed Work, incomplete Work, and unacceptable Work, which is not remedied.

**§ 9.5.1.1.1** The Architect shall deduct and withhold from any certification for payment an amount equal to one hundred and fifty percent (150%) the value of any defective Work.

**§ 9.6.8** Insert the following:

**§ 9.6.8** All Progress Payments and Final Payment are subject to the requirements of the "Maine Prompt Pay Act" Title 10 M.R.S.A. § 201-A, as amended. Payments shall be made on a timely basis in accord with the requirements of this Statute; however, the Contractor waives interest on any late payment.

**§ 9.10.1.1** Insert the following:

**§ 9.10.1.1** Except with the consent of the Owner, the Architect will perform no more than three (3) site reviews to determine whether the Work or a designated portion thereof has attained Final Completion in accordance with the Contract Documents. The Owner shall be entitled to deduct from the Contract Sum amounts paid to the Architect for any additional site reviews.

**§ 9.11** Insert the following:

**§ 9.11** The Contractor and the Contractor's surety, if any, shall be liable for and shall pay the Owner the sums stipulated as liquidated damages in the Contract Documents for each calendar day of delay after the date established for Substantial Completion in the Contract Documents until the Work is substantially complete.

**§10.2.1** Add the following:

**.4** If this Contract involves renovation, repair, or preparation of surfaces for painting in pre-1978 apartments, houses, or spaces used by child care facilities, Contractor shall use certified workers who follow the lead-safe work practices as required by the US Environmental Protection Agency's Renovation, Repair and Remodeling rule described in 40 CFR § 745.85. Notification of the tenants or users under this rule will be the responsibility of the University.

**§ 10.3.2** Replace the existing §10.3.2 with the following:

**§ 10.3.2** Upon receipt of the Contractor's written notice, the Owner shall obtain the services of a licensed laboratory to verify the presence or absence of the material or substance reported by the Contractor and, in the event such material or substance is found to be present, to cause it to be rendered harmless. When the material or substance has been rendered harmless, Work in the affected area shall resume upon written agreement of the Owner and Contractor.

**§ 11.1.3** Add the following:

Certificates of Insurance filed with the University of Maine System shall indicate the Certificate Holder as University of Maine System, 16 Central Street, Bangor, Maine 04401. The Project name, campus, and general liability insurance required policy form and two required endorsements noted in Paragraph 11.1.5.1 below shall be included on the Certificate. Contractor must provide renewal certificates at least 15 days prior to expiration.

**§ 11.1.4** Add the following:

Neither the Contractor nor any Subcontractors or Suppliers shall commence work at the project site under this contract until the Contractor has provided the University with a standard ACORD certificate with an attached AIA Document G715-1991 listing all insurance coverages and limits required under this section. All required insurance shall be maintained throughout the term of this contract (including correction period, defined in 12.2.2.1) and be on a primary basis, noncontributory with any other insurance carried by the University. All required insurance shall be provided by companies that have a current A.M. Best insurance rating of A- or better and that are licensed or approved to do business in the State of Maine.

**§ 11.1.5** Insert the following:

**§ 11.1.5 COVERAGE LIMITS** - The required insurance and coverage limits are as follows:

**§ 11.1.5.1 General Liability** -Contractor shall provide General Liability insurance with

coverage for premises and operations, products and completed operations, explosion, collapse and underground hazards, broad form property damage, contractual, personal and advertising injury liabilities. Insurance shall be provided on a standard Insurance Services Office (ISO) Commercial General Liability Form CG 00 01 12 04 or equivalent and shall include the following three endorsements or their equivalent: 1) Additional Insured—Owners, Lessees or Contractors—Scheduled Person or Organization (CG20 10 07 04) with the University of Maine System, 16 Central Street, Bangor, ME 04401 listed as additional insured; 2) Additional Insured—Owners, Lessees or Contractors—Completed Operations (CG 20 37 07 04) with the University of Maine System, 16 Central Street, Bangor, ME 04401 listed as additional insured; and 3) Designated Construction Project General Aggregate Limit (CG 25 03 03 97) ) as the Aggregate limits shall apply on a per location or job basis. The policy form and endorsements must be included on the certificate of insurance. The below required minimum insurance limits shall not be construed as a limitation of the University's rights under any insurance with higher limits and no insurance shall be endorsed to include such a limitation. General Liability insurance required minimum limits:

|  |             |
|--|-------------|
| .1 General Aggregate                                   | \$2,000,000 |
| .2 Products & Completed Operations Aggregate           | \$2,000,000 |
| .3 Personal Injury Aggregate                           | \$1,000,000 |
| .4 Each Occurrence for Contracts Under \$1 million     | \$1,000,000 |
| .5 Each Occurrence for Contracts \$1 million and above | \$2,000,000 |
| .6 Personal/Advertising Injury                         | \$1,000,000 |
| .7 Medical Payments (Any One Person)                   | \$5,000     |

**§ 11.1.5.2 Workers' Compensation - Contractor including Independent Contractors shall provide Worker's Compensation insurance with coverage on a statutory basis according to Maine Law and apply to all personnel on the job site. Workers' Compensation insurance required minimum limits:**

|                                       |                         |
|---------------------------------------|-------------------------|
| .1 Coverage A (Workers' Compensation) | Statutory Limits        |
| .2 Coverage B (Employers Liability)   |                         |
| .1 Bodily injury by accident          | \$500,000 each accident |
| .2 Bodily injury by disease           | \$500,000 each employee |
| .3 Bodily injury by disease           | \$500,000 policy limit  |

**§ 11.1.5.3 Vehicle Liability Insurance - Contractor shall provide Vehicle Liability insurance with coverage for all owned, hired/rented and non-owned vehicles. Vehicle Liability insurance required minimum limit:**

|                          |  |
|--------------------------|--|
| .1 Combined Single Limit | \$1,000,000 each accident                                |
|                          | Or   |
| .2 Split Limits          | \$1,000,000 bodily injury<br>\$1,000,000 property damage |

**§ 11.3.1** Replace all of the existing § 11.3.1 and its subparagraphs with the following:

**[NOTE: THE PROJECT MANAGER WILL MANUALLY DELETE FROM THIS SECTION THE ONE NOT SELECTED TO DESCRIBE THE TYPE OF PROJECT.]**

**[FOR NEW, STAND-ALONE CONSTRUCTION AND MAJOR ADDITIONS USE THIS PARAGRAPH. Use for stand-alone buildings and major additions with fire walls and fire doors separating the addition from the existing building:]**

§ 11.3.1 The Contractor shall secure "All Risk" type Builder's Risk Insurance, appropriate for the Project, with an insurance company lawfully authorized to do business in the State of Maine, and shall maintain said insurance during the contract time. The insurance shall be written on a replacement cost basis and the amount of the insurance shall not be less than the full replacement cost of the Project and Project materials. The insurance shall cover, at a minimum, losses due to fire, smoke, explosion, hail, lightning, theft, vandalism, malicious mischief, wind, collapse, riot, aircraft, and increased cost of construction. Insurance shall also cover portions of the work located away from the site but intended for use at the site, and for portions of the work in transit. In the event of a loss, the insurance deductible and any uncovered loss will be assumed by the Contractor. The insurance shall name as the insured the Contractor, the Subcontractors, the Designer, and the University. The policy must be written as the primary insurance covering the project and include endorsement providing permission to occupy in advance of project completion. A certificate of insurance verifying coverage shall be forwarded simultaneously to the Designer and the University prior to starting any work at the site. If the Contractor fails to maintain the appropriate insurance, then the Contractor shall bear all reasonable costs attributed to that failure.

**[FOR RENOVATION, ALTERATION AND/OR ADDITION WORK USE THIS PARAGRAPH:]**

§ 11.3.1 For this project, Property Insurance coverage, up to the total amount of the Project, will be provided by the University by adding the Project to the University's existing master property insurance. Coverage shall be included for the Contractor and all Subcontractors, as their interests may appear, while involved in the Project and until the work is completed or the contractor is otherwise advised in writing. This insurance is limited to the "all risk" type coverage provided under the University's master property insurance for direct physical loss or damage to the building or building materials related to the project, subject to standard policy limitations and exclusions. The contractor is responsible for a \$10,000 per claim deductible. Any other insurance desired by the Contractor beyond that covered by the University's insurance, or to cover the \$10,000 deductible, is the responsibility of the Contractor. This contract stands as verification of the University's property insurance coverage on the project and no further verification will be provided.

§ 11.4.1 Replace the existing §11.4.1 with the following:

§ 11.4.1 The Contractor shall furnish a Performance Bond and a Payment Bond covering the faithful performance of the contract and payment of obligations arising thereof. Bonds may be obtained through the Contractor's usual source and the cost thereof shall be included in the Contract Sum. The amount of each bond shall be equal to 100% of the Contract Sum. Should the Contract Sum change during the contract and warranty periods, the amount of the Bonds will be changed to reflect the Contract Sum.

§ 11.4.1.1 The Contractor shall deliver the required bonds to the Owner at the same

time as the signed Contract Agreement is delivered to the Owner. Prior to the commencement of the Work, the Contractor shall submit satisfactory evidence that such bonds will be furnished.

**§ 11.4.1.2** The Contractor shall require the attorney-in-fact who executes the required bonds on behalf of the surety to affix thereto a certified and current copy of the power of attorney.

**§ 11.4.1.3** The Contract Bonds shall continue in effect for one year after final acceptance of each contract to protect the Owner's interest in connection with the one year guarantee of workmanship and materials and to assure settlement of claims, for the payment of all bills for labor, materials, and equipment by the Contractor.

**§ 13.6** Delete §13.6 in its entirety.

**§ 14.1.1.4** Delete §14.1.1.4 in its entirety.

**§ 14.1.3** Delete the words "and damages"

**§ 14.4.3** Replace the existing §14.4.3 with the following:

**§ 14.4.3** In case of such termination for the Owner's convenience, the Contractor shall be entitled to receive payment for the work executed and costs incurred by reason of such termination, but not overhead and profit on Work not executed.

**§ 15.4.1** Replace the existing §15.4.1 with the following:

**§ 15.4.1** The parties have selected arbitration as the method for binding dispute resolution in this Agreement, any claim, dispute or other matter in question arising out of or related to this Agreement subject to, but not resolved by, mediation shall be subject to arbitration, which unless the parties mutually agree otherwise, shall be administered by the American Arbitration Association in accordance with its Construction Industry Arbitration Rules in effect on the date of this Agreement, except that the parties shall select only one Arbitrator, and there shall be no discovery. A demand for arbitration shall be made in writing, delivered to the other party to this Agreement, and filed with the person or entity administering the arbitration. The party filing a notice of demand for arbitration must assert in the demand all Claims then known to that party on which arbitration is permitted to be defended.

# THE MAINE HUMAN RIGHTS ACT GUARANTEES...

## Equal Employment Rights

### EQUAL EMPLOYMENT RIGHTS

1. The RIGHT to freedom from discrimination in employment.
2. The opportunity for an individual to secure employment without discrimination... is declared to be a CIVIL RIGHT.

The Maine Human Rights Act prohibits discrimination because of race, color, sex, sexual orientation, age, physical or mental disability, genetic pre-disposition, religion, ancestry or national origin.

The Maine Human Rights Act also prohibits discrimination because of filing a claim or asserting a right under the Worker's Comp Act or retaliation under the Whistleblower's Act.

### UNLAWFUL EMPLOYMENT DISCRIMINATION

1. For any employer to fail or refuse to hire an applicant
2. For any employer to discharge an employee
3. For any employer to discriminate against an employee with respect to recruitment, tenure, promotion, transfer, or compensation
4. For any employment agency to fail or refuse to classify properly or refer for employment an applicant
5. For any labor organization to exclude from apprenticeship or membership an applicant
6. For any employer, employment agency, or labor organization prior to employment or admission to membership of an individual to ask questions, keep as record, use application form, issue any notice, employ a quota system
7. For any employer, employment agency, or labor organization to retaliate against a person who has opposed a violation of the Maine Human Rights Act

Because of race, color, sex, sexual orientation, age, physical or mental disability, genetic pre-disposition, religion, ancestry or national origin or because of asserting a claim under the Worker's Comp Act or Whistleblower's Act.

## MAINE = HUMAN RIGHTS COMMISSION

IF YOU FEEL YOU HAVE BEEN DISCRIMINATED AGAINST, CONTACT THE COMMISSION OFFICE.

51 STATE HOUSE STATION, AUGUSTA, MAINE 04333-0051

PHONE (207) 624-6050

FAX (207) 624-6063

TTY 1-888-577-6690

(Rev. Dec. 28, 2005)

Printed under appropriation: 01094H1010012

Attachment A



### Schedule of Liquidated Damages

Liquidated damages (a fixed amount set forth in the contract) agreed to by the owner and the contractor are intended to compensate the owner for unexcused delay in the performance of the contract. The parties agree that the purpose of the liquidated damages schedule below is to establish, in advance, a reasonable estimate of the damages that would be incurred by the owner if there is an unexcused delay, or a breach of contract, which causes the work to be extended beyond the contractual substantial completion date. This agreement of liquidated damages by the parties is made to establish the reasonableness of them to the actual damages an owner may have incur due to unexcused delays by the contractor, even though the actual damages may be an uncertain amount and unprovable.

The specific per diem rates for Liquidated Damages are **set forth below** . By executing the Contract, the Contractor acknowledges that such an amount is not a penalty and that the daily amount set forth in the Contract is a reasonable per diem forecast of damages incurred by the Owner due to the Contractor's failure to complete the Work within the Contract Time.

| Original Contract Amount |                     | Per Diem Amount of<br>Liquidated Damages |
|--------------------------|---------------------|--|
| From<br>More Than        | To<br>and Including |  |
| 0                        | \$100,000           | \$500                                    |
| \$100,000                | \$300,000           | \$675                                    |
| \$300,000                | \$500,000           | \$750                                    |
| \$500,000                | \$1,000,000         | \$825                                    |
| \$1,000,000              | \$2,000,000         | \$1,000                                  |
| \$2,000,000              | \$4,000,000         | \$1,250                                  |
| \$4,000,000              | and more            | \$1,500                                  |



**THIS DOCUMENT MUST BE CLEARLY POSTED AT THE PERTAINING STATE FUNDED PREVAILING WAGE CONSTRUCTION SITE**

State of Maine  
 Department of Labor  
 Bureau of Labor Standards  
 Technical Services Division  
 Augusta, Maine 04333-0045  
 Telephone (207) 623-7906

Wage Determination - In accordance with 26 MRSA §1301 et. seq., this is a determination by the Bureau of Labor Standards, of the fair minimum wage rate to be paid to laborers and workers employed on the below titled project.

Title of Project -----Woodbury Bathroom Installation-6100286

Location of Project --Portland, Cumberland County

**2017 Fair Minimum Wage Rates  
 Building 2 Cumberland County  
 (other than 1 or 2 family homes)  
 -REVISED-**

| <u>Occupation Title</u>                    | <u>Minimum Wage</u> | <u>Minimum Benefit</u> | <u>Total</u> | <u>Occupation Title</u>                         | <u>Minimum Wage</u> | <u>Minimum Benefit</u> | <u>Total</u> |
|--|---------------------|------------------------|--------------|---|---------------------|------------------------|--------------|
| Asbestos/Lead Removal Worker               | \$16.25             | \$0.00                 | \$16.25      | Laborers (Incl.Helpers & Tenders)               | \$14.46             | \$1.79                 | \$16.25      |
| Backhoe Loader Operator                    | \$18.25             | \$2.36                 | \$20.61      | Laborer - Skilled                               | \$17.00             | \$2.05                 | \$19.05      |
| Bricklayer                                 | \$23.00             | \$3.67                 | \$26.67      | Loader Operator - Front-End                     | \$18.63             | \$3.66                 | \$22.29      |
| Bulldozer Operator                         | \$20.55             | \$3.83                 | \$24.38      | Mechanic- Maintenance                           | \$20.25             | \$1.48                 | \$21.73      |
| Carpenter                                  | \$21.00             | \$3.44                 | \$24.44      | Mechanic- Refrigeration                         | \$21.69             | \$4.21                 | \$25.90      |
| Carpenter - Acoustical                     | \$17.50             | \$3.20                 | \$20.70      | Millwright                                      | \$26.75             | \$11.19                | \$37.94      |
| Carpenter - Rough                          | \$19.00             | \$1.84                 | \$20.84      | Oil/Fuel Burner Servicer & Installer (Licensed) | \$24.47             | \$3.11                 | \$27.58      |
| Cement Mason/Finisher                      | \$16.25             | \$3.78                 | \$20.03      | Painter   | \$17.50             | \$2.29                 | \$19.79      |
| Crane Operator =>15 Tons)                  | \$25.65             | \$6.76                 | \$32.41      | Pipe/Steam/Sprinkler Fitter                     | \$22.50             | \$3.78                 | \$26.28      |
| Crusher Plant Operator                     | \$18.00             | \$2.91                 | \$20.91      | Pipelayer                                       | \$20.00             | \$2.85                 | \$22.85      |
| Dry-Wall Applicator                        | \$21.62             | \$0.64                 | \$22.26      | Plumber (Licensed)                              | \$25.75             | \$3.95                 | \$29.70      |
| Dry-Wall Taper & Finisher                  | \$21.73             | \$1.82                 | \$23.55      | Plumber Helper/Trainee (Licensed)               | \$18.50             | \$3.42                 | \$21.92      |
| Electrician - Licensed                     | \$25.00             | \$4.61                 | \$29.61      | Roofer  | \$15.00             | \$0.99                 | \$15.99      |
| Electrician Helper/Cable Puller (Licensed) | \$16.00             | \$2.83                 | \$18.83      | Sheet Metal Worker                              | \$20.50             | \$1.68                 | \$22.18      |
| Elevator Constructor/Installer             | \$54.53             | \$36.75                | \$91.28      | Sider   | \$17.50             | \$1.60                 | \$19.10      |
| Excavator Operator                         | \$18.50             | \$1.83                 | \$20.33      | Tile Setter                                     | \$22.08             | \$5.76                 | \$27.84      |
| Fence Setter                               | \$14.75             | \$0.00                 | \$14.75      | Truck Driver - Light                            | \$16.00             | \$1.00                 | \$17.00      |
| Floor Layer                                | \$18.00             | \$4.78                 | \$22.78      | Truck Driver - Medium                           | \$17.00             | \$1.91                 | \$18.91      |
| HVAC                                       | \$26.00             | \$3.82                 | \$29.82      | Truck Driver - Heavy                            | \$14.50             | \$1.44                 | \$15.94      |
| Insulation Installer                       | \$19.50             | \$2.43                 | \$21.93      | Truck Driver - Tractor Trailer                  | \$17.00             | \$2.57                 | \$19.57      |
| Ironworker - Reinforcing                   | \$25.75             | \$5.14                 | \$30.89      | Truck Driver - Mixer (Cement)                   | \$16.00             | \$3.49                 | \$19.49      |
| Ironworker - Structural                    | \$21.00             | \$3.04                 | \$24.04      |   |                     |                        |              |

The Laborer classifications include a wide range of work duties. Therefore, if any specific occupation to be employed on this project is not listed in this determination, call the Bureau of Labor Standards at the above number for further clarification.

Welders are classified in the trade to which the welding is incidental.


Apprentices - The minimum wage rate for registered apprentices are those set forth in the standards and policies of the Maine State Apprenticeship and Training Council for approved apprenticeship programs.

Posting of Schedule - Posting of this schedule is required in accordance with 26 MRSA §1301 et. seq., by any contractor holding a State contract for construction valued at \$50,000 or more and any subcontractors to such a contractor.

Appeal - Any person affected by the determination of these rates may appeal to the Commissioner of Labor by filing a written notice with the Commissioner stating the specific grounds of the objection within ten (10) days from the filing of these rates.

Determination No: B2-073-2017  
 Filing Date: June 30, 2017

A true copy

Attest:   
 Pamela D. Megathlin  
 Director  
 Bureau of Labor Standards

Expiration Date: 12-31-2017

BLS 424BU (R2012) (Building 2 Cumberland)



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 011000 - SUMMARY

PART 1 - GENERAL

1.01 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

1.02 SUMMARY

- A. This Section includes the following:
  - 1. Roles and Responsibilities.
  - 2. Work covered by the Contract Documents.
  - 3. Type of the Contract.
  - 4. Work schedule.
  - 5. Work under other contracts.
  - 6. Use of premises.
  - 7. Owner's occupancy requirements.
  - 8. Work restrictions.
  - 9. Specification formats and conventions.

1.03 ROLES AND RESPONSIBILITIES

- A. Owner: University of Maine System for the University of Southern Maine.
- B. Architect: Oak Point Associates, 231 Main Street, Biddeford, ME 04005.

1.04 WORK COVERED BY CONTRACT DOCUMENTS

- A. Project Identification:
  - 1. Project Location: University of Southern Maine, Portland Campus.
  - 2. Description: Woodbury Campus Center Bathroom Installation.

1.05 TYPE OF CONTRACT

- A. Project will be constructed under a single prime contract, design bid build.

1.06 WORK SCHEDULE

- A. Substantial completion date for the work:
  - 1. The building and site shall be substantially complete by September 29, 2017.
- B. Final completion, including completion of interior punch list items shall be done October 13, 2017.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1.07 WORK UNDER OTHER CONTRACTS

- A. General: Cooperate fully with separate contractors so work on those contracts may be carried out smoothly, without interfering with or delaying work under this Contract. Coordinate the Work of this Contract with work performed under separate contracts.
- B. Concurrent Work: Owner will award separate contract(s) for the following construction operations at Project site. Those operations will be conducted simultaneously with work under this Contract.
  - 1. TAB.
  - 2. Security.

1.08 USE OF PREMISES

- A. General: Contractor shall have limited use of premises for construction operations as indicated on Drawings by the Contract limits.
- B. Use of Site: Limit use of premises to areas within the Contract limits indicated. Do not disturb portions of Project site beyond areas in which the Work is indicated.
  - 1. Owner Occupancy: Allow for Owner occupancy of rooms and facilities adjacent to the work and use by the public.
  - 2. Driveways and Entrances: Keep driveways parking, and entrances serving premises clear and available to Owner, Owner's employees, and emergency vehicles at all times. Do not use these areas for parking or storage of materials.
    - a. Schedule deliveries to minimize use of driveways and entrances.
    - b. Schedule deliveries to minimize space and time requirements for storage of materials and equipment on-site.
- C. Use of Existing Building: Maintain existing building in a weather tight condition throughout construction period. Repair damage caused by construction operations. Protect building and its occupants during construction period.
- D. **Campus Tobacco Use Policy: A tobacco-free campus has been established at The University of Southern Maine to provide a healthy working and learning environment for the entire campus community.**
  - 1. The University of Southern Maine is a tobacco-free campus. This policy applies to faculty, staff, students, contractors, vendors and visitors. The use of tobacco and all smoking products is not permitted on any university-owned property, which includes but is not limited to, buildings, university grounds, parking areas, campus walkways, recreational and sporting facilities, and university or personally-owned, rented or leased vehicles.
  - 2. Tobacco use by definition includes the possession of any lighted tobacco products, or the use of any type of smokeless tobacco, including but not limited to chew, snuff, snus, electronic cigarettes, and all other nicotine delivery devices that are non-FDA approved as cessation products.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

3. It is the shared responsibility of all members of the campus community to respect and abide by this policy. The successful implementation of this policy depends on the courtesy and cooperation of the entire campus community.

#### 1.09 OWNER'S OCCUPANCY REQUIREMENTS

- A. Full Owner Occupancy: Owner will occupy adjacent site and existing building during entire construction period. Cooperate with Owner during construction operations to minimize conflicts and facilitate Owner usage. Perform the Work so as not to interfere with Owner's day-to-day operations. Maintain existing exits, unless otherwise indicated.
  1. Maintain access to existing walkways, corridors, and other adjacent occupied or used facilities. Do not close or obstruct walkways, corridors, or other occupied or used facilities without written permission from Owner and authorities having jurisdiction.
  2. Provide not less than 72 hours' notice to Owner of activities that will affect Owner's operations.

#### 1.10 WORK RESTRICTIONS

- A. Existing Utility Interruptions: Do not interrupt utilities serving facilities occupied by Owner or others unless permitted under the following conditions and then only after arranging to provide temporary utility services according to requirements indicated:
  1. Notify Architect and Owner not less than three days in advance of proposed utility interruptions.
  2. Do not proceed with utility interruptions without Owner's written permission.
  3. Shutdowns shall be scheduled during after hours, or during semester breaks, when the facility is not occupied.

#### 1.11 SPECIFICATION FORMATS AND CONVENTIONS

- A. Specification Format: The Specifications are organized into Divisions and Sections using the 50-division format and CSI/CSC's "2004 MasterFormat" numbering system.
  1. Section Identification: The Specifications use Section numbers and titles to help cross-referencing in the Contract Documents. Sections in the Project Manual are in numeric sequence; however, the sequence is incomplete because all available Section numbers are not used. Consult the table of contents at the beginning of the Project Manual to determine numbers and names of Sections in the Contract Documents.
  2. Division 1: Sections in Division 1 govern the execution of the Work of all Sections in the Specifications.
- B. Specification Content: The Specifications use certain conventions for the style of language and the intended meaning of certain terms, words, and phrases when used in particular situations. These conventions are as follows:
  1. Abbreviated Language: Language used in the Specifications and other Contract Documents is abbreviated. Words and meanings shall be interpreted as appropriate. Words implied, but not stated, shall be inferred as the sense requires. Singular words

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

shall be interpreted as plural, and plural words shall be interpreted as singular where applicable as the context of the Contract Documents indicates.

2. Imperative mood and streamlined language are generally used in the Specifications. Requirements expressed in the imperative mood are to be performed by Contractor. Occasionally, the indicative or subjunctive mood may be used in the Section Text for clarity to describe responsibilities that must be fulfilled indirectly by Contractor or by others when so noted.
  - a. The words "shall," "shall be," or "shall comply with," depending on the context, are implied where a colon (:) is used within a sentence or phrase.

PART 2 - PRODUCTS (Not Used)

PART 3 - EXECUTION (Not Used)

END OF SECTION



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 012600 - CONTRACT MODIFICATION PROCEDURES

PART 1 - GENERAL

1.01 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

1.02 SUMMARY

- A. This Section specifies administrative and procedural requirements for handling and processing Contract modifications.
- B. Related Sections include the following:
  - 1. Division 01 Section "Product Requirements" for administrative procedures for handling requests for substitutions made after Contract award.

1.03 MINOR CHANGES IN THE WORK

- A. Architect will issue supplemental instructions authorizing Minor Changes in the Work, not involving adjustment to the Contract Sum or the Contract Time, on AIA Document G710, "Architect's Supplemental Instructions."

1.04 PROPOSAL REQUESTS

- A. Owner-Initiated Proposal Requests: Architect will issue a detailed description of proposed changes in the Work that may require adjustment to the Contract Sum or the Contract Time. If necessary, the description will include supplemental or revised Drawings and Specifications.
  - 1. Proposal Requests issued by Architect are for information only. Do not consider them instructions either to stop work in progress or to execute the proposed change.
  - 2. Within 20 days after receipt of Proposal Request or earlier as specified in Proposal Request issued, submit a quotation estimating cost adjustments to the Contract Sum and the Contract Time necessary to execute the change.
    - a. Include a list of quantities of products required or eliminated and unit costs, with total amount of purchases and credits to be made. If requested, furnish survey data to substantiate quantities.
    - b. Indicate applicable taxes, delivery charges, equipment rental, and amounts of trade discounts.
    - c. Include costs of labor and supervision directly attributable to the change.
    - d. Include quotes on supplier's and subcontractor's letterhead for the requested change.
    - e. Include an updated Contractor's Construction Schedule that indicates the effect of the change, including, but not limited to, changes in activity duration, start and

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

finish times, and activity relationship. Use available total float time before requesting an extension of the Contract Time.

- B. Contractor-Initiated Proposals: If latent or unforeseen conditions require modifications to the Contract, Contractor may propose changes by submitting a request for a change to Architect.
1. Include a statement outlining reasons for the change and the effect of the change on the Work. Provide a complete description of the proposed change. Indicate the effect of the proposed change on the Contract Sum and the Contract Time.
  2. Include a list of quantities of products required or eliminated and unit costs, with total amount of purchases and credits to be made. If requested, furnish survey data to substantiate quantities.
  3. Indicate applicable taxes, delivery charges, equipment rental, and amounts of trade discounts.
  4. Include costs of labor and supervision directly attributable to the change.
  5. Include an updated Contractor's Construction Schedule that indicates the effect of the change, including, but not limited to, changes in activity duration, start and finish times, and activity relationship. Use available total float time before requesting an extension of the Contract Time.
  6. Comply with requirements in Division 1 Section "Product Requirements" if the proposed change requires substitution of one product or system for product or system specified.
- C. Proposal Request Form: Use AIA Document G709 for Proposal Requests, or format as approved by the Owner.

1.05 ALLOWANCES

- A. Allowance Adjustment: To adjust allowance amounts, base each Change Order proposal on the difference between purchase amount and the allowance, multiplied by final measurement of work-in-place. If applicable, include reasonable allowances for cutting losses, tolerances, mixing wastes, normal product imperfections, and similar margins.
1. Include installation costs in purchase amount only where indicated as part of the allowance.
  2. If requested, prepare explanation and documentation to substantiate distribution of overhead costs and other margins claimed.
  3. Submit substantiation of a change in scope of work, if any, claimed in Change Orders related to unit-cost allowances.
  4. Owner reserves the right to establish the quantity of work-in-place by independent quantity survey, measure, or count.
- B. Submit claims for increased costs because of a change in scope or nature of the allowance described in the Contract Documents, whether for the Purchase Order amount or Contractor's handling, labor, installation, overhead, and profit. Submit claims within 21 days of receipt of the Change Order or Construction Change Directive authorizing work to proceed. Owner will reject claims submitted later than 21 days after such authorization.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1. Do not include Contractor's or subcontractor's indirect expense in the Change Order cost amount unless it is clearly shown that the nature or extent of work has changed from what could have been foreseen from information in the Contract Documents.
2. No change to Contractor's indirect expense is permitted for selection of higher- or lower-priced materials or systems of the same scope and nature as originally indicated.

1.06 CHANGE ORDER PROCEDURES

- A. On Owner's approval of a Proposal Request, Architect will issue a University of Maine Change Order form for signatures of Owner and Contractor.

1.07 CONSTRUCTION CHANGE DIRECTIVE

- A. Construction Change Directive: Architect may issue a Construction Change Directive on AIA Document G714 . Construction Change Directive instructs Contractor to proceed with a change in the Work, for subsequent inclusion in a Change Order.
  1. Construction Change Directive contains a complete description of change in the Work. It also designates method to be followed to determine change in the Contract Sum or the Contract Time.
- B. Documentation: Maintain detailed records on a time and material basis of work required by the Construction Change Directive.
  1. After completion of change, submit an itemized account and supporting data necessary to substantiate cost and time adjustments to the Contract.

PART 2 - PRODUCTS (Not Used)

PART 3 - EXECUTION (Not Used)

END OF SECTION



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 012900 - PAYMENT PROCEDURES

PART 1 - GENERAL

1.01 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

1.02 SUMMARY

- A. This Section specifies administrative and procedural requirements necessary to prepare and process Applications for Payment.

- B. Related Sections include the following:

1. Division 1 Section "Contract Modification Procedures" for administrative procedures for handling changes to the Contract.
2. Division 1 Section "Construction Progress Documentation" for administrative requirements governing preparation and submittal of Contractor's Construction Schedule and Submittals Schedule.
3. Division 1 Section "Operation and Maintenance Data" for concurrent submittal of Preliminary Operation and Maintenance Summary with schedule of values submittal.

1.03 DEFINITIONS

- A. Schedule of Values: A statement furnished by Contractor allocating portions of the Contract Sum to various portions of the Work and used as the basis for reviewing Contractor's Applications for Payment.

1.04 SCHEDULE OF VALUES

- A. Coordination: Coordinate preparation of the Schedule of Values with preparation of Contractor's Construction Schedule.

1. Correlate line items in the Schedule of Values with other required administrative forms and schedules, including the following:
  - a. Application for Payment forms with Continuation Sheets.
  - b. Submittals Schedule.
  - c. Contractor's Construction Schedule.
2. Submit the Schedule of Values to Architect at earliest possible date but no later than seven days before the date scheduled for submittal of initial Applications for Payment.
  - a. Submit Schedule of Values to the Architect in electronic format for review, comment and approval by the Owner.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

3. Subschedules: Where the Work is separated into phases requiring separately phased payments, provide subschedules showing values correlated with each phase of payment.
- B. Format and Content: Use the Project Manual table of contents as a guide to establish line items for the Schedule of Values. Provide at least one line item for each Specification Section.
1. Cover Sheet Identification: Include the following Project identification on the Schedule of Values:
    - a. Project name and location.
    - b. Name of Architect.
    - c. Architect's project number.
    - d. Contractor's name and address.
    - e. Date of submittal.
    - f. Certification that Record Drawings have been updated and verified.
  2. Submit draft of Continuation Sheets.
  3. Arrange the Schedule of Values in tabular form with separate columns to indicate the following for each item listed:
    - a. Related Specification Section or Division.
    - b. Description of the Work.
    - c. Name of subcontractor.
    - d. Name of manufacturer or fabricator.
    - e. Name of supplier.
    - f. Change Orders (numbers) that affect value.
    - g. Dollar value.
      - 1) Percentage of the Contract Sum to nearest one-hundredth percent, adjusted to total 100 percent.
  4. Provide a breakdown of the Contract Sum in enough detail to facilitate continued evaluation of Applications for Payment and progress reports. Coordinate with the Project Manual table of contents, providing at least one line item for each Specification Section. Provide several line items for principal subcontract amounts, where appropriate.
    - a. For each line item, provide a sublist breakdown as follows:
      - 1) Material.
      - 2) Labor.
      - 3) IDAT (Integrated Deliverables and Testing).
  5. Documentation: Submit proper documentation for the amounts being requisitioned from subcontractors and material suppliers with each Application for Payment.
  6. Round amounts to nearest whole dollar; total shall equal the Contract Sum.
  7. Provide a separate line item in the Schedule of Values for each part of the Work where Applications for Payment may include materials or equipment purchased or fabricated and stored, but not yet installed.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- a. Differentiate between items stored on-site and items stored off-site. If specified, include evidence of insurance or bonded warehousing.
  - b. Only major long lead delivery items may be considered for off-site storage (Example: Long lead custom mechanical unit). Standard order and production materials and products shall be delivered to the site before including in Application of Payment on such items.
8. Provide separate line items in the Schedule of Values for initial cost of materials, for each subsequent stage of completion, and for total installed value of that part of the Work.
  9. Each item in the Schedule of Values and Applications for Payment shall be complete.
    - a. Temporary facilities and other major cost items that are not direct cost of actual work-in-place may be shown either as separate line items in the Schedule of Values or distributed as general overhead expense, at Contractor's option.
  10. Schedule Updating: Update and resubmit the Schedule of Values before the next Applications for Payment when Change Orders or Construction Change Directives result in a change in the Contract Sum.
- C. The Contractor shall furnish to the Owner at the beginning of the project an expected monthly requisition estimate for the Owner's use in planning funding.

1.05 APPLICATIONS FOR PAYMENT

- A. Each Application for Payment shall be consistent with previous applications and payments as certified and paid for by Owner.
1. Initial Application for Payment, Application for Payment at time of Substantial Completion, and final Application for Payment involve additional requirements.
- B. Payment Application Times: Progress Payment Applications shall be submitted not less than 7 days before monthly progress meeting. The period covered by each Application for Payment is one month, ending on the last day of the month.
1. Submit electronic copy to Owner for review and comment at least 7 days before monthly progress meeting. Upon receipt of review comments, prepare notarized paper copies and transmit for signing at the progress meeting.
- C. Payment Application Forms: Use AIA Document G702 and AIA Document G703 Continuation Sheets form for Applications for Payment.
- D. Application Preparation: Complete every entry on form. Notarize and execute by a person authorized to sign legal documents on behalf of Contractor. Incomplete applications will be returned without action.
1. Entries shall match data on the Schedule of Values and Contractor's Construction Schedule. Use updated schedules if revisions were made.
  2. Include amounts of Change Orders and Construction Change Directives issued before last day of construction period covered by application.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- E. Transmittal: Submit 3 signed and notarized original copies of each Application for Payment by a method ensuring receipt within 24 hours. One copy shall include waivers of lien and similar attachments if required.
1. Transmit each copy with a transmittal form listing attachments and recording appropriate information about application.
  2. Submit one electronic copy of Application for Payment.
- F. Waivers of Mechanic's Lien: With each Application for Payment, submit waivers of mechanic's liens from subcontractors, sub-subcontractors, and suppliers for construction period covered by the previous application.
1. Submit partial waivers on each item for amount requested in previous application, after deduction for retainage, on each item.
  2. When an application shows completion of an item, submit final or full waivers.
  3. Owner reserves the right to designate which entities involved in the Work must submit waivers.
  4. Submit final Application for Payment with or preceded by final waivers from every entity involved with performance of the Work covered by the application who is lawfully entitled to a lien.
  5. Waiver Forms: Submit waivers of lien on University of Maine System Wavier of Lien form, executed in a manner acceptable to Owner.
- G. Record Drawing Updates: With each Application of Payment, record documents shall be maintained and current for all trades, available for viewing at a central location.
- H. Initial Application for Payment: Administrative actions and submittals that must precede or coincide with submittal of first Application for Payment include the following:
1. List of subcontractors.
  2. Schedule of Values.
  3. Contractor's Construction Schedule (preliminary if not final).
  4. Products list.
  5. Schedule of unit prices.
  6. Submittals Schedule (preliminary if not final).
  7. List of Contractor's staff assignments.
  8. List of Contractor's principal consultants.
  9. Copies of building permits and other required permits.
  10. Copies of authorizations and licenses from authorities having jurisdiction for performance of the Work.
  11. Initial progress report.
  12. Report of preconstruction conference.
  13. Certificates of insurance and insurance policies.
  14. Performance and payment bonds.
- I. Progress Applications for Payment: Administrative actions and submittals that must precede or coincide with submittal of progress Applications for Payment include the following:
1. Contractor's Construction Schedule update.



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

2. Submittals for Work being requisitioned for are complete and approved.
  3. Submit list of completed tests, checklists, commissioning, reports, IDAT and similar requirements for the work are submitted and in compliance with the Contract Documents.
  4. Minutes of previous month's progress meeting have been distributed.
  5. Record drawings are current.
- J. Application for Payment at Substantial Completion: After issuing the Certificate of Substantial Completion, submit an Application for Payment showing 100 percent completion less retainage, for portion of the Work claimed as substantially complete.
1. Include documentation supporting claim that the Work is substantially complete and a statement showing an accounting of changes to the Contract Sum.
  2. This application shall reflect Certificates of Partial Substantial Completion issued previously for Owner occupancy of designated portions of the Work.
- K. Final Payment Application: Submit final Application for Payment with releases and supporting documentation not previously submitted and accepted, including, but not limited, to the following:
1. Evidence of completion of Project closeout requirements, record documents, operation and maintenance data, and demonstration and training.
  2. Insurance certificates for products and completed operations where required and proof that taxes, fees, and similar obligations were paid.
  3. Updated final statement, accounting for final changes to the Contract Sum.
  4. University of Maine System - Certificate of Completion.
  5. University of Maine System - Waiver of Lien.
  6. Separate Releases of Waivers of Liens from Subcontractors and material and equipment suppliers.
  7. AIA Document G707, "Consent of Surety to Final Payment."
  8. Evidence that claims have been settled.
  9. Submission of Waste Reporting Sheets and Waste Handling Certificates.
  10. Final meter readings for utilities, a measured record of stored fuel, and similar data as of date of Substantial Completion or when Owner took possession of and assumed responsibility for corresponding elements of the Work.
  11. Final, liquidated damages settlement statement.

PART 2 - PRODUCTS (Not Used)

PART 3 - EXECUTION (Not Used)

END OF SECTION



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 013100 - PROJECT MANAGEMENT AND COORDINATION

PART 1 - GENERAL

1.01 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

1.02 SUMMARY

- A. This Section includes administrative provisions for coordinating construction operations on Project including, but not limited to, the following:

- 1. Administrative and supervisory personnel.
- 2. Project meetings.

- B. Related Sections include the following:

- 1. Division 01 Section "Construction Progress Documentation" for preparing and submitting Contractor's Construction Schedule.
- 2. Division 01 Section "Execution" for procedures for coordinating general installation and field-engineering services, including establishment of benchmarks and control points.
- 3. Division 01 Section "Closeout Procedures" for coordinating Contract closeout.

1.03 COORDINATION

- A. Coordination: Coordinate construction operations included in different Sections of the Specifications to ensure efficient and orderly installation of each part of the Work. Coordinate construction operations, included in different Sections that depend on each other for proper installation, connection, and operation.

- 1. Schedule construction operations in sequence required to obtain the best results where installation of one part of the Work depends on installation of other components, before or after its own installation.
- 2. Coordinate installation of different components with other contractors to ensure maximum accessibility for required maintenance, service, and repair.
- 3. Make adequate provisions to accommodate items scheduled for later installation.
- 4. Where availability of space is limited, coordinate installation of different components to ensure maximum performance and accessibility for required maintenance, service, and repair of all components, including mechanical and electrical. Coordinate location of pipes, conduits, ducts and similar items in confined areas to assure proper fit and access. Contractor is responsible for handling interferences created by the work of subcontractors (example, sprinkler pipe interfering with installation of duct work; duct work interfering with installation of tight fixtures).

- B. Coordinate with contractors doing work for the Owner under separate contracts.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- C. Prepare memoranda for distribution to each party involved, outlining special procedures required for coordination. Include such items as required notices, reports, and list of attendees at meetings.
  - 1. Prepare similar memoranda for Owner and separate contractors if coordination of their Work is required.
- D. Administrative Procedures: Coordinate scheduling and timing of required administrative procedures with other construction activities and activities of other contractors to avoid conflicts and to ensure orderly progress of the Work. Such administrative activities include, but are not limited to, the following:
  - 1. Preparation of Contractor's Construction Schedule.
  - 2. Preparation of the Schedule of Values.
  - 3. Installation and removal of temporary facilities and controls.
  - 4. Delivery and processing of submittals.
  - 5. Progress meetings.
  - 6. Preinstallation conferences.
  - 7. Project closeout activities.
  - 8. Startup and adjustment of systems.
  - 9. Project closeout activities.
- E. Conservation: Coordinate construction activities to ensure that operations are carried out with consideration given to conservation of energy, water, and materials.

1.04 SUBMITTALS

- A. Key Personnel Names: Within 15 days of starting construction operations, submit a list of key personnel assignments, including superintendent and other personnel in attendance at Project site. Identify individuals and their duties and responsibilities; list addresses and telephone numbers, including home and office telephone numbers. Provide names, addresses, and telephone numbers of individuals assigned as standbys in the absence of individuals assigned to Project.
  - 1. Post copies of list in Project meeting room, in temporary field office, and by each temporary telephone. Keep list current at all times.

1.05 ADMINISTRATIVE AND SUPERVISORY PERSONNEL

- A. General: In addition to Project superintendent, provide other administrative and supervisory personnel as required for proper performance of the Work.
  - 1. Include special personnel required for coordination of operations with other contractors.

1.06 PROJECT MEETINGS

- A. General: Schedule and conduct meetings and conferences at Project site, unless otherwise indicated.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1. Attendees: Inform participants and others involved, and individuals whose presence is required, of date and time of each meeting. Notify Owner and Architect of scheduled meeting dates and times.
  2. Agenda: Prepare the meeting agenda. Distribute the agenda to all invited attendees.
  3. Minutes: Record significant discussions and agreements achieved. Distribute the meeting minutes to everyone concerned, including Owner and Architect, within three days of the meeting.
- B. Preconstruction Conference: Schedule a preconstruction conference before starting construction, at a time convenient to Owner and Architect, but no later than 15 days after execution of the Agreement. Hold the conference at Project site or another convenient location. Conduct the meeting to review responsibilities and personnel assignments.
1. Attendees: Authorized representatives of Owner, Architect, and their consultants; Contractor and its superintendent; major subcontractors; suppliers; and other concerned parties shall attend the conference. All participants at the conference shall be familiar with Project and authorized to conclude matters relating to the Work.
  2. Agenda: Discuss items of significance that could affect progress, including the following:
    - a. Tentative construction schedule.
    - b. Phasing.
    - c. Critical work sequencing and long-lead items.
    - d. Designation of key personnel and their duties.
    - e. Procedures for processing field decisions and Change Orders.
    - f. Procedures for requests for interpretations (RFIs).
    - g. Procedures for testing and inspecting.
    - h. Procedures for processing Applications for Payment.
    - i. Distribution of the Contract Documents.
    - j. Submittal procedures.
    - k. Preparation of Record Documents.
    - l. Use of the premises.
    - m. Work restrictions.
    - n. Owner's occupancy requirements.
    - o. Responsibility for temporary facilities and controls.
    - p. Construction waste management and recycling.
    - q. Parking availability.
    - r. Office, work, and storage areas.
    - s. Equipment deliveries and priorities.
    - t. First aid.
    - u. Security.
    - v. Progress cleaning.
    - w. Working hours.
    - x. USM campus operational protocols and procedures.
  3. Minutes: Record and distribute meeting minutes.
    - a. Include action items and responsible party.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- C. Monthly Progress Meetings: Conduct progress meetings at monthly intervals. Coordinate dates of meetings with preparation of payment requests.
1. Attendees: In addition to representatives of Owner and Architect, each contractor, subcontractor, supplier, and other entity concerned with current progress or involved in planning, coordination, or performance of future activities shall be represented at these meetings. All participants at the conference shall be familiar with Project and authorized to conclude matters relating to the Work.
  2. Agenda: Review and correct or approve minutes of previous progress meeting. Review other items of significance that could affect progress. Include topics for discussion as appropriate to status of Project.
    - a. Contractor's Construction Schedule: Review progress since the last meeting. Determine whether each activity is on time, ahead of schedule, or behind schedule, in relation to Contractor's Construction Schedule. Determine how construction behind schedule will be expedited; secure commitments from parties involved to do so. Discuss whether schedule revisions are required to ensure that current and subsequent activities will be completed within the Contract Time.
      - 1) Review schedule for next period.
    - b. Application for Payment: Contractor shall bring copy of Application for Payment to meeting. Review Application for Payment and required attachments, including record drawing and documents status, waivers of mechanic's liens, list of completed tests, checklists, and similar requirements for the work are submitted and in compliance with the Contract Documents.
    - c. Review present and future needs of each entity present, including the following:
      - 1) Interface requirements.
      - 2) Sequence of operations.
      - 3) Status of submittals.
      - 4) Deliveries.
      - 5) Off-site fabrication.
      - 6) Access.
      - 7) Site utilization.
      - 8) Temporary facilities and controls.
      - 9) Work hours.
      - 10) Hazards and risks.
      - 11) Progress cleaning.
      - 12) Quality and work standards.
      - 13) Status of correction of deficient items.
      - 14) Field observations.
      - 15) Requests for interpretations (RFIs).
      - 16) Status of proposal requests.
      - 17) Pending changes.
      - 18) Status of Change Orders.
      - 19) Pending claims and disputes.
      - 20) Documentation of information for payment requests.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

3. Minutes: Record and distribute the meeting minutes.
    - a. Include action items and responsible party.
  4. Reporting: Distribute minutes of the meeting to each party present and to parties who should have been present.
    - a. Schedule Updating: Revise Contractor's Construction Schedule after each progress meeting where revisions to the schedule have been made or recognized. Issue revised schedule concurrently with the report of each meeting.
- D. Coordination/Progress Meetings: Conduct Project coordination/progress meetings at weekly intervals. Project coordination meetings are in addition to specific meetings held for other purposes, such as progress meetings and preinstallation conferences.
1. Attendees: In addition to representatives of Owner, each contractor, subcontractor, supplier, and other entity concerned with current progress or involved in planning, coordination, or performance of future activities shall be represented at these meetings. All participants at the conference shall be familiar with Project and authorized to conclude matters relating to the Work
  2. Agenda: Review and correct or approve minutes of the previous coordination meeting. Review other items of significance that could affect progress. Include topics for discussion as appropriate to status of Project.
  3. Reporting: Record meeting results and distribute copies to everyone in attendance and to others affected by decisions or actions resulting from each meeting.
    - a. Include action items and responsible party.

PART 2 - PRODUCTS (Not Used)

PART 3 - EXECUTION (Not Used)

END OF SECTION





WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 013200 - CONSTRUCTION PROGRESS DOCUMENTATION

PART 1 - GENERAL

1.01 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

1.02 SUMMARY

- A. This Section includes administrative and procedural requirements for documenting the progress of construction during performance of the Work, including the following:

- 1. Preliminary Construction Schedule.
- 2. Contractor's Construction Schedule.
- 3. Submittals Schedule.
- 4. Field condition reports.
- 5. Special reports.

- B. Related Sections include the following:

- 1. Division 1 Section "Payment Procedures" for submitting the Schedule of Values.
- 2. Division 1 Section "Project Management and Coordination" for submitting and distributing meeting and conference minutes.
- 3. Division 1 Section "Submittal Procedures" for submitting schedules and reports.

1.03 DEFINITIONS

- A. Activity: A discrete part of a project that can be identified for planning, scheduling, monitoring, and controlling the construction project. Activities included in a construction schedule consume time and resources.

- 1. Critical activities are activities on the critical path. They must start and finish on the planned early start and finish times.
- 2. Predecessor Activity: An activity that precedes another activity in the network.
- 3. Successor Activity: An activity that follows another activity in the network.

- B. Cost Loading: The allocation of the Schedule of Values for the completion of an activity as scheduled. The sum of costs for all activities must equal the total Contract Sum, unless otherwise approved by Architect.

- C. CPM: Critical path method, which is a method of planning and scheduling a construction project where activities are arranged based on activity relationships. Network calculations determine when activities can be performed and the critical path of Project.

- D. Critical Path: The longest connected chain of interdependent activities through the network schedule that establishes the minimum overall Project duration and contains no float.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- E. Event: The starting or ending point of an activity.
  - F. Float: The measure of leeway in starting and completing an activity.
    - 1. Float time is not for the exclusive use or benefit of either Owner or Contractor, but is a jointly owned, expiring Project resource available to both parties as needed to meet schedule milestones and Contract completion date.
    - 2. Free float is the amount of time an activity can be delayed without adversely affecting the early start of the successor activity.
    - 3. Total float is the measure of leeway in starting or completing an activity without adversely affecting the planned Project completion date.
  - G. Fragnet: A partial or fragmentary network that breaks down activities into smaller activities for greater detail.
  - H. Major Area: A story of construction, a separate building, or a similar significant construction element.
  - I. Milestone: A key or critical point in time for reference or measurement.
  - J. Network Diagram: A graphic diagram of a network schedule, showing activities and activity relationships.
  - K. Resource Loading: The allocation of manpower and equipment necessary for the completion of an activity as scheduled.
- 1.04 SUBMITTALS
- A. Submittals Schedule: Submit three copies of schedule. Arrange the following information in a tabular format:
    - 1. Scheduled date for first submittal.
    - 2. Specification Section number and title.
    - 3. Submittal category (action or informational).
    - 4. Name of subcontractor.
    - 5. Description of the Work covered.
    - 6. Scheduled date for Architect's final release or approval.
  - B. Preliminary Construction Schedule: Submit two paper copies and one electronic copy in "mpp" format.
    - 1. Approval of cost-loaded preliminary construction schedule will not constitute approval of Schedule of Values for cost-loaded activities.
  - C. Contractor's Construction Schedule: Submit two paper copies and written narrative, of initial schedule, large enough to show entire schedule for entire construction period and one electronic copy in "mpp" format. The narrative shall include as a minimum, identification and discussion of milestones, constraints and critical path.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- D. Field Condition Reports: Submit two copies at time of discovery of differing conditions.
- E. Special Reports: Submit two copies at time of unusual event.

1.05 COORDINATION

- A. Coordinate preparation and processing of schedules and reports with performance of construction activities and with scheduling and reporting of separate contractors.
- B. Coordinate Contractor's Construction Schedule with the Schedule of Values, list of subcontracts, Submittals Schedule, progress reports, payment requests, and other required schedules and reports.
  - 1. Secure time commitments for performing critical elements of the Work from parties involved.
  - 2. Coordinate each construction activity in the network with other activities and schedule them in proper sequence.

PART 2 - PRODUCTS

2.01 SUBMITTALS SCHEDULE

- A. Preparation: Submit a schedule of submittals, arranged in chronological order by dates required by construction schedule. Include time required for review, resubmittal, ordering, manufacturing, fabrication, and delivery when establishing dates.
  - 1. Coordinate Submittals Schedule with list of subcontracts, the Schedule of Values, and Contractor's Construction Schedule.
  - 2. The Owner will review the schedule of submittals and identify the submittals that they want to receive a copy of at the same time that the Architect's copies are sent out.

2.02 CONTRACTOR'S CONSTRUCTION SCHEDULE, GENERAL

- A. Time Frame: Extend schedule from date established by the Notice to Proceed to date of Final Completion.
  - 1. Contract completion date shall not be changed by submission of a schedule that shows an early completion date, unless specifically authorized by Change Order.
- B. Constraints: Include constraints and work restrictions indicated in the Contract Documents and as follows in schedule, and show how the sequence of the Work is affected.
- C. Milestones: Include milestones indicated in the Contract Documents in schedule, including, but not limited to, the Notice to Proceed, Mechanical Commissioning, Substantial Completion, and Final Completion.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

2.03 REPORTS

- A. Field Condition Reports: Immediately on discovery of a difference between field conditions and the Contract Documents, prepare and submit a detailed report. Submit with a request for interpretation. Include a detailed description of the differing conditions, together with recommendations for changing the Contract Documents.

2.04 SPECIAL REPORTS

- A. General: Submit special reports to Architect within one day(s) of an occurrence. Distribute copies of report to parties affected by the occurrence.
- B. Reporting Unusual Events: When an event of an unusual and significant nature occurs at Project site, whether or not related directly to the Work, prepare and submit a special report. List chain of events, persons participating, response by Contractor's personnel, evaluation of results or effects, and similar pertinent information. Advise Owner in advance when these events are known or predictable.

PART 3 - EXECUTION

3.01 CONTRACTOR'S CONSTRUCTION SCHEDULE

- A. Contractor's Construction Schedule Updating: At monthly intervals, update schedule to reflect actual construction progress and activities. Issue schedule one week before each regularly scheduled progress meeting.
  - 1. Revise schedule immediately after each meeting or other activity where revisions have been recognized or made. Issue updated schedule concurrently with the report of each such meeting.
  - 2. Include a narrative report with the updated schedule that indicates every change, including, but not limited to, changes in logic, durations, actual starts and finishes, and activity durations.
  - 3. As the Work progresses, indicate Actual Completion percentage for each activity.

END OF SECTION

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 013300 - SUBMITTAL PROCEDURES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes requirements for the submittal schedule and administrative and procedural requirements for submitting Shop Drawings, Product Data, Samples, and other submittals.
- B. Related Requirements:
  - 1. Section 012900 "Payment Procedures" for submitting Applications for Payment and the schedule of values.
  - 2. Section 013200 "Construction Progress Documentation" for submitting schedules and reports, including Contractor's construction schedule.
  - 3. Section 017823 "Operation and Maintenance Data" for submitting operation and maintenance manuals.
  - 4. Section 017839 "Project Record Documents" for submitting record Drawings, record Specifications, and record Product Data.

1.3 DEFINITIONS

- A. Action Submittals: Written and graphic information and physical samples that require Architect's responsive action. Action submittals are those submittals indicated in individual Specification Sections as "action submittals."
- B. Informational Submittals: Written and graphic information and physical samples that do not require Architect's responsive action. Submittals may be rejected for not complying with requirements. Informational submittals are those submittals indicated in individual Specification Sections as "informational submittals."

1.4 ACTION SUBMITTALS

- A. Submittal Schedule: Submit a schedule of submittals, arranged in chronological order by dates required by construction schedule. Include time required for review, ordering, manufacturing, fabrication, and delivery when establishing dates. Include additional time required for making corrections or revisions to submittals noted by Architect and additional time for handling and reviewing submittals required by those corrections.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1. Coordinate submittal schedule with list of subcontracts, the schedule of values, and Contractor's construction schedule.
2. Format: Arrange the following information in a tabular format:
  - a. Scheduled date for first submittal.
  - b. Specification Section number and title.
  - c. Submittal category: Action; informational.
  - d. Name of subcontractor.
  - e. Description of the Work covered.
  - f. Scheduled date for Architect's final release or approval.
  - g. Scheduled date of fabrication.
  - h. Scheduled dates for purchasing.
  - i. Scheduled dates for installation.
  - j. Activity or event number.

1.5 SUBMITTAL ADMINISTRATIVE REQUIREMENTS

- A. Coordination: Coordinate preparation and processing of submittals with performance of construction activities.
  1. Coordinate each submittal with fabrication, purchasing, testing, delivery, other submittals, and related activities that require sequential activity.
  2. Submit all submittal items required for each Specification Section concurrently unless partial submittals for portions of the Work are indicated on approved submittal schedule.
  3. Submit action submittals and informational submittals required by the same Specification Section as separate packages under separate transmittals.
  4. Coordinate transmittal of different types of submittals for related parts of the Work so processing will not be delayed because of need to review submittals concurrently for coordination.
    - a. Architect reserves the right to withhold action on a submittal requiring coordination with other submittals until related submittals are received.
- B. Processing Time: Allow time for submittal review, including time for resubmittals, as follows. Time for review shall commence on Architect's receipt of submittal. No extension of the Contract Time will be authorized because of failure to transmit submittals enough in advance of the Work to permit processing, including resubmittals.
  1. Initial Review: Allow seven days for initial review of each submittal. Allow additional time if coordination with subsequent submittals is required. Architect will advise Contractor when a submittal being processed must be delayed for coordination.
  2. Intermediate Review: If intermediate submittal is necessary, process it in same manner as initial submittal.
  3. Resubmittal Review: Allow seven days for review of each resubmittal.
- C. Electronic Submittals: Identify and incorporate information in each electronic submittal file as follows:

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1. Assemble complete submittal package into a single indexed file incorporating submittal requirements of a single Specification Section and transmittal form with links enabling navigation to each item.
  2. Name file with submittal number or other unique identifier, including revision identifier.
    - a. File name shall use project identifier and Specification Section number followed by a decimal point and then a sequential number (e.g., LNHS-061000.01). Resubmittals shall include an alphabetic suffix after another decimal point (e.g., LNHS-061000.01.A).
  3. Provide means for insertion to permanently record Contractor's review and approval markings and action taken by Architect.
  4. Transmittal Form for Electronic Submittals: Use software-generated form from electronic project management software acceptable to Owner, containing the following information:
    - a. Project name.
    - b. Date.
    - c. Name and address of Architect.
    - d. Name of Construction Manager.
    - e. Name of Contractor.
    - f. Name of firm or entity that prepared submittal.
    - g. Names of subcontractor, manufacturer, and supplier.
    - h. Category and type of submittal.
    - i. Submittal purpose and description.
    - j. Specification Section number and title.
    - k. Specification paragraph number or drawing designation and generic name for each of multiple items.
      - l. Drawing number and detail references, as appropriate.
    - m. Location(s) where product is to be installed, as appropriate.
    - n. Related physical samples submitted directly.
    - o. Indication of full or partial submittal.
    - p. Transmittal number, numbered consecutively.
    - q. Submittal and transmittal distribution record.
    - r. Other necessary identification.
    - s. Remarks.
- D. Options: Identify options requiring selection by Architect.
- E. Deviations and Additional Information: On an attached separate sheet, prepared on Contractor's letterhead, record relevant information, requests for data, revisions other than those requested by Architect on previous submittals, and deviations from requirements in the Contract Documents, including minor variations and limitations. Include same identification information as related submittal.
- F. Resubmittals: Make resubmittals in same form and number of copies as initial submittal.
1. Note date and content of previous submittal.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

2. Note date and content of revision in label or title block and clearly indicate extent of revision.
  3. Resubmit submittals until they are marked with approval notation from Architect's action stamp.
- G. Distribution: Furnish copies of final submittals to manufacturers, subcontractors, suppliers, fabricators, installers, authorities having jurisdiction, and others as necessary for performance of construction activities. Show distribution on transmittal forms.
- H. Use for Construction: Retain complete copies of submittals on Project site. Use only final action submittals that are marked with approval notation from Architect's action stamp.

## PART 2 - PRODUCTS

### 2.1 SUBMITTAL PROCEDURES

- A. General Submittal Procedure Requirements: Prepare and submit submittals required by individual Specification Sections. Types of submittals are indicated in individual Specification Sections.
1. Submit electronic submittals via email as PDF electronic files.
    - a. Architect will return annotated file. Annotate and retain one copy of file as an electronic Project record document file.
  2. Certificates and Certifications Submittals: Provide a statement that includes signature of entity responsible for preparing certification. Certificates and certifications shall be signed by an officer or other individual authorized to sign documents on behalf of that entity.
    - a. Provide a digital signature with digital certificate on electronically submitted certificates and certifications where indicated.
    - b. Provide a notarized statement on original paper copy certificates and certifications where indicated.
- B. Product Data: Collect information into a single submittal for each element of construction and type of product or equipment.
1. If information must be specially prepared for submittal because standard published data are not suitable for use, submit as Shop Drawings, not as Product Data.
  2. Mark each copy of each submittal to show which products and options are applicable.
  3. Include the following information, as applicable:
    - a. Manufacturer's catalog cuts.
    - b. Manufacturer's product specifications.
    - c. Standard color charts.
    - d. Statement of compliance with specified referenced standards.



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- e. Testing by recognized testing agency.
  - f. Application of testing agency labels and seals.
  - g. Notation of coordination requirements.
  - h. Availability and delivery time information.
4. For equipment, include the following in addition to the above, as applicable:
    - a. Wiring diagrams showing factory-installed wiring.
    - b. Printed performance curves.
    - c. Operational range diagrams.
    - d. Clearances required to other construction, if not indicated on accompanying Shop Drawings.
  5. Submit Product Data before or concurrent with Samples.
  6. Submit Product Data in the following format:
    - a. PDF electronic file.
- C. Shop Drawings: Prepare Project-specific information, drawn accurately to scale. Do not base Shop Drawings on reproductions of the Contract Documents or standard printed data, unless submittal based on Architect's digital data drawing files is otherwise permitted.
1. Preparation: Fully illustrate requirements in the Contract Documents. Include the following information, as applicable:
    - a. Identification of products.
    - b. Schedules.
    - c. Compliance with specified standards.
    - d. Notation of coordination requirements.
    - e. Notation of dimensions established by field measurement.
    - f. Relationship and attachment to adjoining construction clearly indicated.
    - g. Seal and signature of professional engineer if specified.
  2. Submit Shop Drawings in the following format:
    - a. PDF electronic file.
- D. Product Schedule: As required in individual Specification Sections, prepare a written summary indicating types of products required for the Work and their intended location. Include the following information in tabular form:
1. Type of product. Include unique identifier for each product indicated in the Contract Documents or assigned by Contractor if none is indicated.
  2. Manufacturer and product name, and model number if applicable.
  3. Number and name of room or space.
  4. Location within room or space.
  5. Submit product schedule in the following format:
    - a. PDF electronic file.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- E. Contractor's Construction Schedule: Comply with requirements specified in Section 013200 "Construction Progress Documentation."
- F. Application for Payment and Schedule of Values: Comply with requirements specified in Section 012900 "Payment Procedures."
- G. Closeout Submittals and Maintenance Material Submittals: Comply with requirements specified in Section 017700 "Closeout Procedures."
- H. Maintenance Data: Comply with requirements specified in Section 017823 "Operation and Maintenance Data."
- I. Qualification Data: Prepare written information that demonstrates capabilities and experience of firm or person. Include lists of completed projects with project names and addresses, contact information of architects and owners, and other information specified.
- J. Welding Certificates: Prepare written certification that welding procedures and personnel comply with requirements in the Contract Documents. Submit record of Welding Procedure Specification and Procedure Qualification Record on AWS forms. Include names of firms and personnel certified.
- K. Installer Certificates: Submit written statements on manufacturer's letterhead certifying that Installer complies with requirements in the Contract Documents and, where required, is authorized by manufacturer for this specific Project.
- L. Manufacturer Certificates: Submit written statements on manufacturer's letterhead certifying that manufacturer complies with requirements in the Contract Documents. Include evidence of manufacturing experience where required.
- M. Product Certificates: Submit written statements on manufacturer's letterhead certifying that product complies with requirements in the Contract Documents.
- N. Material Certificates: Submit written statements on manufacturer's letterhead certifying that material complies with requirements in the Contract Documents.
- O. Material Test Reports: Submit reports written by a qualified testing agency, on testing agency's standard form, indicating and interpreting test results of material for compliance with requirements in the Contract Documents.
- P. Product Test Reports: Submit written reports indicating that current product produced by manufacturer complies with requirements in the Contract Documents. Base reports on evaluation of tests performed by manufacturer and witnessed by a qualified testing agency, or on comprehensive tests performed by a qualified testing agency.
- Q. Preconstruction Test Reports: Submit reports written by a qualified testing agency, on testing agency's standard form, indicating and interpreting results of tests performed before installation of product, for compliance with performance requirements in the Contract Documents.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- R. Compatibility Test Reports: Submit reports written by a qualified testing agency, on testing agency's standard form, indicating and interpreting results of compatibility tests performed before installation of product. Include written recommendations for primers and substrate preparation needed for adhesion.
- S. Field Test Reports: Submit written reports indicating and interpreting results of field tests performed either during installation of product or after product is installed in its final location, for compliance with requirements in the Contract Documents.

PART 3 - EXECUTION

3.1 CONTRACTOR'S REVIEW

- A. Action and Informational Submittals: Review each submittal and check for coordination with other Work of the Contract and for compliance with the Contract Documents. Note corrections and field dimensions. Mark with approval stamp before submitting to Architect.
- B. Project Closeout and Maintenance Material Submittals: See requirements in Section 017700 "Closeout Procedures."
- C. Approval Stamp: Stamp each submittal with a uniform, approval stamp. Include Project name and location, submittal number, Specification Section title and number, name of reviewer, date of Contractor's approval, and statement certifying that submittal has been reviewed, checked, and approved for compliance with the Contract Documents.

3.2 ARCHITECT'S ACTION

- A. Action Submittals: Architect will review each submittal, make marks to indicate corrections or revisions required, and return it. Architect will stamp each submittal with an action stamp and will mark stamp appropriately to indicate action.
- B. Informational Submittals: Architect will review each submittal and will not return it, or will return it if it does not comply with requirements. Architect will forward each submittal to appropriate party.
- C. Partial submittals prepared for a portion of the Work will be reviewed when use of partial submittals has received prior approval from Architect.
- D. Incomplete submittals are unacceptable, will be considered nonresponsive, and will be returned for resubmittal without review.
- E. Submittals not required by the Contract Documents will be returned by the Architect without action.

END OF SECTION



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 014200 - REFERENCES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

1.2 DEFINITIONS

- A. General: Basic Contract definitions are included in the Conditions of the Contract.
- B. "Approved": When used to convey Architect's action on Contractor's submittals, applications, and requests, "approved" is limited to Architect's duties and responsibilities as stated in the Conditions of the Contract.
- C. "Directed": A command or instruction by Architect. Other terms including "requested," "authorized," "selected," "required," and "permitted" have the same meaning as "directed."
- D. "Indicated": Requirements expressed by graphic representations or in written form on Drawings, in Specifications, and in other Contract Documents. Other terms including "shown," "noted," "scheduled," and "specified" have the same meaning as "indicated."
- E. "Regulations": Laws, ordinances, statutes, and lawful orders issued by authorities having jurisdiction, and rules, conventions, and agreements within the construction industry that control performance of the Work.
- F. "Furnish": Supply and deliver to Project site, ready for unloading, unpacking, assembly, installation, and similar operations.
- G. "Install": Operations at Project site including unloading, temporarily storing, unpacking, assembling, erecting, placing, anchoring, applying, working to dimension, finishing, curing, protecting, cleaning, and similar operations.
- H. "Provide": Furnish and install, complete and ready for the intended use.
- I. "Project Site": Space available for performing construction activities. The extent of Project site is shown on Drawings and may or may not be identical with the description of the land on which Project is to be built.

1.3 INDUSTRY STANDARDS

- A. Applicability of Standards: Unless the Contract Documents include more stringent requirements, applicable construction industry standards have the same force and effect as if

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

bound or copied directly into the Contract Documents to the extent referenced. Such standards are made a part of the Contract Documents by reference.

- B. Publication Dates: Comply with standards in effect as of date of the Contract Documents unless otherwise indicated.

1.4 ABBREVIATIONS AND ACRONYMS

- A. Industry Organizations: Where abbreviations and acronyms are used in Specifications or other Contract Documents, they shall mean the recognized name of the entities indicated in Thomson Gale's "Encyclopedia of Associations" or in Columbia Books' "National Trade & Professional Associations of the U.S."

PART 2 - PRODUCTS (Not Used)

PART 3 - EXECUTION (Not Used)

END OF SECTION

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 016000 - PRODUCT REQUIREMENTS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes administrative and procedural requirements for selection of products for use in Project; product delivery, storage, and handling; manufacturers' standard warranties on products; special warranties; and comparable products.
- B. Related Requirements:
  - 1. Section 014200 "References" for applicable industry standards for products specified.

1.3 DEFINITIONS

- A. Products: Items obtained for incorporating into the Work, whether purchased for Project or taken from previously purchased stock. The term "product" includes the terms "material," "equipment," "system," and terms of similar intent.
  - 1. Named Products: Items identified by manufacturer's product name, including make or model number or other designation shown or listed in manufacturer's published product literature, that is current as of date of the Contract Documents.
  - 2. New Products: Items that have not previously been incorporated into another project or facility. Products salvaged or recycled from other projects are not considered new products.
  - 3. Comparable Product: Product that is demonstrated and approved through submittal process to have the indicated qualities related to type, function, dimension, in-service performance, physical properties, appearance, and other characteristics that equal or exceed those of specified product.
- B. Basis-of-Design Product Specification: A specification in which a specific manufacturer's product is named and accompanied by the words "basis-of-design product," including make or model number or other designation, to establish the significant qualities related to type, function, dimension, in-service performance, physical properties, appearance, and other characteristics for purposes of evaluating comparable products of additional manufacturers named in the specification.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1.4 ACTION SUBMITTALS

- A. Comparable Product Requests: Submit request for consideration of each comparable product. Identify product or fabrication or installation method to be replaced. Include Specification Section number and title and Drawing numbers and titles.
  - 1. Include data to indicate compliance with the requirements specified in "Comparable Products" Article.
  - 2. Engineer's Action: If necessary, Engineer will request additional information or documentation for evaluation within one week of receipt of a comparable product request. Engineer will notify Contractor of approval or rejection of proposed comparable product request within 15 days of receipt of request, or seven days of receipt of additional information or documentation, whichever is later.
    - a. Form of Approval: As specified in Section 013300 "Submittal Procedures."
    - b. Use product specified if Engineer does not issue a decision on use of a comparable product request within time allocated.
- B. Basis-of-Design Product Specification Submittal: Comply with requirements in Section 013300 "Submittal Procedures." Show compliance with requirements.

1.5 QUALITY ASSURANCE

- A. Compatibility of Options: If Contractor is given option of selecting between two or more products for use on Project, select product compatible with products previously selected, even if previously selected products were also options.
  - 1. Each contractor is responsible for providing products and construction methods compatible with products and construction methods of other contractors.
  - 2. If a dispute arises between contractors over concurrently selectable but incompatible products, Engineer will determine which products shall be used.

1.6 PRODUCT DELIVERY, STORAGE, AND HANDLING

- A. Deliver, store, and handle products using means and methods that will prevent damage, deterioration, and loss, including theft and vandalism. Comply with manufacturer's written instructions.
- B. Delivery and Handling:
  - 1. Schedule delivery to minimize long-term storage at Project site and to prevent overcrowding of construction spaces.
  - 2. Coordinate delivery with installation time to ensure minimum holding time for items that are flammable, hazardous, easily damaged, or sensitive to deterioration, theft, and other losses.
  - 3. Deliver products to Project site in an undamaged condition in manufacturer's original sealed container or other packaging system, complete with labels and instructions for handling, storing, unpacking, protecting, and installing.



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

4. Inspect products on delivery to determine compliance with the Contract Documents and to determine that products are undamaged and properly protected.

C. Storage:

1. Store products to allow for inspection and measurement of quantity or counting of units.
2. Store materials in a manner that will not endanger Project structure.
3. Store products that are subject to damage by the elements, under cover in a weathertight enclosure above ground, with ventilation adequate to prevent condensation.
4. Protect foam plastic from exposure to sunlight, except to extent necessary for period of installation and concealment.
5. Comply with product manufacturer's written instructions for temperature, humidity, ventilation, and weather-protection requirements for storage.
6. Protect stored products from damage and liquids from freezing.

1.7 PRODUCT WARRANTIES

- A. Warranties specified in other Sections shall be in addition to, and run concurrent with, other warranties required by the Contract Documents. Manufacturer's disclaimers and limitations on product warranties do not relieve Contractor of obligations under requirements of the Contract Documents.

1. Manufacturer's Warranty: Written warranty furnished by individual manufacturer for a particular product and specifically endorsed by manufacturer to Owner.
2. Special Warranty: Written warranty required by the Contract Documents to provide specific rights for Owner.

- B. Special Warranties: Prepare a written document that contains appropriate terms and identification, ready for execution.

1. Manufacturer's Standard Form: Modified to include Project-specific information and properly executed.
2. Specified Form: When specified forms are included with the Specifications, prepare a written document using indicated form properly executed.
3. See other Sections for specific content requirements and particular requirements for submitting special warranties.

- C. Submittal Time: Comply with requirements in Section 017700 "Closeout Procedures."

PART 2 - PRODUCTS

2.1 PRODUCT SELECTION PROCEDURES

- A. General Product Requirements: Provide products that comply with the Contract Documents, are undamaged and, unless otherwise indicated, are new at time of installation.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1. Provide products complete with accessories, trim, finish, fasteners, and other items needed for a complete installation and indicated use and effect.
2. Standard Products: If available, and unless custom products or nonstandard options are specified, provide standard products of types that have been produced and used successfully in similar situations on other projects.
3. Owner reserves the right to limit selection to products with warranties not in conflict with requirements of the Contract Documents.
4. Where products are accompanied by the term "as selected," Engineer will make selection.
5. Descriptive, performance, and reference standard requirements in the Specifications establish salient characteristics of products.
6. Or Equal: For products specified by name and accompanied by the term "or equal," or "or approved equal," or "or approved," comply with requirements in "Comparable Products" Article to obtain approval for use of an unnamed product.

B. Product Selection Procedures:

1. Product: Where Specifications name a single manufacturer and product, provide the named product that complies with requirements. Comparable products or substitutions for Contractor's convenience will not be considered.
2. Manufacturer/Source: Where Specifications name a single manufacturer or source, provide a product by the named manufacturer or source that complies with requirements. Comparable products or substitutions for Contractor's convenience will not be considered.
3. Products:
  - a. Restricted List: Where Specifications include a list of names of both manufacturers and products, provide one of the products listed that complies with requirements. Comparable products or substitutions for Contractor's convenience will be considered.
4. Manufacturers:
  - a. Restricted List: Where Specifications include a list of manufacturers' names, provide a product by one of the manufacturers listed that complies with requirements. Comparable products or substitutions for Contractor's convenience will be considered.
5. Basis-of-Design Product: Where Specifications name a product, or refer to a product indicated on Drawings, and include a list of manufacturers, provide the specified or indicated product or a comparable product by one of the other named manufacturers. Drawings and Specifications indicate sizes, profiles, dimensions, and other characteristics that are based on the product named. Comply with requirements in "Comparable Products" Article for consideration of an unnamed product by one of the other named manufacturers.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

2.2 COMPARABLE PRODUCTS

- A. Conditions for Consideration: Engineer will consider Contractor's request for comparable product when the following conditions are satisfied. If the following conditions are not satisfied, Engineer may return requests without action, except to record noncompliance with these requirements:
1. Evidence that the proposed product does not require revisions to the Contract Documents, that it is consistent with the Contract Documents and will produce the indicated results, and that it is compatible with other portions of the Work.
  2. Detailed comparison of significant qualities of proposed product with those named in the Specifications. Significant qualities include attributes such as performance, weight, size, durability, visual effect, and specific features and requirements indicated.
  3. Evidence that proposed product provides specified warranty.
  4. List of similar installations for completed projects with project names and addresses and names and addresses of Engineers and owners, if requested.
  5. Samples, if requested.

PART 3 - EXECUTION (Not Used)

END OF SECTION



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 017300 - EXECUTION

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes general administrative and procedural requirements governing execution of the Work.
- B. Related Requirements:
  - 1. Section 011000 "Summary" for limits on use of Project site.
  - 2. Section 013300 "Submittal Procedures" for submitting surveys.
  - 3. Section 017700 "Closeout Procedures" for submitting final property survey with Project Record Documents, recording of Owner-accepted deviations from indicated lines and levels, and final cleaning.

1.3 DEFINITIONS

- A. Cutting: Removal of in-place construction necessary to permit installation or performance of other work.
- B. Patching: Fitting and repair work required to restore construction to original conditions after installation of other work.

1.4 QUALITY ASSURANCE

- A. Cutting and Patching: Comply with requirements for and limitations on cutting and patching of construction elements.
  - 1. Structural Elements: When cutting and patching structural elements, notify Engineer of locations and details of cutting and await directions from Engineer before proceeding. Shore, brace, and support structural elements during cutting and patching. Do not cut and patch structural elements in a manner that could change their load-carrying capacity or increase deflection
  - 2. Operational Elements: Do not cut and patch operating elements and related components in a manner that results in reducing their capacity to perform as intended or that results in increased maintenance or decreased operational life or safety.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

3. Other Construction Elements: Do not cut and patch other construction elements or components in a manner that could change their load-carrying capacity, that results in reducing their capacity to perform as intended, or that results in increased maintenance or decreased operational life or safety.
  4. Visual Elements: Do not cut and patch construction in a manner that results in visual evidence of cutting and patching. Do not cut and patch exposed construction in a manner that would, in Engineer's opinion, reduce the building's aesthetic qualities. Remove and replace construction that has been cut and patched in a visually unsatisfactory manner.
- B. Manufacturer's Installation Instructions: Obtain and maintain on-site manufacturer's written recommendations and instructions for installation of products and equipment.

## PART 2 - PRODUCTS

### 2.1 MATERIALS

- A. General: Comply with requirements specified in other Sections.
- B. In-Place Materials: Use materials for patching identical to in-place materials. For exposed surfaces, use materials that visually match in-place adjacent surfaces to the fullest extent possible.
1. If identical materials are unavailable or cannot be used, use materials that, when installed, will provide a match acceptable to Engineer for the visual and functional performance of in-place materials.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examination and Acceptance of Conditions: Before proceeding with each component of the Work, examine substrates, areas, and conditions, with Installer or Applicator present where indicated, for compliance with requirements for installation tolerances and other conditions affecting performance. Record observations.
1. Examine roughing-in for mechanical and electrical systems to verify actual locations of connections before equipment and fixture installation.
  2. Examine walls, floors, and roofs for suitable conditions where products and systems are to be installed.
  3. Verify compatibility with and suitability of substrates, including compatibility with existing finishes or primers.
- B. Proceed with installation only after unsatisfactory conditions have been corrected. Proceeding with the Work indicates acceptance of surfaces and conditions.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

3.2 PREPARATION

- A. Field Measurements: Take field measurements as required to fit the Work properly. Recheck measurements before installing each product. Where portions of the Work are indicated to fit to other construction, verify dimensions of other construction by field measurements before fabrication. Coordinate fabrication schedule with construction progress to avoid delaying the Work.
- B. Space Requirements: Verify space requirements and dimensions of items shown diagrammatically on Drawings.
- C. Review of Contract Documents and Field Conditions: Immediately on discovery of the need for clarification of the Contract Documents caused by differing field conditions outside the control of Contractor, submit a request for information to Engineer.

3.3 INSTALLATION

- A. General: Locate the Work and components of the Work accurately, in correct alignment and elevation, as indicated.
  - 1. Make vertical work plumb and make horizontal work level.
  - 2. Where space is limited, install components to maximize space available for maintenance and ease of removal for replacement.
  - 3. Conceal pipes, ducts, and wiring in finished areas unless otherwise indicated.
- B. Comply with manufacturer's written instructions and recommendations for installing products in applications indicated.
- C. Install products at the time and under conditions that will ensure the best possible results. Maintain conditions required for product performance until Substantial Completion.
- D. Conduct construction operations so no part of the Work is subjected to damaging operations or loading in excess of that expected during normal conditions of occupancy.
- E. Sequence the Work and allow adequate clearances to accommodate movement of construction items on site and placement in permanent locations.
- F. Tools and Equipment: Do not use tools or equipment that produce harmful noise levels.
- G. Templates: Obtain and distribute to the parties involved templates for work specified to be factory prepared and field installed. Check Shop Drawings of other work to confirm that adequate provisions are made for locating and installing products to comply with indicated requirements.
- H. Attachment: Provide blocking and attachment plates and anchors and fasteners of adequate size and number to securely anchor each component in place, accurately located and aligned with other portions of the Work. Where size and type of attachments are not indicated, verify size and type required for load conditions.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1. Mounting Heights: Where mounting heights are not indicated, mount components at heights directed by Engineer.
  2. Allow for building movement, including thermal expansion and contraction.
  3. Coordinate installation of anchorages. Furnish setting drawings, templates, and directions for installing anchorages, including sleeves, concrete inserts, anchor bolts, and items with integral anchors, that are to be embedded in concrete or masonry. Deliver such items to Project site in time for installation.
- I. Joints: Make joints of uniform width. Where joint locations in exposed work are not indicated, arrange joints for the best visual effect. Fit exposed connections together to form hairline joints.
- J. Hazardous Materials: Use products, cleaners, and installation materials that are not considered hazardous.

### 3.4 CUTTING AND PATCHING

- A. Cutting and Patching, General: Employ skilled workers to perform cutting and patching. Proceed with cutting and patching at the earliest feasible time, and complete without delay.
1. Cut in-place construction to provide for installation of other components or performance of other construction, and subsequently patch as required to restore surfaces to their original condition.
- B. Existing Warranties: Remove, replace, patch, and repair materials and surfaces cut or damaged during installation or cutting and patching operations, by methods and with materials so as not to void existing warranties.
- C. Temporary Support: Provide temporary support of work to be cut.
- D. Protection: Protect in-place construction during cutting and patching to prevent damage. Provide protection from adverse weather conditions for portions of Project that might be exposed during cutting and patching operations.
- E. Adjacent Occupied Areas: Where interference with use of adjoining areas or interruption of free passage to adjoining areas is unavoidable, coordinate cutting and patching according to requirements in Section 011000 "Summary."
- F. Existing Utility Services and Mechanical/Electrical Systems: Where existing services/systems are required to be removed, relocated, or abandoned, bypass such services/systems before cutting to minimize interruption to occupied areas.
- G. Cutting: Cut in-place construction by sawing, drilling, breaking, chipping, grinding, and similar operations, including excavation, using methods least likely to damage elements retained or adjoining construction. If possible, review proposed procedures with original Installer; comply with original Installer's written recommendations.
1. In general, use hand or small power tools designed for sawing and grinding, not hammering and chopping. Cut holes and slots neatly to minimum size required, and with minimum disturbance of adjacent surfaces. Temporarily cover openings when not in use.



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

2. Finished Surfaces: Cut or drill from the exposed or finished side into concealed surfaces.
  3. Concrete and Masonry: Cut using a cutting machine, such as an abrasive saw or a diamond-core drill.
  4. Excavating and Backfilling: Comply with requirements in applicable Sections where required by cutting and patching operations.
  5. Mechanical and Electrical Services: Cut off pipe or conduit in walls or partitions to be removed. Cap, valve, or plug and seal remaining portion of pipe or conduit to prevent entrance of moisture or other foreign matter after cutting.
  6. Proceed with patching after construction operations requiring cutting are complete.
- H. Patching: Patch construction by filling, repairing, refinishing, closing up, and similar operations following performance of other work. Patch with durable seams that are as invisible as practicable. Provide materials and comply with installation requirements specified in other Sections, where applicable.
1. Inspection: Where feasible, test and inspect patched areas after completion to demonstrate physical integrity of installation.
  2. Exposed Finishes: Restore exposed finishes of patched areas and extend finish restoration into retained adjoining construction in a manner that will minimize evidence of patching and refinishing.
    - a. Clean piping, conduit, and similar features before applying paint or other finishing materials.
    - b. Restore damaged pipe covering to its original condition.
  3. Floors and Walls: Where walls or partitions that are removed extend one finished area into another, patch and repair floor and wall surfaces in the new space. Provide an even surface of uniform finish, color, texture, and appearance. Remove in-place floor and wall coverings and replace with new materials, if necessary, to achieve uniform color and appearance.
    - a. Where patching occurs in a painted surface, prepare substrate and apply primer and intermediate paint coats appropriate for substrate over the patch, and apply final paint coat over entire unbroken surface containing the patch. Provide additional coats until patch blends with adjacent surfaces.
  4. Ceilings: Patch, repair, or rehang in-place ceilings as necessary to provide an even-plane surface of uniform appearance.
  5. Exterior Building Enclosure: Patch components in a manner that restores enclosure to a weathertight condition and ensures thermal and moisture integrity of building enclosure.
- I. Cleaning: Clean areas and spaces where cutting and patching are performed. Remove paint, mortar, oils, putty, and similar materials from adjacent finished surfaces.

### 3.5 PROGRESS CLEANING

- A. General: Clean Project site and work areas daily, including common areas. Enforce requirements strictly. Dispose of materials lawfully.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1. Comply with requirements in NFPA 241 for removal of combustible waste materials and debris.
  2. Do not hold waste materials more than seven days during normal weather or three days if the temperature is expected to rise above 80 deg F.
  3. Containerize hazardous and unsanitary waste materials separately from other waste. Mark containers appropriately and dispose of legally, according to regulations.
    - a. Use containers intended for holding waste materials of type to be stored.
- B. Site: Maintain Project site free of waste materials and debris.
- C. Work Areas: Clean areas where work is in progress to the level of cleanliness necessary for proper execution of the Work.
1. Remove liquid spills promptly.
  2. Where dust would impair proper execution of the Work, broom-clean or vacuum the entire work area, as appropriate.
- D. Installed Work: Keep installed work clean. Clean installed surfaces according to written instructions of manufacturer or fabricator of product installed, using only cleaning materials specifically recommended. If specific cleaning materials are not recommended, use cleaning materials that are not hazardous to health or property and that will not damage exposed surfaces.
- E. Concealed Spaces: Remove debris from concealed spaces before enclosing the space.
- F. Exposed Surfaces in Finished Areas: Clean exposed surfaces and protect as necessary to ensure freedom from damage and deterioration at time of Substantial Completion.

3.6 STARTING AND ADJUSTING

- A. Start equipment and operating components to confirm proper operation. Remove malfunctioning units, replace with new units, and retest.
- B. Adjust equipment for proper operation. Adjust operating components for proper operation without binding.
- C. Test each piece of equipment to verify proper operation. Test and adjust controls and safeties. Replace damaged and malfunctioning controls and equipment.
- D. Manufacturer's Field Service: Comply with qualification requirements in Section 014000 "Quality Requirements."

END OF SECTION

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 017419 - CONSTRUCTION WASTE MANAGEMENT AND DISPOSAL

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes administrative and procedural requirements for the following:
  - 1. Salvaging nonhazardous demolition and construction waste.
  - 2. Recycling nonhazardous demolition and construction waste.
  - 3. Disposing of nonhazardous demolition and construction waste.
  - 4. Recycling of DEP-Regulated Universal waste.
- B. Related Requirements:
  - 1. Section 024119 "Selective Demolition" for disposition of waste resulting from partial demolition of buildings, structures, and site improvements.
  - 2. Refer to drawings for additional information.

1.3 DEFINITIONS

- A. Construction Waste: Building and site improvement materials and other solid waste resulting from construction, remodeling, renovation, or repair operations. Construction waste includes packaging.
- B. Demolition Waste: Building and site improvement materials resulting from demolition or selective demolition operations.
- C. Disposal: Removal off-site of demolition and construction waste and subsequent sale, recycling, reuse, or deposit in landfill or incinerator acceptable to authorities having jurisdiction.
- D. Recycle: Recovery of demolition or construction waste for subsequent processing in preparation for reuse.
- E. Reused or Salvaged: Recovery of demolition or construction waste and subsequent sale, donation, or reuse in another facility or incorporated into the Work.
- F. Universal Waste: Any waste designated by the Maine Department of Environmental Protection as Universal Waste i.e. fluorescent lamps, ballasts, thermostats and other lead and mercury

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

containing devices. Information can be found on the DEP's website:

<http://www.maine.gov/dep/index.html>

- G. USM Waste Minimization Policy: This policy and additional Information on recycling and waste can be found on the USM Recycling Website:  
<http://www.usm.maine.edu/sustainability/recycling>

#### 1.4 PERFORMANCE REQUIREMENTS

- A. General: Practice efficient waste management in the use of materials in the course of the Work. Use all reasonable means to divert construction and demolition waste from landfills and incinerators by sorting prior to leaving the jobsite. Facilitate recycling and salvage of materials. All waste must be disposed of at facilities that operate in accordance with all local, state, and federal waste regulations. Documentation of compliance can be requested by the University of Southern Maine at any time.

#### 1.5 SUBMITTALS

- A. Submit 'Anticipated Project Waste Sheet' before commencement of work.
- B. Submit 'Waste Reporting Sheet' monthly with each Pay Requisition during the course of the project and prior to Final Requisition.
1. Include the following information on Waste Reporting Sheet:
- Date of disposal
  - Type of material(s)
  - Method(s) of disposal: recycled, reused/salvaged, landfilled, incinerated.
  - Weight(s): attach copies of scale tickets to form (see below)
- C. Copies of scale tickets from waste facilities, including transfer and processing facilities, for each haul must be attached to monthly 'Project Waste Sheet' on which the waste is listed.
- D. Copies of Certificates of Recycling from DEP-approved consolidators for all hauls over the course of the project which involved Universal Waste must be attached to final Waste Reporting Sheet at conclusion of project.
- E. Copy of Certificate of Refrigerant Recovery must be attached to Waste Reporting Sheet on which device is listed. Refrigerant Recovery must be performed by an EPA-approved Refrigerant Recovery Technician.

#### 1.6 QUALITY ASSURANCE

- A. Contractors must designate someone in their employ (a direct paid employee of the general contractor) to be the contact for waste reporting for the duration of the project.
- B. Refrigerant Recovery Technician Qualifications: Certified by EPA-approved certification program.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- C. Regulatory Requirements: Comply with hauling and disposal regulations of authorities having jurisdiction.
  - 1. For any questions or clarifications of waste handling procedures contact the USM project manager directly.

PART 2 - PRODUCTS (Not Used)

PART 3 - EXECUTION

3.1 RECYCLING / SALVAGING DEMOLITION AND CONSTRUCTION WASTE, GENERAL

- A. General: Recycle paper and beverage containers used by on-site workers in accordance with USM Waste Minimization policy.
- B. Preparation of Waste: Prepare and maintain recyclable and salvageable waste materials according to recycling or reuse facility requirements. Maintain materials free of dirt, adhesives, solvents, petroleum contamination, and other substances deleterious to the recycling or reusing process.
- C. Procedures: Separate recyclable and salvageable waste from other waste materials, trash, and debris. Sort recyclable waste by type at Project site to the maximum extent practical.
  - 1. Provide appropriately marked containers or bins for controlling recyclable waste until removed from Project site. Include list of acceptable and unacceptable materials at each container and bin.
  - 2. Inspect containers and bins for contamination and remove contaminated materials if found.

3.2 DISPOSAL OF WASTE

- A. General: Except for items or materials to be salvaged/reused or recycled, remove waste materials from Project site and legally dispose of them in a landfill or incinerator acceptable to authorities having jurisdiction.
  - 1. Except as otherwise specified, do not allow waste materials that are to be disposed of accumulate on-site.
  - 2. Remove and transport debris in a manner that will prevent spillage on adjacent surfaces and areas.

END OF SECTION

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
 UNIVERSITY OF SOUTHERN MAINE  
 PORTLAND, MAINE

Building, Campus: \_\_\_\_\_ Project Description: \_\_\_\_\_

Company Name: \_\_\_\_\_ Project Number: \_\_\_\_\_

Designated Contact: \_\_\_\_\_ Phone: \_\_\_\_\_ Date: \_\_\_\_\_

List types of waste materials anticipated throughout the duration of the project. Include demolition waste, bulky waste, product packaging, and anything generated that will need to be disposed of. Complete a second sheet if additional space is necessary. Include estimates of quantities, if able. In the second column describe proposed method of disposal, if known. In the third column estimate when the waste will be generated over the duration of the project.

| Waste Materials / Quantities | Method of Disposal | Week # / Date |
|------------------------------|--------------------|---------------|
|                              |                    |               |
|                              |                    |               |
|                              |                    |               |
|                              |                    |               |
|                              |                    |               |
|                              |                    |               |
|                              |                    |               |
|                              |                    |               |
|                              |                    |               |
|                              |                    |               |

*Questions: contact Steve Sweeney, Resource Recovery Supervisor, USM Facilities Management: (207) 780-4160*







WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 017700 - CLOSEOUT PROCEDURES

PART 1 - GENERAL

1.01 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

1.02 SUMMARY

- A. This Section includes administrative and procedural requirements for contract closeout, including, but not limited to, the following:

1. Inspection procedures.
2. Warranties.
3. Final cleaning.

- B. Related Sections include the following:

1. Division 01 Section "Payment Procedures" for requirements for Applications for Payment for Substantial and Final Completion.
2. Division 01 Section "Execution Requirements" for progress cleaning of Project site.
3. Division 01 Section "Project Record Documents" for submitting Record Drawings, Record Specifications, and Record Product Data.
4. Division 01 Section "Operation and Maintenance Data" for operation and maintenance manual requirements.
5. Divisions 02 through 33 Sections for specific closeout and special cleaning requirements for the Work in those Sections.

1.03 SUBSTANTIAL COMPLETION

- A. Preliminary Procedures: Before requesting inspection for determining date of Substantial Completion, complete the following. List items below that are incomplete in request.

1. Prepare a list of items to be completed and corrected (punch list), the value of items on the list, and reasons why the Work is not complete.
2. Advise Owner of pending insurance changeover requirements.
3. Submit specific warranties, workmanship bonds, maintenance service agreements, final certifications, and similar documents.
4. Obtain and submit releases permitting Owner unrestricted use of the Work and access to services and utilities. Include occupancy permits, operating certificates, and similar releases.
5. Prepare and submit Project Record Documents, operation and maintenance manuals.
6. Deliver tools, spare parts, extra materials, and similar items to location designated by Owner. Label with manufacturer's name and model number where applicable.
7. Complete startup testing of systems.
8. Submit test/adjust/balance records.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

9. Terminate and remove temporary facilities from Project site, along with mockups, construction tools, and similar elements.
10. Submit changeover information related to Owner's occupancy, use, operation, and maintenance.
11. Complete final cleaning requirements, including touchup painting.
12. Touch up and otherwise repair and restore marred exposed finishes to eliminate visual defects.
13. Submit initial draft copy of operation and maintenance manuals at least 15 days before requesting inspection for Substantial Completion.

B. Inspection: Submit a written request for inspection for Substantial Completion. On receipt of request, Architect will either proceed with inspection or notify Contractor of unfulfilled requirements. Architect will prepare the Certificate of Substantial Completion after inspection or will notify Contractor of items, either on Contractor's list or additional items identified by Architect, that must be completed or corrected before certificate will be issued.

1. Reinspection: Request reinspection when the Work identified in previous inspections as incomplete is completed or corrected.
2. Results of completed inspection will form the basis of requirements for Final Completion.

#### 1.04 FINAL COMPLETION

A. Preliminary Procedures: Before requesting final inspection for determining date of Final Completion, complete the following:

1. Submit a final Application for Payment according to Division 1 Section "Payment Procedures."
2. Submit certified copy of Architect's Substantial Completion inspection list of items to be completed or corrected (punch list), endorsed and dated by Architect. The certified copy of the list shall state that each item has been completed or otherwise resolved for acceptance.
3. Submit evidence of final, continuing insurance coverage complying with insurance requirements.
4. Instruct Owner's personnel in operation, adjustment, and maintenance of products, equipment, and systems.

B. Inspection: Submit a written request for final inspection for acceptance. On receipt of request, Architect will either proceed with inspection or notify Contractor of unfulfilled requirements. Architect will prepare a final Certificate for Payment after inspection or will notify Contractor of construction that must be completed or corrected before certificate will be issued.

1. Reinspection: Request reinspection when the Work identified in previous inspections as incomplete is completed or corrected.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1.05 INSPECTION FEES

- A. If the Architect Performs Reinspections Due to Failure of the Work to Comply with the Claims of Status of Completion Made by the Contractor, Or, Should the Contractor fail to complete the work, Or, Should the Contractor fail to promptly correct warranty items or work later found to be deficient:
1. Owner will compensate Architect for such additional services.
  2. Owner will deduct the amount of such compensation from the final payment to the Contractor.
- B. If the Work is not completed by the date set in the Agreement, and the Architect needs to perform additional Contract Administrative and on site observation duties:
1. Owner will compensate Architect for such additional services.
  2. Owner will deduct the amount of such compensation from the final payment to the Contractor.

1.06 LIST OF INCOMPLETE ITEMS (PUNCH LIST)

- A. Preparation: Submit three copies of list. Include name and identification of each space and area affected by construction operations for incomplete items and items needing correction including, if necessary, areas disturbed by Contractor that are outside the limits of construction.
1. Organize list of spaces in sequential order.
  2. Organize items applying to each space by major element, including categories for ceiling, individual walls, floors, equipment, and building systems.
  3. Include the following information at the top of each page:
    - a. Project name.
    - b. Date.
    - c. Name of Architect.
    - d. Name of Contractor.
    - e. Page number.

1.07 WARRANTIES

- A. Submittal Time: Submit written warranties on request of Architect for designated portions of the Work where commencement of warranties other than date of Substantial Completion is indicated in the contract documents.
1. Unless indicated otherwise, all warranties shall commence on the date of Substantial Completion.
- B. Partial Occupancy: Submit properly executed warranties within 15 days of completion of designated portions of the Work that are completed and occupied or used by Owner during construction period by separate agreement with Contractor.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- C. Organize warranty documents into an orderly sequence based on the table of contents of the Project Manual.
  - 1. Submit final warranties as a package for the entire project, assembled and identified as described below.
  - 2. Bind warranties and bonds in heavy-duty, D-ring, vinyl-covered, loose-leaf binders, thickness as necessary to accommodate contents but not greater than 2 inches, and sized to receive 8-1/2-by-11-inch paper. Do not over fill D-ring, allowing 1/2-inch space for future additions.
  - 3. Provide heavy paper dividers with plastic-covered tabs for each separate warranty. Mark tab to identify the product or installation. Provide a typed description of the product or installation, including the name of the product and the name, address, and telephone number of Installer.
  - 4. Identify each binder on the front and spine with the typed or printed title "WARRANTIES," Project name, and name of Contractor.
  - 5. Electronic Media: Submit copy of warranty binder on CD-R in .PDF format. Bookmark based on the table of contents, and for each warranty within each section.
- D. Provide additional electronic media copies of each warranty to include in operation and maintenance manuals.

## PART 2 - PRODUCTS

### 2.01 MATERIALS

- A. Cleaning Agents: Use cleaning materials and agents recommended by manufacturer or fabricator of the surface to be cleaned. Do not use cleaning agents that are potentially hazardous to health or property or that might damage finished surfaces.

## PART 3 - EXECUTION

### 3.01 FINAL CLEANING

- A. General: Provide final cleaning. Conduct cleaning and waste-removal operations to comply with local laws and ordinances and Federal and local environmental and antipollution regulations.
- B. Cleaning: Employ experienced workers or professional cleaners for final cleaning. Clean each surface or unit to condition expected in an average commercial building cleaning and maintenance program. Comply with manufacturer's written instructions.
  - 1. Complete the following cleaning operations before requesting inspection for certification of Substantial Completion for entire Project or for a portion of Project:
    - a. Clean Project site, yard, and grounds, in areas disturbed by construction activities, including landscape development areas, of rubbish, waste material, litter, and other foreign substances.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- b. Remove tools, construction equipment, machinery, and surplus material from Project site.
  - c. Clean exposed exterior and interior hard-surfaced finishes to a dirt-free condition, free of stains, films, and similar foreign substances. Avoid disturbing natural weathering of exterior surfaces. Restore reflective surfaces to their original condition.
  - d. Remove debris and surface dust from limited access spaces, including roofs, plenums, shafts, trenches, equipment vaults, manholes, attics, and similar spaces.
  - e. Sweep concrete floors broom clean in unoccupied spaces.
  - f. Vacuum carpet and similar soft surfaces, removing debris and excess nap; shampoo if visible soil or stains remain.
  - g. Remove labels that are not permanent.
  - h. Touch up and otherwise repair and restore marred, exposed finishes and surfaces. Replace finishes and surfaces that cannot be satisfactorily repaired or restored or that already show evidence of repair or restoration.
    - 1) Do not paint over "UL" and similar labels, including mechanical and electrical nameplates.
  - i. Wipe surfaces of mechanical and electrical equipment, elevator equipment, and similar equipment. Remove excess lubrication, paint and mortar droppings, and other foreign substances.
  - j. Replace parts subject to unusual operating conditions.
  - k. Replace disposable air filters and clean permanent air filters that are exposed to the work. Clean exposed surfaces of diffusers, registers, and grills.
  - l. Clean ducts, blowers, and coils if units were operated without filters during construction.
  - m. Clean light fixtures, lamps, globes, and reflectors to function with full efficiency. Replace burned-out bulbs, and those noticeably dimmed by hours of use, and defective and noisy starters in fluorescent and mercury vapor fixtures to comply with requirements for new fixtures.
  - n. Leave Project clean and ready for occupancy.
- C. Comply with safety standards for cleaning. Do not burn waste materials. Do not bury debris or excess materials on Owner's property. Do not discharge volatile, harmful, or dangerous materials into drainage systems. Remove waste materials from Project site and dispose of lawfully.

END OF SECTION



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 017823 - OPERATION AND MAINTENANCE DATA

PART 1 - GENERAL

1.01 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

1.02 SUMMARY

- A. This Section includes administrative and procedural requirements for preparing operation and maintenance manuals, including the following:
  - 1. Operation and maintenance documentation directory.
  - 2. Operation manuals for systems, subsystems, and equipment.
  - 3. Maintenance manuals for the care and maintenance of products, materials, and finishes, systems and equipment.
- B. Related Sections include the following:
  - 1. Division 01 Section "Submittal Procedures" for submitting copies of submittals for operation and maintenance manuals.
  - 2. Division 01 Section "Closeout Procedures" for submitting operation and maintenance manuals.
  - 3. Division 01 Section "Project Record Documents" for preparing Record Drawings for operation and maintenance manuals.
  - 4. Divisions 02 through 33 Sections for specific operation and maintenance manual requirements for the Work in those Sections.

1.03 DEFINITIONS

- A. System: An organized collection of parts, equipment, or subsystems united by regular interaction.
- B. Subsystem: A portion of a system with characteristics similar to a system.

1.04 SUBMITTALS

- A. Initial Submittal: Submit 2 draft copies of each manual at least 15 days before requesting inspection for Substantial Completion. Include a complete operation and maintenance directory. Architect will review concurrently with Owner for comment. Architect will return copy of draft and mark whether general scope and content of manual are acceptable.
- B. Final Submittal: Submit 2 copies of each manual in final form at least 15 days before final inspection. Architect will review concurrently with Owner for comment. Architect will return copy with comments after final inspection.
  - 1. Correct or modify each manual to comply with comments. Submit copies of each corrected manual within 15 days of receipt of Architect's comments.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- C. Preliminary Operation and Maintenance Manual Summary: Submit two copies concurrently with the submittal of the Schedule of Values in accordance with Division 01 section, "Submittal Procedures."

1.05 COORDINATION

- A. Where operation and maintenance documentation includes information on installations by more than one factory-authorized service representative, assemble and coordinate information furnished by representatives and prepare manuals.

PART 2 - PRODUCTS

2.01 OPERATION AND MAINTENANCE DOCUMENTATION DIRECTORY

- A. Organization: Include a section in the directory for each of the following:
  - 1. List of documents.
  - 2. List of systems.
  - 3. List of equipment.
  - 4. Table of contents.
- B. List of Systems and Subsystems: List systems alphabetically. Include references to operation and maintenance manuals that contain information about each system.
- C. List of Equipment: List equipment for each system, organized alphabetically by system. For pieces of equipment not part of system, list alphabetically in separate list.
- D. Tables of Contents: Include a table of contents for each emergency, operation, and maintenance manual.
- E. Identification: In the documentation directory and in each operation and maintenance manual, identify each system, subsystem, and piece of equipment with same designation used in the Contract Documents. If no designation exists, assign a designation according to ASHRAE Guideline 4, "Preparation of Operating and Maintenance Documentation for Building Systems."

2.02 MANUALS, GENERAL

- A. Organization: Unless otherwise indicated, organize each manual into a separate section for each system and subsystem, and a separate section for each piece of equipment not part of a system. Each manual shall contain the following materials, in the order listed:
  - 1. Title page.
  - 2. Table of contents.
  - 3. Manual contents.
- B. Title Page: Enclose title page in transparent plastic sleeve. Include the following information:
  - 1. Subject matter included in manual.
  - 2. Name and address of Project.
  - 3. Name and address of Owner.



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

4. Date of submittal.
  5. Name, address, and telephone number of Contractor and primary subcontractors.
  6. Name and address of Architect.
  7. Cross-reference to related systems in other operation and maintenance manuals.
- C. Table of Contents: List each product included in manual, identified by product name, indexed to the content of the volume, and cross-referenced to Specification Section number in Project Manual.
1. If operation or maintenance documentation requires more than one volume to accommodate data, include comprehensive table of contents for all volumes in each volume of the set.
- D. Manual Contents: Organize into sets of manageable size. Arrange contents alphabetically by system, subsystem, and equipment. If possible, assemble instructions for subsystems, equipment, and components of one system into a single binder.
1. Binders: Heavy-duty, D-ring, vinyl-covered, loose-leaf binders, in thickness necessary to accommodate contents but not greater than 2 inches, sized to hold 8-1/2-by-11-inch paper; with clear plastic sleeve on spine to hold label describing contents and with pockets inside covers to hold folded oversize sheets. Do not over fill D-ring, allowing 1/2-inch space for future additions.
    - a. If two or more binders are necessary to accommodate data of a system, organize data in each binder into groupings by subsystem and related components. Cross-reference other binders if necessary to provide essential information for proper operation or maintenance of equipment or system.
    - b. Identify each binder on front and spine, with printed title "OPERATION AND MAINTENANCE MANUAL," Project title or name, and subject matter of contents. Indicate volume number for multiple-volume sets.
  2. Dividers: Heavy-paper dividers with plastic-covered tabs for each section. Mark each tab to indicate contents. Include typed list of products and major components of equipment included in the section on each divider, cross-referenced to Specification Section number and title of Project Manual.
  3. Protective Plastic Sleeves: Transparent plastic sleeves designed to enclose diagnostic software diskettes for computerized electronic equipment.
  4. Supplementary Text: Prepared on 8-1/2-by-11-inch white bond paper.
  5. Drawings: Attach reinforced, punched binder tabs on drawings and bind with text.
    - a. Maximum size of drawings to be included in the binders shall not exceed 11-by-17-inch. Fold drawings to same size as text pages and use as foldouts.
    - b. If drawings are too large to be used as foldouts, fold and place drawings in labeled envelopes and submit envelopes with manual. At appropriate locations in manual, insert typewritten pages indicating drawing titles, descriptions of contents, and drawing locations.
- E. Electronic Media: Submit one copy of each complete manual, including Record Shop Drawings and Product Data on CD-R in .PDF format. Bookmark based on the specifications table of contents and manual dividers.
- F. Follow ASHRAE Guideline 4 - 2008 in the preparation of operating and maintenance documentation.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

2.03 OPERATION MANUALS

- A. Content: Daily operations and management of systems and equipment. In addition to requirements in this Section, include operation data required in individual Specification Sections and the following information:
1. System, subsystem, and equipment descriptions.
  2. Performance and design criteria if Contractor is delegated design responsibility.
  3. Operating standards.
  4. Operating procedures.
  5. Operating logs.
  6. Wiring diagrams.
  7. Control diagrams.
  8. Piped system diagrams.
  9. Precautions against improper use.
  10. License requirements including inspection and renewal dates.
- B. Descriptions: Include the following:
1. Product name and model number.
  2. Manufacturer's name.
  3. Equipment identification with serial number of each component.
  4. Equipment function.
  5. Operating characteristics.
  6. Limiting conditions.
  7. Performance curves.
  8. Engineering data and tests.
  9. Complete nomenclature and number of replacement parts.
- C. Operating Procedures: Include the following, as applicable:
1. Startup procedures.
  2. Equipment or system break-in procedures.
  3. Routine and normal operating instructions.
  4. Regulation and control procedures.
  5. Instructions on stopping.
  6. Normal shutdown instructions.
  7. Seasonal and weekend operating instructions.
  8. Required sequences for electric or electronic systems.
  9. Special operating instructions and procedures.
- D. Systems and Equipment Controls: Describe the sequence of operation, and diagram controls as installed.
- E. Piped Systems: Diagram piping as installed, and identify color-coding where required for identification.

2.04 PRODUCT MAINTENANCE MANUAL

- A. Content: Organize manual into a separate section for each product, material, and finish. Include source information, product information, maintenance procedures, repair materials and sources, and warranties and bonds, as described below.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- B. Source Information: List each product included in manual, identified by product name and arranged to match manual's table of contents. For each product, list name, address, and telephone number of Installer or supplier and maintenance service agent, and cross-reference Specification Section number and title in Project Manual.
- C. Product Information: Include the following, as applicable:
  - 1. Product name and model number.
  - 2. Manufacturer's name.
  - 3. Color, pattern, and texture.
  - 4. Material and chemical composition.
  - 5. Reordering information for specially manufactured products.
- D. Maintenance Procedures: Include manufacturer's written recommendations and the following:
  - 1. Inspection procedures.
  - 2. Types of cleaning agents to be used and methods of cleaning.
  - 3. List of cleaning agents and methods of cleaning detrimental to product.
  - 4. Schedule for routine cleaning and maintenance.
  - 5. Repair instructions.
- E. Repair Materials and Sources: Include lists of materials and local sources of materials and related services.
- F. Warranties and Bonds: Include copies of warranties and bonds and lists of circumstances and conditions that would affect validity of warranties or bonds.
  - 1. Include procedures to follow and required notifications for warranty claims.

2.05 SYSTEMS AND EQUIPMENT MAINTENANCE MANUAL

- A. Content: For each system, subsystem, and piece of equipment not part of a system, include source information, manufacturers' maintenance documentation, maintenance procedures, maintenance and service schedules, spare parts list and source information, maintenance service contracts, and warranty and bond information, as described below.
- B. Source Information: List each system, subsystem, and piece of equipment included in manual, identified by product name and arranged to match manual's table of contents. For each product, list name, address, and telephone number of Installer or supplier and maintenance service agent, and cross-reference Specification Section number and title in Project Manual.
- C. Manufacturers' Maintenance Documentation: Manufacturers' maintenance documentation including the following information for each component part or piece of equipment:
  - 1. Standard printed maintenance instructions and bulletins.
  - 2. Drawings, diagrams, and instructions required for maintenance, including disassembly and component removal, replacement, and assembly.
  - 3. Identification and nomenclature of parts and components.
  - 4. List of items recommended to be stocked as spare parts.
- D. Maintenance Procedures: Include the following information and items that detail essential maintenance procedures:
  - 1. Test and inspection instructions.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

2. Troubleshooting guide.
  3. Precautions against improper maintenance.
  4. Disassembly; component removal, repair, and replacement; and reassembly instructions.
  5. Aligning, adjusting, and checking instructions.
  6. Demonstration and training videotape, if available.
- E. Maintenance and Service Schedules: Include service and lubrication requirements, list of required lubricants for equipment, and separate schedules for preventive and routine maintenance and service with standard time allotment.
1. Scheduled Maintenance and Service: Tabulate actions for daily, weekly, monthly, quarterly, semiannual, and annual frequencies.
  2. Maintenance and Service Record: Include manufacturers' forms for recording maintenance.
- F. Spare Parts List and Source Information: Include lists of replacement and repair parts, with parts identified and cross-referenced to manufacturers' maintenance documentation and local sources of maintenance materials and related services.
- G. Maintenance Service Contracts: Include copies of maintenance agreements with name and telephone number of service agent.
- H. Warranties and Bonds: Include copies of warranties and bonds and lists of circumstances and conditions that would affect validity of warranties or bonds.
1. Include procedures to follow and required notifications for warranty claims.

### PART 3 - EXECUTION

#### 3.01 MANUAL PREPARATION

- A. Operation and Maintenance Documentation Directory: Prepare a separate manual that provides an organized reference to emergency, operation, and maintenance manuals.
- B. Emergency Manual: Assemble a complete set of emergency information indicating procedures for use by emergency personnel and by Owner's operating personnel for types of emergencies indicated.
- C. Product Maintenance Manual: Assemble a complete set of maintenance data indicating care and maintenance of each product, material, and finish incorporated into the Work.
- D. Operation and Maintenance Manuals: Assemble a complete set of operation and maintenance data indicating operation and maintenance of each system, subsystem, and piece of equipment not part of a system.
1. Engage a factory-authorized service representative to assemble and prepare information for each system, subsystem, and piece of equipment not part of a system.
  2. Prepare a separate manual for each system and subsystem, in the form of an instructional manual for use by Owner's operating personnel.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- E. Manufacturers' Data: Where manuals contain manufacturers' standard printed data, include only sheets pertinent to product or component installed. Mark each sheet to identify each product or component incorporated into the Work. If data include more than one item in a tabular format, identify each item using appropriate references from the Contract Documents. Identify data applicable to the Work and delete references to information not applicable.
  - 1. Prepare supplementary text if manufacturers' standard printed data are not available and where the information is necessary for proper operation and maintenance of equipment or systems.
  
- F. Drawings: Prepare drawings supplementing manufacturers' printed data to illustrate the relationship of component parts of equipment and systems and to illustrate control sequence and flow diagrams. Coordinate these drawings with information contained in Record Drawings to ensure correct illustration of completed installation.
  - 1. Do not use original Project Record Documents as part of operation and maintenance manuals.
  
- G. Comply with Division 1 Section "Closeout Procedures" for schedule for submitting operation and maintenance documentation.

END OF SECTION



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 017839 - PROJECT RECORD DOCUMENTS

PART 1 - GENERAL

1.01 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

1.02 SUMMARY

- A. This Section includes administrative and procedural requirements for Project Record Documents, including the following:
  - 1. Record Drawings.
  - 2. Record Specifications.
  - 3. Record Product Data.
  - 4. Record Shop Drawings.
- B. Related Sections include the following:
  - 1. Division 01 Section "Closeout Procedures" for general closeout procedures.
  - 2. Divisions 02 through 33 Sections for specific requirements for Project Record Documents of the Work in those Sections.

1.03 SUBMITTALS

- A. Record Drawings: Comply with the following:
  - 1. Number of Copies: Submit copies of Record Drawings as follows:
    - a. Submit one set(s) of marked-up Record Prints
- B. Record Specifications: Submit one hard copy and one copy on electronic media of Project's Specifications, including addenda and contract modifications.
- C. Record Shop Drawings and Product Data: Submit one hard copy and one copy on electronic media of each Product Data submittal.
  - 1. Where Record Shop Drawings and Product Data is required as part of operation and maintenance manuals, submit marked-up Shop Drawings and Product Data as an insert in manual instead of submittal as Record Shop Drawings and Product Data. Insert typewritten pages indicating drawing titles, descriptions of contents, and Record Shop Drawings and Product Data locations that are part of operation and maintenance manuals.
  - 2. Electronic Media: In addition to paper copy, submit record copy of record Shop Drawings and Product Data specification on CD-R in .PDF format. Bookmark Product Data based on the table of contents.
- D. Directories: Material supplier directory and subcontractor directory.+

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

PART 2 - PRODUCTS

2.01 RECORD DRAWINGS

- A. Record Prints: Maintain one set of blue- or black-line white prints of the Contract Drawings and Shop Drawings.
1. Preparation: Mark Record Prints to show the actual installation where installation varies from that shown originally. Require individual or entity who obtained record data, whether individual or entity is Installer, subcontractor, or similar entity, to prepare the marked-up Record Prints.
    - a. Give particular attention to information on concealed elements that would be difficult to identify or measure and record later.
    - b. Accurately record information in an understandable drawing technique.
    - c. Record data as soon as possible after obtaining it. Record and check the markup before enclosing concealed installations.
  2. Content: Types of items requiring marking include, but are not limited to, the following:
    - a. Dimensional changes to Drawings.
    - b. Revisions to details shown on Drawings.
    - c. Revisions to routing of piping and conduits.
    - d. Revisions to electrical circuitry.
    - e. Actual equipment locations.
    - f. Duct size and routing.
    - g. Locations of concealed internal utilities.
    - h. Changes made by Change Order or Construction Change Directive.
    - i. Changes made following Architect's written orders.
    - j. Details not on the original Contract Drawings.
    - k. Field records for variable and concealed conditions.
    - l. Record information on the Work that is shown only schematically.
  3. Mark the Contract Drawings or Shop Drawings, whichever is most capable of showing actual physical conditions, completely and accurately. If Shop Drawings are marked, show cross-reference on the Contract Drawings.
  4. Mark record sets with erasable, red-colored pencil. Use other colors to distinguish between changes for different categories of the Work at same location.
  5. Mark important additional information that was either shown schematically or omitted from original Drawings.
  6. Note Construction Change Directive numbers, alternate numbers, Change Order numbers, and similar identification, where applicable.
- B. Format: Identify and date each Record Drawing; include the designation "PROJECT RECORD DRAWING" in a prominent location.
1. Record Prints: Organize Record Prints into manageable sets. Bind each set with durable paper cover sheets. Include identification on cover sheets.



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

2.02 RECORD SPECIFICATIONS

- A. Preparation: Mark Specifications to indicate the actual product installation where installation varies from that indicated in Specifications, addenda, and contract modifications.
1. Give particular attention to information on concealed products and installations that cannot be readily identified and recorded later.
  2. Mark copy with the proprietary name and model number of products, materials, and equipment furnished, including substitutions, change orders and product options selected.
  3. Record the name of manufacturer, supplier, Installer, and other information necessary to provide a record of selections made.
  4. For each principal product, indicate whether Record Product Data has been submitted in operation and maintenance manuals instead of submitted as Record Product Data.
  5. Note related Change Orders, Record Product Data, and Record Drawings where applicable.
  6. Electronic Media: Submit record copy of record specification on CD-R in .PDF format. Bookmark based on the table of contents.

2.03 RECORD SHOP DRAWINGS AND PRODUCT DATA

- A. Preparation: Mark Shop Drawings and Product Data to indicate the actual product installation where installation varies substantially from that indicated in Shop Drawings and Product Data submittal.
1. Give particular attention to information on concealed products and installations that cannot be readily identified and recorded later.
  2. Include significant changes in the product delivered to Project site and changes in manufacturer's written instructions for installation.
  3. Note related Change Orders, Record Specifications, and Record Drawings where applicable.
  4. Bind product data in heavy-duty, D-ring, vinyl-covered, loose-leaf binders, thickness as necessary to accommodate contents but not greater than 2 inches, and sized to receive 8-1/2-by-11-inch paper. Do not over fill D-ring, allowing 1/2 inch space for future additions.
  5. Provide heavy paper dividers with plastic-covered tabs for each specification section with product data. Mark tab to identify the specification section. Provide a typed description of the product or installation, including the name of the product and the name, address, and telephone number of Installer.
  6. Identify each binder on the front and spine with the typed or printed title "PRODUCT DATA," Project name, and name of Contractor.
  7. Drawings: Attach reinforced, punched binder tabs on drawings and bind with text.
    - a. Maximum size of drawings to be included in the binders shall not exceed 11-by-17-inch. Fold drawings to same size as text pages and use as foldouts.
    - b. If drawings are too large to be used as foldouts, fold and place drawings in labeled envelopes and submit envelopes with manual. At appropriate locations in manual, insert typewritten pages indicating drawing titles, descriptions of contents, and drawing locations.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

8. Electronic Media: Submit record copy of marked-up Shop Drawings and Product Data on CD-R in .PDF format. Bookmark based on the table of contents, and for each Shop Drawings and Product Data within each section. Where Record Shop Drawings and Product Data is required as part of operation and maintenance manuals, submit electronic media of marked-up Shop Drawings and Product Data as part of manual instead of submittal as Record Shop Drawings and Product Data.

2.04 MISCELLANEOUS RECORD SUBMITTALS

- A. Assemble miscellaneous records required by other Specification Sections for miscellaneous record keeping and submittal in connection with actual performance of the Work. Bind or file miscellaneous records and identify each, ready for continued use and reference.
- B. Subcontractor Directory: Name, address and telephone number for all major subcontractors, organized by specification section.
- C. Material Supplier Directory: Name, address and telephone number for major material suppliers, organized by specification section.

PART 3 - EXECUTION

3.01 RECORDING AND MAINTENANCE

- A. Recording: Maintain one copy of each submittal during the construction period for Project Record Document purposes. Post changes and modifications to Project Record Documents as they occur; do not wait until the end of Project.

END OF SECTION

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 017900 - DEMONSTRATION AND TRAINING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes administrative and procedural requirements for instructing Owner's personnel, including the following:
  - 1. Demonstration of operation of systems, subsystems, and equipment.
  - 2. Training in operation and maintenance of systems, subsystems, and equipment.
- B. Related Sections include the following:
  - 1. Division 01 Section "Project Management and Coordination" for requirements for preinstruction conferences.
  - 2. Divisions 02 through 33 Sections for specific requirements for demonstration and training for products in those Sections.

1.3 SUBMITTALS

- A. Attendance Record: For each training session, submit list of participants.

1.4 QUALITY ASSURANCE

- A. Demonstrator and Instructor Qualifications: A factory-authorized service representative, complying with requirements in Division 1 Section "Quality Requirements," experienced in operation and maintenance procedures and training.

1.5 COORDINATION

- A. Coordinate instruction schedule with Owner's operations. Adjust schedule as required to minimize disrupting Owner's operations.
- B. Coordinate providing notification of dates, times, length of instruction time, and training content.
- C. Coordinate content of training with content of approved operation and maintenance manuals.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

PART 2 - PRODUCTS

2.1 INSTRUCTION PROGRAM

- A. Program: Develop an instruction program that includes individual training for each system and equipment not part of a system, as required by individual Specification Sections, and as follows:
  - 1. HVAC systems equipment.
- B. Training Modules: Include instruction as applicable for the following:
  - 1. Basis of System Design, Operational Requirements, and Criteria: Include the following:
    - a. System, subsystem, and equipment descriptions.
    - b. Performance and design criteria if Contractor is delegated design responsibility.
    - c. Operating standards.
    - d. Regulatory requirements.
    - e. Equipment function.
    - f. Operating characteristics.
    - g. Limiting conditions.
    - h. Performance curves.
  - 2. Documentation: Review the following items in detail:
    - a. Operations and maintenance manuals.
    - b. Project Record Documents.
    - c. Warranties and bonds.
    - d. Maintenance service agreements and similar continuing commitments.
  - 3. Emergencies: Include the following, as applicable:
    - a. Instructions on meaning of warnings, trouble indications, and error messages.
    - b. Instructions on stopping.
    - c. Shutdown instructions for each type of emergency.
    - d. Operating instructions for conditions outside of normal operating limits.
    - e. Sequences for electric or electronic systems.
    - f. Special operating instructions and procedures.
  - 4. Operations: Include the following, as applicable:
    - a. Instructions on meaning of warnings, trouble indications, and error messages.
    - b. Startup procedures.
    - c. Equipment or system break-in procedures.
    - d. Routine and normal operating instructions.
    - e. Regulation and control procedures.
    - f. Control sequences.
    - g. Safety procedures.
    - h. Instructions on stopping.
    - i. Normal and emergency shutdown instructions.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- j. Operating procedures for system, subsystem, or equipment failure.
  - k. Seasonal and weekend operating instructions.
  - l. Required sequences for electric or electronic systems.
  - m. Special operating instructions and procedures.
5. Adjustments: Include the following:
- a. Alignments.
  - b. Checking adjustments.
  - c. Noise and vibration adjustments.
  - d. Economy and efficiency adjustments.
6. Troubleshooting: Include the following:
- a. Diagnostic instructions.
  - b. Test and inspection procedures.
7. Maintenance: Include the following:
- a. Inspection procedures.
  - b. Types of cleaning agents to be used and methods of cleaning.
  - c. List of cleaning agents and methods of cleaning detrimental to product.
  - d. Procedures for routine cleaning
  - e. Procedures for preventive maintenance.
  - f. Procedures for routine maintenance.
  - g. Instruction on use of special tools.
8. Repairs: Include the following:
- a. Diagnosis instructions.
  - b. Repair instructions.
  - c. Disassembly; component removal, repair, and replacement; and reassembly instructions.
  - d. Instructions for identifying parts and components.
  - e. Review of spare parts needed for operation and maintenance.

### PART 3 - EXECUTION

#### 3.1 PREPARATION

- A. Assemble materials necessary for instruction.
- B. Set up instructional equipment at instruction location.

#### 3.2 INSTRUCTION

- A. Engage qualified instructors to instruct Owner's personnel to adjust, operate, and maintain systems, subsystems, and equipment not part of a system.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1. Owner will furnish Contractor with names and positions of participants.
- B. Scheduling: Provide instruction at mutually agreed on times. For equipment that requires seasonal operation, provide similar instruction at start of each season.
  1. Schedule training with Owner with at least fifteen days' advance notice.

END OF SECTION

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 019500 - TESTING, ADJUSTING, AND BALANCING

PART 1 - GENERAL

1.1 FOR INFORMATION ONLY

- A. The testing, adjusting and balancing (TAB) Agent shall be contracted directly with the Owner. This Specification section has been included for information only, to inform the Contractor that testing, adjusting and balancing will be performed on the mechanical systems and that the Contractor is responsible for assisting and coordinating with the TAB Agency as described in this section.

1.2 SECTION INCLUDES

- A. Testing, Adjustment, and Balancing of Air Systems.
- B. Measurement of Final Operating Condition of HVAC Systems.

1.3 RELATED SECTIONS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.
- B. Section 017700 – Closeout Procedures.
- C. Section 017839 –Project Record Documents.
- D. Division 23 – Warranty:
  - 1. TAB warranties shall conform to guidelines indicated in Division 23 with all references to Mechanical Contractor changes to TAB Contractor.

1.4 REFERENCES

- A. AABC - National Standards for Total System Balance.
- B. ADC - Test Code for Grilles, Registers, and Diffusers.
- C. ASHRAE 111 - Practices for Measurement, Testing, Adjusting, and Balancing of Building Heating, Ventilation, Air-conditioning, and Refrigeration Systems.
- D. NEBB - Procedural Standards for Testing, Adjusting, and Balancing of Environmental Systems.
- E. SMACNA - HVAC Systems Testing, Adjusting, and Balancing.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1.5 SUBMITTALS

- A. Submit under provisions of Section 013300.
- B. Submit name of Testing, Adjusting, and Balancing (TAB) Agency for approval within 30 days after award of Contract.
- C. Design Review Reports:
  - 1. Submit prior to commencement of construction under provisions of Section 014000.
  - 2. Review the Contract Documents, and indicate deficiencies in systems that would prevent proper testing, adjusting, and balancing of systems and equipment to achieve specified performance.
- D. Preliminary Report Submittals:
  - 1. Prior to commencing work of this Section, and no more than 30 days after approval of TAB Agency submittals, submit report forms or outlines indicating adjusting, balancing, and equipment data required, with columns of design data filled in. By means of plan views, equipment profiles, and similar graphical descriptions, indicate where measurements will be taken.
  - 2. Submit the procedures to be used.
- G. Field Reports: Submit draft copies of report for review prior to final acceptance of Project. Provide final copies for Architect/Engineer and for inclusion in operating and maintenance manuals.
- H. Provide reports in letter size, 3-ring binder manuals, complete with index page and indexing tabs, with cover identification at front and side. Include set of reduced drawings with air outlets and equipment identified to correspond with data sheets, and indicating thermostat locations.
- I. Include detailed procedures, agenda, sample report forms and copy of AABC National Project Performance Guaranty prior to commencing system balance.
- J. Test Reports: Indicate data on AABC National Standards for Total System Balance forms, forms prepared following ASHRAE 111, or NEBB forms.

1.6 QUALITY ASSURANCE

- A. Perform total system balance in accordance with AABC National Standards for Field Measurement and Instrumentation, Total System Balance, ASHRAE 111 or NEBB Procedural Standards for Testing, Balancing and Adjusting of Environmental Systems.
- B. Instrument Calibration: Calibrate instruments every 6 months, or more frequently if Manufacturer requires same.”
  - 1. Keep an updated record of instrument calibration that indicates date of calibration and the name of party performing instrument calibration.



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- C. Certification of TAB Reports: Certify TAB field data reports. This certification includes the following:
  - 1. Review field data reports to validate accuracy of data and to prepare certified TAB reports.
  - 2. Certify that TAB team complied with approved TAB plan and the procedures specified and referenced in this Specification.
- D. TAB Report Forms: Use standard forms from AABC's "National Standards for Testing and Balancing Heating, Ventilating, and Air Conditioning Systems." or NEBB's "Procedural Standards for Testing, Adjusting, and Balancing of Environmental Systems."

### 1.7 QUALIFICATIONS

- A. Agency: Company specializing in the testing, adjusting, and balancing of systems specified in this Section with minimum three years' experience and certified by AABC or NEBB, or equivalent experience which would qualify for membership in these testing organizations. Agency shall be one of those listed under paragraph 3.01 AGENCIES in this Section.
- B. Perform Work under supervision of AABC Certified Test and Balance Engineer, NEBB Certified Testing, Balancing and Adjusting Supervisor or registered Professional Engineer experienced in performance of this Work and licensed in the state of Maine.
- C. The approved Agency shall be in no way affiliated with the installing Subcontractor.

### 1.8 SEQUENCING

- A. Sequence work under the provisions of Section 011000.
- B. Sequence work to commence after completion of systems or portions of work, and schedule completion of work before Substantial Completion of Project.
- C. Acceptance of work shall be upon written completion and acceptance of the TAB report.

## PART 2 - PRODUCTS (Not Used)

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Verify that systems are complete and operating correctly in accordance with sequence of operations before commencing work. Ensure the following conditions:
  - 1. Systems are started and operating in a safe and normal condition.
  - 2. Temperature control systems are installed complete and operable.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

3. Proper thermal overload protection is in place for electrical equipment.
  4. Final filters are clean and in place. If required, install temporary media in addition to final filters.
  5. Duct systems are clean of debris.
  6. Fans are rotating correctly.
  7. Volume dampers are in place and open.
  8. Air coil fins are cleaned and combed.
  9. Access doors are closed and duct end caps are in place.
  10. Air outlets are installed and connected.
  11. Duct system leakage is minimized.
  12. Proper strainer baskets are clean and in place.
  13. Service and balance valves are open.
- B. Submit field reports. Report to the responsible Subcontractors, defects and deficiencies noted during performance of services which prevent system balance. Submit list of locations where the Contractor needs to provide additional balancing devices. Field reports shall be submitted in accordance with the IDAT plan.
- C. Beginning of work means acceptance of existing conditions.

### 3.2 PREPARATION

- A. Provide instruments required for testing, adjusting, and balancing operations. Make instruments available to Architect/Engineer to facilitate spot checks during testing.

### 3.3 INSTALLATION TOLERANCES

- A. Air Handling Systems: Adjust to within plus or minus 5 percent of design for supply systems and plus or minus 5 percent of design for return and exhaust systems.
- B. Air Outlets and Inlets: Adjust total to within plus 10 percent and minus 5 percent of design to space. Adjust outlets and inlets in space to within plus or minus 10 percent of design.

### 3.4 ADJUSTING

- A. Ensure recorded data represents actual measured or observed conditions.
- B. Permanently mark settings of valves, dampers, and other adjustment devices allowing settings to be restored. Set and lock memory stops.
- C. After adjustment, take measurements to verify balance has not been disrupted or that such disruption has been rectified.
- D. Leave systems in proper working order, replacing belt guards, closing access doors, closing doors to electrical switch boxes, and restoring thermostats to specified settings.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- E. For belt driven equipment, provide sheave and belt modifications and/or replacements as required to ensure design flow rates as specified.

3.5 AIR SYSTEM PROCEDURE

- A. Adjust air handling and distribution systems to provide design supply, return, and exhaust air quantities.
- B. Make air quantity measurements in ducts by Pitot tube traverse of entire cross sectional area of duct.
- C. Measure air quantities at air inlets and outlets.
- D. Adjust distribution system to obtain uniform space temperatures free from objectionable drafts and noise.
- E. Use volume control devices to regulate air quantities only to extent that adjustments do not create objectionable air motion or sound levels. Effect volume control by duct internal devices such as dampers and splitters.
- F. Vary total system air quantities by adjustment of fan speeds. Vary branch air quantities by damper regulation.
- G. Provide system schematic with required and actual air quantities recorded at each outlet or inlet.
- H. Measure static air pressure conditions on air supply units, including filter and coil pressure drops, and total pressure across the fan. Make allowances for 50 percent loading of filters.
- I. Adjust outside air automatic dampers, outside air, return air, and exhaust dampers for design conditions. Adjust at minimum position and maximum position, and use manual dampers and actuator limit stops to minimize differences.
- J. Measure temperature conditions across outside air, return air, and exhaust dampers to check leakage.
- K. Where modulating dampers are provided, take measurements and balance at extreme conditions. Balance variable volume systems at maximum air flow rate, full cooling, and at minimum air flow rate, full heating.
- L. Measure building static pressure and adjust supply, return, and exhaust air systems to provide required relationship between each to maintain approximately 0.05 inches (12.5 Pa) positive static pressure near the building entries.
- M. For variable air volume system powered units set volume controller to air flow setting indicated. Confirm connections properly made and confirm proper operation for automatic variable air volume temperature control.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- N. Where available fan capacity is less than total flow requirements of individual system parts (due to system diversity), full flow in one part may be simulated by temporary restriction of flow to other parts.

3.6 COORDINATION OF SERVICES

- A. The General Contractor and his Subcontractors shall be responsible for providing the following assistance to the TAB Agent:
  - 1. Provide access to the Contractors on site ladders and man-lifts as required to allow access to required equipment by the TAB Agent.
  - 2. Keep the TAB Agent informed of the project schedule and ensure that adequate notice is given to the TAB Agent to allow for the proper testing, adjusting and balancing of mechanical systems before ceilings are flooded or access to systems is otherwise obstructed.
  - 3. Ensure that adequate time is allotted in the project schedule to allow for the proper testing, adjusting and balancing of the mechanical systems.
  - 4. Coordinate with the TAB Agent to correct system deficiencies that are discovered by the TAB Agent. Notify the TAB Agent once system deficiencies are corrected.

3.7 PROJECT CLOSEOUT

- A. At final inspection, recheck random selections of data recorded in TAB report. Recheck points or areas as selected and witnessed by the Architect.
  - a. Check and adjust systems approximately six months after final acceptance and submit final TAB report. Systems shall be rechecked and adjusted during each season.
  - b. Retests: If random tests elicit a measured flow deviation of ten percent or more from that recorded in the certified report listings, at ten percent or more of the rechecked selections, the report shall be automatically rejected. In the event the report is rejected, systems shall be readjusted and tested, new data recorded, new certified reports submitted, and new inspection tests made.
  - c. System shall be verified for proper performance 90 days after Owner acceptance.
- B. Provide instrument calibration reports by type used for air and water procedures and dates of last calibration.

3.8 SCHEDULES

- A. Equipment Requiring Testing, Adjusting, and Balancing:

- Air Handling Units
- Exhaust Fans
- Diffusers
- Grilles

END OF SECTION

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 024119 - SELECTIVE DEMOLITION

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

A. Section Includes:

1. Demolition and removal of selected portions of building or structure.
2. Demolition and removal of selected site elements.
3. Salvage of existing items to be reused or recycled.

B. Related Requirements:

1. Section 011000 "Summary" for restrictions on use of the premises, Owner-occupancy requirements, and phasing requirements.
2. Section 017300 "Execution" for cutting and patching procedures.

1.3 DEFINITIONS

- A. Remove: Detach items from existing construction and dispose of them off-site unless indicated to be salvaged or reinstalled.
- B. Existing to Remain: Leave existing items that are not to be removed and that are not otherwise indicated to be salvaged or reinstalled.
- C. Dismantle: To remove by disassembling or detaching an item from a surface, using gentle methods and equipment to prevent damage to the item and surfaces; disposing of items unless indicated to be salvaged or reinstalled.
- D. Salvage: Detach items from existing construction, store, and prepare for reinstallation or delivery to Owner as indicated.

1.4 MATERIALS OWNERSHIP

- A. Unless otherwise indicated, demolition waste becomes property of Contractor.
- B. Historic items, relics, antiques, and similar objects including, but not limited to, cornerstones and their contents, commemorative plaques and tablets, and other items of interest or value to Owner that may be uncovered during demolition remain the property of Owner.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1. Carefully salvage in a manner to prevent damage and promptly return to Owner.

1.5 PREINSTALLATION MEETINGS

- A. Predemolition Conference: Conduct conference at Project site.
1. Inspect and discuss condition of construction to be selectively demolished.
  2. Review structural load limitations of existing structure.
  3. Review and finalize selective demolition schedule and verify availability of materials, demolition personnel, equipment, and facilities needed to make progress and avoid delays.
  4. Review requirements of work performed by other trades that rely on substrates exposed by selective demolition operations.
  5. Review areas where existing construction is to remain and requires protection.

1.6 INFORMATIONAL SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Qualification Data: For refrigerant recovery technician.
- C. Proposed Protection Measures: Submit report, including Drawings, that indicates the measures proposed for protecting individuals and property, for environmental protection, for dust control and, for noise control. Indicate proposed locations and construction of barriers.
- D. Schedule of Selective Demolition Activities: Indicate the following:
1. Detailed sequence of selective demolition and removal work, with starting and ending dates for each activity.
  2. Interruption of utility services. Indicate how long utility services will be interrupted.
  3. Coordination for shutoff, capping, and continuation of utility services.
  4. Use of elevator and stairs.
  5. Coordination of Owner's continuing occupancy of portions of existing building and of Owner's partial occupancy of completed Work.
- E. Predemolition Photographs or Video: Show existing conditions of adjoining construction, including finish surfaces, that might be misconstrued as damage caused by demolition operations. Comply with Section 013233 "Photographic Documentation." Submit before Work begins.
- F. Statement of Refrigerant Recovery: Signed by refrigerant recovery technician responsible for recovering refrigerant, stating that all refrigerant that was present was recovered and that recovery was performed according to EPA regulations. Include name and address of technician and date refrigerant was recovered.
- G. Warranties: Documentation indicating that existing warranties are still in effect after completion of selective demolition.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1.7 CLOSEOUT SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Inventory: Submit a list of items that have been removed and salvaged.

1.8 QUALITY ASSURANCE

- A. Refrigerant Recovery Technician Qualifications: Certified by an EPA-approved certification program.

1.9 FIELD CONDITIONS

- A. Owner will occupy portions of building immediately adjacent to selective demolition area. Conduct selective demolition so Owner's operations will not be disrupted.
- B. Notify Architect of discrepancies between existing conditions and Drawings before proceeding with selective demolition.
- C. Hazardous Materials: It is not expected that hazardous materials will be encountered in the Work.
  - 1. If suspected hazardous materials are encountered, do not disturb materials and immediately notify the Owner for direction.
- D. Storage or sale of removed items or materials on-site is not permitted.
- E. Utility Service: Maintain existing utilities indicated to remain in service and protect them against damage during selective demolition operations.
  - 1. Maintain fire-protection facilities in service during selective demolition operations.

1.10 COORDINATION

- A. Arrange selective demolition schedule so as not to interfere with Owner's operations.

PART 2 - PRODUCTS

2.1 PERFORMANCE REQUIREMENTS

- A. Regulatory Requirements: Comply with governing EPA notification regulations before beginning selective demolition. Comply with hauling and disposal regulations of authorities having jurisdiction.
- B. Standards: Comply with ASSE A10.6 and NFPA 241.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Verify that utilities have been disconnected and capped before starting selective demolition operations.
- B. Review Project Record Documents of existing construction or other existing condition and hazardous material information provided by Owner. Owner does not guarantee that existing conditions are same as those indicated in Project Record Documents.
- C. Verify that hazardous materials have been remediated before proceeding with building demolition operations.
- D. Survey of Existing Conditions: Record existing conditions by use of measured drawings.
  - 1. Comply with requirements specified in Section 013233 "Photographic Documentation."
  - 2. Inventory and record the condition of items to be removed and salvaged. Provide photographs or video of conditions that might be misconstrued as damage caused by salvage operations.
  - 3. Before selective demolition or removal of existing building elements that will be reproduced or duplicated in final Work, make permanent record of measurements, materials, and construction details required to make exact reproduction.

3.2 PREPARATION

- A. Refrigerant: Before starting demolition, remove refrigerant from mechanical equipment according to 40 CFR 82 and regulations of authorities having jurisdiction.

3.3 UTILITY SERVICES AND MECHANICAL/ELECTRICAL SYSTEMS

- A. Existing Services/Systems to Remain: Maintain services/systems indicated to remain and protect them against damage.
- B. Existing Services/Systems to Be Removed, Relocated, or Abandoned: Locate, identify, disconnect, and seal or cap off utility services and mechanical/electrical systems serving areas to be selectively demolished.
  - 1. Arrange to shut off utilities with utility companies.
  - 2. If services/systems are required to be removed, relocated, or abandoned, provide temporary services/systems that bypass area of selective demolition and that maintain continuity of services/systems to other parts of building.
  - 3. Disconnect, demolish, and remove fire-suppression systems, plumbing, and HVAC systems, equipment, and components indicated on Drawings to be removed.
    - a. Piping to Be Removed: Remove portion of piping indicated to be removed and cap or plug remaining piping with same or compatible piping material.



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- b. Piping to Be Abandoned in Place: Drain piping and cap or plug piping with same or compatible piping material and leave in place.
- c. Equipment to Be Removed: Disconnect and cap services and remove equipment.
- d. Equipment to Be Removed and Reinstalled: Disconnect and cap services and remove, clean, and store equipment; when appropriate, reinstall, reconnect, and make equipment operational.
- e. Equipment to Be Removed and Salvaged: Disconnect and cap services and remove equipment and deliver to Owner.
- f. Ducts to Be Removed: Remove portion of ducts indicated to be removed and plug remaining ducts with same or compatible ductwork material.
- g. Ducts to Be Abandoned in Place: Cap or plug ducts with same or compatible ductwork material and leave in place.

### 3.4 PROTECTION

- A. Temporary Protection: Provide temporary barricades and other protection required to prevent injury to people and damage to adjacent buildings and facilities to remain.
  - 1. Provide protection to ensure safe passage of people around selective demolition area and to and from occupied portions of building.
  - 2. Provide temporary weather protection, during interval between selective demolition of existing construction on exterior surfaces and new construction, to prevent water leakage and damage to structure and interior areas.
  - 3. Protect walls, ceilings, floors, and other existing finish work that are to remain or that are exposed during selective demolition operations.
  - 4. Cover and protect furniture, furnishings, and equipment that have not been removed.
  - 5. Comply with requirements for temporary enclosures, dust control, heating, and cooling specified in Section 015000 "Temporary Facilities and Controls."
- B. Temporary Shoring: Design, provide, and maintain shoring, bracing, and structural supports as required to preserve stability and prevent movement, settlement, or collapse of construction and finishes to remain, and to prevent unexpected or uncontrolled movement or collapse of construction being demolished.
  - 1. Strengthen or add new supports when required during progress of selective demolition.
- C. Remove temporary barricades and protections where hazards no longer exist.

### 3.5 SELECTIVE DEMOLITION, GENERAL

- A. General: Demolish and remove existing construction only to the extent required by new construction and as indicated. Use methods required to complete the Work within limitations of governing regulations and as follows:
  - 1. Proceed with selective demolition systematically, from higher to lower level. Complete selective demolition operations above each floor or tier before disturbing supporting members on the next lower level.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

2. Neatly cut openings and holes plumb, square, and true to dimensions required. Use cutting methods least likely to damage construction to remain or adjoining construction. Use hand tools or small power tools designed for sawing or grinding, not hammering and chopping. Temporarily cover openings to remain.
  3. Cut or drill from the exposed or finished side into concealed surfaces to avoid marring existing finished surfaces.
  4. Do not use cutting torches until work area is cleared of flammable materials. At concealed spaces, such as duct and pipe interiors, verify condition and contents of hidden space before starting flame-cutting operations. Maintain portable fire-suppression devices during flame-cutting operations.
  5. Maintain adequate ventilation when using cutting torches.
  6. Remove decayed, vermin-infested, or otherwise dangerous or unsuitable materials and promptly dispose of off-site.
  7. Remove structural framing members and lower to ground by method suitable to avoid free fall and to prevent ground impact or dust generation.
  8. Locate selective demolition equipment and remove debris and materials so as not to impose excessive loads on supporting walls, floors, or framing.
  9. Dispose of demolished items and materials promptly.
- B. Site Access and Temporary Controls: Conduct selective demolition and debris-removal operations to ensure minimum interference with roads, streets, walks, walkways, and other adjacent occupied and used facilities.
- C. Existing Items to Remain: Protect construction indicated to remain against damage and soiling during selective demolition. When permitted by Architect, items may be removed to a suitable, protected storage location during selective demolition and reinstalled in their original locations after selective demolition operations are complete.

### 3.6 SELECTIVE DEMOLITION PROCEDURES FOR SPECIFIC MATERIALS

- A. Concrete: Demolish in small sections. Using power-driven saw, cut concrete to a depth of at least 3/4 inch at junctures with construction to remain. Dislodge concrete from reinforcement at perimeter of areas being demolished, cut reinforcement, and then remove remainder of concrete. Neatly trim openings to dimensions indicated.
- B. Concrete: Demolish in sections. Cut concrete full depth at junctures with construction to remain and at regular intervals using power-driven saw, and then remove concrete between saw cuts.
- C. Masonry: Demolish in small sections. Cut masonry at junctures with construction to remain, using power-driven saw, and then remove masonry between saw cuts.
- D. Concrete Slabs-on-Grade: Saw-cut perimeter of area to be demolished, and then break up and remove.
- E. Resilient Floor Coverings: Remove floor coverings and adhesive according to recommendations in RFCI's "Recommended Work Practices for the Removal of Resilient Floor Coverings."

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

3.7 DISPOSAL OF DEMOLISHED MATERIALS

- A. Remove demolition waste materials from Project site and recycle or dispose of them according to Section 017419 "Construction Waste Management and Disposal."
  - 1. Do not allow demolished materials to accumulate on-site.
  - 2. Remove and transport debris in a manner that will prevent spillage on adjacent surfaces and areas.
  - 3. Remove debris from elevated portions of building by chute, hoist, or other device that will convey debris to grade level in a controlled descent.
  - 4. Comply with requirements specified in Section 017419 "Construction Waste Management and Disposal."
- B. Burning: Do not burn demolished materials.

3.8 CLEANING

- A. Clean adjacent structures and improvements of dust, dirt, and debris caused by selective demolition operations. Return adjacent areas to condition existing before selective demolition operations began.

END OF SECTION



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 079200 - JOINT SEALANTS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
  - 1. Mildew-resistant joint sealants.
  - 2. Latex joint sealants.

1.3 ACTION SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Product Data: For each joint-sealant product.
- C. Samples for Initial Selection: Manufacturer's color charts consisting of strips of cured sealants showing the full range of colors available for each product exposed to view.
- D. Samples for Verification: For each kind and color of joint sealant required, provide Samples with joint sealants in 1/2-inch- wide joints formed between two 6-inch- long strips of material matching the appearance of exposed surfaces adjacent to joint sealants.
- E. Joint-Sealant Schedule: Include the following information:
  - 1. Joint-sealant application, joint location, and designation.
  - 2. Joint-sealant manufacturer and product name.
  - 3. Joint-sealant formulation.
  - 4. Joint-sealant color.

1.4 INFORMATIONAL SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Qualification Data: For qualified testing agency.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- C. Product Test Reports: For each kind of joint sealant, for tests performed by manufacturer and witnessed by a qualified testing agency or a qualified testing agency.
- D. Sample Warranties: For special warranties.

1.5 QUALITY ASSURANCE

- A. Installer Qualifications: An authorized representative who is trained and approved by manufacturer.
- B. Product Testing: Test joint sealants using a qualified testing agency.
  - 1. Testing Agency Qualifications: Qualified according to ASTM C 1021 to conduct the testing indicated.

1.6 FIELD CONDITIONS

- A. Do not proceed with installation of joint sealants under the following conditions:
  - 1. When ambient and substrate temperature conditions are outside limits permitted by joint-sealant manufacturer or are below 40 deg F.
  - 2. When joint substrates are wet.
  - 3. Where joint widths are less than those allowed by joint-sealant manufacturer for applications indicated.
  - 4. Where contaminants capable of interfering with adhesion have not yet been removed from joint substrates.

1.7 WARRANTY

- A. Special Installer's Warranty: Installer agrees to repair or replace joint sealants that do not comply with performance and other requirements specified in this Section within specified warranty period.
  - 1. Warranty Period: Two years from date of Substantial Completion.
- B. Special Manufacturer's Warranty: Manufacturer agrees to furnish joint sealants to repair or replace those joint sealants that do not comply with performance and other requirements specified in this Section within specified warranty period.
  - 1. Warranty Period: Five years from date of Substantial Completion.
- C. Special warranties specified in this article exclude deterioration or failure of joint sealants from the following:
  - 1. Movement of the structure caused by stresses on the sealant exceeding sealant manufacturer's written specifications for sealant elongation and compression.
  - 2. Disintegration of joint substrates from causes exceeding design specifications.
  - 3. Mechanical damage caused by individuals, tools, or other outside agents.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

4. Changes in sealant appearance caused by accumulation of dirt or other atmospheric contaminants.

## PART 2 - PRODUCTS

### 2.1 JOINT SEALANTS, GENERAL

- A. Compatibility: Provide joint sealants, backings, and other related materials that are compatible with one another and with joint substrates under conditions of service and application, as demonstrated by joint-sealant manufacturer, based on testing and field experience.
- B. VOC Content: Sealants and sealant primers shall comply with the following:
  1. Architectural sealants shall have a VOC content of 250 g/L or less.
- C. Colors of Exposed Joint Sealants: As selected by Architect from manufacturer's full range.

### 2.2 MILDEW-RESISTANT JOINT SEALANTS

- A. Mildew-Resistant Joint Sealants: Formulated for prolonged exposure to humidity with fungicide to prevent mold and mildew growth.
- B. Silicone, Mildew Resistant, Acid Curing, S, NS, 25, NT: Mildew-resistant, single-component, nonsag, plus 25 percent and minus 25 percent movement capability, nontraffic-use, acid-curing silicone joint sealant; ASTM C 920, Type S, Grade NS, Class 25, Use NT.
  1. Products: Subject to compliance with requirements, provide one of the following:
    - a. Dow Corning Corporation; DOW CORNING® 786 SILICONE SEALANT -.
    - b. GE Construction Sealants; Momentive Performance Materials Inc.; SCS1700 Sanitary.
    - c. May National Associates, Inc.; a subsidiary of Sika Corporation; Bondaflex Sil 100 WF.
    - d. Soudal USA; RTV GP.
    - e. Tremco Incorporated; Tremsil 200.

### 2.3 LATEX JOINT SEALANTS

- A. Acrylic Latex: Acrylic latex or siliconized acrylic latex, ASTM C 834, Type OP, Grade NF.
  1. Products: Subject to compliance with requirements, provide one of the following:
    - a. BASF Construction Chemicals – Buildings Systems; Sonolac.
    - b. May National Associates, Inc.; a subsidiary of Sika Corporation; Bondaflex Sil-A 700.
    - c. Pecora Corporation; AC-20.
    - d. Sherwin-Williams Company (The); 950A Siliconized Acrylic Latex Caulk, White.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- e. [Tremco Incorporated](#); Tremflex 834.

#### 2.4 JOINT-SEALANT BACKING

- A. Sealant Backing Material, General: Nonstaining; compatible with joint substrates, sealants, primers, and other joint fillers; and approved for applications indicated by sealant manufacturer based on field experience and laboratory testing.
- B. Cylindrical Sealant Backings: ASTM C 1330, Type C (closed-cell material with a surface skin), Type B (bicellular material with a surface skin), or any of the preceding types, as approved in writing by joint-sealant manufacturer for joint application indicated, and of size and density to control sealant depth and otherwise contribute to producing optimum sealant performance.
- C. Bond-Breaker Tape: Polyethylene tape or other plastic tape recommended by sealant manufacturer for preventing sealant from adhering to rigid, inflexible joint-filler materials or joint surfaces at back of joint. Provide self-adhesive tape where applicable.

#### 2.5 MISCELLANEOUS MATERIALS

- A. Primer: Material recommended by joint-sealant manufacturer where required for adhesion of sealant to joint substrates indicated, as determined from preconstruction joint-sealant-substrate tests and field tests.
- B. Cleaners for Nonporous Surfaces: Chemical cleaners acceptable to manufacturers of sealants and sealant backing materials, free of oily residues or other substances capable of staining or harming joint substrates and adjacent nonporous surfaces in any way, and formulated to promote optimum adhesion of sealants to joint substrates.
- C. Masking Tape: Nonstaining, nonabsorbent material compatible with joint sealants and surfaces adjacent to joints.

### PART 3 - EXECUTION

#### 3.1 EXAMINATION

- A. Examine joints indicated to receive joint sealants, with Installer present, for compliance with requirements for joint configuration, installation tolerances, and other conditions affecting performance of the Work.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

#### 3.2 PREPARATION

- A. Surface Cleaning of Joints: Clean out joints immediately before installing joint sealants to comply with joint-sealant manufacturer's written instructions and the following requirements:



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1. Remove all foreign material from joint substrates that could interfere with adhesion of joint sealant, including dust, paints (except for permanent, protective coatings tested and approved for sealant adhesion and compatibility by sealant manufacturer), old joint sealants, oil, grease, waterproofing, water repellents, water, surface dirt, and frost.
2. Clean porous joint substrate surfaces by brushing, grinding, mechanical abrading, or a combination of these methods to produce a clean, sound substrate capable of developing optimum bond with joint sealants. Remove loose particles remaining after cleaning operations above by vacuuming or blowing out joints with oil-free compressed air. Porous joint substrates include the following:
  - a. Concrete.
  - b. Masonry.
  - c. Unglazed surfaces of ceramic tile.
3. Remove laitance and form-release agents from concrete.
4. Clean nonporous joint substrate surfaces with chemical cleaners or other means that do not stain, harm substrates, or leave residues capable of interfering with adhesion of joint sealants. Nonporous joint substrates include the following:
  - a. Metal.
  - b. Glass.
  - c. Porcelain enamel.
  - d. Glazed surfaces of ceramic tile.

- B. Joint Priming: Prime joint substrates where recommended by joint-sealant manufacturer or as indicated by preconstruction joint-sealant-substrate tests or prior experience. Apply primer to comply with joint-sealant manufacturer's written instructions. Confine primers to areas of joint-sealant bond; do not allow spillage or migration onto adjoining surfaces.
- C. Masking Tape: Use masking tape where required to prevent contact of sealant or primer with adjoining surfaces that otherwise would be permanently stained or damaged by such contact or by cleaning methods required to remove sealant smears. Remove tape immediately after tooling without disturbing joint seal.

### 3.3 INSTALLATION OF JOINT SEALANTS

- A. General: Comply with joint-sealant manufacturer's written installation instructions for products and applications indicated, unless more stringent requirements apply.
- B. Sealant Installation Standard: Comply with recommendations in ASTM C 1193 for use of joint sealants as applicable to materials, applications, and conditions indicated.
- C. Install sealant backings of kind indicated to support sealants during application and at position required to produce cross-sectional shapes and depths of installed sealants relative to joint widths that allow optimum sealant movement capability.
1. Do not leave gaps between ends of sealant backings.
  2. Do not stretch, twist, puncture, or tear sealant backings.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

3. Remove absorbent sealant backings that have become wet before sealant application, and replace them with dry materials.
- D. Install bond-breaker tape behind sealants where sealant backings are not used between sealants and backs of joints.
- E. Install sealants using proven techniques that comply with the following and at the same time backings are installed:
  1. Place sealants so they directly contact and fully wet joint substrates.
  2. Completely fill recesses in each joint configuration.
  3. Produce uniform, cross-sectional shapes and depths relative to joint widths that allow optimum sealant movement capability.
- F. Tooling of Nonsag Sealants: Immediately after sealant application and before skinning or curing begins, tool sealants according to requirements specified in subparagraphs below to form smooth, uniform beads of configuration indicated; to eliminate air pockets; and to ensure contact and adhesion of sealant with sides of joint.
  1. Remove excess sealant from surfaces adjacent to joints.
  2. Use tooling agents that are approved in writing by sealant manufacturer and that do not discolor sealants or adjacent surfaces.
  3. Provide concave joint profile per Figure 8A in ASTM C 1193 unless otherwise indicated.

### 3.4 CLEANING

- A. Clean off excess sealant or sealant smears adjacent to joints as the Work progresses by methods and with cleaning materials approved in writing by manufacturers of joint sealants and of products in which joints occur.

### 3.5 PROTECTION

- A. Protect joint sealants during and after curing period from contact with contaminating substances and from damage resulting from construction operations or other causes so sealants are without deterioration or damage at time of Substantial Completion. If, despite such protection, damage or deterioration occurs, cut out, remove, and repair damaged or deteriorated joint sealants immediately so installations with repaired areas are indistinguishable from original work.

### 3.6 JOINT-SEALANT SCHEDULE

- A. Joint-Sealant Application: Interior joints in vertical surfaces and horizontal nontraffic surfaces not subject to significant movement.
  1. Joint Locations:
    - a. Control joints on exposed interior surfaces of exterior walls.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- b. Perimeter joints between interior wall surfaces and frames of interior doors windows and elevator entrances.
    - c. Other joints as indicated on Drawings.
  2. Joint Sealant: Acrylic latex.
  3. Joint-Sealant Color: As selected by Architect from manufacturer's full range of colors.
- B. Joint-Sealant Application: Mildew-resistant interior joints in vertical surfaces and horizontal nontraffic surfaces.
  1. Joint Locations:
    - a. Joints between plumbing fixtures and adjoining walls, floors, and counters.
    - b. Tile control and expansion joints where indicated.
    - c. Other joints as indicated on Drawings.
  2. Joint Sealant: Silicone, mildew resistant, acid curing, S, NS, 25, NT.
  3. Joint-Sealant Color: As selected by Architect from manufacturer's full range of colors.

END OF SECTION



SECTION 081113 - HOLLOW METAL DOORS AND FRAMES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes:
  - 1. Interior standard steel frames.

1.3 DEFINITIONS

- A. Minimum Thickness: Minimum thickness of base metal without coatings according to NAAMM-HMMA 803 or SDI A250.8.

1.4 COORDINATION

- A. Coordinate anchorage installation for hollow-metal frames. Furnish setting drawings, templates, and directions for installing anchorages, including sleeves, concrete inserts, anchor bolts, and items with integral anchors. Deliver such items to Project site in time for installation.
- B. Coordinate requirements for installation of door hardware, access control and security systems.

1.5 ACTION SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Product Data: For each type of product.
  - 1. Include construction details, material descriptions, core descriptions and finishes.
- C. Shop Drawings: Include the following:
  - 1. Frame details for each frame type, including dimensioned profiles and metal thicknesses.
  - 2. Locations of reinforcement and preparations for hardware.
  - 3. Details of each different wall opening condition.
  - 4. Details of anchorages, joints, field splices, and connections.
  - 5. Details of accessories.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

6. Details of moldings, removable stops, and glazing.

D. Product Schedule: For hollow-metal frames, prepared by or under the supervision of supplier, using same reference numbers for details and openings as those on Drawings. Coordinate with final door hardware schedule.

1.6 INFORMATIONAL SUBMITTALS

A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.

B. Product Test Reports: For each type of hollow-metal frame assembly, for tests performed by a qualified testing agency.

1.7 DELIVERY, STORAGE, AND HANDLING

A. Deliver hollow-metal frames palletized, packaged, or crated to provide protection during transit and Project-site storage. Do not use nonvented plastic.

B. Store hollow-metal frames vertically under cover at Project site with head up. Place on minimum 4-inch- high wood blocking.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

1. Ceco Door; ASSA ABLOY.
2. Curries Company; ASSA ABLOY.
3. Custom Metal Products.
4. DE LA FONTAINE.
5. Deansteel Manufacturing Company, Inc.
6. DKS Steel Door & Frame Systems, Inc.
7. Door Components, Inc.
8. Fleming Door Products Ltd.; Assa Abloy Group Company.
9. Gensteel Doors, Inc.
10. Hollow Metal Inc.
11. Hollow Metal Xpress.
12. JR Metal Frames Manufacturing, Inc.
13. Karpen Steel Custom Doors & Frames.
14. LaForce, Inc.
15. Mesker Door Inc.
16. Metropolitan Door Industries Corp.
17. MPI Group, LLC (The).

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

18. [National Custom Hollow Metal Doors & Frames.](#)
19. [North American Door Corp.](#)
20. [Pioneer Industries.](#)
21. [Premier Products, Inc.](#)
22. [Republic Doors and Frames.](#)
23. [Security Metal Products; a brand of ASSA ABLOY.](#)
24. [Shanahan's Manufacturing Limited.](#)
25. [Steelcraft; an Allegion brand.](#)
26. [Stiles Custom Metal, Inc.](#)

## 2.2 INTERIOR STANDARD STEEL DOORS AND FRAMES

- A. Construct hollow-metal frames to comply with standards indicated for materials, fabrication, hardware locations, hardware reinforcement, tolerances, and clearances, and as specified.
- B. Heavy-Duty Frames: SDI A250.8, Level 2; SDI A250.4, Level B.
  1. Frames:
    - a. Materials: Uncoated steel sheet, minimum thickness of 0.042 inch.
    - b. Construction: Knocked-down.
  2. Exposed Finish: Prime.

## 2.3 FRAME ANCHORS

- A. Jamb Anchors:
  1. Type: Anchors of minimum size and type required by applicable frame standard, and suitable for performance level indicated.
  2. Quantity: Minimum of three anchors per jamb, with one additional anchor for frames with no floor anchor. Provide one additional anchor for each 24 inches of frame height above 7 feet.
  3. Postinstalled Expansion Anchor: Minimum 3/8-inch- diameter bolts with expansion shields or inserts, with manufacturer's standard pipe spacer.
- B. Material: ASTM A 879/A 879M, Commercial Steel (CS), 04Z coating designation; mill phosphatized.

## 2.4 MATERIALS

- A. Cold-Rolled Steel Sheet: ASTM A 1008/A 1008M, Commercial Steel (CS), Type B; suitable for exposed applications.
- B. Hot-Rolled Steel Sheet: ASTM A 1011/A 1011M, Commercial Steel (CS), Type B; free of scale, pitting, or surface defects; pickled and oiled.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- C. Inserts, Bolts, and Fasteners: Hot-dip galvanized according to ASTM A 153/A 153M.
- D. Power-Actuated Fasteners in Concrete: Fastener system of type suitable for application indicated, fabricated from corrosion-resistant materials, with clips or other accessory devices for attaching hollow-metal frames of type indicated.

## 2.5 FABRICATION

- A. Hollow-Metal Frames: Fabricate in one piece except where handling and shipping limitations require multiple sections. Where frames are fabricated in sections, provide alignment plates or angles at each joint, fabricated of metal of same or greater thickness as frames.
  - 1. Provide countersunk, flat- or oval-head exposed screws and bolts for exposed fasteners unless otherwise indicated.
  - 2. Door Silencers: Except on weather-stripped frames, drill stops to receive door silencers as follows. Keep holes clear during construction.
    - a. Single-Door Frames: Drill stop in strike jamb to receive three door silencers.
- B. Hardware Preparation: Factory prepare hollow-metal frames to receive templated mortised hardware, and electrical wiring; include cutouts, reinforcement, mortising, drilling, and tapping according to SDI A250.6, the Door Hardware Schedule, and templates.
  - 1. Reinforce frames to receive nontemplated, mortised hardware.
  - 2. Comply with BHMA A156.115 for preparing hollow-metal frames for hardware.

## 2.6 STEEL FINISHES

- A. Prime Finish: Clean, pretreat, and apply manufacturer's standard primer.
  - 1. Shop Primer: Manufacturer's standard, fast-curing, lead- and chromate-free primer complying with SDI A250.10; recommended by primer manufacturer for substrate; compatible with substrate and field-applied coatings despite prolonged exposure.

## PART 3 - EXECUTION

### 3.1 PREPARATION

- A. Remove welded-in shipping spreaders installed at factory. Restore exposed finish by grinding, filling, and dressing, as required to make repaired area smooth, flush, and invisible on exposed faces. Touch up factory-applied finishes where spreaders are removed.
- B. Drill and tap frames to receive nontemplated, mortised hardware.



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

3.2 INSTALLATION

- A. General: Install hollow-metal frames plumb, rigid, properly aligned, and securely fastened in place. Comply with approved Shop Drawings and with manufacturer's written instructions.
- B. Hollow-Metal Frames: Comply with SDI A250.11.
  - 1. Set frames accurately in position; plumbed, aligned, and braced securely until permanent anchors are set. After wall construction is complete, remove temporary braces without damage to completed Work.
    - a. Where frames are fabricated in sections, field splice at approved locations by welding face joint continuously; grind, fill, dress, and make splice smooth, flush, and invisible on exposed faces. Touch-up finishes.
    - b. Install frames with removable stops located on secure side of opening.
  - 2. In-Place Concrete or Masonry Construction: Secure frames in place with postinstalled expansion anchors. Countersink anchors, and fill and make smooth, flush, and invisible on exposed faces.
  - 3. Installation Tolerances: Adjust hollow-metal frames to the following tolerances:
    - a. Squareness: Plus or minus 1/16 inch, measured at door rabbet on a line 90 degrees from jamb perpendicular to frame head.
    - b. Alignment: Plus or minus 1/16 inch, measured at jambs on a horizontal line parallel to plane of wall.
    - c. Twist: Plus or minus 1/16 inch, measured at opposite face corners of jambs on parallel lines, and perpendicular to plane of wall.
    - d. Plumbness: Plus or minus 1/16 inch, measured at jambs at floor.

3.3 CLEANING AND TOUCHUP

- A. Prime-Coat Touchup: Immediately after erection, sand smooth rusted or damaged areas of prime coat and apply touchup of compatible air-drying, rust-inhibitive primer.
- B. Touchup Painting: Cleaning and touchup painting of abraded areas of paint are specified in painting Sections.

END OF SECTION



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 081416 - FLUSH WOOD DOORS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
  - 1. Solid-core doors with wood-veneer faces.
  - 2. Factory finishing flush wood doors.
  - 3. Factory fitting flush wood doors to frames and factory machining for hardware.

1.3 ACTION SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Product Data: For each type of door. Include details of core and edge construction and trim for openings. Include factory-finishing specifications.
- C. Shop Drawings: Indicate location, size, and hand of each door; elevation of each kind of door; construction details not covered in Product Data; and the following:
  - 1. Dimensions and locations of blocking.
  - 2. Dimensions and locations of mortises and holes for hardware.
  - 3. Undercuts.
  - 4. Requirements for veneer matching.
  - 5. Doors to be factory finished and finish requirements.
- D. Samples for Initial Selection: For factory-finished doors.

1.4 INFORMATIONAL SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Sample Warranty: For special warranty.
- C. Quality Standard Compliance Certificates: AWI Quality Certification Program certificates.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1.5 DELIVERY, STORAGE, AND HANDLING

- A. Comply with requirements of referenced standard and manufacturer's written instructions.
- B. Package doors individually in plastic bags or cardboard cartons.
- C. Mark each door on top and bottom rail with opening number used on Shop Drawings.

1.6 FIELD CONDITIONS

- A. Environmental Limitations: Do not deliver or install doors until spaces are enclosed and weathertight, wet work in spaces is complete and dry, and HVAC system is operating and maintaining temperature between 60 and 90 deg F and relative humidity between 25 and 55 percent during remainder of construction period.

1.7 WARRANTY

- A. Special Warranty: Manufacturer agrees to repair or replace doors that fail in materials or workmanship within specified warranty period.
  - 1. Failures include, but are not limited to, the following:
    - a. Warping (bow, cup, or twist) more than 1/4 inch in a 42-by-84-inch section.
    - b. Telegraphing of core construction in face veneers exceeding 0.01 inch in a 3-inch span.
  - 2. Warranty shall also include installation and finishing that may be required due to repair or replacement of defective doors.
  - 3. Warranty Period for Solid-Core Interior Doors: Life of installation.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. Algoma Hardwoods, Inc.
  - 2. Chappell Door Co.
  - 3. Eggers Industries.
  - 4. General Veneer Manufacturing Co.
  - 5. Graham Wood Doors; ASSA ABLOY Group company.
  - 6. Marshfield DoorSystems, Inc.
  - 7. Mohawk Flush Doors, Inc.
  - 8. Oshkosh Door Company.
  - 9. Vancouver Door Company.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- B. Source Limitations: Obtain flush wood doors from single manufacturer.

## 2.2 FLUSH WOOD DOORS, GENERAL

- A. Quality Standard: In addition to requirements specified, comply with AWI's, AWMAC's, and WI's "Architectural Woodwork Standards and WDMA I.S.1-A, "Architectural Wood Flush Doors."
1. Provide AWI Quality Certification Labels indicating that doors comply with requirements of grades specified.
  2. Contract Documents contain selections chosen from options in quality standard and additional requirements beyond those of quality standard. Comply with those selections and requirements in addition to quality standard.
- B. WDMA I.S.1-A Performance Grade:
1. Extra Heavy Duty: Unless indicated otherwise.
- C. Particleboard-Core Doors:
1. Particleboard: ANSI A208.1, Grade LD-2, made with binder containing no urea-formaldehyde.
  2. **Particleboard**: Straw-based particleboard complying with requirements in ANSI A208.1, Grade M-2, except for density.
  3. Blocking: Provide wood blocking in particleboard-core doors as needed to eliminate through-bolting hardware.
  4. Provide doors with glued-wood-stave or structural-composite-lumber cores instead of particleboard cores for doors indicated to receive exit devices.
- D. Structural-Composite-Lumber-Core Doors:
1. Structural Composite Lumber: WDMA I.S.10.
    - a. Screw Withdrawal, Face: 700 lbf.
    - b. Screw Withdrawal, Edge: 400 lbf.

## 2.3 VENEER-FACED DOORS FOR TRANSPARENT FINISH

- A. Interior Solid-Core Doors:
1. Grade: Custom (Grade A faces).
  2. Species: Red Oak (match existing adjacent).
  3. Cut: Rotary cut.
  4. Assembly of Veneer Leaves on Door Faces: Running match.
  5. Exposed Vertical Edges: Same species as faces - edge Type A.
  6. Core: Particleboard, glued wood stave, or structural composite lumber.
  7. Construction: Five plies. Stiles and rails are bonded to core, then entire unit is abrasive planed before veneering.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

8. WDMA I.S.1-A Performance Grade: Extra Heavy Duty.

## 2.4 FABRICATION

- A. Factory fit doors to suit frame-opening sizes indicated. Comply with clearance requirements of referenced quality standard for fitting unless otherwise indicated.
- B. Factory machine doors for hardware that is not surface applied. Locate hardware to comply with DHI-WDHS-3. Comply with final hardware schedules, door frame Shop Drawings, BHMA-156.115-W, and hardware templates.
  1. Coordinate with hardware mortises in metal frames to verify dimensions and alignment before factory machining.

## 2.5 FACTORY FINISHING

- A. General: Comply with referenced quality standard for factory finishing. Complete fabrication, including fitting doors for openings and machining for hardware that is not surface applied, before finishing.
  1. Finish faces, all four edges, edges of cutouts, and mortises. Stains and fillers may be omitted on bottom edges, edges of cutouts, and mortises.
- B. Factory finish doors.
- C. Transparent Finish:
  1. Grade: Custom.
  2. Finish: AWI's, AWMAC's, and WI's "Architectural Woodwork Standards" System 11, catalyzed polyurethane.
  3. Finish: WDMA TR-6 catalyzed polyurethane.
  4. Staining: As selected by Architect from manufacturer's full range.
  5. Effect: Open-grain finish.
  6. Sheen: Satin.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine doors and installed door frames, with Installer present, before hanging doors.
  1. Verify that installed frames comply with indicated requirements for type, size, location, and swing characteristics and have been installed with level heads and plumb jambs.
  2. Reject doors with defects.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

3.2 INSTALLATION

- A. Hardware: For installation, see Section 087100 "Door Hardware."
- B. Installation Instructions: Install doors to comply with manufacturer's written instructions and referenced quality standard, and as indicated.
- C. Job-Fitted Doors: Align and fit doors in frames with uniform clearances and bevels as indicated below; do not trim stiles and rails in excess of limits set by manufacturer or permitted for fire-rated doors. Machine doors for hardware. Seal edges of doors, edges of cutouts, and mortises after fitting and machining.
  - 1. Clearances: Provide 1/8 inch at heads, jambs, and between pairs of doors. Provide 1/8 inch from bottom of door to top of decorative floor finish or covering unless otherwise indicated. Where threshold is shown or scheduled, provide 1/4 inch from bottom of door to top of threshold unless otherwise indicated.
    - a. Bevel non-fire-rated doors 1/8 inch in 2 inches at lock and hinge edges.
- D. Factory-Fitted Doors: Align in frames for uniform clearance at each edge.
- E. Factory-Finished Doors: Restore finish before installation if fitting or machining is required at Project site.

3.3 ADJUSTING

- A. Operation: Rehang or replace doors that do not swing or operate freely.
- B. Finished Doors: Replace doors that are damaged or that do not comply with requirements. Doors may be repaired or refinished if Work complies with requirements and shows no evidence of repair or refinishing.

END OF SECTION





WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 087100 - DOOR HARDWARE

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes:
  - 1. Mechanical door hardware for the following:
    - a. Swinging doors.

1.3 ACTION SUBMITTALS

- A. Submittals shall comply with the requirements of the Construction Contract Clauses, Section 007213 "General Conditions" and the individual sections specifying the work.
- B. Product Data: For each type of product indicated. Include construction and installation details, material descriptions, dimensions of individual components and profiles, and finishes.
- C. Other Action Submittals:
  - 1. Door Hardware Schedule: Prepared by or under the supervision of Installer, detailing fabrication and assembly of door hardware, as well as installation procedures and diagrams. Coordinate final door hardware schedule with doors, frames, and related work to ensure proper size, thickness, hand, function, and finish of door hardware.
    - a. Submittal Sequence: Submit door hardware schedule concurrent with submissions of Product Data, Samples, and Shop Drawings. Coordinate submission of door hardware schedule with scheduling requirements of other work to facilitate the fabrication of other work that is critical in Project construction schedule.
    - b. Format: Comply with scheduling sequence and vertical format in DHI's "Sequence and Format for the Hardware Schedule." Double space entries, and number and date each page.
    - c. Format: Use same scheduling sequence and format and use same door numbers as in the Contract Documents.
    - d. Content: Include the following information:
      - 1) Identification number, location, hand, size, and material of each door and frame.
      - 2) Locations of each door hardware set, cross-referenced to Drawings on floor plans and to door and frame schedule.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- 3) Complete designations, including name and manufacturer, type, style, function, size, quantity, function, and finish of each door hardware product.
  - 4) Fastenings and other pertinent information.
  - 5) Explanation of abbreviations, symbols, and codes contained in schedule.
  - 6) Mounting locations for door hardware.
  - 7) List of related door devices specified in other Sections for each door and frame.
2. Keying Schedule: Prepared by or under the supervision of Installer, detailing Owner's final keying instructions for locks. Include schematic keying diagram and index each key set to unique door designations that are coordinated with the Contract Documents.

#### 1.4 INFORMATIONAL SUBMITTALS

- A. Submittals shall comply with the requirements of the Construction Contract Clauses, Section 007213 "General Conditions" and the individual sections specifying the work.
- B. Qualification Data: For Installer and Architectural Hardware Consultant.
- C. Product Test Reports: For compliance with accessibility requirements, based on evaluation of comprehensive tests performed by manufacturer and witnessed by a qualified testing agency, for door hardware on doors located in accessible routes.
- D. Warranty: Special warranty specified in this Section.

#### 1.5 CLOSEOUT SUBMITTALS

- A. Submittals shall comply with the requirements of the Construction Contract Clauses, Section 007213 "General Conditions" and the individual sections specifying the work.
- B. Maintenance Data: For each type of door hardware to include in maintenance manuals. Include final hardware and keying schedule.

#### 1.6 QUALITY ASSURANCE

- A. Installer Qualifications: Supplier of products and an employer of workers trained and approved by product manufacturers and an Architectural Hardware Consultant who is available during the course of the Work to consult with Contractor, Architect, and Owner about door hardware and keying.
  1. Warehousing Facilities: In Project's vicinity.
  2. Scheduling Responsibility: Preparation of door hardware and keying schedules.
- B. Architectural Hardware Consultant Qualifications: A person who is experienced in providing consulting services for door hardware installations that are comparable in material, design, and extent to that indicated for this Project and who is currently certified by DHI as follows:
  1. For door hardware, an Architectural Hardware Consultant (AHC).

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- C. Source Limitations: Obtain each type of door hardware from a single manufacturer.
- D. Means of Egress Doors: Latches do not require more than 15 lbf to release the latch. Locks do not require use of a key, tool, or special knowledge for operation.
- E. Accessibility Requirements: For door hardware on doors in an accessible route, comply with the U.S. Architectural & Transportation Barriers Compliance Board's ADA-ABA Accessibility Guidelines.
  - 1. Provide operating devices that do not require tight grasping, pinching, or twisting of the wrist and that operate with a force of not more than 5 lbf.
  - 2. Comply with the following maximum opening-force requirements:
    - a. Interior, Non-Fire-Rated Hinged Doors: 5 lbf applied perpendicular to door.
  - 3. Bevel raised thresholds with a slope of not more than 1:2. Provide thresholds not more than 1/2 inch high.
  - 4. Adjust door closer sweep periods so that, from an open position of 70 degrees, the door will take at least 3 seconds to move to a point 3 inches from the latch, measured to the leading edge of the door.
- F. Keying Conference: Conduct conference at Project site to comply with requirements in Section 013100 "Project Management and Coordination." In addition to Owner and Contractor, conference participants shall also include Installer's Architectural Hardware Consultant. Incorporate keying conference decisions into final keying schedule after reviewing door hardware keying system including, but not limited to, the following:
  - 1. Function of building, flow of traffic, purpose of each area, degree of security required, and plans for future expansion.
  - 2. Preliminary key system schematic diagram.
  - 3. Requirements for key control system.
  - 4. Requirements for access control.
  - 5. Address for delivery of keys.

1.7 DELIVERY, STORAGE, AND HANDLING

- A. Inventory door hardware on receipt and provide secure lock-up for door hardware delivered to Project site.
- B. Tag each item or package separately with identification coordinated with the final door hardware schedule, and include installation instructions, templates, and necessary fasteners with each item or package.
- C. Deliver keys and permanent cores to Owner by registered mail or overnight package service.

1.8 COORDINATION

- A. Installation Templates: Distribute for doors, frames, and other work specified to be factory prepared. Check Shop Drawings of other work to confirm that adequate provisions are made for locating and installing door hardware to comply with indicated requirements.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1.9 WARRANTY

- A. Special Warranty: Manufacturer's standard form in which manufacturer agrees to repair or replace components of door hardware that fail in materials or workmanship within specified warranty period.
  - 1. Failures include, but are not limited to, the following:
    - a. Structural failures including excessive deflection, cracking, or breakage.
    - b. Faulty operation of doors and door hardware.
    - c. Deterioration of metals, metal finishes, and other materials beyond normal weathering and use.
  - 2. Warranty Period: Three years from date of Substantial Completion, unless otherwise indicated.
    - a. Manual Closers: 10 years from date of Substantial Completion.

1.10 MAINTENANCE SERVICE

- A. Maintenance Tools and Instructions: Furnish a complete set of specialized tools and maintenance instructions for Owner's continued adjustment, maintenance, and removal and replacement of door hardware.
- B. Maintenance Service: Beginning at Substantial Completion, provide six months' full maintenance by skilled employees of door hardware Installer. Include quarterly preventive maintenance, repair or replacement of worn or defective components, lubrication, cleaning, and adjusting as required for proper door and door hardware operation. Provide parts and supplies that are the same as those used in the manufacture and installation of original products.

PART 2 - PRODUCTS

2.1 SCHEDULED DOOR HARDWARE

- A. Provide door hardware for each door as scheduled in Part 3 "Door Hardware Schedule" Article to comply with requirements in this Section.
  - 1. Door Hardware Sets: Provide quantity, item, size, finish or color indicated, and products equivalent in function and comparable in quality to named products and products complying with BHMA designations referenced.
- B. Designations: Requirements for design, grade, function, finish, size, and other distinctive qualities of each type of door hardware are indicated in Part 3 "Door Hardware Schedule" Article. Products are identified by using door hardware designations, as follows:
  - 1. Named Manufacturers' Products: Manufacturer and product designation are listed for each door hardware type required for the purpose of establishing minimum requirements. Manufacturers' names are abbreviated in Part 3 "Door Hardware Schedule" Article.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

2. References to BHMA Designations: Provide reference designations and requirements for description, quality, and function.

## 2.2 HINGES

- A. Hinges: BHMA A156.1. Provide template-produced hinges for hinges installed on hollow-metal doors and hollow-metal frames.
  1. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on schedule or comparable product by one of the following:
    - a. IVES Hardware; an Ingersoll-Rand company.
    - b. McKinney Products Company; an ASSA ABLOY Group company.
    - c. Stanley Commercial Hardware; Div. of The Stanley Works.

## 2.3 MECHANICAL LOCKS AND LATCHES

- A. Lock Functions: As indicated in door hardware schedule.
- B. Lock Throw: Comply with testing requirements for length of bolts required for labeled fire doors, and as follows:
  1. Mortise Locks: Minimum 3/4-inch latchbolt throw.
- C. Lock Backset: 2-3/4 inches, unless otherwise indicated.
- D. Lock Trim:
  1. Levers: Forged or cast.
    - a. Escutcheons (Roses): Forged or cast.
    - b. Operating Device: lever with escutcheons (roses).
- E. Strikes: Provide manufacturer's standard strike for each lock bolt or latchbolt complying with requirements indicated for applicable lock or latch and with strike box and curved lip extended to protect frame; finished to match lock or latch.
  1. Flat-Lip Strikes: For locks with three-piece antifriction latchbolts, as recommended by manufacturer.
- F. Mortise Locks: BHMA A156.13; Security Grade 1; stamped steel case with steel or brass parts; Series 1000.
  1. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on schedule or comparable product by one of the following:
    - a. Schlage; Allegion plc.
    - b. SARGEANT; an ASSA ABLOY Group company.
    - c. Stanley Commercial Hardware; a division of Stanley Security Solutions.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

2.4 LOCK CYLINDERS

- A. Lock Cylinders: Tumbler type, constructed from brass or bronze, stainless steel, or nickel silver.
  - 1. Basis-of-Design Product: Subject to compliance with requirements, provide product to match existing or indicated on schedule or comparable product by one of the following:
    - a. Best Access Systems; Div. of Stanley Security Solutions, Inc.
    - b. Corbin Russwin Architectural Hardware; an ASSA ABLOY Group company.
    - c. Falcon Lock; an Ingersoll-Rand company.
    - d. Medeco Security Locks, Inc.; an ASSA ABLOY Group company.
    - e. SARGENT Manufacturing Company; an ASSA ABLOY Group company.
    - f. Schlage Commercial Lock Division; an Ingersoll-Rand company.
    - g. Yale Security Inc.; an ASSA ABLOY Group company.
- B. Standard (Small Format Interchangeable Core) Lock Cylinders: BHMA A156.5; Grade 1; permanent cores that are interchangeable; face finished to match lockset.
- C. Construction Cores: Provide construction cores that are replaceable by permanent cores. Provide 2 construction master keys.

2.5 KEYING

- A. Keying System: Factory registered, complying with guidelines in BHMA A156.28, Appendix A. Incorporate decisions made in keying conference.
  - 1. Existing System:
    - a. Master key or grand master key locks to Owner's existing system.
- B. Keys: Nickel silver.
  - 1. Stamping: Permanently inscribe each key with a visual key control number and include the following notation:
    - a. Notation: Review stamping information with Owner at keying conference. Information to be furnished by Owner after keying conference.
  - 2. Quantity: In addition to one extra key blank for each lock, provide the following:
    - a. Cylinder Change Keys: Three.
    - b. Master Keys: Five.

2.6 SURFACE CLOSERS

- A. Surface Closers: BHMA A156.4; rack-and-pinion hydraulic type with adjustable sweep and latch speeds controlled by key-operated valves and forged-steel main arm. Comply with manufacturer's written recommendations for size of door closers depending on size of door, exposure to weather, and anticipated frequency of use. Provide factory-sized closers, adjustable to meet field conditions and requirements for opening force.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on schedule or comparable product by one of the following:
  - a. LCN Closers; an Ingersoll-Rand company.
  - b. SARGENT Manufacturing Company; an ASSA ABLOY Group company.
  - c. Stanley Commercial Hardware; a division of Stanley Security Systems.

## 2.7 MECHANICAL STOPS AND HOLDERS

- A. Wall- and Floor-Mounted Stops: BHMA A156.16; polished cast brass, bronze, or aluminum base metal.
  1. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on schedule or comparable product by one of the following:
    - a. Don-Jo Mfg., Inc.
    - b. IVES Hardware; an Ingersoll-Rand company.
    - c. Stanley Commercial Hardware; Div. of The Stanley Works.
    - d. Trimco.

## 2.8 FABRICATION

- A. Manufacturer's Nameplate: Do not provide products that have manufacturer's name or trade name displayed in a visible location except in conjunction with required fire-rated labels and as otherwise approved by Architect.
  1. Manufacturer's identification is permitted on rim of lock cylinders only.
- B. Base Metals: Produce door hardware units of base metal indicated, fabricated by forming method indicated, using manufacturer's standard metal alloy, composition, temper, and hardness. Furnish metals of a quality equal to or greater than that of specified door hardware units and BHMA A156.18.
- C. Fasteners: Provide door hardware manufactured to comply with published templates prepared for machine, wood, and sheet metal screws. Provide screws that comply with commercially recognized industry standards for application intended, except aluminum fasteners are not permitted. Provide Phillips flat-head screws with finished heads to match surface of door hardware, unless otherwise indicated.
  1. Concealed Fasteners: For door hardware units that are exposed when door is closed, except for units already specified with concealed fasteners. Do not use through bolts for installation where bolt head or nut on opposite face is exposed unless it is the only means of securely attaching the door hardware. Where through bolts are used on hollow door and frame construction, provide sleeves for each through bolt.
  2. Spacers or Sex Bolts: For through bolting of hollow-metal doors.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

2.9 FINISHES

- A. Provide finishes complying with BHMA A156.18. Provide uncoated satin stainless steel (630), satin chromium (626 or 652), or satin aluminum (718) finishes.
- B. Protect mechanical finishes on exposed surfaces from damage by applying a strippable, temporary protective covering before shipping.
- C. Appearance of Finished Work: Variations in appearance of abutting or adjacent pieces are acceptable if they are within one-half of the range of approved Samples. Noticeable variations in the same piece are not acceptable. Variations in appearance of other components are acceptable if they are within the range of approved Samples and are assembled or installed to minimize contrast.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine doors and frames, with Installer present, for compliance with requirements for installation tolerances, labeled fire-rated door assembly construction, wall and floor construction, and other conditions affecting performance.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 PREPARATION

- A. Steel Frames: For surface applied door hardware, drill and tap frames according to ANSI/SDI A250.6.
- B. Wood Doors: Comply with DHI WDHS.5 "Recommended Hardware Reinforcement Locations for Mineral Core Wood Flush Doors."

3.3 INSTALLATION

- A. Mounting Heights: Mount door hardware units at heights to comply with the following unless otherwise indicated or required to comply with governing regulations.
  - 1. Standard Steel Frames: ANSI/SDI A250.8.
  - 2. Wood Doors: Comply with DHI WDHS.3 "Recommended Locations for Architectural Hardware for Wood Flush Doors."
- B. Install each door hardware item to comply with manufacturer's written instructions. Where cutting and fitting are required to install door hardware onto or into surfaces that are later to be painted or finished in another way, coordinate removal, storage, and reinstallation of surface protective trim units with finishing. Do not install surface-mounted items until finishes have been completed on substrates involved.



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1. Set units level, plumb, and true to line and location. Adjust and reinforce attachment substrates as necessary for proper installation and operation.
  2. Drill and countersink units that are not factory prepared for anchorage fasteners. Space fasteners and anchors according to industry standards.
- C. Hinges: Install types and in quantities indicated in door hardware schedule but not fewer than the number recommended by manufacturer for application indicated or one hinge for every 30 inches of door height, whichever is more stringent, unless other equivalent means of support for door, such as spring hinges or pivots, are provided.
- D. Lock Cylinders: Install construction cores to secure building and areas during construction period.
1. Replace construction cores with permanent cores as directed by Owner.
- E. Stops: Provide floor stops for doors unless wall or other type stops are indicated in door hardware schedule. Do not mount floor stops where they will impede traffic.

### 3.4 ADJUSTING

- A. Initial Adjustment: Adjust and check each operating item of door hardware and each door to ensure proper operation or function of every unit. Replace units that cannot be adjusted to operate as intended. Adjust door control devices to compensate for final operation of heating and ventilating equipment and to comply with referenced accessibility requirements.
1. Door Closers: Adjust sweep period to comply with accessibility requirements and requirements of authorities having jurisdiction.
- B. Occupancy Adjustment: Approximately three months after date of Substantial Completion, Installer's Architectural Hardware Consultant shall examine and readjust each item of door hardware, including adjusting operating forces, as necessary to ensure function of doors and door hardware.

### 3.5 CLEANING AND PROTECTION

- A. Clean adjacent surfaces soiled by door hardware installation.
- B. Clean operating items as necessary to restore proper function and finish.
- C. Provide final protection and maintain conditions that ensure that door hardware is without damage or deterioration at time of Substantial Completion.

### 3.6 DEMONSTRATION

- A. Engage a factory-authorized service representative to train Owner's maintenance personnel to adjust, operate, and maintain door hardware and door hardware finishes. Refer to Section 017900 "Demonstration and Training."

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
 UNIVERSITY OF SOUTHERN MAINE  
 PORTLAND, MAINE

3.7 DOOR HARDWARE SCHEDULE

| Hardware Set HW-1 (Privacy)   |           |  |
|-------------------------------|-----------|--|
|                               | Hinges    | Existing   |
| 1                             | Lockset   | Schlage; "L-Series, L9040 Privacy Lock (F22)"                          |
| 1                             | Cylinder  | Best; "1E Series Mortise Lock Cylinder (7 pin)"                        |
| 1                             | Closer    | LCN; "4040XP Series (parallel arm)"                                    |
|                               | Door Stop | Existing   |
| Hardware Set HW-2 (Classroom) |           |  |
| 3                             | Hinges    | Stanley; "CB199 Heavy-Weight Concealed Bearing. Satin Stainless Steel" |
| 1                             | Lockset   | Schlage; "L-Series, L9070 Classroom Lock (F05, rose trim)"             |
| 1                             | Closer    | LCN; "4040XP Series (parallel arm)"                                    |
| 1                             | Cylinder  | Best; "1E Series Mortise Lock Cylinder"                                |
| 1                             | Door Stop | Baldwin; "4015 Flush Bumper (wall convex)"                             |

END OF SECTION

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 092216 - NON-STRUCTURAL METAL FRAMING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
  - 1. Non-load-bearing steel framing systems for interior partitions.

1.3 ACTION SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Product Data: For each type of product.

1.4 INFORMATIONAL SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Product Certificates: For each type of code-compliance certification for studs and tracks.
- C. Evaluation Reports: For embossed steel studs and tracks, post-installed anchors and power-actuated fasteners, from ICC-ES or other qualified testing agency acceptable to authorities having jurisdiction.

1.5 QUALITY ASSURANCE

- A. Code-Compliance Certification of Studs and Tracks: Provide documentation that framing members are certified according to the product-certification program of the Steel Framing Industry Association or the Steel Stud Manufacturers Association.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE  
PART 2 - PRODUCTS

2.1 PERFORMANCE REQUIREMENTS

- A. Horizontal Deflection: For wall assemblies, limited to 1/240 of the wall height based on horizontal loading of 5 lbf/sq. ft.

2.2 FRAMING SYSTEMS

- A. Framing Members, General: Comply with ASTM C 754 for conditions indicated.
1. Steel Sheet Components: Comply with ASTM C 645 requirements for metal unless otherwise indicated.
  2. Protective Coating: ASTM A 653/A 653M, G40, hot-dip galvanized unless otherwise indicated.
- B. Studs and Tracks: ASTM C 645. Use either steel studs and tracks or embossed steel studs and tracks.
1. Steel Studs and Tracks:
    - a. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
      - 1) CEMCO; California Expanded Metal Products Co.
      - 2) Custom Stud.
      - 3) MarinoWARE.
      - 4) MBA Building Supplies.
      - 5) MRI Steel Framing, LLC.
      - 6) Phillips Manufacturing Co.
      - 7) SCAFCO Steel Stud Company.
      - 8) Steel Network, Inc. (The).
      - 9) Telling Industries.
    - b. Minimum Base-Metal Thickness: As required by performance requirements for horizontal deflection.
    - c. Depth: As indicated on Drawings.
  2. Embossed Steel Studs and Tracks: Roll-formed and embossed with surface deformations to stiffen the framing members so that they are structurally equivalent to conventional ASTM C 645 steel studs and tracks.
    - a. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
      - 1) CEMCO; California Expanded Metal Products Co.
      - 2) ClarkDietrich Building Systems.
      - 3) MarinoWARE.
      - 4) MBA Building Supplies.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- 5) [Phillips Manufacturing Co.](#)
- 6) [SCAFCO Steel Stud Company.](#)
- 7) [Steel Network, Inc. \(The\).](#)
- 8) [Telling Industries.](#)

- b. Minimum Base-Metal Thickness: As required by horizontal deflection performance requirements.
- c. Depth: As indicated on Drawings.

C. Slip-Type Head Joints: Where indicated, provide one of the following:

1. Single Long-Leg Track System: ASTM C 645 top track with 2-inch- deep flanges in thickness not less than indicated for studs, installed with studs friction fit into top track and with continuous bridging located within 12 inches of the top of studs to provide lateral bracing.
2. Double-Track System: ASTM C 645 top outer tracks, inside track with 2-inch- deep flanges in thickness not less than indicated for studs and fastened to studs, and outer track sized to friction-fit over inner track.
3. Deflection Track: Steel sheet top track manufactured to prevent cracking of finishes applied to interior partition framing resulting from deflection of structure above; in thickness not less than indicated for studs and in width to accommodate depth of studs.

a. [Products](#): Subject to compliance with requirements, provide one of the following:

- 1) [Blazeframe Industries](#); Bare Slotted Track (BST/BST 2).
- 2) [CEMCO; California Expanded Metal Products Co.](#); SLP-TRK Slotted Deflection Track.
- 3) [ClarkDietrich Building Systems](#); MaxTrak Slotted Deflection Track.
- 4) [MBA Building Supplies](#); Slotted Deflecto Track.
- 5) [Metal-Lite](#); The System.
- 6) [Perfect Wall, Inc.](#); The System Slotted Deflection Track.
- 7) [SCAFCO Steel Stud Company](#); SCAFCO Slotted Leg Track System.
- 8) [Steel Network, Inc. \(The\)](#); VertiTrack VTD.
- 9) [Telling Industries](#); Vertical Slip Track II.

D. Flat Strap and Backing Plate: Steel sheet for blocking and bracing in length and width indicated.

1. [Manufacturers](#): Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:

- a. [ClarkDietrich Building Systems.](#)
- b. [MarinoWARE.](#)
- c. [MRI Steel Framing, LLC.](#)
- d. [SCAFCO Steel Stud Company.](#)

2. Minimum Base-Metal Thickness: 0.0296 inch.

E. Cold-Rolled Channel Bridging: Steel, 0.0538-inch minimum base-metal thickness, with minimum 1/2-inch- wide flanges.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1. **Manufacturers:** Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
  - a. [ClarkDietrich Building Systems.](#)
  - b. [MarinoWARE.](#)
  - c. [MRI Steel Framing, LLC.](#)
  - d. [SCAFCO Steel Stud Company.](#)
2. Depth: As indicated on Drawings.
3. Clip Angle: Not less than 1-1/2 by 1-1/2 inches, 0.068-inch- thick, galvanized steel.

### 2.3 AUXILIARY MATERIALS

- A. General: Provide auxiliary materials that comply with referenced installation standards.
  1. Fasteners for Steel Framing: Of type, material, size, corrosion resistance, holding power, and other properties required to fasten steel members to substrates.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine areas and substrates, with Installer present, and including welded hollow-metal frames, cast-in anchors, and structural framing, for compliance with requirements and other conditions affecting performance of the Work.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

### 3.2 INSTALLATION, GENERAL

- A. Installation Standard: ASTM C 754.
  1. Gypsum Board Assemblies: Also comply with requirements in ASTM C 840 that apply to framing installation.
- B. Install framing and accessories plumb, square, and true to line, with connections securely fastened.
- C. Install supplementary framing, and blocking to support fixtures, equipment services, heavy trim, grab bars, toilet accessories, furnishings, or similar construction.
- D. Install bracing at terminations in assemblies.
- E. Do not bridge building control and expansion joints with non-load-bearing steel framing members. Frame both sides of joints independently.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

3.3 INSTALLING FRAMED ASSEMBLIES

- A. Install framing system components according to spacings indicated, but not greater than spacings required by referenced installation standards for assembly types.
  - 1. Single-Layer Application: 16 inches o.c. unless otherwise indicated.
- B. Where studs are installed directly against exterior masonry walls or dissimilar metals at exterior walls, install isolation strip between studs and exterior wall.
- C. Install studs so flanges within framing system point in same direction.
- D. Install tracks at floors and overhead supports. Extend framing full height to structural supports or substrates above suspended ceilings except where partitions are indicated to terminate at suspended ceilings. Continue framing around ducts that penetrate partitions above ceiling.
  - 1. Slip-Type Head Joints: Where framing extends to overhead structural supports, install to produce joints at tops of framing systems that prevent axial loading of finished assemblies.
  - 2. Door Openings: Screw vertical studs at jambs to jamb anchor clips on door frames; install track section (for cripple studs) at head and secure to jamb studs.
    - a. Install two studs at each jamb unless otherwise indicated.
    - b. Extend jamb studs through suspended ceilings and attach to underside of overhead structure.

END OF SECTION





WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 092900 - GYPSUM BOARD

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:

- 1. Interior gypsum board.

- B. Related Requirements:

- 1. Section 092216 "Non-Structural Metal Framing" for non-structural steel framing systems that support gypsum board panels.

1.3 ACTION SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.

- B. Product Data: For each type of product.

- C. Samples: For the following products:

- 1. Trim Accessories: Full-size Sample in 12-inch-long length for each trim accessory indicated.

- D. Samples for Initial Selection: For each type of trim accessory indicated.

1.4 DELIVERY, STORAGE AND HANDLING

- A. Store materials inside under cover and keep them dry and protected against weather, condensation, direct sunlight, construction traffic, and other potential causes of damage. Stack panels flat and supported on risers on a flat platform to prevent sagging.

1.5 FIELD CONDITIONS

- A. Environmental Limitations: Comply with ASTM C 840 requirements or gypsum board manufacturer's written instructions, whichever are more stringent.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- B. Do not install paper-faced gypsum panels until installation areas are enclosed and conditioned.
- C. Do not install panels that are wet, moisture damaged, and mold damaged.
  - 1. Indications that panels are wet or moisture damaged include, but are not limited to, discoloration, sagging, or irregular shape.
  - 2. Indications that panels are mold damaged include, but are not limited to, fuzzy or splotchy surface contamination and discoloration.

PART 2 - PRODUCTS

2.1 GYPSUM BOARD, GENERAL

- A. Size: Provide maximum lengths and widths available that will minimize joints in each area and that correspond with support system indicated.

2.2 INTERIOR GYPSUM BOARD

- A. Gypsum Wallboard: ASTM C 1396/C 1396M.
  - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. American Gypsum.
    - b. CertainTeed Corporation.
    - c. Continental Building Products, LLC.
    - d. Georgia-Pacific Building Products.
    - e. National Gypsum Company.
    - f. PABCO Gypsum.
    - g. Temple-Inland Building Products by Georgia-Pacific.
    - h. USG Corporation.
  - 2. Thickness: 5/8 inch.
  - 3. Long Edges: Tapered for prefilling.
- B. Gypsum Ceiling Board: ASTM C 1396/C 1396M.
  - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. American Gypsum.
    - b. CertainTeed Corporation.
    - c. Continental Building Products, LLC.
    - d. Georgia-Pacific Building Products.
    - e. National Gypsum Company.
    - f. PABCO Gypsum.
    - g. Temple-Inland Building Products by Georgia-Pacific.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

h. USG Corporation.

2. Thickness: 1/2 inch.
3. Long Edges: Tapered.

2.3 TRIM ACCESSORIES

A. Interior Trim: ASTM C 1047.

1. Material: Galvanized or aluminum-coated steel sheet, rolled zinc, plastic, or paper-faced galvanized-steel sheet.
2. Shapes:
  - a. Cornerbead.
  - b. Bullnose bead.
  - c. LC-Bead: J-shaped; exposed long flange receives joint compound.
  - d. L-Bead: L-shaped; exposed long flange receives joint compound.
  - e. U-Bead: J-shaped; exposed short flange does not receive joint compound.
  - f. Expansion (control) joint.
  - g. Curved-Edge Cornerbead: With notched or flexible flanges.

2.4 JOINT TREATMENT MATERIALS

A. General: Comply with ASTM C 475/C 475M.

B. Joint Tape:

1. Interior Gypsum Board: Paper.

C. Joint Compound for Interior Gypsum Board: For each coat, use formulation that is compatible with other compounds applied on previous or for successive coats.

1. Prefilling: At open joints, rounded or beveled panel edges, and damaged surface areas, use setting-type taping compound.
2. Embedding and First Coat: For embedding tape and first coat on joints, fasteners, and trim flanges, use drying-type, all-purpose compound.
  - a. Use setting-type compound for installing paper-faced metal trim accessories.
3. Fill Coat: For second coat, use drying-type, all-purpose compound.
4. Finish Coat: For third coat, use drying-type, all-purpose compound.
5. Skim Coat: For final coat of Level 5 finish, use drying-type, all-purpose compound or high-build interior coating product designed for application by airless sprayer and to be used instead of skim coat to produce Level 5 finish.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

2.5 AUXILIARY MATERIALS

- A. General: Provide auxiliary materials that comply with referenced installation standards and manufacturer's written instructions.
- B. Steel Drill Screws: ASTM C 1002 unless otherwise indicated.
  - 1. Use screws complying with ASTM C 954 for fastening panels to steel members from 0.033 to 0.112 inch thick.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine areas and substrates including welded hollow-metal frames and support framing, with Installer present, for compliance with requirements and other conditions affecting performance of the Work.
- B. Examine panels before installation. Reject panels that are wet, moisture damaged, and mold damaged.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 APPLYING AND FINISHING PANELS, GENERAL

- A. Comply with ASTM C 840.
- B. Install ceiling panels across framing to minimize the number of abutting end joints and to avoid abutting end joints in central area of each ceiling. Stagger abutting end joints of adjacent panels not less than one framing member.
- C. Install panels with face side out. Butt panels together for a light contact at edges and ends with not more than 1/16 inch of open space between panels. Do not force into place.
- D. Locate edge and end joints over supports, except in ceiling applications where intermediate supports or gypsum board back-blocking is provided behind end joints. Do not place tapered edges against cut edges or ends. Stagger vertical joints on opposite sides of partitions. Do not make joints other than control joints at corners of framed openings.
- E. Form control and expansion joints with space between edges of adjoining gypsum panels.
- F. Cover both faces of support framing with gypsum panels in concealed spaces (above ceilings, etc.), except in chases braced internally.
  - 1. Unless concealed application is indicated or required for sound, fire, air, or smoke ratings, coverage may be accomplished with scraps of not less than 8 sq. ft. in area.
  - 2. Fit gypsum panels around ducts, pipes, and conduits.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

3. Where partitions intersect structural members projecting below underside of floor/roof slabs and decks, cut gypsum panels to fit profile formed by structural members; allow 1/4- to 3/8-inch- wide joints to install sealant.
- G. Isolate perimeter of gypsum board applied to non-load-bearing partitions at structural abutments. Provide 1/4- to 1/2-inch- wide spaces at these locations and trim edges with edge trim where edges of panels are exposed. Seal joints between edges and abutting structural surfaces with acoustical sealant.
- H. Attachment to Steel Framing: Attach panels so leading edge or end of each panel is attached to open (unsupported) edges of stud flanges first.

### 3.3 APPLYING INTERIOR GYPSUM BOARD

- A. Install interior gypsum board in the following locations:
  1. Wallboard Type: Vertical surfaces unless otherwise indicated.
  2. Ceiling Type: Ceiling surfaces.
- B. Single-Layer Application:
  1. On ceilings, apply gypsum panels before wall/partition board application to greatest extent possible and at right angles to framing unless otherwise indicated.
  2. On partitions/walls, apply gypsum panels vertically (parallel to framing) unless otherwise indicated or required by fire-resistance-rated assembly, and minimize end joints.
    - a. Stagger abutting end joints not less than one framing member in alternate courses of panels.
  3. Fastening Methods: Apply gypsum panels to supports with steel drill screws.

### 3.4 INSTALLING TRIM ACCESSORIES

- A. General: For trim with back flanges intended for fasteners, attach to framing with same fasteners used for panels. Otherwise, attach trim according to manufacturer's written instructions.
- B. Control Joints: Install control joints at locations indicated on Drawings and according to ASTM C 840 and in specific locations approved by Architect for visual effect.
- C. Interior Trim: Install in the following locations:
  1. Cornerbead: Use at outside corners unless otherwise indicated.
  2. Bullnose Bead: Use where indicated.
  3. LC-Bead: Use at exposed panel edges.
  4. L-Bead: Use where indicated.
  5. U-Bead: Use at exposed panel edges.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

3.5 FINISHING GYPSUM BOARD

- A. General: Treat gypsum board joints, interior angles, edge trim, control joints, penetrations, fastener heads, surface defects, and elsewhere as required to prepare gypsum board surfaces for decoration. Promptly remove residual joint compound from adjacent surfaces.
- B. Prefill open joints, rounded or beveled edges, and damaged surface areas.
- C. Apply joint tape over gypsum board joints, except for trim products specifically indicated as not intended to receive tape.
- D. Gypsum Board Finish Levels: Finish panels to levels indicated below and according to ASTM C 840:
  - 1. Level 1: Ceiling plenum areas, concealed areas, and where indicated.
  - 2. Level 2: Panels that are substrate for tile.
  - 3. Level 4: At panel surfaces that will be exposed to view unless otherwise indicated.
    - a. Primer and its application to surfaces are specified in Section 099123 "Interior Painting."
  - 4. Level 5: Where indicated on Drawings.
    - a. Primer and its application to surfaces are specified in Section 099123 "Interior Painting."

3.6 PROTECTION

- A. Protect adjacent surfaces from drywall compound and promptly remove from floors and other non-drywall surfaces. Repair surfaces stained, marred, or otherwise damaged during drywall application.
- B. Protect installed products from damage from weather, condensation, direct sunlight, construction, and other causes during remainder of the construction period.
- C. Remove and replace panels that are wet, moisture damaged, and mold damaged.
  - 1. Indications that panels are wet or moisture damaged include, but are not limited to, discoloration, sagging, or irregular shape.
  - 2. Indications that panels are mold damaged include, but are not limited to, fuzzy or splotchy surface contamination and discoloration.

END OF SECTION

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 093013 - CERAMIC TILING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

A. Section Includes:

1. Porcelain tile.
2. Glazed wall tile.
3. Stone thresholds.
4. Metal edge strips.

B. Related Requirements:

1. Section 079200 "Joint Sealants" for sealing of expansion, contraction, control, and isolation joints in tile surfaces.
2. Section 092900 "Gypsum Board" for cementitious backer units.

1.3 DEFINITIONS

- A. General: Definitions in the ANSI A108 series of tile installation standards and in ANSI A137.1 apply to Work of this Section unless otherwise specified.
- B. ANSI A108 Series: ANSI A108.01, ANSI A108.02, ANSI A108.1A, ANSI A108.1B, ANSI A108.1C, ANSI A108.4, ANSI A108.5, ANSI A108.6, ANSI A108.8, ANSI A108.9, ANSI A108.10, ANSI A108.11, ANSI A108.12, ANSI A108.13, ANSI A108.14, ANSI A108.15, ANSI A108.16, and ANSI A108.17, which are contained in its "Specifications for Installation of Ceramic Tile."
- C. Module Size: Actual tile size plus joint width indicated.
- D. Face Size: Actual tile size, excluding spacer lugs.

1.4 PREINSTALLATION MEETINGS

- A. Preinstallation Conference: Conduct conference at Project site.
  1. Review requirements in ANSI A108.01 for substrates and for preparation by other trades.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1.5 ACTION SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 “Submittal Procedures” and the individual sections specifying the work.
- B. Product Data: For each type of product.
- C. Shop Drawings: Show locations of each type of tile and tile pattern. Show widths, details, and locations of expansion, contraction, control, and isolation joints in tile substrates and finished tile surfaces.
- D. Samples for Initial Selection: For tile, grout, and accessories involving color selection.

1.6 INFORMATIONAL SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 “Submittal Procedures” and the individual sections specifying the work.
- B. Qualification Data: For Installer.
- C. Master Grade Certificates: For each shipment, type, and composition of tile, signed by tile manufacturer and Installer.
- D. Product Certificates: For each type of product.
- E. Product Test Reports: For tile-setting and -grouting products and certified porcelain tile.

1.7 MAINTENANCE MATERIAL SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 “Submittal Procedures” and the individual sections specifying the work.
- B. Furnish extra materials that match and are from same production runs as products installed and that are packaged with protective covering for storage and identified with labels describing contents.
  - 1. Tile and Trim Units: Furnish quantity of full-size units equal to 1 box for each type, composition, color, pattern, and size indicated.
  - 2. Grout: Furnish quantity of grout equal to 1 box for each type, composition, and color indicated.

1.8 QUALITY ASSURANCE

- A. Installer Qualifications:
  - 1. Installer employs Ceramic Tile Education Foundation Certified Installers or installers recognized by the U.S. Department of Labor as Journeyman Tile Layers.



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1.9 DELIVERY, STORAGE, AND HANDLING

- A. Deliver and store packaged materials in original containers with seals unbroken and labels intact until time of use. Comply with requirements in ANSI A137.1 for labeling tile packages.
- B. Store tile and cementitious materials on elevated platforms, under cover, and in a dry location.
- C. Store aggregates where grading and other required characteristics can be maintained and contamination can be avoided.
- D. Store liquid materials in unopened containers and protected from freezing.

1.10 FIELD CONDITIONS

- A. Environmental Limitations: Do not install tile until construction in spaces is complete and ambient temperature and humidity conditions are maintained at the levels indicated in referenced standards and manufacturer's written instructions.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

- A. Source Limitations for Tile: Obtain tile of each type and color or finish from single source or producer.
  - 1. Obtain tile of each type and color or finish from same production run and of consistent quality in appearance and physical properties for each contiguous area.
- B. Source Limitations for Setting and Grouting Materials: Obtain ingredients of a uniform quality for each mortar, adhesive, and grout component from single manufacturer and each aggregate from single source or producer.
  - 1. Obtain setting and grouting materials, except for unmodified Portland cement and aggregate, from single manufacturer.
  - 2. Obtain waterproof membrane and crack isolation membrane, except for sheet products, from manufacturer of setting and grouting materials.
- C. Source Limitations for Other Products: Obtain each of the following products specified in this Section from a single manufacturer:
  - 1. Stone thresholds.
  - 2. Waterproof membrane.
  - 3. Crack isolation membrane.
  - 4. Cementitious backer units.
  - 5. Metal edge strips.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

2.2 PRODUCTS, GENERAL

- A. ANSI Ceramic Tile Standard: Provide tile that complies with ANSI A137.1 for types, compositions, and other characteristics indicated.
  - 1. Provide tile complying with Standard grade requirements unless otherwise indicated.
- B. ANSI Standards for Tile Installation Materials: Provide materials complying with ANSI A108.02, ANSI standards referenced in other Part 2 articles, ANSI standards referenced by TCNA installation methods specified in tile installation schedules, and other requirements specified.
- C. Factory Blending: For tile exhibiting color variations within ranges, blend tile in factory and package so tile units taken from one package show same range in colors as those taken from other packages and match approved Samples.
- D. Mounting: For factory-mounted tile, provide back- or edge-mounted tile assemblies as standard with manufacturer unless otherwise indicated.

2.3 TILE PRODUCTS

- A. Ceramic Tile Type (CWT-2): Factory-mounted glazed ceramic tile.
  - 1. **Basis-of-Design Product:** Subject to compliance with requirements, provide “Continental Slate,” Daltile, or comparable product by one of the following:
    - a. [American Marazzi Tile, Inc.](#)
    - b. [American Olean; a division of Dal-Tile Corporation.](#)
    - c. [Crossville, Inc.](#)
    - d. [Interceramic.](#)
    - e. [Seneca Tiles, Inc.](#)
  - 2. Composition: Porcelain.
  - 3. Certification: Porcelain tile certified by the Porcelain Tile Certification Agency.
  - 4. Module Size: 4 by 12 inch (decorative border).
  - 5. Thickness: 5/16 inch.
  - 6. Face: Plain with cushion edges.
  - 7. Surface: Smooth, without abrasive admixture.
  - 8. Dynamic Coefficient of Friction: Not less than 0.42.
  - 9. Tile Color and Pattern: As selected by Architect from manufacturer's full range.
  - 10. Grout Color: As selected by Architect from manufacturer's full range.
- B. Ceramic Tile Type (CFT-1): Glazed porcelain tile.
  - 1. **Basis-of-Design Product:** Subject to compliance with requirements, provide “Continental Slate” Daltile, or comparable product by one of the following:
    - a. [American Olean; a division of Dal-Tile Corporation.](#)
    - b. [Crossville, Inc.](#)

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- c. [Florida Tile, Inc.](#)
  - d. [Interceramic.](#)
2. Certification: Tile certified by the Porcelain Tile Certification Agency.
  3. Face Size: 12 by 12 inches.
  4. Face Size Variation: Rectified.
  5. Thickness: 5/16 inch.
  6. Face: Textured with cushion edge.
  7. Dynamic Coefficient of Friction: Not less than 0.42.
  8. Tile Color, Glaze, and Pattern: As selected by Architect from manufacturer's full range.
  9. Grout Color: As selected by Architect from manufacturer's full range.
  10. Trim Units: Coordinated with sizes and coursing of adjoining flat tile where applicable and matching characteristics of adjoining flat tile. Provide shapes as follows, selected from manufacturer's standard shapes:
- C. Ceramic Tile Type (CWT 1): Glazed wall tile.
1. [Basis-of-Design Product:](#) Subject to compliance with requirements, provide "Continental Slate," Daltile, or comparable product by one of the following:
    - a. [American Olean; a division of Dal-Tile Corporation.](#)
    - b. Mosa Tile.
  2. Module Size: 6 by 6 inches.
  3. Face Size Variation: Rectified.
  4. Thickness: 5/16 inch.
  5. Face: Plain with cushion edges.
  6. Finish: Bright, opaque glaze.
  7. Tile Color and Pattern: As selected by Architect from manufacturer's full range, Grade 1-4.
  8. Grout Color: As selected by Architect from manufacturer's full range.
  9. Mounting: Factory, back mounted.
  10. Trim Units: Coordinated with sizes and coursing of adjoining flat tile where applicable and matching characteristics of adjoining flat tile. Provide shapes as follows, selected from manufacturer's standard shapes:
    - a. Wainscot Cap for Thinset Mortar Installations: Surface bullnose, module size 3 by 12 inches.

## 2.4 THRESHOLDS

- A. General: Fabricate to sizes and profiles indicated or required to provide transition between adjacent floor finishes.
1. Bevel edges at 1:2 slope, with lower edge of bevel aligned with or up to 1/16 inch above adjacent floor surface. Finish bevel to match top surface of threshold. Limit height of threshold to 1/2 inch or less above adjacent floor surface.
- B. Granite Thresholds: ASTM C 615/C 615M, with honed finish.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1. Description: Uniform, fine-grained, gray stone without veining.

## 2.5 SETTING MATERIALS

### A. Modified Dry-Set Mortar (Thinset): ANSI A118.4.

1. **Manufacturers:** Subject to compliance with requirements, provide products by one of the following:
  - a. [ARDEX Americas.](#)
  - b. [LATICRETE SUPERCAP, LLC.](#)
  - c. [MAPEI Corporation.](#)
2. Provide prepackaged, dry-mortar mix containing dry, redispersible, vinyl acetate or acrylic additive to which only water must be added at Project site.
3. For wall applications, provide mortar that complies with requirements for nonsagging mortar in addition to the other requirements in ANSI A118.4.
4. Provide prepackaged, dry-mortar mix containing dry, redispersible, vinyl acetate or acrylic additive to which only water must be added at Project site.

### B. Improved Modified Dry-Set Mortar (Thinset): ANSI A118.15.

1. **Manufacturers:** Subject to compliance with requirements, provide products by one of the following:
  - a. [ARDEX Americas.](#)
  - b. [Bonsal American, an Oldcastle company.](#)
  - c. [C-Cure.](#)
  - d. [Custom Building Products.](#)
  - e. [H.B. Fuller Construction Products Inc. / TEC.](#)
  - f. [LATICRETE SUPERCAP, LLC.](#)
  - g. [MAPEI Corporation.](#)
  - h. [Merkrete by Parex USA, Inc.](#)
2. Provide prepackaged, dry-mortar mix containing dry, redispersible, vinyl acetate or acrylic additive to which only water must be added at Project site.
3. For wall applications, provide mortar that complies with requirements for nonsagging mortar in addition to the other requirements in ANSI A118.15.

## 2.6 GROUT MATERIALS

### A. Water-Cleanable Epoxy Grout: ANSI A118.3, with a VOC content of 65 g/L or less.

1. **Basis-of-Design Product:** Subject to compliance with requirements, provide “Kerapoxy CQ,” Mapei Corp., or comparable product by one of the following:
  - a. [Bostik, Inc.](#)
  - b. [C-Cure.](#)

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- c. [Custom Building Products.](#)
- d. [H.B. Fuller Construction Products Inc. / TEC.](#)
- e. [LATICRETE SUPERCAP, LLC.](#)
- f. [Merkrete by Parex USA, Inc.](#)
- g. [Summitville Tiles, Inc.](#)

## 2.7 MISCELLANEOUS MATERIALS

- A. Trowelable Underlayments and Patching Compounds: Latex-modified, portland cement-based formulation provided or approved by manufacturer of tile-setting materials for installations indicated.
- B. Metal Edge Strips: Angle, height to match tile and setting-bed thickness, metallic, designed specifically for flooring applications; stainless-steel, ASTM A 666, 300 Series exposed-edge material.
  - 1. [Basis-of-Design Product:](#) Subject to compliance with requirements, provide “QUADEC,” Schluter Systems, or comparable product by one of the following:
    - a. [Blanke Corporation.](#)
    - b. [Ceramic Tool Company, Inc.](#)
    - c. [Schluter Systems L.P.](#)
- C. Tile Cleaner: A neutral cleaner capable of removing soil and residue without harming tile and grout surfaces, specifically approved for materials and installations indicated by tile and grout manufacturers.

## 2.8 MIXING MORTARS AND GROUT

- A. Mix mortars and grouts to comply with referenced standards and mortar and grout manufacturers' written instructions.
- B. Add materials, water, and additives in accurate proportions.
- C. Obtain and use type of mixing equipment, mixer speeds, mixing containers, mixing time, and other procedures to produce mortars and grouts of uniform quality with optimum performance characteristics for installations indicated.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine substrates, areas, and conditions where tile will be installed, with Installer present, for compliance with requirements for installation tolerances and other conditions affecting performance of the Work.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1. Verify that substrates for setting tile are firm; dry; clean; free of coatings that are incompatible with tile-setting materials, including curing compounds and other substances that contain soap, wax, oil, or silicone; and comply with flatness tolerances required by ANSI A108.01 for installations indicated.
  2. Verify that concrete substrates for tile floors installed with thinset mortar comply with surface finish requirements in ANSI A108.01 for installations indicated.
    - a. Verify that surfaces that received a steel trowel finish have been mechanically scarified.
    - b. Verify that protrusions, bumps, and ridges have been removed by sanding or grinding.
  3. Verify that installation of grounds, anchors, recessed frames, electrical and mechanical units of work, and similar items located in or behind tile has been completed.
  4. Verify that joints and cracks in tile substrates are coordinated with tile joint locations; if not coordinated, adjust joint locations in consultation with Architect.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

### 3.2 PREPARATION

- A. Fill cracks, holes, and depressions in concrete substrates for tile floors installed with thinset mortar with trowelable leveling and patching compound specifically recommended by tile-setting material manufacturer.
- B. Where indicated, prepare substrates to receive waterproofing by applying a reinforced mortar bed that complies with ANSI A108.1A and is sloped 1/4 inch per foot toward drains.
- C. Blending: For tile exhibiting color variations, verify that tile has been factory blended and packaged so tile units taken from one package show same range of colors as those taken from other packages and match approved Samples. If not factory blended, either return to manufacturer or blend tiles at Project site before installing.

### 3.3 CERAMIC TILE INSTALLATION

- A. Comply with TCNA's "Handbook for Ceramic, Glass, and Stone Tile Installation" for TCNA installation methods specified in tile installation schedules. Comply with parts of the ANSI A108 series "Specifications for Installation of Ceramic Tile" that are referenced in TCNA installation methods, specified in tile installation schedules, and apply to types of setting and grouting materials used.
  1. For the following installations, follow procedures in the ANSI A108 series of tile installation standards for providing 95 percent mortar coverage:
    - a. Tile floors in wet areas.
    - b. Tile floors consisting of tiles 8 by 8 inches or larger.
    - c. Tile floors consisting of rib-backed tiles.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- B. Extend tile work into recesses and under or behind equipment and fixtures to form complete covering without interruptions unless otherwise indicated. Terminate work neatly at obstructions, edges, and corners without disrupting pattern or joint alignments.
- C. Accurately form intersections and returns. Perform cutting and drilling of tile without marring visible surfaces. Carefully grind cut edges of tile abutting trim, finish, or built-in items for straight aligned joints. Fit tile closely to electrical outlets, piping, fixtures, and other penetrations so plates, collars, or covers overlap tile.
- D. Provide manufacturer's standard trim shapes where necessary to eliminate exposed tile edges.
- E. Where accent tile differs in thickness from field tile, vary setting-bed thickness so that tiles are flush.
- F. Jointing Pattern: Lay tile in grid pattern unless otherwise indicated. Lay out tile work and center tile fields in both directions in each space or on each wall area. Lay out tile work to minimize the use of pieces that are less than half of a tile. Provide uniform joint widths unless otherwise indicated.
  - 1. For tile mounted in sheets, make joints between tile sheets same width as joints within tile sheets so joints between sheets are not apparent in finished work.
  - 2. Where adjoining tiles on floor, base, walls, or trim are specified or indicated to be same size, align joints.
  - 3. Where tiles are specified or indicated to be whole integer multiples of adjoining tiles on floor, base, walls, or trim, align joints unless otherwise indicated.
- G. Joint Widths: Unless otherwise indicated, install tile with the following joint widths:
  - 1. Glazed Wall Tile: 3/16 inch.
  - 2. Porcelain Tile: 3/16 inch.
- H. Lay out tile wainscots to dimensions indicated or to next full tile beyond dimensions indicated.
- I. Expansion Joints: Provide expansion joints and other sealant-filled joints, including control, contraction, and isolation joints, where indicated. Form joints during installation of setting materials, mortar beds, and tile. Do not saw-cut joints after installing tiles.
  - 1. Where joints occur in concrete substrates, locate joints in tile surfaces directly above them.
- J. Stone Thresholds: Install stone thresholds in same type of setting bed as adjacent floor unless otherwise indicated.
  - 1. Do not extend waterproofing or crack isolation membrane under thresholds set in improved modified dry-set mortar. Fill joints between such thresholds and adjoining tile set on waterproofing or crack isolation membrane with elastomeric sealant.
- K. Metal Edge Strips: Install at locations indicated where exposed edge of tile flooring meets carpet, wood, or other flooring that finishes flush with or below top of tile and no threshold is indicated.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

3.4 ADJUSTING AND CLEANING

- A. Remove and replace tile that is damaged or that does not match adjoining tile. Provide new matching units, installed as specified and in a manner to eliminate evidence of replacement.
- B. Cleaning: On completion of placement and grouting, clean all ceramic tile surfaces so they are free of foreign matter.
  - 1. Remove grout residue from tile as soon as possible.
  - 2. Clean grout smears and haze from tile according to tile and grout manufacturer's written instructions but no sooner than 10 days after installation. Use only cleaners recommended by tile and grout manufacturers and only after determining that cleaners are safe to use by testing on samples of tile and other surfaces to be cleaned. Protect metal surfaces and plumbing fixtures from effects of cleaning. Flush surfaces with clean water before and after cleaning.

3.5 PROTECTION

- A. Protect installed tile work with kraft paper or other heavy covering during construction period to prevent staining, damage, and wear. If recommended by tile manufacturer, apply coat of neutral protective cleaner to completed tile walls and floors.
- B. Prohibit foot and wheel traffic from tiled floors for at least seven days after grouting is completed.
- C. Before final inspection, remove protective coverings and rinse neutral protective cleaner from tile surfaces.

3.6 INTERIOR CERAMIC TILE INSTALLATION SCHEDULE

- A. Concrete Subfloor:
  - 1. Ceramic Tile Installation (CFT-1): TCNA F113; thinset mortar.
    - a. Ceramic Tile Type: CFT-1.
    - b. Thinset Mortar: Modified dry-set mortar.
    - c. Grout: Water-cleanable epoxy grout.
- B. Interior Wall Installations, Wood or Metal Studs or Furring:
  - 1. Ceramic Tile Installation (CWT 1-2): TCNA W243; thinset mortar on gypsum board.
    - a. Ceramic Tile Type: CWT 1-2.
    - b. Thinset Mortar: Modified dry-set mortar.
    - c. Grout: Water-cleanable epoxy grout.

END OF SECTION



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 096513 - RESILIENT BASE AND ACCESSORIES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
  - 1. Thermoset-rubber base.
  - 2. Rubber molding accessories.
- B. Related Sections include the following:
  - 1. Section 096519 "Resilient Tile Flooring" for rubber tile.

1.3 ACTION SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Product Data: For each type of product.
- C. Samples for Initial Selection: For each type of product indicated.

1.4 MAINTENANCE MATERIAL SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Furnish extra materials, from the same product run, that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.
  - 1. Furnish not less than 10 linear feet for every 500 linear feet or fraction thereof, of each type, color, pattern, and size of resilient product installed.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1.5 DELIVERY, STORAGE, AND HANDLING

- A. Store resilient products and installation materials in dry spaces protected from the weather, with ambient temperatures maintained within range recommended by manufacturer, but not less than 50 deg F or more than 90 deg F.

1.6 FIELD CONDITIONS

- A. Maintain ambient temperatures within range recommended by manufacturer, but not less than 70 deg F or more than 95 deg F, in spaces to receive resilient products during the following periods:
  - 1. 48 hours before installation.
  - 2. During installation.
  - 3. 48 hours after installation.
- B. After installation and until Substantial Completion, maintain ambient temperatures within range recommended by manufacturer, but not less than 55 deg F or more than 95 deg F.
- C. Install resilient products after other finishing operations, including painting, have been completed.

PART 2 - PRODUCTS

2.1 THERMOSET-RUBBER BASE

- A. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
  - 1. Burke Mercer Flooring Products; a division of Burke Industries Inc.
  - 2. Flexco.
  - 3. Johnsonite; a Tarkett company.
  - 4. Roppe Corporation, USA.
- B. Product Standard: ASTM F 1861, Type TS (rubber, vulcanized thermoset), Group I (solid, homogeneous).
  - 1. Style and Location:
    - a. Style B, Cove: Provide in areas with resilient floor coverings.
- C. Thickness: 0.125 inch.
- D. Height: 4 inches.
- E. Lengths: Coils in manufacturer's standard length.
- F. Outside Corners: Job formed.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- G. Inside Corners: Job formed.
- H. Colors: As selected by Architect from manufacturer's full range of colors.

## 2.2 RUBBER MOLDING ACCESSORY

- A. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
  - 1. Roppe Corporation, USA.
  - 2. VPI Corporation.
  - 3. Johnsonite.
  - 4. Flexco.
- B. Description: Reducer strip for resilient floor covering and transition strips.
- C. Profile and Dimensions: As indicated.
- D. Locations: Provide rubber molding accessories at junctions of dissimilar floor coverings.
- E. Colors and Patterns: As selected by Architect from manufacturer's full range of colors.

## 2.3 INSTALLATION MATERIALS

- A. Trowelable Leveling and Patching Compounds: Latex-modified, portland-cement-based or blended hydraulic-cement-based formulation provided or approved by resilient-product manufacturer for applications indicated.
- B. Adhesives: Water-resistant type recommended by resilient-product manufacturer for resilient products and substrate conditions indicated.
  - 1. Adhesives shall have a VOC content of 50 g/L or less and 60 g/L or less for rubber stair treads.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine substrates, with Installer present, for compliance with requirements for maximum moisture content and other conditions affecting performance of the Work.
  - 1. Verify that finishes of substrates comply with tolerances and other requirements specified in other Sections and that substrates are free of cracks, ridges, depressions, scale, and foreign deposits that might interfere with adhesion of resilient products.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1. Installation of resilient products indicates acceptance of surfaces and conditions.

### 3.2 PREPARATION

- A. Prepare substrates according to manufacturer's written instructions to ensure adhesion of resilient products.
- B. Fill cracks, holes, and depressions in substrates with trowelable leveling and patching compound; remove bumps and ridges to produce a uniform and smooth substrate.
- C. Do not install resilient products until materials are the same temperature as space where they are to be installed.
  1. At least 48 hours in advance of installation, move resilient products and installation materials into spaces where they will be installed.
- D. Immediately before installation, sweep and vacuum clean substrates to be covered by resilient products.

### 3.3 RESILIENT BASE INSTALLATION

- A. Comply with manufacturer's written instructions for installing resilient base.
- B. Apply resilient base to walls, columns, pilasters, casework and cabinets in toe spaces, and other permanent fixtures in rooms and areas where base is required.
- C. Install resilient base in lengths as long as practical without gaps at seams and with tops of adjacent pieces aligned.
- D. Tightly adhere resilient base to substrate throughout length of each piece, with base in continuous contact with horizontal and vertical substrates.
- E. Do not stretch resilient base during installation.
- F. On masonry surfaces or other similar irregular substrates, fill voids along top edge of resilient base with manufacturer's recommended adhesive filler material.
- G. Job-Formed Corners:
  1. Outside Corners: Use straight pieces of maximum lengths possible and form with returns not less than 6 inches in length.
    - a. Form without producing discoloration (whitening) at bends.
  2. Inside Corners: Use straight pieces of maximum lengths possible and form with returns not less than 6 inches in length.
    - a. Miter corners to minimize open joints.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

3.4 RESILIENT ACCESSORY INSTALLATION

- A. Comply with manufacturer's written instructions for installing resilient accessories.
- B. Resilient Molding Accessories: Butt to adjacent materials and tightly adhere to substrates throughout length of each piece. Install reducer strips at edges of floor covering that would otherwise be exposed.

3.5 CLEANING AND PROTECTION

- A. Comply with manufacturer's written instructions for cleaning and protecting resilient products.
- B. Perform the following operations immediately after completing resilient-product installation:
  - 1. Remove adhesive and other blemishes from surfaces.
  - 2. Sweep and vacuum horizontal surfaces thoroughly.
  - 3. Damp-mop horizontal surfaces to remove marks and soil.
- C. Protect resilient products from mars, marks, indentations, and other damage from construction operations and placement of equipment and fixtures during remainder of construction period.
- D. Cover resilient products subject to wear and foot traffic until Substantial Completion.

END OF SECTION



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 096519 - RESILIENT TILE FLOORING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
  - 1. Vinyl composition floor tile.

1.3 ACTION SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Product Data: For each type of product.

1.4 INFORMATIONAL SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Qualification Data: For Installer.

1.5 CLOSEOUT SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Maintenance Data: For each type of floor tile to include in maintenance manuals.

1.6 MAINTENANCE MATERIAL SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Furnish extra materials, from the same product run, that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1. Floor Tile: Furnish one box for every 50 boxes or fraction thereof, of each type, color, and pattern of floor tile installed.

1.7 QUALITY ASSURANCE

- A. Installer Qualifications: An entity that employs installers and supervisors who are competent in techniques required by manufacturer for floor tile installation and seaming method indicated.
  1. Engage an installer who employs workers for this Project who are trained or certified by floor tile manufacturer for installation techniques required.

1.8 DELIVERY, STORAGE, AND HANDLING

- A. Store floor tile and installation materials in dry spaces protected from the weather, with ambient temperatures maintained within range recommended by manufacturer, but not less than 50 deg F or more than 90 deg F. Store floor tiles on flat surfaces.

1.9 FIELD CONDITIONS

- A. Maintain ambient temperatures within range recommended by manufacturer, but not less than 70 deg F or more than 95 deg F, in spaces to receive floor tile during the following periods:
  1. 48 hours before installation.
  2. During installation.
  3. 48 hours after installation.
- B. After installation and until Substantial Completion, maintain ambient temperatures within range recommended by manufacturer, but not less than 55 deg F or more than 95 deg F.
- C. Close spaces to traffic during floor tile installation.
- D. Close spaces to traffic for 48 hours after floor tile installation.
- E. Install floor tile after other finishing operations, including painting, have been completed.

PART 2 - PRODUCTS

2.1 PERFORMANCE REQUIREMENTS

- A. Fire-Test-Response Characteristics: For resilient floor tile, as determined by testing identical products according to ASTM E 648 or NFPA 253 by a qualified testing agency.
  1. Critical Radiant Flux Classification: Class I, not less than 0.45 W/sq. cm.



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

2.2 VINYL COMPOSITION FLOOR TILE (VCT)

- A. **Basis-of-Design Product:** Subject to compliance with requirements, provide “Standard Excelon Imperial Texture,” Armstrong World Industries, or comparable product by one of the following:
  - 1. Johnsonite; a Tarkett Company.
  - 2. Mannington Mills, Inc.
- B. Tile Standard: ASTM F 1066, Class 2, through patterned.
- C. Wearing Surface: Smooth.
- D. Thickness: 0.125 inch.
- E. Size: 12 by 12 inches.
- F. Colors and Patterns: As selected by Architect from full range of colors.

2.3 INSTALLATION MATERIALS

- A. Trowelable Leveling and Patching Compounds: Latex-modified, portland-cement-based or blended hydraulic-cement-based formulation provided or approved by floor tile manufacturer for applications indicated.
- B. Adhesives: Water-resistant type recommended by floor tile and adhesive manufacturers to suit floor tile and substrate conditions indicated.
  - 1. Adhesives shall have a VOC content of 50 g/L or less.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine substrates, with Installer present, for compliance with requirements for maximum moisture content and other conditions affecting performance of the Work.
  - 1. Verify that finishes of substrates comply with tolerances and other requirements specified in other Sections and that substrates are free of cracks, ridges, depressions, scale, and foreign deposits that might interfere with adhesion of floor tile.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 PREPARATION

- A. Prepare substrates according to floor tile manufacturer's written instructions to ensure adhesion of resilient products.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- B. Concrete Substrates: Prepare according to ASTM F 710.
  - 1. Verify that substrates are dry and free of curing compounds, sealers, and hardeners.
  - 2. Remove substrate coatings and other substances that are incompatible with adhesives and that contain soap, wax, oil, or silicone, using mechanical methods recommended by floor tile manufacturer. Do not use solvents.
  - 3. Alkalinity and Adhesion Testing: Perform tests recommended by floor tile manufacturer. Proceed with installation only after substrate alkalinity falls within range on pH scale recommended by manufacturer in writing, but not less than 5 or more than 10 pH.
  - 4. Moisture Testing: Perform tests so that each test area does not exceed 1000 sq. ft., and perform no fewer than three tests in each installation area and with test areas evenly spaced in installation areas.
    - a. Anhydrous Calcium Chloride Test: ASTM F 1869. Proceed with installation only after substrates have maximum moisture-vapor-emission rate of 3 lb of water/1000 sq. ft. in 24 hours.
    - b. Relative Humidity Test: Using in-situ probes, ASTM F 2170. Proceed with installation only after substrates have a maximum 75 percent relative humidity level measurement.
- C. Fill cracks, holes, and depressions in substrates with trowelable leveling and patching compound; remove bumps and ridges to produce a uniform and smooth substrate.
- D. Do not install floor tiles until materials are the same temperature as space where they are to be installed.
  - 1. At least 48 hours in advance of installation, move resilient floor tile and installation materials into spaces where they will be installed.
- E. Immediately before installation, sweep and vacuum clean substrates to be covered by resilient floor tile.

### 3.3 FLOOR TILE INSTALLATION

- A. Comply with manufacturer's written instructions for installing floor tile.
- B. Lay out floor tiles from center marks established with principal walls, discounting minor offsets, so tiles at opposite edges of room are of equal width. Adjust as necessary to avoid using cut widths that equal less than one-half tile at perimeter.
  - 1. Lay tiles square with room axis.
- C. Match floor tiles for color and pattern by selecting tiles from cartons in the same sequence as manufactured and packaged, if so numbered. Discard broken, cracked, chipped, or deformed tiles.
  - 1. Lay tiles with directional arrows pointing in the same direction.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- D. Scribe, cut, and fit floor tiles to butt neatly and tightly to vertical surfaces and permanent fixtures including built-in furniture, cabinets, pipes, outlets, and door frames.
- E. Extend floor tiles into toe spaces, door reveals, closets, and similar openings. Extend floor tiles to center of door openings.
- F. Maintain reference markers, holes, and openings that are in place or marked for future cutting by repeating on floor tiles as marked on substrates. Use chalk or other nonpermanent marking device.
- G. Install floor tiles on covers for telephone and electrical ducts, building expansion-joint covers, and similar items in installation areas. Maintain overall continuity of color and pattern between pieces of tile installed on covers and adjoining tiles. Tightly adhere tile edges to substrates that abut covers and to cover perimeters.
- H. Adhere floor tiles to substrates using a full spread of adhesive applied to substrate to produce a completed installation without open cracks, voids, raising and puckering at joints, telegraphing of adhesive spreader marks, and other surface imperfections.

3.4 CLEANING AND PROTECTION

- A. Comply with manufacturer's written instructions for cleaning and protecting floor tile.
- B. Perform the following operations immediately after completing floor tile installation:
  - 1. Remove adhesive and other blemishes from surfaces.
  - 2. Sweep and vacuum surfaces thoroughly.
  - 3. Damp-mop surfaces to remove marks and soil.
- C. Protect floor tile from mars, marks, indentations, and other damage from construction operations and placement of equipment and fixtures during remainder of construction period.
- D. Cover floor tile until Substantial Completion.

END OF SECTION



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 099123 - INTERIOR PAINTING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes surface preparation and the application of paint systems on the following interior substrates:
  - 1. Concrete masonry units (CMUs).
  - 2. Steel and iron.
  - 3. Gypsum board.

1.3 DEFINITIONS

- A. MPI Gloss Level 1: Not more than five units at 60 degrees and 10 units at 85 degrees, according to ASTM D 523.
- B. MPI Gloss Level 2: Not more than 10 units at 60 degrees and 10 to 35 units at 85 degrees, according to ASTM D 523.
- C. MPI Gloss Level 3: 10 to 25 units at 60 degrees and 10 to 35 units at 85 degrees, according to ASTM D 523.
- D. MPI Gloss Level 4: 20 to 35 units at 60 degrees and not less than 35 units at 85 degrees, according to ASTM D 523.
- E. MPI Gloss Level 5: 35 to 70 units at 60 degrees, according to ASTM D 523.
- F. MPI Gloss Level 6: 70 to 85 units at 60 degrees, according to ASTM D 523.
- G. MPI Gloss Level 7: More than 85 units at 60 degrees, according to ASTM D 523.

1.4 ACTION SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Product Data: For each type of product. Include preparation requirements and application instructions.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1. Include Printout of current "MPI Approved Products List" for each product category specified, with the proposed product highlighted.
2. Indicate VOC content.

C. Samples for Initial Selection: For each type of topcoat product.

D. Product List: Cross-reference to paint system and locations of application areas. Use same designations indicated on Drawings and in schedules. Include color designations.

#### 1.5 DELIVERY, STORAGE, AND HANDLING

A. Store materials not in use in tightly covered containers in well-ventilated areas with ambient temperatures continuously maintained at not less than 45 deg F.

1. Maintain containers in clean condition, free of foreign materials and residue.
2. Remove rags and waste from storage areas daily.

#### 1.6 FIELD CONDITIONS

A. Apply paints only when temperature of surfaces to be painted and ambient air temperatures are between 50 and 95 deg F.

B. Do not apply paints when relative humidity exceeds 85 percent; at temperatures less than 5 deg F above the dew point; or to damp or wet surfaces.

### PART 2 - PRODUCTS

#### 2.1 MANUFACTURERS

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

1. Benjamin Moore & Co.
2. California Paints.
3. Diamond Vogel Paints.
4. Dulux (formerly ICI Paints); a brand of AkzoNobel.
5. Dunn-Edwards Corporation.
6. Glidden Professional.
7. Kelly-Moore Paint Company Inc.
8. PPG Architectural Coatings.
9. Pratt & Lambert.
10. Rust-Oleum Corporation; a subsidiary of RPM International, Inc.
11. Sherwin-Williams Company (The).
12. Zinsser; Rust-Oleum Corporation.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- B. Products: Subject to compliance with requirements, provide product listed in the Interior Painting Schedule for the paint category indicated.

## 2.2 PAINT, GENERAL

- A. MPI Standards: Products shall comply with MPI standards indicated and shall be listed in its "MPI Approved Products Lists."
- B. Material Compatibility:
  - 1. Materials for use within each paint system shall be compatible with one another and substrates indicated, under conditions of service and application as demonstrated by manufacturer, based on testing and field experience.
  - 2. For each coat in a paint system, products shall be recommended in writing by topcoat manufacturers for use in paint system and on substrate indicated.
- C. **VOC Content:** For field applications that are inside the weatherproofing system, paints and coatings shall comply with VOC content limits of authorities having jurisdiction and the following VOC content limits:
  - 1. Flat Paints and Coatings: 50 g/L.
  - 2. Nonflat Paints and Coatings: 150 g/L.
  - 3. Dry-Fog Coatings: 400 g/L.
  - 4. Primers, Sealers, and Undercoaters: 200 g/L.
  - 5. Anticorrosive and Antirust Paints Applied to Ferrous Metals: 250 g/L.
  - 6. Zinc-Rich Industrial Maintenance Primers: 340 g/L.
  - 7. Pretreatment Wash Primers: 420 g/L.
  - 8. Shellacs, Clear: 730 g/L.
  - 9. Shellacs, Pigmented: 550 g/L.
- D. Low-Emitting Materials: Interior paints and coatings shall comply with the testing and product requirements of the California Department of Public Health's "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers."
- E. Colors: As selected by Architect from manufacturer's full range.

## 2.3 SOURCE QUALITY CONTROL

- A. Testing of Paint Materials: Owner reserves the right to invoke the following procedure:
  - 1. Owner may engage the services of a qualified testing agency to sample paint materials. Contractor will be notified in advance and may be present when samples are taken. If paint materials have already been delivered to Project site, samples may be taken at Project site. Samples will be identified, sealed, and certified by testing agency.
  - 2. Testing agency will perform tests for compliance with product requirements.
  - 3. Owner may direct Contractor to stop applying paints if test results show materials being used do not comply with product requirements. Contractor shall remove noncomplying

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

paint materials from Project site, pay for testing, and repaint surfaces painted with rejected materials. Contractor will be required to remove rejected materials from previously painted surfaces if, on repainting with complying materials, the two paints are incompatible.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine substrates and conditions, with Applicator present, for compliance with requirements for maximum moisture content and other conditions affecting performance of the Work.
- B. Maximum Moisture Content of Substrates: When measured with an electronic moisture meter as follows:
  - 1. Masonry (Clay and CMUs): 12 percent.
  - 2. Gypsum Board: 12 percent.
- C. Gypsum Board Substrates: Verify that finishing compound is sanded smooth.
- D. Verify suitability of substrates, including surface conditions and compatibility, with existing finishes and primers.
- E. Proceed with coating application only after unsatisfactory conditions have been corrected.
  - 1. Application of coating indicates acceptance of surfaces and conditions.

3.2 PREPARATION

- A. Comply with manufacturer's written instructions and recommendations in "MPI Architectural Painting Specification Manual" applicable to substrates and paint systems indicated.
- B. Remove hardware, covers, plates, and similar items already in place that are removable and are not to be painted. If removal is impractical or impossible because of size or weight of item, provide surface-applied protection before surface preparation and painting.
  - 1. After completing painting operations, use workers skilled in the trades involved to reinstall items that were removed. Remove surface-applied protection if any.
- C. Clean substrates of substances that could impair bond of paints, including dust, dirt, oil, grease, and incompatible paints and encapsulants.
  - 1. Remove incompatible primers and reprime substrate with compatible primers or apply tie coat as required to produce paint systems indicated.
- D. Masonry Substrates: Remove efflorescence and chalk. Do not paint surfaces if moisture content or alkalinity of surfaces or mortar joints exceeds that permitted in manufacturer's written instructions.



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- E. Steel Substrates: Remove rust, loose mill scale, and shop primer, if any. Clean using methods recommended in writing by paint manufacturer but not less than the following:
  - 1. SSPC-SP 2.
  - 2. SSPC-SP 3.
- F. Shop-Primed Steel Substrates: Clean field welds, bolted connections, and areas where shop paint is abraded. Paint exposed areas with the same material as used for shop priming to comply with SSPC-PA 1 for touching up shop-primed surfaces.

### 3.3 APPLICATION

- A. Apply paints according to manufacturer's written instructions and to recommendations in "MPI Manual."
  - 1. Use applicators and techniques suited for paint and substrate indicated.
  - 2. Paint surfaces behind movable equipment and furniture same as similar exposed surfaces. Before final installation, paint surfaces behind permanently fixed equipment or furniture with prime coat only.
  - 3. Paint front and backsides of access panels, removable or hinged covers, and similar hinged items to match exposed surfaces.
  - 4. Do not paint over labels of independent testing agencies or equipment name, identification, performance rating, or nomenclature plates.
  - 5. Primers specified in painting schedules may be omitted on items that are factory primed or factory finished if acceptable to topcoat manufacturers.
- B. If undercoats or other conditions show through topcoat, apply additional coats until cured film has a uniform paint finish, color, and appearance.
- C. Apply paints to produce surface films without cloudiness, spotting, holidays, laps, brush marks, roller tracking, runs, sags, ropiness, or other surface imperfections. Cut in sharp lines and color breaks.
- D. Painting Fire Suppression, Plumbing, HVAC, Electrical, Communication, and Electronic Safety and Security Work:
  - 1. Paint the following work where exposed in occupied spaces:
    - a. Equipment, including panelboards.
    - b. Uninsulated metal piping.
    - c. Uninsulated plastic piping.
    - d. Pipe hangers and supports.
    - e. Metal conduit.
    - f. Plastic conduit.
    - g. Duct, equipment, and pipe insulation having covering paintable jacket material.
    - h. Other items as directed by Architect.
  - 2. Paint portions of internal surfaces of metal ducts, without liner, behind air inlets and outlets that are visible from occupied spaces.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

3.4 FIELD QUALITY CONTROL

- A. Dry Film Thickness Testing: Owner may engage the services of a qualified testing and inspecting agency to inspect and test paint for dry film thickness.
  - 1. Contractor shall touch up and restore painted surfaces damaged by testing.
  - 2. If test results show that dry film thickness of applied paint does not comply with paint manufacturer's written recommendations, Contractor shall pay for testing and apply additional coats as needed to provide dry film thickness that complies with paint manufacturer's written recommendations.

3.5 CLEANING AND PROTECTION

- A. At end of each workday, remove rubbish, empty cans, rags, and other discarded materials from Project site.
- B. After completing paint application, clean spattered surfaces. Remove spattered paints by washing, scraping, or other methods. Do not scratch or damage adjacent finished surfaces.
- C. Protect work of other trades against damage from paint application. Correct damage to work of other trades by cleaning, repairing, replacing, and refinishing, as approved by Architect, and leave in an undamaged condition.
- D. At completion of construction activities of other trades, touch up and restore damaged or defaced painted surfaces.

3.6 INTERIOR PAINTING SCHEDULE

- A. CMU Substrates:
  - 1. Institutional Low-Odor/VOC Latex System MPI INT 4.2E:
    - a. Block Filler: Block filler, latex, interior/exterior, MPI #4.
    - b. Intermediate Coat: Latex, interior, institutional low odor/VOC, matching topcoat.
    - c. Topcoat: Latex, interior, institutional low odor/VOC (MPI Gloss Level 3) eggshell, MPI #145.
    - d. Topcoat: Latex, interior, institutional low odor/VOC, semi-gloss (MPI Gloss Level 5), MPI #147.
- B. Steel Substrates:
  - 1. Institutional Low-Odor/VOC Latex System MPI INT 5.1S:
    - a. Prime Coat: Primer, rust inhibitive, water based MPI #107.
    - b. Topcoat: Latex, interior, institutional low odor/VOC, semi-gloss (MPI Gloss Level 5), MPI #147.
- C. Gypsum Board Substrates:

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1. Institutional Low-Odor/VOC Latex System MPI INT 9.2M:
  - a. Prime Coat: Primer sealer, interior, institutional low odor/VOC, MPI #149.
  - b. Intermediate Coat: Latex, interior, institutional low odor/VOC, matching topcoat.
  - c. Topcoat: Latex, interior, institutional low odor/VOC (MPI Gloss Level 3) eggshell, MPI #145.

END OF SECTION



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 102800 - TOILET, BATH, AND LAUNDRY ACCESSORIES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

A. Section Includes:

- 1. Public-use washroom accessories.
- 2. Underlavatory guards.

B. Related Requirements:

- 1. Section 093013 "Ceramic Tiling" for ceramic toilet and bath accessories.

1.3 COORDINATION

- A. Coordinate accessory locations with other work to prevent interference with clearances required for access by people with disabilities, and for proper installation, adjustment, operation, cleaning, and servicing of accessories.
- B. Deliver inserts and anchoring devices set into concrete or masonry as required to prevent delaying the Work.

1.4 ACTION SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Product Data: For each type of product.
  - 1. Include construction details, material descriptions, dimensions of individual components and profiles, and finishes.
  - 2. Include anchoring and mounting requirements, including requirements for cutouts in other work and substrate preparation.
  - 3. Include electrical characteristics.
- C. Product Schedule: Indicating types, quantities, sizes, and installation locations by room of each accessory required.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1. Identify locations using room designations indicated.
2. Identify accessories using designations indicated.

1.5 INFORMATIONAL SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Sample Warranty: For manufacturer's special warranty.

1.6 CLOSEOUT SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Maintenance Data: For accessories to include in maintenance manuals.

1.7 WARRANTY

- A. Manufacturer's Special Warranty for Mirrors: Manufacturer agrees to repair or replace mirrors that fail in materials or workmanship within specified warranty period.
  1. Failures include, but are not limited to, visible silver spoilage defects.
  2. Warranty Period: 15 years from date of Substantial Completion.

PART 2 - PRODUCTS

2.1 OWNER-FURNISHED MATERIALS

- A. Owner-Furnished Materials:
  1. Paper towel dispensers.
  2. Toilet paper dispensers.
  3. Liquid soap dispensers.

2.2 PERFORMANCE REQUIREMENTS

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.

2.3 PUBLIC-USE WASHROOM ACCESSORIES

- A. Source Limitations: Obtain public-use washroom accessories from single source from single manufacturer.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

B. Grab Bar:

1. Basis-of-Design Product: Subject to compliance with requirements, provide “B-6206,” Bobrick Washroom Equipment, Inc., or comparable product by one of the following:
  - a. AJW Architectural Products.
  - b. American Specialties, Inc.
  - c. Bradley Corporation.
  - d. Brey-Krause Manufacturing Co.
  - e. GAMCO Specialty Accessories; a division of Bobrick.
  - f. Tubular Specialties Manufacturing, Inc.
2. Mounting: Flanges with concealed fasteners.
3. Material: Stainless steel, 0.05 inch thick.
  - a. Finish: Smooth, No. 4 finish (satin).
4. Outside Diameter: 1-1/2 inches.
5. Configuration and Length: As indicated on Drawings.

C. Mirror Unit:

1. Basis-of-Design Product: Subject to compliance with requirements, provide “B-290 1836,” Bobrick Washroom Equipment, Inc., or comparable product by one of the following:
  - a. AJW Architectural Products.
  - b. American Specialties, Inc.
  - c. Bradley Corporation.
  - d. Brey-Krause Manufacturing Co.
  - e. GAMCO Specialty Accessories; a division of Bobrick.
  - f. Tubular Specialties Manufacturing, Inc.
2. Frame: Stainless-steel angle, 0.05 inch thick.
  - a. Corners: Mitered and mechanically interlocked.
3. Hangers: Produce rigid, tamper- and theft-resistant installation, using method indicated below.
  - a. One-piece, galvanized-steel, wall-hanger device with spring-action locking mechanism to hold mirror unit in position with no exposed screws or bolts.
  - b. Wall bracket of galvanized steel, equipped with concealed locking devices requiring a special tool to remove.
4. Size: As indicated on Drawings.

D. Coat Hook:

1. Basis-of-Design Product: Subject to compliance with requirements, provide “B-211,” Bobrick Washroom Equipment, Inc., or comparable product by one of the following:

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- a. [AJW Architectural Products.](#)
  - b. [American Specialties, Inc.](#)
  - c. [Bradley Corporation.](#)
  - d. [Brey-Krause Manufacturing Co.](#)
  - e. [GAMCO Specialty Accessories; a division of Bobrick.](#)
  - f. [Tubular Specialties Manufacturing, Inc.](#)
2. Description: Double-prong unit.
  3. Material and Finish: Stainless steel, No. 4 finish (satin).
- E. Towel Bar:
1. [Basis-of-Design Product:](#) Subject to compliance with requirements, provide “B-673 x 18” Bobrick Washroom Equipment, Inc., or comparable product by one of the following:
    - a. [American Specialties, Inc.](#)
    - b. [Basco, Inc.](#)
    - c. [GAMCO Specialty Accessories; a division of Bobrick.](#)
    - d. [Tubular Specialties Manufacturing, Inc.](#)
  2. Description: 3/4-inch square tube with rectangular end brackets.
  3. Mounting: Flanges with concealed fasteners.
  4. Length: 18 inches.
  5. Material and Finish: Stainless steel, No. 4 finish (satin).

## 2.4 UNDERLAVATORY GUARDS

- A. Underlavatory Guard:
1. [Manufacturers:](#) Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
    - a. [Plumberex Specialty Products, Inc.](#)
    - b. [Truebro by IPS Corporation.](#)
  2. Description: Insulating pipe covering for supply and drain piping assemblies that prevents direct contact with and burns from piping; allow service access without removing coverings.
  3. Material and Finish: Antimicrobial, molded plastic, white.

## 2.5 MATERIALS

- A. Stainless Steel: ASTM A 666, Type 304, 0.031-inch minimum nominal thickness unless otherwise indicated.
- B. Steel Sheet: ASTM A 1008/A 1008M, Designation CS (cold rolled, commercial steel), 0.036-inch minimum nominal thickness.



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- C. Galvanized-Steel Sheet: ASTM A 653/A 653M, with G60 hot-dip zinc coating.
- D. Galvanized-Steel Mounting Devices: ASTM A 153/A 153M, hot-dip galvanized after fabrication.
- E. Fasteners: Screws, bolts, and other devices of same material as accessory unit and tamper-and-theft resistant where exposed, and of galvanized steel where concealed.
- F. Chrome Plating: ASTM B 456, Service Condition Number SC 2 (moderate service).
- G. Mirrors: ASTM C 1503, Mirror Glazing Quality, clear-glass mirrors, nominal 6.0 mm thick.

## 2.6 FABRICATION

- A. General: Fabricate units with tight seams and joints, and exposed edges rolled. Equip units for concealed anchorage and with corrosion-resistant backing plates.

## PART 3 - EXECUTION

### 3.1 INSTALLATION

- A. Install accessories according to manufacturers' written instructions, using fasteners appropriate to substrate indicated and recommended by unit manufacturer. Install units level, plumb, and firmly anchored in locations and at heights indicated.
- B. Grab Bars: Install to withstand a downward load of at least 250 lbf, when tested according to ASTM F 446.

### 3.2 ADJUSTING AND CLEANING

- A. Adjust accessories for unencumbered, smooth operation. Replace damaged or defective items.
- B. Remove temporary labels and protective coatings.
- C. Clean and polish exposed surfaces according to manufacturer's written instructions.

END OF SECTION



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 220517 - SLEEVES AND SLEEVE SEALS FOR PLUMBING PIPING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
  - 1. Sleeves.
  - 2. Sleeve-seal systems.
  - 3. Grout.

1.3 ACTION SUBMITTALS

- A. Submittals shall comply with the requirements of the Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Product Data: For each type of product indicated. On data submittal sheets where more than one product is described, clearly annotate which product(s) is to be supplied.

PART 2 - PRODUCTS

2.1 SLEEVES

- A. Cast-Iron Wall Pipes: Cast or fabricated of cast or ductile iron and equivalent to ductile-iron pressure pipe, with plain ends and integral waterstop unless otherwise indicated.
- B. Galvanized-Steel-Pipe Sleeves: ASTM A 53/A 53M, Type E, Grade B, Schedule 40, zinc coated, with plain ends.
- C. Galvanized-Steel-Sheet Sleeves: 0.0239-inch minimum thickness; round tube closed with welded longitudinal joint.

2.2 SLEEVE-SEAL SYSTEMS

- A. Description: Modular sealing-element unit, designed for field assembly, for filling annular space between piping and sleeve.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1. Sealing Elements: EPDM-rubber or NBR interlocking links shaped to fit surface of pipe. Include type and number required for pipe material and size of pipe.
2. Pressure Plates: Carbon steel or stainless steel.
3. Connecting Bolts and Nuts: Stainless steel of length required to secure pressure plates to sealing elements.

2.3 GROUT

- A. Standard: ASTM C 1107/C 1107M, Grade B, post-hardening and volume-adjusting, dry, hydraulic-cement grout.
- B. Characteristics: Nonshrink; recommended for interior and exterior applications.
- C. Design Mix: 5000-psi, 28-day compressive strength.
- D. Packaging: Premixed and factory packaged.

PART 3 - EXECUTION

3.1 SLEEVE INSTALLATION

- A. Install sleeves for piping passing through penetrations in floors, partitions, roofs, and walls.
- B. For sleeves that will have sleeve-seal system installed, select sleeves of size large enough to provide 1-inch annular clear space between piping and concrete slabs and walls.
  1. Sleeves are not required for core-drilled holes through walls.
- C. Install sleeves in concrete floors, concrete roof slabs, and concrete walls as new slabs and walls are constructed.
  1. Cut sleeves to length for mounting flush with both surfaces.
    - a. Exception: Extend sleeves installed in floors of mechanical equipment areas or other wet areas 4 inches above finished floor level.
  2. Using grout, seal the space outside of sleeves in slabs and walls.
- D. Install sleeves for pipes passing through interior partitions.
  1. Cut sleeves to length for mounting flush with both surfaces.
  2. Install sleeves that are large enough to provide 1/4-inch annular clear space between sleeve and pipe or pipe insulation.
  3. Seal annular space between sleeve and piping or piping insulation; use joint sealants appropriate for size, depth, and location of joint. Comply with requirements for sealants specified in Section 079200 "Joint Sealants."

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- E. Fire-Barrier Penetrations: Maintain indicated fire rating of walls, partitions, ceilings, and floors at pipe penetrations. Seal pipe penetrations with firestop materials. Comply with requirements for firestopping specified in Section 078413 "Penetration Firestopping."

3.2 SLEEVE-SEAL-SYSTEM INSTALLATION

- A. Install sleeve-seal systems in sleeves in exterior concrete walls and slabs-on-grade at service piping entries into building.
- B. Select type, size, and number of sealing elements required for piping material and size and for sleeve ID or hole size. Position piping in center of sleeve. Center piping in penetration, assemble sleeve-seal system components, and install in annular space between piping and sleeve. Tighten bolts against pressure plates that cause sealing elements to expand and make a watertight seal.

3.3 SLEEVE AND SLEEVE-SEAL SCHEDULE

- A. Use sleeves and sleeve seals for the following piping-penetration applications:
  - 1. Exterior Concrete Walls above Grade:
    - a. Galvanized-steel-pipe sleeves.
  - 2. Exterior Concrete Walls below Grade:
    - a. Cast-iron wall sleeves with sleeve-seal system or Galvanized-steel-pipe sleeves with sleeve-seal system.
      - 1) Select sleeve size to allow for 1-inch annular clear space between piping and sleeve for installing sleeve-seal system.
  - 3. Concrete Slabs-on-Grade:
    - a. Galvanized-steel-pipe sleeves with sleeve-seal system.
      - 1) Select sleeve size to allow for 1-inch annular clear space between piping and sleeve for installing sleeve-seal system.
  - 4. Concrete Slabs above Grade:
    - a. Galvanized-steel-pipe sleeves.
  - 5. Interior Partitions:
    - a. Piping Smaller than NPS 6: Galvanized-steel-pipe sleeves.
    - b. Piping NPS 6 and Larger: Galvanized-steel-sheet sleeves.

END OF SECTION



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 220518 - ESCUTCHEONS FOR PLUMBING PIPING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
  - 1. Escutcheons.
  - 2. Floor plates.

1.3 ACTION SUBMITTALS

- A. Submittals shall comply with the requirements of the Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Product Data: For each type of product indicated. On data submittal sheets where more than one product is described, clearly annotate which product(s) is to be supplied.

PART 2 - PRODUCTS

2.1 ESCUTCHEONS

- A. One-Piece, Cast-Brass Type: With polished, chrome-plated and rough-brass finish and setscrew fastener.
- B. One-Piece, Deep-Pattern Type: Deep-drawn, box-shaped brass with chrome-plated finish and spring-clip fasteners.

2.2 FLOOR PLATES

- A. One-Piece Floor Plates: Cast-iron flange with holes for fasteners.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install escutcheons for piping penetrations of walls, ceilings, and finished floors.
- B. Install escutcheons with ID to closely fit around pipe, tube, and insulation of insulated piping and with OD that completely covers opening.
  - 1. Escutcheons for New Piping:
    - a. Piping with Fitting or Sleeve Protruding from Wall: One-piece, deep-pattern type.
    - b. Chrome-Plated Piping: One-piece, cast-brass type with polished, chrome-plated finish.
    - c. Bare Piping at Wall and Floor Penetrations in Finished Spaces: One-piece, cast-brass type with polished, chrome-plated finish.
    - d. Bare Piping at Ceiling Penetrations in Finished Spaces: One-piece, cast-brass type with polished, chrome-plated finish.
    - e. Bare Piping in Unfinished Service Spaces: One-piece, cast-brass type with rough-brass finish.
    - f. Bare Piping in Equipment Rooms: One-piece, cast-brass type with rough-brass finish.
- C. Install floor plates for piping penetrations of equipment-room floors.
- D. Install floor plates with ID to closely fit around pipe, tube, and insulation of piping and with OD that completely covers opening.
  - 1. New Piping: One-piece, floor-plate type.
  - 2. Existing Piping: Split-casting, floor-plate type.

3.2 FIELD QUALITY CONTROL

- A. Replace broken and damaged escutcheons and floor plates using new materials.

END OF SECTION



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 220523.12 - BALL VALVES FOR PLUMBING PIPING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
  - 1. Bronze ball valves.

1.3 DEFINITIONS

- A. CWP: Cold working pressure.

1.4 ACTION SUBMITTALS

- A. Submittals shall comply with the requirements of the Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Product Data: For each type of valve. On data submittal sheets where more than one product is described, clearly annotate which product(s) is to be supplied.
  - 1. Certification that products comply with NSF 61 Annex G and NSF 372.

1.5 DELIVERY, STORAGE, AND HANDLING

- A. Prepare valves for shipping as follows:
  - 1. Protect internal parts against corrosion.
  - 2. Protect threads and flange faces.
  - 3. Set ball valves open to minimize exposure of functional surfaces.
- B. Use the following precautions during storage:
  - 1. Maintain valve end protection.
  - 2. Store valves indoors and maintain at higher-than-ambient-dew-point temperature. If outdoor storage is necessary, store valves off the ground in watertight enclosures.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- C. Use sling to handle large valves; rig sling to avoid damage to exposed parts. Do not use operating handles or stems as lifting or rigging points.

PART 2 - PRODUCTS

2.1 GENERAL REQUIREMENTS FOR VALVES

- A. Source Limitations for Valves: Obtain each type of valve from single source from single manufacturer.
- B. ASME Compliance:
  - 1. ASME B1.20.1 for threads for threaded end valves.
- C. Bronze valves shall be made with dezincification-resistant materials. Bronze valves made with copper alloy (brass) containing more than 15 percent zinc are not permitted.
- D. NSF Compliance: NSF 61 Annex G and NSF 372 for valve materials for potable-water service.
- E. Valve Pressure-Temperature Ratings: Not less than indicated and as required for system pressures and temperatures.
- F. Valve Sizes: Same as upstream piping unless otherwise indicated.
- G. Valve Actuator Types:
  - 1. Handlever: For quarter-turn valves smaller than NPS 4.
- H. Valves in Insulated Piping:
  - 1. Include 2-inch stem extensions.
  - 2. Extended operating handles of nonthermal-conductive material and protective sleeves that allow operation of valves without breaking vapor seals or disturbing insulation.
  - 3. Memory stops that are fully adjustable after insulation is applied.

2.2 BRONZE BALL VALVES

- A. Bronze Ball Valves, Two-Piece with Full Port and Stainless-Steel Trim:
  - 1. Description:
    - a. Standard: MSS SP-110.
    - b. CWP Rating: 600 psig.
    - c. Body Design: Two piece.
    - d. Body Material: Bronze.
    - e. Ends: Threaded.
    - f. Seats: PTFE.
    - g. Stem: Brass.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- h. Ball: Stainless-steel.
- i. Port: Full.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine valve interior for cleanliness, freedom from foreign matter, and corrosion. Remove special packing materials, such as blocks, used to prevent disc movement during shipping and handling.
- B. Operate valves in positions from fully open to fully closed. Examine guides and seats made accessible by such operations.
- C. Examine threads on valve and mating pipe for form and cleanliness.
- D. Do not attempt to repair defective valves; replace with new valves.

3.2 VALVE INSTALLATION

- A. Install valves with unions or flanges at each piece of equipment arranged to allow service, maintenance, and equipment removal without system shutdown.
- B. Locate valves for easy access and provide separate support where necessary.
- C. Install valves in horizontal piping with stem at or above center of pipe.
- D. Install valves in position to allow full stem movement.
- E. Install valve tags. Comply with requirements in Section 220553 "Identification for Plumbing Piping and Equipment" for valve tags and schedules.

3.3 GENERAL REQUIREMENTS FOR VALVE APPLICATIONS

- A. If valves with specified CWP ratings are unavailable, the same types of valves with higher CWP ratings may be substituted.
- B. Select valves with the following end connections:
  - 1. For Copper Tubing, NPS 2 and Smaller: Threaded ends.

3.4 DOMESTIC HOT- AND COLD-WATER VALVE SCHEDULE

- A. Pipe NPS 2 and Smaller:
  - 1. Bronze ball valves, two-piece with full port, stainless-steel trim, and threaded ends.

END OF SECTION



SECTION 220529 - HANGERS AND SUPPORTS FOR PLUMBING PIPING AND EQUIPMENT

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

A. Section Includes:

1. Metal pipe hangers and supports.
2. Trapeze pipe hangers.
3. Thermal-hanger shield inserts.
4. Fastener systems.
5. Pipe stands.
6. Pipe positioning systems.
7. Equipment supports.

B. Related Sections:

1. Section 055000 "Metal Fabrications" for structural-steel shapes and plates for trapeze hangers for pipe and equipment supports.

1.3 DEFINITIONS

- A. MSS: Manufacturers Standardization Society of The Valve and Fittings Industry Inc.

1.4 PERFORMANCE REQUIREMENTS

- A. Structural Performance: Hangers and supports for plumbing piping and equipment shall withstand the effects of gravity loads and stresses within limits and under conditions indicated according to ASCE/SEI 7.
  1. Design supports for multiple pipes, including pipe stands, capable of supporting combined weight of supported systems, system contents, and test water.
  2. Design equipment supports capable of supporting combined operating weight of supported equipment and connected systems and components.
  3. Design seismic-restraint hangers and supports for piping and equipment and obtain approval from authorities having jurisdiction.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1.5 ACTION SUBMITTALS

- A. Submittals shall comply with the requirements of the Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Product Data: For each type of product indicated. On data submittal sheets where more than one product is described, clearly annotate which product(s) is to be supplied.
- C. Shop Drawings: Show fabrication and installation details and include calculations for the following; include Product Data for components:
  - 1. Trapeze pipe hangers.
  - 2. Metal framing systems.
  - 3. Pipe stands.
  - 4. Equipment supports.

1.6 INFORMATIONAL SUBMITTALS

- A. Submittals shall comply with the requirements of the Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Welding certificates.

1.7 QUALITY ASSURANCE

- A. Structural Steel Welding Qualifications: Qualify procedures and personnel according to AWS D1.1/D1.1M, "Structural Welding Code - Steel."
- B. Pipe Welding Qualifications: Qualify procedures and operators according to ASME Boiler and Pressure Vessel Code.

PART 2 - PRODUCTS

2.1 METAL PIPE HANGERS AND SUPPORTS

- A. Carbon-Steel Pipe Hangers and Supports:
  - 1. Description: MSS SP-58, Types 1 through 58, factory-fabricated components.
  - 2. Galvanized Metallic Coatings: Pregalvanized or hot dipped.
  - 3. Nonmetallic Coatings: Plastic coating, jacket, or liner.
  - 4. Padded Hangers: Hanger with fiberglass or other pipe insulation pad or cushion to support bearing surface of piping.
  - 5. Hanger Rods: Continuous-thread rod, nuts, and washer made of carbon steel.
- B. Copper Pipe Hangers:

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1. Description: MSS SP-58, Types 1 through 58, copper-coated-steel, factory-fabricated components.
2. Hanger Rods: Continuous-thread rod, nuts, and washer made of copper-coated steel.

## 2.2 TRAPEZE PIPE HANGERS

- A. Description: MSS SP-69, Type 59, shop- or field-fabricated pipe-support assembly made from structural carbon-steel shapes with MSS SP-58 carbon-steel hanger rods, nuts, saddles, and U-bolts.

## 2.3 THERMAL-HANGER SHIELD INSERTS

- A. Insulation-Insert Material for Piping: ASTM C 552, Type II cellular glass with 100-psig or ASTM C 591, Type VI, Grade 1 polyisocyanurate with 125-psig minimum compressive strength and vapor barrier.
- B. For Trapeze or Clamped Systems: Insert and shield shall cover entire circumference of pipe.
- C. For Clevis or Band Hangers: Insert and shield shall cover lower 180 degrees of pipe.
- D. Insert Length: Extend 2 inches beyond sheet metal shield for piping operating below ambient air temperature.

## 2.4 FASTENER SYSTEMS

- A. Powder-Actuated Fasteners: Threaded-steel stud, for use in hardened portland cement concrete with pull-out, tension, and shear capacities appropriate for supported loads and building materials where used.
- B. Mechanical-Expansion Anchors: Insert-wedge-type, zinc-coated steel anchors, for use in hardened portland cement concrete; with pull-out, tension, and shear capacities appropriate for supported loads and building materials where used.

## 2.5 PIPE STANDS

- A. General Requirements for Pipe Stands: Shop- or field-fabricated assemblies made of manufactured corrosion-resistant components to support roof-mounted piping.
- B. Compact Pipe Stand: One-piece plastic unit with integral-rod roller, pipe clamps, or V-shaped cradle to support pipe, for roof installation without membrane penetration.
- C. High-Type, Single-Pipe Stand:
  1. Description: Assembly of base, vertical and horizontal members, and pipe support, for roof installation without membrane penetration.
  2. Base: Plastic or stainless steel.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

3. Vertical Members: Two or more cadmium-plated-steel or stainless-steel, continuous-thread rods.
4. Horizontal Member: Cadmium-plated-steel or stainless-steel rod with plastic or stainless-steel, roller-type pipe support.

D. High-Type, Multiple-Pipe Stand:

1. Description: Assembly of bases, vertical and horizontal members, and pipe supports, for roof installation without membrane penetration.
2. Bases: One or more; plastic.
3. Vertical Members: Two or more protective-coated-steel channels.
4. Horizontal Member: Protective-coated-steel channel.
5. Pipe Supports: Galvanized-steel, clevis-type pipe hangers.

E. Curb-Mounting-Type Pipe Stands: Shop- or field-fabricated pipe supports made from structural-steel shapes, continuous-thread rods, and rollers, for mounting on permanent stationary roof curb.

## 2.6 PIPE POSITIONING SYSTEMS

- A. Description: IAPMO PS 42, positioning system of metal brackets, clips, and straps for positioning piping in pipe spaces; for plumbing fixtures in commercial applications.

## 2.7 EQUIPMENT SUPPORTS

- A. Description: Welded, shop- or field-fabricated equipment support made from structural carbon-steel shapes.

## 2.8 MISCELLANEOUS MATERIALS

- A. Structural Steel: ASTM A 36/A 36M, carbon-steel plates, shapes, and bars; black and galvanized.
- B. Grout: ASTM C 1107, factory-mixed and -packaged, dry, hydraulic-cement, nonshrink and nonmetallic grout; suitable for interior and exterior applications.
1. Properties: Nonstaining, noncorrosive, and nongaseous.
  2. Design Mix: 5000-psi, 28-day compressive strength.

## PART 3 - EXECUTION

### 3.1 HANGER AND SUPPORT INSTALLATION

- A. Metal Pipe-Hanger Installation: Comply with MSS SP-69 and MSS SP-89. Install hangers, supports, clamps, and attachments as required to properly support piping from the building structure.



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- B. Metal Trapeze Pipe-Hanger Installation: Comply with MSS SP-69 and MSS SP-89. Arrange for grouping of parallel runs of horizontal piping, and support together on field-fabricated trapeze pipe hangers.
  - 1. Pipes of Various Sizes: Support together and space trapezes for smallest pipe size or install intermediate supports for smaller diameter pipes as specified for individual pipe hangers.
  - 2. Field fabricate from ASTM A 36/A 36M, carbon-steel shapes selected for loads being supported. Weld steel according to AWS D1.1/D1.1M.
- C. Thermal-Hanger Shield Installation: Install in pipe hanger or shield for insulated piping.
- D. Fastener System Installation:
  - 1. Install powder-actuated fasteners for use in lightweight concrete or concrete slabs less than 4 inches thick in concrete after concrete is placed and completely cured. Use operators that are licensed by powder-actuated tool manufacturer. Install fasteners according to powder-actuated tool manufacturer's operating manual.
  - 2. Install mechanical-expansion anchors in concrete after concrete is placed and completely cured. Install fasteners according to manufacturer's written instructions.
- E. Pipe Stand Installation:
  - 1. Pipe Stand Types except Curb-Mounted Type: Assemble components and mount on smooth roof surface. Do not penetrate roof membrane.
  - 2. Curb-Mounted-Type Pipe Stands: Assemble components or fabricate pipe stand and mount on permanent, stationary roof curb. See Section 077200 "Roof Accessories" for curbs.
- F. Pipe Positioning-System Installation: Install support devices to make rigid supply and waste piping connections to each plumbing fixture.
- G. Install hangers and supports complete with necessary attachments, inserts, bolts, rods, nuts, washers, and other accessories.
- H. Equipment Support Installation: Fabricate from welded-structural-steel shapes.
- I. Install hangers and supports to allow controlled thermal and seismic movement of piping systems, to permit freedom of movement between pipe anchors, and to facilitate action of expansion joints, expansion loops, expansion bends, and similar units.
- J. Install lateral bracing with pipe hangers and supports to prevent swaying.
- K. Install building attachments within concrete slabs or attach to structural steel. Install additional attachments at concentrated loads, including valves, flanges, and strainers, NPS 2-1/2 and larger and at changes in direction of piping. Install concrete inserts before concrete is placed; fasten inserts to forms and install reinforcing bars through openings at top of inserts.
- L. Load Distribution: Install hangers and supports so that piping live and dead loads and stresses from movement will not be transmitted to connected equipment.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

M. Pipe Slopes: Install hangers and supports to provide indicated pipe slopes and to not exceed maximum pipe deflections allowed by ASME B31.9 for building services piping.

N. Insulated Piping:

1. Attach clamps and spacers to piping.
  - a. Piping Operating above Ambient Air Temperature: Clamp may project through insulation.
  - b. Piping Operating below Ambient Air Temperature: Use thermal-hanger shield insert with clamp sized to match OD of insert.
  - c. Do not exceed pipe stress limits allowed by ASME B31.9 for building services piping.
2. Install MSS SP-58, Type 39, protection saddles if insulation without vapor barrier is indicated. Fill interior voids with insulation that matches adjoining insulation.
  - a. Option: Thermal-hanger shield inserts may be used. Include steel weight-distribution plate for pipe NPS 4 and larger if pipe is installed on rollers.
3. Install MSS SP-58, Type 40, protective shields on cold piping with vapor barrier. Shields shall span an arc of 180 degrees.
  - a. Option: Thermal-hanger shield inserts may be used. Include steel weight-distribution plate for pipe NPS 4 and larger if pipe is installed on rollers.
4. Shield Dimensions for Pipe: Not less than the following:
  - a. NPS 1/4 to NPS 3-1/2: 12 inches long and 0.048 inch thick.
  - b. NPS 4: 12 inches long and 0.06 inch thick.
  - c. NPS 5 and NPS 6: 18 inches long and 0.06 inch thick.
5. Thermal-Hanger Shields: Install with insulation same thickness as piping insulation.

### 3.2 EQUIPMENT SUPPORTS

- A. Fabricate structural-steel stands to suspend equipment from structure overhead or to support equipment above floor.
- B. Grouting: Place grout under supports for equipment and make bearing surface smooth.
- C. Provide lateral bracing, to prevent swaying, for equipment supports.

### 3.3 METAL FABRICATIONS

- A. Cut, drill, and fit miscellaneous metal fabrications for trapeze pipe hangers and equipment supports.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- B. Fit exposed connections together to form hairline joints. Field weld connections that cannot be shop welded because of shipping size limitations.
- C. Field Welding: Comply with AWS D1.1/D1.1M procedures for shielded, metal arc welding; appearance and quality of welds; and methods used in correcting welding work; and with the following:
  - 1. Use materials and methods that minimize distortion and develop strength and corrosion resistance of base metals.
  - 2. Obtain fusion without undercut or overlap.
  - 3. Remove welding flux immediately.
  - 4. Finish welds at exposed connections so no roughness shows after finishing and so contours of welded surfaces match adjacent contours.

### 3.4 ADJUSTING

- A. Hanger Adjustments: Adjust hangers to distribute loads equally on attachments and to achieve indicated slope of pipe.
- B. Trim excess length of continuous-thread hanger and support rods to 1-1/2 inches.

### 3.5 PAINTING

- A. Touchup: Clean field welds and abraded areas of shop paint. Paint exposed areas immediately after erecting hangers and supports. Use same materials as used for shop painting. Comply with SSPC-PA 1 requirements for touching up field-painted surfaces.
  - 1. Apply paint by brush or spray to provide a minimum dry film thickness of 2.0 mils.
- B. Galvanized Surfaces: Clean welds, bolted connections, and abraded areas and apply galvanizing-repair paint to comply with ASTM A 780.

### 3.6 HANGER AND SUPPORT SCHEDULE

- A. Specific hanger and support requirements are in Sections specifying piping systems and equipment.
- B. Comply with MSS SP-69 for pipe-hanger selections and applications that are not specified in piping system Sections.
- C. Use hangers and supports with galvanized metallic coatings for piping and equipment that will not have field-applied finish.
- D. Use nonmetallic coatings on attachments for electrolytic protection where attachments are in direct contact with copper tubing.
- E. Use carbon-steel pipe hangers and supports, metal trapeze pipe hangers, and metal framing systems and attachments for general service applications.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- F. Use copper-plated pipe hangers and copper attachments for copper piping and tubing.
- G. Use padded hangers for piping that is subject to scratching.
- H. Use thermal-hanger shield inserts for insulated piping and tubing.
- I. Horizontal-Piping Hangers and Supports: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
  - 1. Adjustable, Steel Clevis Hangers (MSS Type 1): For suspension of stationary pipes NPS 1/2 to NPS 30.
  - 2. U-Bolts (MSS Type 24): For support of heavy pipes NPS 1/2 to NPS 30.
  - 3. Adjustable Pipe Saddle Supports (MSS Type 38): For stanchion-type support for pipes NPS 2-1/2 to NPS 36 if vertical adjustment is required, with steel-pipe base stanchion support and cast-iron floor flange.
  - 4. Single-Pipe Rolls (MSS Type 41): For suspension of pipes NPS 1 to NPS 30, from two rods if longitudinal movement caused by expansion and contraction might occur.
- J. Vertical-Piping Clamps: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
  - 1. Extension Pipe or Riser Clamps (MSS Type 8): For support of pipe risers NPS 3/4 to NPS 24.
  - 2. Carbon- or Alloy-Steel Riser Clamps (MSS Type 42): For support of pipe risers NPS 3/4 to NPS 24 if longer ends are required for riser clamps.
- K. Hanger-Rod Attachments: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
  - 1. Steel Turnbuckles (MSS Type 13): For adjustment up to 6 inches for heavy loads.
  - 2. Steel Clevises (MSS Type 14): For 120 to 450 deg F piping installations.
  - 3. Malleable-Iron Sockets (MSS Type 16): For attaching hanger rods to various types of building attachments.
- L. Building Attachments: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
  - 1. Steel or Malleable Concrete Inserts (MSS Type 18): For upper attachment to suspend pipe hangers from concrete ceiling.
  - 2. Top-Beam C-Clamps (MSS Type 19): For use under roof installations with bar-joint construction, to attach to top flange of structural shape.
  - 3. Side-Beam or Channel Clamps (MSS Type 20): For attaching to bottom flange of beams, channels, or angles.
  - 4. Center-Beam Clamps (MSS Type 21): For attaching to center of bottom flange of beams.
  - 5. Welded Beam Attachments (MSS Type 22): For attaching to bottom of beams if loads are considerable and rod sizes are large.
  - 6. C-Clamps (MSS Type 23): For structural shapes.
  - 7. Top-Beam Clamps (MSS Type 25): For top of beams if hanger rod is required tangent to flange edge.
  - 8. Side-Beam Clamps (MSS Type 27): For bottom of steel I-beams.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

9. Steel-Beam Clamps with Eye Nuts (MSS Type 28): For attaching to bottom of steel I-beams for heavy loads.
  10. Malleable-Beam Clamps with Extension Pieces (MSS Type 30): For attaching to structural steel.
  11. Welded-Steel Brackets: For support of pipes from below or for suspending from above by using clip and rod. Use one of the following for indicated loads:
    - a. Light (MSS Type 31): 750 lb.
    - b. Medium (MSS Type 32): 1500 lb.
    - c. Heavy (MSS Type 33): 3000 lb.
- M. Saddles and Shields: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
1. Steel-Pipe-Covering Protection Saddles (MSS Type 39): To fill interior voids with insulation that matches adjoining insulation.
  2. Protection Shields (MSS Type 40): Of length recommended in writing by manufacturer to prevent crushing insulation.
  3. Thermal-Hanger Shield Inserts: For supporting insulated pipe.
- N. Comply with MSS SP-69 for trapeze pipe-hanger selections and applications that are not specified in piping system Sections.
- O. Comply with MFMA-103 for metal framing system selections and applications that are not specified in piping system Sections.
- P. Use powder-actuated fasteners or mechanical-expansion anchors instead of building attachments where required in concrete construction.
- Q. Use pipe positioning systems in pipe spaces behind plumbing fixtures to support supply and waste piping for plumbing fixtures.

END OF SECTION



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 220553 - IDENTIFICATION FOR PLUMBING PIPING AND EQUIPMENT

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:

- 1. Equipment labels.
- 2. Pipe labels.
- 3. Valve tags.
- 4. Warning tags.

1.3 ACTION SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Product Data: For each type of product indicated. On data submittal sheets where more than one product is described, clearly annotate which product(s) is to be supplied.
- C. Samples: For color, letter style, and graphic representation required for each identification material and device.
- D. Equipment Label Schedule: Include a listing of all equipment to be labeled with the proposed content for each label.
- E. Valve numbering scheme.
- F. Valve Schedules: For each piping system to include in maintenance manuals.

PART 2 - PRODUCTS

2.1 EQUIPMENT LABELS

- A. Plastic Labels for Equipment:

- 1. Material and Thickness: Multilayer, multicolor, plastic labels for mechanical engraving, 1/8 inch thick, and having predrilled holes for attachment hardware.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

2. Letter Color: White.
3. Background Color: Red.
4. Maximum Temperature: Able to withstand temperatures up to 160 deg F.
5. Minimum Label Size: Length and width vary for required label content, but not less than 2-1/2 by 3/4 inch.
6. Minimum Letter Size: 1/4 inch for name of units if viewing distance is less than 24 inches, 1/2 inch for viewing distances up to 72 inches, and proportionately larger lettering for greater viewing distances. Include secondary lettering two-thirds to three-quarters the size of principal lettering.
7. Fasteners: Stainless-steel rivets or self-tapping screws.
8. Adhesive: Contact-type permanent adhesive, compatible with label and with substrate.

- B. Label Content: Include equipment's Drawing designation or unique equipment number.
- C. Equipment Label Schedule: For each item of equipment to be labeled, on 8-1/2-by-11-inch bond paper. Tabulate equipment identification number, and identify Drawing numbers where equipment is indicated (plans, details, and schedules) and the Specification Section number and title where equipment is specified. Equipment schedule shall be included in operation and maintenance data.

## 2.2 PIPE LABELS

- A. General Requirements for Manufactured Pipe Labels: Preprinted, color-coded, with lettering indicating service, and showing flow direction.
- B. Pretensioned Pipe Labels: Precoiled, semirigid plastic formed to cover full circumference of pipe and to attach to pipe without fasteners or adhesive.
- C. Self-Adhesive Pipe Labels: Printed plastic with contact-type, permanent-adhesive backing.
- D. Pipe Label Contents: Include identification of piping service using same designations or abbreviations as used on Drawings; also include pipe size and an arrow indicating flow direction.
1. Flow-Direction Arrows: Integral with piping-system service lettering to accommodate both directions or as separate unit on each pipe label to indicate flow direction.
  2. Lettering Size: Size letters according to ASME A13.1 for piping.

## 2.3 VALVE TAGS

- A. Valve Tags: Stamped or engraved with 1/4-inch letters for piping system abbreviation and 1/2-inch numbers.
1. Tag Material: Brass, 0.032-inch minimum thickness, and having predrilled or stamped holes for attachment hardware.
  2. Fasteners: Brass wire-link chain.



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- B. Valve Schedules: For each piping system, on 8-1/2-by-11-inch bond paper. Tabulate valve number, piping system, system abbreviation (as shown on valve tag), location of valve (room or space), normal-operating position (open, closed, or modulating), and variations for identification. Mark valves for emergency shutoff and similar special uses.

- 1. Valve-tag schedule shall be included in operation and maintenance data.

## 2.4 WARNING TAGS

- A. Description: Preprinted or partially preprinted accident-prevention tags of plasticized card stock with matte finish suitable for writing.
  - 1. Size: 3 by 5-1/4 inches minimum.
  - 2. Fasteners: Brass grommet and wire.
  - 3. Nomenclature: Large-size primary caption such as "DANGER," "CAUTION," or "DO NOT OPERATE."
  - 4. Color: Safety yellow background with black lettering.

## PART 3 - EXECUTION

### 3.1 PREPARATION

- A. Clean piping and equipment surfaces of substances that could impair bond of identification devices, including dirt, oil, grease, release agents, and incompatible primers, paints, and encapsulants.

### 3.2 GENERAL INSTALLATION REQUIREMENTS

- A. Coordinate installation of identifying devices with completion of covering and painting of surfaces where devices are to be applied.
- B. Coordinate installation of identifying devices with locations of access panels and doors.
- C. Install identifying devices before installing acoustical ceilings and similar concealment.

### 3.3 EQUIPMENT LABEL INSTALLATION

- A. Install or permanently fasten labels on each major item of mechanical equipment.
- B. Locate equipment labels where accessible and visible.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

3.4 PIPE LABEL INSTALLATION

- A. Pipe Label Locations: Locate pipe labels where piping is exposed or above accessible ceilings in finished spaces; machine rooms; accessible maintenance spaces such as shafts, tunnels, and plenums; and exterior exposed locations as follows:
1. Near each valve and control device.
  2. Near each branch connection, excluding short takeoffs for fixtures and terminal units. Where flow pattern is not obvious, mark each pipe at branch.
  3. Near penetrations through walls, floors, ceilings, and inaccessible enclosures.
  4. At access doors, manholes, and similar access points that permit view of concealed piping.
  5. Near major equipment items and other points of origination and termination.
  6. Spaced at maximum intervals of 50 feet along each run. Reduce intervals to 25 feet in areas of congested piping and equipment.
  7. On piping above removable acoustical ceilings. Omit intermediately spaced labels.
- B. Directional Flow Arrows: Arrows shall be used to indicate direction of flow in pipes, including pipes where flow is allowed in both directions.
- C. Pipe Label Color Schedule:
1. Domestic Water Piping
    - a. Background: Safety green.
    - b. Letter Colors: White.
  2. Sanitary Waste and Vent, and Storm Drainage Piping:
    - a. Background Color: Safety white.
    - b. Letter Color: Black.

3.5 VALVE-TAG INSTALLATION

- A. Install tags on valves and control devices in piping systems, except check valves, valves within factory-fabricated equipment units, shutoff valves, faucets, convenience and lawn-watering hose connections, and similar roughing-in connections of end-use fixtures and units. List tagged valves in a valve schedule.
- B. Valve-Tag Application Schedule: Tag valves according to size, shape, and color scheme and with captions similar to those indicated in the following subparagraphs:
1. Valve-Tags:
    - a. Valve-Tag Size and Shape: 2 inches, round.
    - b. Valve-Tag Color: Natural.
    - c. Letter Colors: Black.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

3.6 WARNING-TAG INSTALLATION

- A. Write required message on, and attach warning tags to, equipment and other items where required.

END OF SECTION



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 220719 - PLUMBING PIPING INSULATION

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes insulating the following plumbing piping services:
  - 1. Domestic cold-water piping.
  - 2. Domestic hot-water piping.
- B. Related Sections:
  - 1. Section 224216.13 "Commercial Lavatories" for protective shielding coverage for supplies and drains for handicapped-accessible fixtures.

1.3 ACTION SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. On data submittal sheets where more than one product is described, clearly annotate which product(s) is to be supplied.
- C. Product Data: For each type of product indicated. Include thermal conductivity, water-vapor permeance thickness, and jackets (both factory- and field-applied, if any).
- D. Sustainable Design Submittals:
  - 1. **Product Data:** For adhesives, mastics, and sealants, indicating VOC content.
  - 2. Laboratory Test Reports: For adhesives, mastics, and sealants, indicating compliance with requirements for low-emitting materials.

1.4 INFORMATIONAL SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Qualification Data: For qualified Installer.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- C. Material Test Reports: From a qualified testing agency acceptable to authorities having jurisdiction indicating, interpreting, and certifying test results for compliance of insulation materials, sealers, attachments, cements, and jackets, with requirements indicated. Include dates of tests and test methods employed.
- D. Field quality-control reports.

1.5 QUALITY ASSURANCE

- A. Installer Qualifications: Skilled mechanics who have successfully completed an apprenticeship program or another craft training program certified by the Department of Labor, Bureau of Apprenticeship and Training.
- B. Surface-Burning Characteristics: For insulation and related materials, as determined by testing identical products according to ASTM E 84 by a testing agency acceptable to authorities having jurisdiction. Factory label insulation and jacket materials and adhesive, mastic, tapes, and cement material containers, with appropriate markings of applicable testing agency.
  - 1. Insulation Installed Indoors: Flame-spread index of 25 or less, and smoke-developed index of 50 or less.
  - 2. Insulation Installed Outdoors: Flame-spread index of 75 or less, and smoke-developed index of 150 or less.

1.6 DELIVERY, STORAGE, AND HANDLING

- A. Packaging: Insulation material containers shall be marked by manufacturer with appropriate ASTM standard designation, type and grade, and maximum use temperature.

1.7 COORDINATION

- A. Coordinate sizes and locations of supports, hangers, and insulation shields specified in Section 220529 "Hangers and Supports for Plumbing Piping and Equipment."
- B. Coordinate clearance requirements with piping Installer for piping insulation application. Before preparing piping Shop Drawings, establish and maintain clearance requirements for installation of insulation and field-applied jackets and finishes and for space required for maintenance.
- C. Coordinate installation and testing of heat tracing for temperature maintenance system.

1.8 SCHEDULING

- A. Schedule insulation application after pressure testing systems and, where required, after installing and testing heat tracing. Insulation application may begin on segments that have satisfactory test results.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- B. Complete installation and concealment of plastic materials as rapidly as possible in each area of construction.

PART 2 - PRODUCTS

2.1 INSULATION MATERIALS

- A. Comply with requirements in "Piping Insulation Schedule, General" and "Indoor Piping Insulation Schedule" articles for where insulating materials shall be applied.
- B. Products shall not contain asbestos, lead, mercury, or mercury compounds.
- C. Products that come in contact with stainless steel shall have a leachable chloride content of less than 50 ppm when tested according to ASTM C 871.
- D. Insulation materials for use on austenitic stainless steel shall be qualified as acceptable according to ASTM C 795.
- E. Foam insulation materials shall not use CFC or HCFC blowing agents in the manufacturing process.
- F. Flexible Elastomeric Insulation: Closed-cell, sponge- or expanded-rubber materials. Comply with ASTM C 534, Type I for tubular materials.
- G. Mineral-Fiber, Preformed Pipe Insulation:
  - 1. Type I, 850 Deg F Materials: Mineral or glass fibers bonded with a thermosetting resin. Comply with ASTM C 547, Type I, Grade A, with factory-applied ASJ-SSL. Factory-applied jacket requirements are specified in "Factory-Applied Jackets" Article.

2.2 INSULATING CEMENTS

- A. Mineral-Fiber Insulating Cement: Comply with ASTM C 195.
- B. Mineral-Fiber, Hydraulic-Setting Insulating and Finishing Cement: Comply with ASTM C 449.

2.3 ADHESIVES

- A. Materials shall be compatible with insulation materials, jackets, and substrates and for bonding insulation to itself and to surfaces to be insulated, unless otherwise indicated.
- B. Flexible Elastomeric Adhesive: Comply with MIL-A-24179A, Type II, Class I.
  - 1. Adhesives and sealants shall comply with the testing and product requirements of the California Department of Public Health's "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers."

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- C. Mineral-Fiber Adhesive: Comply with MIL-A-3316C, Class 2, Grade A.
  - 1. Adhesive: As recommended by mineral fiber manufacturer and with a VOC content of 80 g/L or less.
  - 2. Adhesives and sealants shall comply with the testing and product requirements of the California Department of Public Health's "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers."
  
- D. PVC Jacket Adhesive: Compatible with PVC jacket.
  - 1. Adhesive: As recommended by Adhesive - PVC Jacket manufacturer and with a VOC content of 50 g/L or less.
  - 2. Adhesives and sealants shall comply with the testing and product requirements of the California Department of Public Health's "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers."

## 2.4 MASTICS

- A. Materials shall be compatible with insulation materials, jackets, and substrates; comply with MIL-PRF-19565C, Type II.
  - 1. Mastics shall comply with the testing and product requirements of the California Department of Public Health's "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers."
  
- B. Vapor-Barrier Mastic: Water based; suitable for indoor use on below-ambient services.
  - 1. Water-Vapor Permeance: ASTM E 96/E 96M, Procedure B, 0.013 perm at 43-mil dry film thickness.
  - 2. Service Temperature Range: Minus 20 to plus 180 deg F.
  - 3. Solids Content: ASTM D 1644, 58 percent by volume and 70 percent by weight.
  - 4. Color: White.
  
- C. Breather Mastic: Water based; suitable for indoor and outdoor use on above-ambient services.
  - 1. Water-Vapor Permeance: ASTM F 1249, 1.8 perms at 0.0625-inch dry film thickness.
  - 2. Service Temperature Range: Minus 20 to plus 180 deg F.
  - 3. Solids Content: 60 percent by volume and 66 percent by weight.
  - 4. Color: White.

## 2.5 LAGGING ADHESIVES

- A. Description: Comply with MIL-A-3316C, Class I, Grade A, and shall be compatible with insulation materials, jackets, and substrates.



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1. For indoor applications, use lagging adhesives that have a VOC content of 50 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).
2. Fire-resistant, water-based lagging adhesive and coating for use indoors to adhere fire-resistant lagging cloths over pipe insulation.
3. Service Temperature Range: 0 to plus 180 deg F.
4. Color: White.

## 2.6 SEALANTS

### A. ASJ Flashing Sealants and PVC Jacket Flashing Sealants:

1. Materials shall be compatible with insulation materials, jackets, and substrates.
2. Fire- and water-resistant, flexible, elastomeric sealant.
3. Service Temperature Range: Minus 40 to plus 250 deg F.
4. Color: White.
5. Sealant shall comply with the testing and product requirements of the California Department of Public Health's "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers."

## 2.7 FACTORY-APPLIED JACKETS

### A. Insulation system schedules indicate factory-applied jackets on various applications. When factory-applied jackets are indicated, comply with the following:

1. ASJ: White, kraft-paper, fiberglass-reinforced scrim with aluminum-foil backing; complying with ASTM C 1136, Type I.
2. ASJ-SSL: ASJ with self-sealing, pressure-sensitive, acrylic-based adhesive covered by a removable protective strip; complying with ASTM C 1136, Type I.

## 2.8 FIELD-APPLIED JACKETS

### A. Field-applied jackets shall comply with ASTM C 921, Type I, unless otherwise indicated.

### B. PVC Jacket: High-impact-resistant, UV-resistant PVC complying with ASTM D 1784, Class 16354-C; thickness as scheduled; roll stock ready for shop or field cutting and forming. Thickness is indicated in field-applied jacket schedules.

1. Adhesive: As recommended by jacket material manufacturer.
2. Color: White.
3. Factory-fabricated fitting covers to match jacket if available; otherwise, field fabricate.
  - a. Shapes: 45- and 90-degree, short- and long-radius elbows, tees, valves, flanges, unions, reducers, end caps, soil-pipe hubs, traps, mechanical joints, and P-trap and supply covers for lavatories.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

2.9 TAPES

- A. ASJ Tape: White vapor-retarder tape matching factory-applied jacket with acrylic adhesive, complying with ASTM C 1136.
  - 1. Width: 3 inches.
  - 2. Thickness: 11.5 mils.
  - 3. Adhesion: 90 ounces force/inch in width.
  - 4. Elongation: 2 percent.
  - 5. Tensile Strength: 40 lbf/inch in width.
  - 6. ASJ Tape Disks and Squares: Precut disks or squares of ASJ tape.
  
- B. PVC Tape: White vapor-retarder tape matching field-applied PVC jacket with acrylic adhesive; suitable for indoor and outdoor applications.
  - 1. Width: 2 inches.
  - 2. Thickness: 6 mils.
  - 3. Adhesion: 64 ounces force/inch in width.
  - 4. Elongation: 500 percent.
  - 5. Tensile Strength: 18 lbf/inch in width.

2.10 SECUREMENTS

- A. Bands:
  - 1. Stainless Steel: ASTM A 167 or ASTM A 240/A 240M, Type 304 or Type 316; 0.015 inch thick, 1/2 inch wide with wing seal or closed seal.
  
- B. Staples: Outward-clinching insulation staples, nominal 3/4-inch-wide, stainless steel or Monel.
  
- C. Wire: 0.062-inch soft-annealed, stainless steel.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine substrates and conditions for compliance with requirements for installation tolerances and other conditions affecting performance of insulation application.
  - 1. Verify that systems to be insulated have been tested and are free of defects.
  - 2. Verify that surfaces to be insulated are clean and dry.
  
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

3.2 PREPARATION

- A. Surface Preparation: Clean and dry surfaces to receive insulation. Remove materials that will adversely affect insulation application.
- B. Coordinate insulation installation with the trade installing heat tracing. Comply with requirements for heat tracing that apply to insulation.
- C. Mix insulating cements with clean potable water; if insulating cements are to be in contact with stainless-steel surfaces, use demineralized water.

3.3 GENERAL INSTALLATION REQUIREMENTS

- A. Install insulation materials, accessories, and finishes with smooth, straight, and even surfaces; free of voids throughout the length of piping including fittings, valves, and specialties.
- B. Install insulation materials, forms, vapor barriers or retarders, jackets, and thicknesses required for each item of pipe system as specified in insulation system schedules.
- C. Install accessories compatible with insulation materials and suitable for the service. Install accessories that do not corrode, soften, or otherwise attack insulation or jacket in either wet or dry state.
- D. Install insulation with longitudinal seams at top and bottom of horizontal runs.
- E. Install multiple layers of insulation with longitudinal and end seams staggered.
- F. Do not weld brackets, clips, or other attachment devices to piping, fittings, and specialties.
- G. Keep insulation materials dry during application and finishing.
- H. Install insulation with tight longitudinal seams and end joints. Bond seams and joints with adhesive recommended by insulation material manufacturer.
- I. Install insulation with least number of joints practical.
- J. Where vapor barrier is indicated, seal joints, seams, and penetrations in insulation at hangers, supports, anchors, and other projections with vapor-barrier mastic.
  - 1. Install insulation continuously through hangers and around anchor attachments.
  - 2. For insulation application where vapor barriers are indicated, extend insulation on anchor legs from point of attachment to supported item to point of attachment to structure. Taper and seal ends at attachment to structure with vapor-barrier mastic.
  - 3. Install insert materials and install insulation to tightly join the insert. Seal insulation to insulation inserts with adhesive or sealing compound recommended by insulation material manufacturer.
  - 4. Cover inserts with jacket material matching adjacent pipe insulation. Install shields over jacket, arranged to protect jacket from tear or puncture by hanger, support, and shield.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- K. Apply adhesives, mastics, and sealants at manufacturer's recommended coverage rate and wet and dry film thicknesses.
- L. Install insulation with factory-applied jackets as follows:
  - 1. Draw jacket tight and smooth.
  - 2. Cover circumferential joints with 3-inch-wide strips, of same material as insulation jacket. Secure strips with adhesive and outward clinching staples along both edges of strip, spaced 4 inches o.c.
  - 3. Overlap jacket longitudinal seams at least 1-1/2 inches. Install insulation with longitudinal seams at bottom of pipe. Clean and dry surface to receive self-sealing lap. Staple laps with outward clinching staples along edge at 2 inches o.c.
    - a. For below-ambient services, apply vapor-barrier mastic over staples.
  - 4. Cover joints and seams with tape, according to insulation material manufacturer's written instructions, to maintain vapor seal.
  - 5. Where vapor barriers are indicated, apply vapor-barrier mastic on seams and joints and at ends adjacent to pipe flanges and fittings.
- M. Cut insulation in a manner to avoid compressing insulation more than 75 percent of its nominal thickness.
- N. Finish installation with systems at operating conditions. Repair joint separations and cracking due to thermal movement.
- O. Repair damaged insulation facings by applying same facing material over damaged areas. Extend patches at least 4 inches beyond damaged areas. Adhere, staple, and seal patches similar to butt joints.
- P. For above-ambient services, do not install insulation to the following:
  - 1. Vibration-control devices.
  - 2. Testing agency labels and stamps.
  - 3. Nameplates and data plates.
  - 4. Cleanouts.

### 3.4 PENETRATIONS

- A. Insulation Installation at Underground Exterior Wall Penetrations: Terminate insulation flush with sleeve seal. Seal terminations with flashing sealant.
- B. Insulation Installation at Aboveground Exterior Wall Penetrations:
  - 1. Seal penetrations with flashing sealant.
  - 2. For applications requiring only indoor insulation, terminate insulation inside wall surface and seal with joint sealant.
  - 3. Seal jacket to wall flashing with flashing sealant.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- C. Insulation Installation at Interior Wall and Partition Penetrations (That Are Not Fire Rated):  
Install insulation continuously through walls and partitions.
- D. Insulation Installation at Fire-Rated Wall and Partition Penetrations: Install insulation continuously through penetrations of fire-rated walls and partitions.
  - 1. Comply with requirements in Section 078413 "Penetration Firestopping" for firestopping and fire-resistive joint sealers.
- E. Insulation Installation at Floor Penetrations:
  - 1. Pipe: Install insulation continuously through floor penetrations.
  - 2. Seal penetrations through fire-rated assemblies. Comply with requirements in Section 078413 "Penetration Firestopping."

### 3.5 GENERAL PIPE INSULATION INSTALLATION

- A. Requirements in this article generally apply to all insulation materials except where more specific requirements are specified in various pipe insulation material installation articles.
- B. Insulation Installation on Fittings, Valves, Strainers, Flanges, and Unions:
  - 1. Install insulation over fittings, valves, strainers, flanges, unions, and other specialties with continuous thermal and vapor-retarder integrity unless otherwise indicated.
  - 2. Insulate pipe elbows using preformed fitting insulation or mitered fittings made from same material and density as adjacent pipe insulation. Each piece shall be butted tightly against adjoining piece and bonded with adhesive. Fill joints, seams, voids, and irregular surfaces with insulating cement finished to a smooth, hard, and uniform contour that is uniform with adjoining pipe insulation.
  - 3. Insulate tee fittings with preformed fitting insulation or sectional pipe insulation of same material and thickness as used for adjacent pipe. Cut sectional pipe insulation to fit. Butt each section closely to the next and hold in place with tie wire. Bond pieces with adhesive.
  - 4. Insulate valves using preformed fitting insulation or sectional pipe insulation of same material, density, and thickness as used for adjacent pipe. Overlap adjoining pipe insulation by not less than two times the thickness of pipe insulation, or one pipe diameter, whichever is thicker. For valves, insulate up to and including the bonnets, valve stuffing-box studs, bolts, and nuts. Fill joints, seams, and irregular surfaces with insulating cement.
  - 5. Insulate strainers using preformed fitting insulation or sectional pipe insulation of same material, density, and thickness as used for adjacent pipe. Overlap adjoining pipe insulation by not less than two times the thickness of pipe insulation, or one pipe diameter, whichever is thicker. Fill joints, seams, and irregular surfaces with insulating cement. Insulate strainers so strainer basket flange or plug can be easily removed and replaced without damaging the insulation and jacket. Provide a removable reusable insulation cover. For below-ambient services, provide a design that maintains vapor barrier.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

6. Insulate flanges and unions using a section of oversized preformed pipe insulation. Overlap adjoining pipe insulation by not less than two times the thickness of pipe insulation, or one pipe diameter, whichever is thicker.
  7. Cover segmented insulated surfaces with a layer of finishing cement and coat with a mastic. Install vapor-barrier mastic for below-ambient services and a breather mastic for above-ambient services. Reinforce the mastic with fabric-reinforcing mesh. Trowel the mastic to a smooth and well-shaped contour.
  8. For services not specified to receive a field-applied jacket except for flexible elastomeric and polyolefin, install fitted PVC cover over elbows, tees, strainers, valves, flanges, and unions. Terminate ends with PVC end caps. Tape PVC covers to adjoining insulation facing using PVC tape.
  9. Stencil or label the outside insulation jacket of each union with the word "union." Match size and color of pipe labels.
- C. Insulate instrument connections for thermometers, pressure gages, pressure temperature taps, test connections, flow meters, sensors, switches, and transmitters on insulated pipes. Shape insulation at these connections by tapering it to and around the connection with insulating cement and finish with finishing cement, mastic, and flashing sealant.
- D. Install removable insulation covers at locations indicated. Installation shall conform to the following:
1. Make removable flange and union insulation from sectional pipe insulation of same thickness as that on adjoining pipe. Install same insulation jacket as adjoining pipe insulation.
  2. When flange and union covers are made from sectional pipe insulation, extend insulation from flanges or union long at least two times the insulation thickness over adjacent pipe insulation on each side of flange or union. Secure flange cover in place with stainless-steel or aluminum bands. Select band material compatible with insulation and jacket.
  3. Construct removable valve insulation covers in same manner as for flanges, except divide the two-part section on the vertical center line of valve body.
  4. When covers are made from block insulation, make two halves, each consisting of mitered blocks wired to stainless-steel fabric. Secure this wire frame, with its attached insulation, to flanges with tie wire. Extend insulation at least 2 inches over adjacent pipe insulation on each side of valve. Fill space between flange or union cover and pipe insulation with insulating cement. Finish cover assembly with insulating cement applied in two coats. After first coat is dry, apply and trowel second coat to a smooth finish.

### 3.6 INSTALLATION OF FLEXIBLE ELASTOMERIC INSULATION

- A. Seal longitudinal seams and end joints with manufacturer's recommended adhesive to eliminate openings in insulation that allow passage of air to surface being insulated.
- B. Insulation Installation on Pipe Flanges:
1. Install pipe insulation to outer diameter of pipe flange.
  2. Make width of insulation section same as overall width of flange and bolts, plus twice the thickness of pipe insulation.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

3. Fill voids between inner circumference of flange insulation and outer circumference of adjacent straight pipe segments with cut sections of sheet insulation of same thickness as pipe insulation.
4. Secure insulation to flanges and seal seams with manufacturer's recommended adhesive to eliminate openings in insulation that allow passage of air to surface being insulated.

C. Insulation Installation on Pipe Fittings and Elbows:

1. Install mitered sections of pipe insulation.
2. Secure insulation materials and seal seams with manufacturer's recommended adhesive to eliminate openings in insulation that allow passage of air to surface being insulated.

D. Insulation Installation on Valves and Pipe Specialties:

1. Install preformed valve covers manufactured of same material as pipe insulation when available.
2. When preformed valve covers are not available, install cut sections of pipe and sheet insulation to valve body. Arrange insulation to permit access to packing and to allow valve operation without disturbing insulation.
3. Install insulation to flanges as specified for flange insulation application.
4. Secure insulation to valves and specialties and seal seams with manufacturer's recommended adhesive to eliminate openings in insulation that allow passage of air to surface being insulated.

3.7 INSTALLATION OF MINERAL-FIBER INSULATION

A. Insulation Installation on Straight Pipes and Tubes:

1. Secure each layer of preformed pipe insulation to pipe with wire or bands and tighten bands without deforming insulation materials.
2. Where vapor barriers are indicated, seal longitudinal seams, end joints, and protrusions with vapor-barrier mastic and joint sealant.
3. For insulation with factory-applied jackets on above-ambient surfaces, secure laps with outward clinched staples at 6 inches o.c.
4. For insulation with factory-applied jackets on below-ambient surfaces, do not staple longitudinal tabs. Instead, secure tabs with additional adhesive as recommended by insulation material manufacturer and seal with vapor-barrier mastic and flashing sealant.

B. Insulation Installation on Pipe Flanges:

1. Install preformed pipe insulation to outer diameter of pipe flange.
2. Make width of insulation section same as overall width of flange and bolts, plus twice the thickness of pipe insulation.
3. Fill voids between inner circumference of flange insulation and outer circumference of adjacent straight pipe segments with mineral-fiber blanket insulation.
4. Install jacket material with manufacturer's recommended adhesive, overlap seams at least 1 inch, and seal joints with flashing sealant.

C. Insulation Installation on Pipe Fittings and Elbows:

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1. Install preformed sections of same material as straight segments of pipe insulation when available.
2. When preformed insulation elbows and fittings are not available, install mitered sections of pipe insulation, to a thickness equal to adjoining pipe insulation. Secure insulation materials with wire or bands.

D. Insulation Installation on Valves and Pipe Specialties:

1. Install preformed sections of same material as straight segments of pipe insulation when available.
2. When preformed sections are not available, install mitered sections of pipe insulation to valve body.
3. Arrange insulation to permit access to packing and to allow valve operation without disturbing insulation.
4. Install insulation to flanges as specified for flange insulation application.

3.8 FIELD-APPLIED JACKET INSTALLATION

- A. Where PVC jackets are indicated, install with 1-inch overlap at longitudinal seams and end joints. Seal with manufacturer's recommended adhesive.
1. Apply two continuous beads of adhesive to seams and joints, one bead under lap and the finish bead along seam and joint edge.

3.9 FINISHES

- A. Flexible Elastomeric Thermal Insulation: After adhesive has fully cured, apply two coats of insulation manufacturer's recommended protective coating.

3.10 FIELD QUALITY CONTROL

- A. Perform tests and inspections.
- B. Tests and Inspections:
1. Inspect pipe, fittings, strainers, and valves, randomly selected by Architect, by removing field-applied jacket and insulation in layers in reverse order of their installation. Extent of inspection shall be limited to three locations of straight pipe, three locations of threaded fittings, two locations of threaded strainers, three locations of threaded valves, and three locations of flanged valves for each pipe service defined in the "Piping Insulation Schedule, General" Article.
- C. All insulation applications will be considered defective Work if sample inspection reveals noncompliance with requirements.



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
 UNIVERSITY OF SOUTHERN MAINE  
 PORTLAND, MAINE

3.11 PIPING INSULATION SCHEDULE, GENERAL

- A. Acceptable preformed pipe and tubular insulation materials and thicknesses are identified for each piping system and pipe size range. If more than one material is listed for a piping system, selection from materials listed is Contractor's option.
- B. Items Not Insulated: Unless otherwise indicated, do not install insulation on the following:
  - 1. Chrome-plated pipes and fittings unless there is a potential for personnel injury.

3.12 INDOOR PIPING INSULATION SCHEDULE

- A. Domestic Cold Water:
  - 1. NPS 1 and Smaller: Insulation shall be the following:
    - a. Flexible Elastomeric: 1/2 inch thick.
  - 2. Vapor Barrier: Required.
- B. Domestic Hot Water:
  - 1. NPS 1-1/4 and Smaller Without Temperature Maintenance System: Insulation shall be the following:
    - a. Mineral-Fiber, Preformed Pipe Insulation, Type I: 1 inch thick.

| <u>Nominal Installed<br/>Pipe Size</u> | <u>Insulation<br/>Thickness</u> | <u>Nominal Pipe<br/>Insulation Size</u> |
|--|---------------------------------|---|
| 1/2"                                   | 1 inch                          | 3/4"                                    |
| 3/4"                                   | 1 inch                          | 1"                                      |
| 1"                                     | 1 inch                          | 1-1/4"                                  |
| 1-1/4"                                 | 1-1/2 inch                      | 1-1/2"                                  |
| 1-1/2"                                 | 1-1/2 inch                      | 1-1/2"                                  |

- 2. Vapor Barrier: Not Required.

3.13 INDOOR, FIELD-APPLIED JACKET SCHEDULE

- A. Install jacket over insulation material. For insulation with factory-applied jacket, install the field-applied jacket over the factory-applied jacket.
- B. If more than one material is listed, selection from materials listed is Contractor's option.
- C. Piping, Concealed:
  - 1. None.
- D. Exposed, domestic water piping in mechanical space:

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1. PVC: 20 mils thick.

END OF SECTION

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 221116 - DOMESTIC WATER PIPING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
  - 1. Aboveground domestic water pipes, tubes, and fittings inside buildings.

1.3 ACTION SUBMITTALS

- A. Submittals shall comply with the requirements of the Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. On data submittal sheets where more than one product is described, clearly annotate which product(s) is to be supplied.
- C. Product Data: Domestic water pipes, tubes, and fittings.
- D. Product Data: For transition fittings and dielectric fittings.

1.4 INFORMATIONAL SUBMITTALS

- A. Submittals shall comply with the requirements of the Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. System purging and disinfecting activities report.
- C. Field quality-control reports.

PART 2 - PRODUCTS

2.1 PIPING MATERIALS

- A. Comply with requirements in "Piping Schedule" Article for applications of pipe, tube, fitting materials, and joining methods for specific services, service locations, and pipe sizes.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- B. Potable-water piping and components shall comply with NSF 14 and NSF 61 Annex G. Plastic piping components shall be marked with "NSF-pw."
- C. Comply with NSF Standard 372 for low lead.

2.2 DUCTILE-IRON PIPE AND FITTINGS

- A. Mechanical-Joint, Ductile-Iron Pipe: AWWA C151, with mechanical-joint bell and plain spigot end unless grooved or flanged ends are indicated, with AWWA C104 cement lining and seal coating.
  - 1. Interior seal coating: bituminous paint oil cut, emulsion not acceptable, with a minimum dry film thickness of 2 mils.
  - 2. Exterior seal coating: bituminous seal coating, with a minimum dry film thickness of 2 mils.
  - 3. Mechanical-Joint, Ductile-Iron Fittings: ASTM A536, grade 70-50-05, in accordance with AWWA C153, compact pattern, Class 350
    - a. Lining: AWWA C104 cement lining or AWWA C550 and C116 fusion bonded epoxy coating with 5 mils nominal thickness.
    - b. Interior seal coating: AWWA C104 with a minimum dry film thickness of 4 mils.
    - c. Exterior seal coating: bituminous seal coating with a minimum dry film thickness of 4 mils or fusion bonded epoxy coated with a minimum nominal thickness of 5 mils per AWWA C550 and AWWA C116.
    - d. Fittings must provide adequate space for the mechanical joint and accessories to be installed without special tools (i.e. Lowell wrench can be used).
  - 4. Glands, Gaskets, and Bolts: AWWA C111, ductile- or gray-iron glands, rubber gaskets, and High Strength/Low Alloy (Cor-Ten) steel bolts and nuts.
- B. Push-on-Joint, Ductile-Iron Pipe: AWWA C151, with mechanical-joint bell and plain spigot end unless grooved or flanged ends are indicated, with AWWA C104 cement lining and seal coating.
  - 1. Interior seal coating: bituminous paint oil cut, emulsion not acceptable, with a minimum dry film thickness of 2 mils.
  - 2. Exterior seal coating: bituminous seal coating, with a minimum dry film thickness of 2 mils.
  - 3. 4 Inch through 12 Inch: Thickness Class 52.
  - 4. Gaskets: AWWA C111, rubber.
- C. Pipe and joint manufacturer shall be approved by PWD. Approved manufacturers include:
  - 1. American Cast Iron Pipe.
  - 2. Griffin Pipe.
  - 3. U.S. Pipe.
  - 4. Clow Pipe.
  - 5. McWain Pipe.
  - 6. Atlantic States Pipe.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

2.3 COPPER TUBE AND FITTINGS

- A. Hard Copper Tube: ASTM B 88, Type L water tube, drawn temper.
- B. Soft Copper Tube: ASTM B 88, Type M water tube, annealed temper.
- C. Wrought-Copper, Solder-Joint Fittings: ASME B16.22, wrought-copper pressure fittings.
- D. Bronze Flanges: ASME B16.24, Class 150, with solder-joint ends.
- E. Copper Unions:
  - 1. MSS SP-123.
  - 2. Cast-copper-alloy, hexagonal-stock body.
  - 3. Ball-and-socket, metal-to-metal seating surfaces.
  - 4. Solder-joint or threaded ends.

2.4 PEX TUBE AND FITTINGS

- A. PEX Distribution System: ASTM F 877, SDR 9 tubing.
- B. Fittings for PEX Tube: ASTM F 1807, metal insert type with copper or stainless-steel crimp rings and matching PEX tube dimensions.

2.5 PE PIPE AND FITTINGS

- A. PE, ASTM Pipe: AWWA C 901 and ASTM D 3035; with dimension ratio and PE compound number required to give pressure rating not less than 200 psig.
  - 1. Molded PE Fittings: ASTM D 3350, PE resin, socket- or butt-fusion type, made to match PE pipe dimensions and class.
- B. PE CTS Tubing: AWWA C 901 and ASTM D 2737 with working pressure rating of 200 psi.
  - 1. Compression Fittings for CTS Tubing: All brass with insert stiffeners.

2.6 DIELECTRIC FITTINGS

- A. General Requirements: Assembly of copper alloy and ferrous materials with separating nonconductive insulating material. Include end connections compatible with pipes to be joined.
- B. Dielectric Unions:
  - 1. Standard: ASSE 1079.
  - 2. Pressure Rating: 125 psig minimum at 180 deg F.
  - 3. End Connections: Solder-joint copper alloy and threaded ferrous.
- C. Dielectric Flanges:

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1. Standard: ASSE 1079.
2. Factory-fabricated, bolted, companion-flange assembly.
3. Pressure Rating: 125 psig minimum at 180 deg F.
4. End Connections: Solder-joint copper alloy and threaded ferrous; threaded solder-joint copper alloy and threaded ferrous.

D. Dielectric-Flange Insulating Kits:

1. Nonconducting materials for field assembly of companion flanges.
2. Pressure Rating: 150 psig.
3. Gasket: Neoprene or phenolic.
4. Bolt Sleeves: Phenolic or polyethylene.
5. Washers: Phenolic with steel backing washers.

E. Dielectric Nipples:

1. Standard: IAPMO PS 66.
2. Electroplated steel nipple complying with ASTM F 1545.
3. Pressure Rating and Temperature: 300 psig at 225 deg F.
4. End Connections: Male threaded or grooved.
5. Lining: Inert and noncorrosive, propylene.

PART 3 - EXECUTION

3.1 PIPING INSTALLATION

- A. Drawing plans, schematics, and diagrams indicate general location and arrangement of domestic water piping. Indicated locations and arrangements are used to size pipe and calculate friction loss, expansion, and other design considerations. Install piping as indicated unless deviations to layout are approved on coordination drawings.
- B. Install copper tubing under building slab according to CDA's "Copper Tube Handbook."
- C. Install shutoff valve immediately upstream of each dielectric fitting.
- D. Install domestic water piping level and plumb.
- E. Rough-in domestic water piping for water-meter installation according to utility company's requirements.
- F. Install piping concealed from view and protected from physical contact by building occupants unless otherwise indicated and except in equipment rooms and service areas.
- G. Install piping indicated to be exposed and piping in equipment rooms and service areas at right angles or parallel to building walls. Diagonal runs are prohibited unless specifically indicated otherwise.
- H. Install piping to permit valve servicing.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- I. Install nipples, unions, special fittings, and valves with pressure ratings the same as or higher than the system pressure rating used in applications below unless otherwise indicated.
- J. Install piping free of sags and bends.
- K. Install fittings for changes in direction and branch connections.
- L. Install PEX tubing with loop at each change of direction of more than 90 degrees.
- M. Install unions in copper tubing at final connection to each piece of equipment, machine, and specialty.
- N. Install sleeves for piping penetrations of walls, ceilings, and floors. Comply with requirements for sleeves specified in Section 220517 "Sleeves and Sleeve Seals for Plumbing Piping."
- O. Install sleeve seals for piping penetrations of concrete walls and slabs. Comply with requirements for sleeve seals specified in Section 220517 "Sleeves and Sleeve Seals for Plumbing Piping."
- P. Install escutcheons for piping penetrations of walls, ceilings, and floors. Comply with requirements for escutcheons specified in Section 220518 "Escutcheons for Plumbing Piping."

### 3.2 JOINT CONSTRUCTION

- A. Ream ends of pipes and tubes and remove burrs. Bevel plain ends of steel pipe.
- B. Remove scale, slag, dirt, and debris from inside and outside of pipes, tubes, and fittings before assembly.
- C. Soldered Joints for Copper Tubing: Apply ASTM B 813, water-flushable flux to end of tube. Join copper tube and fittings according to ASTM B 828 or CDA's "Copper Tube Handbook."
- D. Flanged Joints: Select appropriate asbestos-free, nonmetallic gasket material in size, type, and thickness suitable for domestic water service. Join flanges with gasket and bolts according to ASME B31.9.
- E. Joints for PEX Tubing: Join according to ASTM F 1807 for metal insert and copper crimp ring fittings and ASTM F 1960 for cold expansion fittings and reinforcing rings.
- F. PE Piping Compression-Fitting Joints: Use brass compression fittings according to manufacturer's written instructions.
- G. Joints for Dissimilar-Material Piping: Make joints using adapters compatible with materials of both piping systems.

### 3.3 TRANSITION FITTING INSTALLATION

- A. Install transition couplings at joints of dissimilar piping.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

3.4 DIELECTRIC FITTING INSTALLATION

- A. Install dielectric fittings in piping at connections of dissimilar metal piping and tubing.

3.5 HANGER AND SUPPORT INSTALLATION

- A. Comply with requirements for pipe hanger, support products, and installation in Section 220529 "Hangers and Supports for Plumbing Piping and Equipment."
  - 1. Vertical Piping: MSS Type 8 or 42, clamps.
  - 2. Individual, Straight, Horizontal Piping Runs:
    - a. 100 Feet and Less: MSS Type 1, adjustable, steel clevis hangers.
  - 3. Base of Vertical Piping: MSS Type 52, spring hangers.
- B. Support vertical piping and tubing at base and at each floor.
- C. Rod diameter may be reduced one size for double-rod hangers, to a minimum of 3/8 inch.
- D. Install hangers for copper tubing with the following maximum horizontal spacing and minimum rod diameters:
  - 1. NPS 3/4 and Smaller: 60 inches with 3/8-inch rod.
  - 2. NPS 1 and NPS 1-1/4: 72 inches with 3/8-inch rod.
  - 3. NPS 1-1/2 and NPS 2: 96 inches with 3/8-inch rod.
- E. Install supports for vertical copper tubing every 10 feet.
- F. Support piping and tubing not listed in this article according to MSS SP-58 and manufacturer's written instructions.

3.6 CONNECTIONS

- A. Drawings indicate general arrangement of piping, fittings, and specialties.
- B. When installing piping adjacent to equipment and machines, allow space for service and maintenance.
- C. Connect domestic water piping to exterior water-service piping. Use transition fitting to join dissimilar piping materials.
- D. Connect domestic water piping to water-service piping with shutoff valve; extend and connect to the following:
  - 1. Water Heaters: Cold-water inlet and hot-water outlet piping in sizes indicated, but not smaller than sizes of water heater connections.
  - 2. Plumbing Fixtures: Cold- and hot-water-supply piping in sizes indicated, but not smaller than that required by plumbing code.



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

3. Equipment: Cold- and hot-water-supply piping as indicated, but not smaller than equipment connections. Provide shutoff valve and union for each connection.

3.7 IDENTIFICATION

- A. Identify system components. Comply with requirements for identification materials and installation in Section 220553 "Identification for Plumbing Piping and Equipment."

3.8 FIELD QUALITY CONTROL

- A. Perform the following tests and inspections:

1. Piping Inspections:

- a. Do not enclose, cover, or put piping into operation until it has been inspected and approved by authorities having jurisdiction.
- b. During installation, notify authorities having jurisdiction at least one day before inspection must be made. Perform tests specified below in presence of authorities having jurisdiction:
  - 1) Roughing-in Inspection: Arrange for inspection of piping before concealing or closing in after roughing in and before setting fixtures.
  - 2) Final Inspection: Arrange for authorities having jurisdiction to observe tests specified in "Piping Tests" Subparagraph below and to ensure compliance with requirements.
- c. Reinspection: If authorities having jurisdiction find that piping will not pass tests or inspections, make required corrections and arrange for reinspection.
- d. Reports: Prepare inspection reports and have them signed by authorities having jurisdiction.

2. Piping Tests:

- a. Fill domestic water piping. Check components to determine that they are not air bound and that piping is full of water.
- b. Test for leaks and defects in new piping and parts of existing piping that have been altered, extended, or repaired. If testing is performed in segments, submit a separate report for each test, complete with diagram of portion of piping tested.
- c. Leave new, altered, extended, or replaced domestic water piping uncovered and unconcealed until it has been tested and approved. Expose work that was covered or concealed before it was tested.
- d. Cap and subject piping to static water pressure of 50 psig above operating pressure, without exceeding pressure rating of piping system materials. Isolate test source and allow it to stand for four hours. Leaks and loss in test pressure constitute defects that must be repaired.
- e. Repair leaks and defects with new materials, and retest piping or portion thereof until satisfactory results are obtained.
- f. Prepare reports for tests and for corrective action required.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- B. Domestic water piping will be considered defective if it does not pass tests and inspections.
- C. Prepare test and inspection reports.

3.9 ADJUSTING

- A. Perform the following adjustments before operation:
  - 1. Close drain valves, hydrants, and hose bibbs.
  - 2. Open shutoff valves to fully open position.
  - 3. Open throttling valves to proper setting.
  - 4. Adjust balancing valves in hot-water-circulation return piping to provide adequate flow.
    - a. Manually adjust ball-type balancing valves in hot-water-circulation return piping to provide hot-water flow in each branch.
    - b. Adjust calibrated balancing valves to flows indicated.
  - 5. Remove plugs used during testing of piping and for temporary sealing of piping during installation.
  - 6. Remove and clean strainer screens. Close drain valves and replace drain plugs.
  - 7. Remove filter cartridges from housings and verify that cartridges are as specified for application where used and are clean and ready for use.
  - 8. Check plumbing specialties and verify proper settings, adjustments, and operation.

3.10 CLEANING

- A. Clean and disinfect potable domestic water piping as follows:
  - 1. Purge new piping and parts of existing piping that have been altered, extended, or repaired before using.
  - 2. Use purging and disinfecting procedures prescribed by authorities having jurisdiction; if methods are not prescribed, use procedures described in either AWWA C651 or AWWA C652 or follow procedures described below:
    - a. Flush piping system with clean, potable water until dirty water does not appear at outlets.
    - b. Fill and isolate system according to either of the following:
      - 1) Fill system or part thereof with water/chlorine solution with at least 50 ppm of chlorine. Isolate with valves and allow to stand for 24 hours.
      - 2) Fill system or part thereof with water/chlorine solution with at least 200 ppm of chlorine. Isolate and allow to stand for three hours.
    - c. Flush system with clean, potable water until no chlorine is in water coming from system after the standing time.
    - d. Repeat procedures if biological examination shows contamination.
    - e. Submit water samples in sterile bottles to authorities having jurisdiction.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- B. Prepare and submit reports of purging and disinfecting activities. Include copies of water-sample approvals from authorities having jurisdiction.
- C. Clean interior of domestic water piping system. Remove dirt and debris as work progresses.

3.11 PIPING SCHEDULE

- A. Transition and special fittings with pressure ratings at least equal to piping rating may be used in applications below unless otherwise indicated.
- B. Flanges and unions may be used for aboveground piping joints unless otherwise indicated.
- C. Under-building-slab, trap primer piping, shall be the following:
  - 1. PEX tube with crimped joints.
- D. Aboveground trap primer piping shall be the following:
  - 1. Soft copper tube, ASTM B 88, Type M; cast- or wrought-copper, solder-joint fittings; and soldered joints.
- E. Aboveground domestic water piping, shall be the following:
  - 1. Hard copper tube, ASTM B 88, Type L; cast- or wrought-copper, solder-joint fittings; and soldered joints.
- F. Under-building slab, domestic water, non-potable application piping, NPS 2 and smaller, shall be the following:
  - 1. PE ASTM pipe; insert fittings for PE pipe; and clamped joints.
- G. Under-building slab, domestic water, building-service piping shall be the following:
  - 1. Mechanical-joint, ductile iron pipe; standard- or compact-pattern, mechanical-joint fittings; and mechanical joints.

3.12 VALVE SCHEDULE

- A. Drawings indicate valve types to be used. Where specific valve types are not indicated, the following requirements apply:
  - 1. Shutoff Duty: Use ball valves.
  - 2. Throttling Duty: Use ball valves.
  - 3. Drain Duty: Hose-end drain valves.
- B. Use check valves to maintain correct direction of domestic water flow to and from equipment.

END OF SECTION



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 221316 - SANITARY WASTE AND VENT PIPING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
  - 1. Pipe, tube, and fittings.
  - 2. Specialty pipe fittings.
- B. Sustainable Design Requirements: Work included in this specification shall conform to the US Green Building Council LEED requirements listed in Section 018113.23 "Sustainable Design Requirements - LEED 2009 for Schools."

1.3 ACTION SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Product Data: For each type of product. On data submittal sheets where more than one product is described, clearly annotate which product(s) is to be supplied.
- C. Piping Schedule: Identify type of material, fittings and joining method to be used for each piping application and size range.
- D. Provide piping layouts, including pipe size and insulation requirements to General Contractor for inclusion in project coordination drawings.
- E. Sustainable Design Submittals:
  - 1. **Product Data:** For adhesives, indicating VOC content.
  - 2. **Laboratory Test Reports:** For adhesives, indicating compliance with requirements for low-emitting materials.

1.4 INFORMATIONAL SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- B. Field quality-control reports.

1.5 FIELD CONDITIONS

- A. Interruption of Existing Sanitary Waste Service: Do not interrupt service to facilities occupied by Owner or others unless permitted under the following conditions and then only after arranging to provide temporary service according to requirements indicated:
  - 1. Notify Owner no fewer than seven days in advance of proposed interruption of sanitary waste service.
  - 2. Do not proceed with interruption of sanitary waste service without Owner's written permission.

PART 2 - PRODUCTS

2.1 PERFORMANCE REQUIREMENTS

- A. Components and installation shall be capable of withstanding the following minimum working pressure unless otherwise indicated:
  - 1. Soil, Waste, and Vent Piping: 10-foot head of water.
  - 2. Waste, Force-Main Piping: 50 psig.

2.2 PIPING MATERIALS

- A. Piping materials shall bear label, stamp, or other markings of specified testing agency.
- B. Comply with requirements in "Piping Schedule" Article for applications of pipe, tube, fitting materials, and joining methods for specific services, service locations, and pipe sizes.

2.3 HUBLESS, CAST-IRON SOIL PIPE AND FITTINGS

- A. Pipe and Fittings: ASTM A 888 or CISPI 301.
- B. Heavy-Duty, Hubless-Piping Couplings:
  - 1. Standards: ASTM C 1277 and ASTM C 1540.
  - 2. Description: Stainless-steel shield with stainless-steel bands and tightening devices; and ASTM C 564, rubber sleeve with integral, center pipe stop.

2.4 PVC PIPE AND FITTINGS

- A. Comply with NSF 14, "Plastics Piping Systems Components and Related Materials," for plastic piping components. Include marking with "NSF-dwv" for plastic drain, waste, and vent piping and "NSF-sewer" for plastic sewer piping.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- B. Solid-Wall PVC Pipe: ASTM D 2665, drain, waste, and vent.
- C. PVC Socket Fittings: ASTM D 2665, made to ASTM D 3311, drain, waste, and vent patterns and to fit Schedule 40 pipe.
- D. Adhesive Primer: ASTM F 656.
  - 1. Adhesive primer shall have a VOC content of 550 g/L or less.
- E. Solvent Cement: ASTM D 2564.
  - 1. Solvent cement shall have a VOC content of 510 g/L or less.

## 2.5 SPECIALTY PIPE FITTINGS

- A. Transition Couplings:
  - 1. Fitting-Type Transition Couplings: Manufactured piping coupling or specified piping system fitting.
  - 2. Unshielded, Nonpressure Transition Couplings:
    - a. Standard: ASTM C 1173.
    - b. Description: Elastomeric, sleeve-type, reducing or transition pattern. Include shear ring and corrosion-resistant-metal tension band and tightening mechanism on each end.
    - c. End Connections: Same size as and compatible with pipes to be joined.
    - d. Sleeve Materials:
      - 1) For Cast-Iron Soil Pipes: ASTM C 564, rubber.
      - 2) For Plastic Pipes: ASTM F 477, elastomeric seal or ASTM D 5926, PVC.
      - 3) For Dissimilar Pipes: ASTM D 5926, PVC or other material compatible with pipe materials being joined.

## PART 3 - EXECUTION

### 3.1 PIPING INSTALLATION

- A. Drawing plans, schematics, and diagrams and diagrammatic in nature and indicate general location and arrangement of piping systems.
  - 1. Indicated locations and arrangements were used to size pipe and calculate friction loss, expansion, pump sizing, and other design considerations.
  - 2. Install piping as indicated unless deviations to layout are approved on coordination drawings.
- B. Install piping in concealed locations unless otherwise indicated and except in equipment rooms and service areas.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- C. Install piping indicated to be exposed and piping in equipment rooms and service areas at right angles or parallel to building walls. Diagonal runs are prohibited unless specifically indicated otherwise.
- D. Install piping above accessible ceilings to allow sufficient space for ceiling panel removal.
- E. Install piping to permit valve servicing.
- F. Install piping at indicated slopes.
- G. Install piping free of sags and bends.
- H. Install fittings for changes in direction and branch connections.
- I. Install piping to allow application of insulation.
- J. Make changes in direction for soil and waste drainage and vent piping using appropriate branches, bends, and long-sweep bends.
  - 1. Sanitary tees and short-sweep 1/4 bends may be used on vertical stacks if change in direction of flow is from horizontal to vertical.
  - 2. Use long-turn, double Y-branch and 1/8-bend fittings if two fixtures are installed back to back or side by side with common drain pipe.
    - a. Straight tees, elbows, and crosses may be used on vent lines.
  - 3. Do not change direction of flow more than 90 degrees.
  - 4. Use proper size of standard increasers and reducers if pipes of different sizes are connected.
    - a. Reducing size of waste piping in direction of flow is prohibited.
- K. Lay buried building waste piping beginning at low point of each system.
  - 1. Install true to grades and alignment indicated, with unbroken continuity of invert. Place hub ends of piping upstream.
  - 2. Install required gaskets according to manufacturer's written instructions for use of lubricants, cements, and other installation requirements.
  - 3. Maintain swab in piping and pull past each joint as completed.
- L. Install soil and waste and vent piping at the following minimum slopes unless otherwise indicated:
  - 1. Building Sanitary Waste: 2 percent downward in direction of flow.
  - 2. Horizontal Sanitary Waste Piping: 2 percent downward in direction of flow.
  - 3. Vent Piping: 1 percent down toward vertical fixture vent or toward vent stack.
- M. Install cast-iron soil piping according to CISPI's "Cast Iron Soil Pipe and Fittings Handbook," Chapter IV, "Installation of Cast Iron Soil Pipe and Fittings."



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1. Install encasement on underground piping according to ASTM A 674 or AWWA C105/A 21.5.
  - N. Install aboveground PVC piping according to ASTM D 2665.
  - O. Plumbing Specialties:
    1. Install cleanouts at grade and extend to where building sanitary drains connect to building sanitary sewers in sanitary waste gravity-flow piping.
      - a. Install cleanout fitting with closure plug inside the building in sanitary drainage force-main piping.
      - b. Comply with requirements for cleanouts specified in Section 221319 "Sanitary Waste Piping Specialties."
    2. Install drains in sanitary waste gravity-flow piping.
      - a. Comply with requirements for drains specified in Section 221319 "Sanitary Waste Piping Specialties."
  - P. Do not enclose, cover, or put piping into operation until it is inspected and approved by authorities having jurisdiction.
  - Q. Install sleeves for piping penetrations of walls, ceilings, and floors.
    1. Comply with requirements for sleeves specified in Section 220517 "Sleeves and Sleeve Seals for Plumbing Piping."
  - R. Install sleeve seals for piping penetrations of concrete walls and slabs.
    1. Comply with requirements for sleeve seals specified in Section 220517 "Sleeves and Sleeve Seals for Plumbing Piping."
  - S. Install escutcheons for piping penetrations of walls, ceilings, and floors.
    1. Comply with requirements for escutcheons specified in Section 220518 "Escutcheons for Plumbing Piping."
- 3.2 JOINT CONSTRUCTION
- A. Join hubless, cast-iron soil piping according to CISPI 310 and CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for hubless-piping coupling joints.
  - B. Ream ends of pipes and tubes and remove burrs.
  - C. Remove scale, slag, dirt, and debris from inside and outside of pipe and fittings before assembly.
  - D. Threaded Joints: Thread pipe with tapered pipe threads according to ASME B1.20.1.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1. Cut threads full and clean using sharp dies.
2. Ream threaded pipe ends to remove burrs and restore full ID. Join pipe fittings and valves as follows:
  - a. Apply appropriate tape or thread compound to external pipe threads unless dry seal threading is specified.
  - b. Damaged Threads: Do not use pipe or pipe fittings with threads that are corroded or damaged.
  - c. Do not use pipe sections that have cracked or open welds.
- E. Join copper tube and fittings with soldered joints according to ASTM B 828. Use ASTM B 813, water-flushable, lead-free flux and ASTM B 32, lead-free-alloy solder.
- F. Plastic, Nonpressure-Piping, Solvent-Cement Joints: Clean and dry joining surfaces. Join pipe and fittings according to the following:
  1. Comply with ASTM F 402 for safe-handling practice of cleaners, primers, and solvent cements.
  2. ABS Piping: Join according to ASTM D 2235 and ASTM D 2661 appendixes.
  3. PVC Piping: Join according to ASTM D 2855 and ASTM D 2665 appendixes.
- G. Soldered Joints: Apply ASTM B 813, water-flushable flux, unless otherwise indicated, to tube end. Construct joints according to ASTM B 828 or CDA's "Copper Tube Handbook," using lead-free solder alloy complying with ASTM B 32.

### 3.3 SPECIALTY PIPE FITTING INSTALLATION

- A. Transition Couplings:
  1. Install transition couplings at joints of piping with small differences in ODs.

### 3.4 HANGER AND SUPPORT INSTALLATION

- A. Comply with requirements for seismic-restraint devices specified in Section 220548 "Vibration and Seismic Controls for Plumbing Piping and Equipment."
- B. Comply with requirements for pipe hanger and support devices and installation specified in Section 220529 "Hangers and Supports for Plumbing Piping and Equipment."
- C. Support horizontal piping and tubing within 12 inches of each fitting, valve, and coupling.
- D. Support vertical piping and tubing at base and at each floor.
- E. Rod diameter may be reduced one size for double-rod hangers, with 3/8-inch minimum rods.
- F. Install hangers for cast-iron soil piping with the following maximum horizontal spacing and minimum rod diameters:
  1. NPS 1-1/2 and NPS 2: 60 inches with 3/8-inch rod.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

2. NPS 3: 60 inches with 1/2-inch rod.
  3. NPS 4 and NPS 5: 60 inches with 5/8-inch rod.
- G. Install supports for vertical cast-iron soil piping every 15 feet.
- H. Install hangers for steel piping with the following maximum horizontal spacing and minimum rod diameters:
1. NPS 1-1/4: 84 inches with 3/8-inch rod.
  2. NPS 1-1/2: 108 inches with 3/8-inch rod.
  3. NPS 2: 10 feet with 3/8-inch rod.
- I. Install supports for vertical steel piping every 10 feet.
- J. Install hangers for copper tubing with the following maximum horizontal spacing and minimum rod diameters:
1. NPS 1-1/4: 72 inches with 3/8-inch rod.
  2. NPS 1-1/2 and NPS 2: 96 inches with 3/8-inch rod.
  3. NPS 2-1/2: 108 inches with 1/2-inch rod.
- K. Install supports for vertical copper tubing every 10 feet.
- L. Install hangers for PVC piping with the following maximum horizontal spacing and minimum rod diameters:
1. NPS 1-1/2 and NPS 2: 48 inches with 3/8-inch rod.
  2. NPS 3: 48 inches with 1/2-inch rod.
  3. NPS 4 and NPS 5: 48 inches with 5/8-inch rod.
- M. Install supports for vertical PVC piping every 48 inches.
- N. Support piping and tubing not listed above according to MSS SP-58 and manufacturer's written instructions.

### 3.5 CONNECTIONS

- A. Drawings indicate general arrangement of piping, fittings, and specialties.
- B. Connect soil and waste piping to exterior sanitary sewerage piping. Use transition fitting to join dissimilar piping materials.
- C. Connect waste and vent piping to the following:
1. Plumbing Fixtures: Connect waste piping in sizes indicated, but not smaller than required by plumbing code.
  2. Plumbing Fixtures and Equipment: Connect atmospheric vent piping in sizes indicated, but not smaller than required by authorities having jurisdiction.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

3. Plumbing Specialties: Connect waste and vent piping in sizes indicated, but not smaller than required by plumbing code.
  4. Install test tees (wall cleanouts) in conductors near floor and floor cleanouts with cover flush with floor.
  5. Equipment: Connect waste piping as indicated.
    - a. Provide shutoff valve if indicated and union for each connection.
    - b. Use flanges instead of unions for connections NPS 2-1/2 and larger.
- D. Where installing piping adjacent to equipment, allow space for service and maintenance of equipment.

### 3.6 IDENTIFICATION

- A. Identify exposed sanitary waste and vent piping.
- B. Comply with requirements for identification specified in Section 220553 "Identification for Plumbing Piping and Equipment."

### 3.7 FIELD QUALITY CONTROL

- A. During installation, notify authorities having jurisdiction at least 72 hours before inspection must be made. Perform tests specified below in presence of authorities having jurisdiction.
  1. Roughing-in Inspection: Arrange for inspection of piping before concealing or closing-in after roughing-in and before setting fixtures.
  2. Final Inspection: Arrange for final inspection by authorities having jurisdiction to observe tests specified below and to ensure compliance with requirements.
- B. Reinspection: If authorities having jurisdiction find that piping will not pass test or inspection, make required corrections and arrange for reinspection.
- C. Reports: Prepare inspection reports and have them signed by authorities having jurisdiction.
- D. Test sanitary waste and vent piping according to procedures of authorities having jurisdiction or, in absence of published procedures, as follows:
  1. Test for leaks and defects in new piping and parts of existing piping that have been altered, extended, or repaired.
    - a. If testing is performed in segments, submit separate report for each test, complete with diagram of portion of piping tested.
  2. Leave uncovered and unconcealed new, altered, extended, or replaced waste and vent piping until it has been tested and approved.
    - a. Expose work that was covered or concealed before it was tested.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

3. Roughing-in Plumbing Test Procedure: Test waste and vent piping except outside leaders on completion of roughing-in.
    - a. Close openings in piping system and fill with water to point of overflow, but not less than 10-foot head of water.
    - b. From 15 minutes before inspection starts to completion of inspection, water level must not drop.
    - c. Inspect joints for leaks.
  4. Finished Plumbing Test Procedure: After plumbing fixtures have been set and traps filled with water, test connections and prove they are gastight and watertight.
    - a. Plug vent-stack openings on roof and building drains where they leave building. Introduce air into piping system equal to pressure of 1-inch wg.
    - b. Use U-tube or manometer inserted in trap of water closet to measure this pressure.
    - c. Air pressure must remain constant without introducing additional air throughout period of inspection.
    - d. Inspect plumbing fixture connections for gas and water leaks.
  5. Repair leaks and defects with new materials and retest piping, or portion thereof, until satisfactory results are obtained.
  6. Prepare reports for tests and required corrective action.
- E. Test force-main piping according to procedures of authorities having jurisdiction or, in absence of published procedures, as follows:
1. Leave uncovered and unconcealed new, altered, extended, or replaced force-main piping until it has been tested and approved.
    - a. Expose work that was covered or concealed before it was tested.
  2. Cap and subject piping to static-water pressure of 50 psig above operating pressure, without exceeding pressure rating of piping system materials.
    - a. Isolate test source and allow to stand for four hours.
    - b. Leaks and loss in test pressure constitute defects that must be repaired.
  3. Repair leaks and defects with new materials and retest piping, or portion thereof, until satisfactory results are obtained.
  4. Prepare reports for tests and required corrective action.

### 3.8 CLEANING AND PROTECTION

- A. Clean interior of piping. Remove dirt and debris as work progresses.
- B. Protect sanitary waste and vent piping during remainder of construction period to avoid clogging with dirt and debris and to prevent damage from traffic and construction work.
- C. Place plugs in ends of uncompleted piping at end of day and when work stops.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- D. Exposed PVC Piping: Protect plumbing vents exposed to sunlight with two coats of water-based latex paint.
- E. Repair damage to adjacent materials caused by waste and vent piping installation.

3.9 PIPING SCHEDULE

- A. Flanges and unions may be used on aboveground pressure piping unless otherwise indicated.
- B. Aboveground, soil and waste piping shall be the following:
  - 1. Hubless, cast-iron soil pipe and fittings; heavy-duty hubless-piping couplings; and coupled joints.
- C. Aboveground, vent piping shall be the following:
  - 1. Hubless, cast-iron soil pipe and fittings; heavy-duty hubless-piping couplings; and coupled joints.
- D. Underground, soil, waste, and vent piping shall be the following:
  - 1. Hubless, cast-iron soil pipe and fittings; heavy-duty hubless-piping couplings; and coupled joints.
  - 2. Dissimilar Pipe-Material Couplings: Nonpressure transition couplings.

END OF SECTION

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 221319 - SANITARY WASTE PIPING SPECIALTIES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:

- 1. Cleanouts.

1.3 ACTION SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Product Data: For each type of product. Include rated capacities, operating characteristics, and accessories. On data submittal sheets where more than one product is described, clearly annotate which product(s) is to be supplied.

PART 2 - PRODUCTS

2.1 ASSEMBLY DESCRIPTIONS

- A. Sanitary waste piping specialties shall bear label, stamp, or other markings of specified testing agency.
- B. Comply with NSF 14 for plastic sanitary waste piping specialty components.

2.2 CLEANOUTS

- A. Cast-Iron Exposed Cleanouts (CO):
  - 1. Standard: ASME A112.36.2M.
  - 2. Size: Same as connected drainage piping
  - 3. Body Material: As required to match connected piping.
  - 4. Closure: Countersunk, brass plug.
  - 5. Closure Plug Size: Same as or not more than one size smaller than cleanout size.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

B. Cast-Iron Exposed Floor Cleanouts (FCO):

1. Standard: ASME A112.36.2M.
2. Size: Same as connected branch.
3. Type: Threaded, adjustable housing.
4. Body or Ferrule: Cast iron.
5. Closure: Brass plug with tapered threads.
6. Adjustable Housing Material: Cast iron with threads.
7. Frame and Cover Material and Finish: Polished bronze.
8. Frame and Cover Shape: Round.
9. Top Loading Classification: Light Duty.
10. Riser: ASTM A 74, Service class, cast-iron drainage pipe fitting and riser to cleanout.

C. Cast-Iron Wall Cleanouts (WCO):

1. Standard: ASME A112.36.2M. Include wall access.
2. Size: Same as connected drainage piping.
3. Body: As required to match connected piping.
4. Closure Plug:
  - a. Brass.
  - b. Countersunk head.
  - c. Drilled and threaded for cover attachment screw.
  - d. Size: Same as or not more than one size smaller than cleanout size.
5. Wall Access: Round, flat, chrome-plated brass or stainless steel cover plate with screw.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install cleanouts in aboveground piping and building drain piping according to the following, unless otherwise indicated:
1. Size same as drainage piping up to NPS 4. Use NPS 4 for larger drainage piping unless larger cleanout is indicated.
  2. Locate at each change in direction of piping greater than 45 degrees.
  3. Locate at minimum intervals of 50 feet for piping NPS 4 and smaller and 100 feet for larger piping.
  4. Locate at base of each vertical soil and waste stack.
- B. For floor cleanouts for piping below floors, install cleanout deck plates with top flush with finished floor.
- C. For cleanouts located in concealed piping, install cleanout wall access covers, of types indicated, with frame and cover flush with finished wall.
- D. Install deep-seal traps on floor drains and other waste outlets, if indicated.



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- E. Install floor-drain, trap-seal primer fittings on inlet to floor drains that require trap-seal primer connection.
  - 1. Exception: Fitting may be omitted if trap has trap-seal primer connection.
  - 2. Size: Same as floor drain inlet.
- F. Install air-gap fittings on draining-type backflow preventers and on indirect-waste piping discharge into sanitary drainage system.
- G. Install sleeve and sleeve seals with each riser and stack passing through floors with waterproof membrane.
- H. Install traps on plumbing specialty drain outlets. Omit traps on indirect wastes unless trap is indicated.

### 3.2 CONNECTIONS

- A. Comply with requirements in Section 221316 "Sanitary Waste and Vent Piping" for piping installation requirements. Drawings indicate general arrangement of piping, fittings, and specialties.
- B. Install piping adjacent to equipment to allow service and maintenance.

### 3.3 PROTECTION

- A. Protect drains during remainder of construction period to avoid clogging with dirt or debris and to prevent damage from traffic or construction work.
- B. Place plugs in ends of uncompleted piping at end of each day or when work stops.

END OF SECTION



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 221319.13 - SANITARY DRAINS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:

- 1. Foot bath drains.

1.3 ACTION SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Product Data: For each type of product. On data submittal sheets where more than one product is described, clearly annotate which product(s) is to be supplied.

PART 2 - PRODUCTS

2.1 DRAIN ASSEMBLIES

- A. Sanitary drains shall bear label, stamp, or other markings of specified testing agency.

2.2 FOOT BATH

- A. Acrylic Foot Bath (FB):

- 1. **Basis-of-Design Product:** Subject to compliance with requirements, provide Zurn Industries, LLC's product scheduled on Drawings or comparable product by one of the following:
  - a. **WuduMate-M.**
- 2. Body Material: White sanitary-grade reinforced acrylic.
- 3. Anchor Flange: Required.
- 4. Outlet: Bottom.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install foot bath drain at low points of surface areas to be drained.
  - 1. Position drains for easy access and maintenance.
  - 2. Install individual traps for floor drains connected to sanitary building drain, unless otherwise indicated.

3.2 CONNECTIONS

- A. Comply with requirements in Section 221316 "Sanitary Waste and Vent Piping" for piping installation requirements. Drawings indicate general arrangement of piping, fittings, and specialties.
- B. Install piping adjacent to equipment to allow service and maintenance.

3.3 PROTECTION

- A. Protect drains during remainder of construction period to avoid clogging with dirt or debris and to prevent damage from traffic or construction work.
- B. Place plugs in ends of uncompleted piping at end of each day or when work stops.

END OF SECTION

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 224213.13 - COMMERCIAL WATER CLOSETS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:

1. Water closets.
2. Flushometer valves.
3. Toilet seats.
4. Supports.

1.3 ACTION SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Product Data: For each type of product. On data submittal sheets where more than one product is described, clearly annotate which product(s) is to be supplied.
  1. Include construction details, material descriptions, dimensions of individual components and profiles, and finishes for water closets.
  2. Include rated capacities, operating characteristics, electrical characteristics, and furnished specialties and accessories.

1.4 CLOSEOUT SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Operation and Maintenance Data: For flushometer valves to include in operation and maintenance manuals.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

PART 2 - PRODUCTS

2.1 WALL-MOUNTED WATER CLOSETS

A. Water Closets (WC-1): Wall mounted, top spud, accessible.

1. Basis-of-Design Product: Subject to compliance with requirements, provide Kohler Kingston Model K-4325 or a comparable product by one of the following:
  - a. American Standard America.
  - b. Crane Plumbing, L.L.C.
  - c. Zurn Industries, LLC.
2. Bowl:
  - a. Standards: ASME A112.19.2/CSA B45.1 and ASME A112.19.5.
  - b. Material: Vitreous china.
  - c. Type: Siphon jet.
  - d. Style: Flushometer valve.
  - e. Rim Contour: Elongated.
  - f. Water Consumption: 1.28 gal. per flush.
  - g. Spud Size and Location: NPS 1-1/2; top.
3. Flushometer Valve: WC.
4. Toilet Seat: WC.
5. Support: Water closet carrier.
6. Water-Closet Mounting Height: Handicapped/elderly according to ICG/ANSI A 117.1 for WC-1; standard for WC-2; child accessible for WC-3.

2.2 FLUSHOMETER VALVES

A. Lever-Handle, Diaphragm Flushometer Valves (WC):

1. Basis-of-Design Product: Subject to compliance with requirements, provide Sloan Royal Model 111-1.28 or a comparable product by the following:
  - a. Zurn Industries, LLC.
2. Standard: ASSE 1037.
3. Minimum Pressure Rating: 125 psig.
4. Features: Include integral check stop and backflow-prevention device.
5. Material: Brass body with corrosion-resistant components.
6. Exposed Flushometer-Valve Finish: Chrome plated.
7. Consumption: 1.28 gal. per flush, maximum.
8. Minimum Inlet: NPS 1.
9. Minimum Outlet: NPS 1-1/4.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

2.3 TOILET SEATS

A. Toilet Seats (WC):

1. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
  - a. Bemis Manufacturing Company.
  - b. Church Seats.
  - c. Olsonite Corp.
2. Standard: IAPMO/ANSI Z124.5.
3. Material: Plastic.
4. Type: Commercial (Heavy duty).
5. Shape: Elongated rim, open front.
6. Hinge: Check.
7. Hinge Material: Noncorroding metal.
8. Seat Cover: Not required.
9. Color: White.

2.4 SUPPORTS

A. Water Closet Carrier:

1. Standard: ASME A112.6.1M.
2. Description: Waste-fitting assembly, as required to match drainage piping material and arrangement with faceplates, couplings gaskets, and feet; bolts and hardware matching fixture.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine roughing-in of water supply and sanitary drainage and vent piping systems to verify actual locations of piping connections before water-closet installation.
- B. Examine walls and floors for suitable conditions where water closets will be installed.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 INSTALLATION

A. Water-Closet Installation:

1. Install level and plumb according to roughing-in drawings.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

2. Install accessible, wall-mounted water closets at mounting height for handicapped/elderly, according to ICC/ANSI A117.1.

B. Support Installation:

1. Install supports, affixed to building substrate, for wall-mounted, back-outlet water closets.
2. Use carrier supports with waste-fitting assembly and seal.
3. Install wall-mounted, back-outlet water-closet supports with waste-fitting assembly and waste-fitting seals; and affix to building substrate.

C. Flushometer-Valve Installation:

1. Install flushometer-valve, water-supply fitting on each supply to each water closet.
2. Attach supply piping to supports or substrate within pipe spaces behind fixtures.
3. Install lever-handle flushometer valves for accessible water closets with handle mounted on open side of water closet.
4. Install actuators in locations that are easy for children and people with disabilities to reach.

D. Install toilet seats on water closets.

E. Wall Flange and Escutcheon Installation:

1. Install wall flanges or escutcheons at piping wall penetrations in exposed, finished locations and within cabinets and millwork.
2. Install deep-pattern escutcheons if required to conceal protruding fittings.
3. Comply with escutcheon requirements specified in Section 220518 "Escutcheons for Plumbing Piping."

F. Joint Sealing:

1. Seal joints between water closets and walls and floors using sanitary-type, one-part, mildew-resistant silicone sealant.
2. Match sealant color to water-closet color.
3. Comply with sealant requirements specified in Section 079200 "Joint Sealants."

### 3.3 CONNECTIONS

- A. Connect water closets with water supplies and soil, waste, and vent piping. Use size fittings required to match water closets.
- B. Comply with water piping requirements specified in Section 221116 "Domestic Water Piping."
- C. Comply with soil and waste piping requirements specified in Section 221316 "Sanitary Waste and Vent Piping."
- D. Where installing piping adjacent to water closets, allow space for service and maintenance.



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

3.4 ADJUSTING

- A. Operate and adjust water closets and controls. Replace damaged and malfunctioning water closets, fittings, and controls.
- B. Adjust water pressure at flushometer valves to produce proper flow.

3.5 CLEANING AND PROTECTION

- A. Clean water closets and fittings with manufacturers' recommended cleaning methods and materials.
- B. Install protective covering for installed water closets and fittings.
- C. Do not allow use of water closets for temporary facilities unless approved in writing by Owner.

END OF SECTION



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 224216.13 - COMMERCIAL LAVATORIES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
  - 1. Lavatories.
  - 2. Faucets.
  - 3. Supports.

1.3 ACTION SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Product Data: For each type of product. On data submittal sheets where more than one product is described, clearly annotate which product(s) is to be supplied.
  - 1. Include construction details, material descriptions, dimensions of individual components and profiles, and finishes for lavatories.
  - 2. Include rated capacities, operating characteristics, electrical characteristics, and furnished specialties and accessories.

1.4 CLOSEOUT SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Operation and Maintenance Data: For lavatories and faucets to include in operation and maintenance manuals.

1.5 MAINTENANCE MATERIAL SUBMITTALS

- A. Furnish extra materials that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1. Faucet Washers and O-Rings: Equal to 10 percent of amount of each type and size installed.
2. Faucet Cartridges and O-Rings: Equal to 10 percent of amount of each type and size installed.

PART 2 - PRODUCTS

2.1 LAVATORIES

A. Lavatories, L-1:

1. Basis-of-Design Product: Subject to compliance with requirements, provide Kohler Model Kingston K-2005 or a comparable product by one of the following:
  - a. American Standard.
  - b. Crane Plumbing, L.L.C./Fiat Products.
  - c. Eljer.
  - d. TOTO USA, Inc.
  - e. Zurn.
2. Description: Accessible, wall mounting, vitreous-china fixture.
  - a. Type: Self draining deck with integral back and side shields.
  - b. Faucet Hole Punching: One hole.
  - c. Faucet Hole Location: Top.
  - d. Color: White.
  - e. Faucet: Lavatory L-1/2.
  - f. Supplies: NPS 3/8 chrome-plated copper with stops.
  - g. Drain: See faucet.
    - 1) Location: Near back of bowl.
  - h. Protective Shielding Guard(s): L-1.
  - i. Fixture Support: Type II, concealed-arm lavatory carrier. Include rectangular steel uprights with integral welded feet.

2.2 SOLID-BRASS, MANUALLY OPERATED FAUCETS

- A. NSF Standard: Comply with NSF/ANSI 61 Annex G, "Drinking Water System Components - Health Effects," for faucet materials that will be in contact with potable water.
- B. Lavatory Faucets L-1/2: Manual-type, solid-brass valve.
  1. Basis-of-Design Product: Subject to compliance with requirements, provide Moen Model 8413F03 or a comparable approved product.
  2. Standard: ASME A112.18.1/CSA B125.1.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

3. General: Include hot- and cold-water indicators; coordinate faucet inlets with supplies and fixture hole punchings; coordinate outlet with spout and fixture receptor.
4. Body Material: Commercial, solid brass.
5. Finish: Polished chrome plate.
6. Maximum Flow Rate: 0.35 gpm.
7. Centers: 4-inch.
8. Mounting Type: Deck, exposed.
9. Valve Handle: Single lever.
10. Inlets: NPS 3/8 tubing, plain end.
11. Spout: Rigid type.
12. Spout Outlet: Aerator.
13. Drain: Grid strainer.

### 2.3 SUPPLY FITTINGS

- A. NSF Standard: Comply with NSF/ANSI 61 Annex G, "Drinking Water System Components - Health Effects," for supply-fitting materials that will be in contact with potable water.
- B. Standard: ASME A112.18.1/CSA B125.1.
- C. Supply Piping: Chrome-plated-brass pipe or chrome-plated copper tube matching water-supply piping size. Include chrome-plated-brass or stainless-steel wall flange.
- D. Supply Stops: Chrome-plated-brass, one-quarter-turn, ball-type or compression valve with inlet connection matching supply piping.
- E. Operation: Loose key.

### 2.4 WASTE FITTINGS

- A. Standard: ASME A112.18.2/CSA B125.2.
- B. Drain: Grid type with NPS 1-1/4 offset and straight tailpiece.
- C. Trap:
  1. Size: NPS 1-1/2 by NPS 1-1/4.
  2. Material: Chrome-plated, two-piece, cast-brass trap and ground-joint swivel elbow with 0.032-inch- thick brass tube to wall; and chrome-plated, brass or steel wall flange.
  3. Material: Stainless-steel, two-piece trap and swivel elbow with 0.012-inch- thick stainless-steel tube to wall; and stainless-steel wall flange.

### 2.5 PROTECTIVE SHIELDING GUARDS

- A. Protective Shielding Pipe and Trap Protectors, L-1:

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
    - a. McGuire Manufacturing Co., Inc.
    - b. Plumberex Specialty Products Inc.
    - c. TCI Products.
    - d. TRUEBRO, Inc.
  2. Description: Manufactured plastic wraps for covering plumbing fixture hot- and cold-water supplies and trap and drain piping. Comply with Americans with Disabilities Act (ADA) requirements.
- B. Protective Shielding Pipe and Trap Protectors, L-1:
1. Architectural skirt board trim. Refer to casework and countertop details on drawings.

### PART 3 - EXECUTION

#### 3.1 EXAMINATION

- A. Examine roughing-in of water supply and sanitary drainage and vent piping systems to verify actual locations of piping connections before lavatory installation.
- B. Examine counters and walls for suitable conditions where lavatories will be installed.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

#### 3.2 INSTALLATION

- A. Install lavatories level and plumb according to roughing-in drawings.
- B. Install supports, affixed to building substrate, for wall-mounted lavatories.
- C. Install accessible wall-mounted lavatories at handicapped/elderly mounting height for people with disabilities or the elderly, according to ICC/ANSI A117.1.
- D. Install wall flanges or escutcheons at piping wall penetrations in exposed, finished locations. Use deep-pattern escutcheons if required to conceal protruding fittings. Comply with escutcheon requirements specified in Section 220518 "Escutcheons for Plumbing Piping."
- E. Seal joints between lavatories, counters, and walls using sanitary-type, one-part, mildew-resistant silicone sealant. Match sealant color to fixture color. Comply with sealant requirements specified in Section 079200 "Joint Sealants."
- F. Install protective shielding pipe covers and enclosures on exposed supplies and waste piping of accessible lavatories.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

3.3 CONNECTIONS

- A. Connect fixtures with water supplies, stops, and risers, and with traps, soil, waste, and vent piping. Use size fittings required to match fixtures.
- B. Comply with water piping requirements specified in Section 221116 "Domestic Water Piping."
- C. Comply with soil and waste piping requirements specified in Section 221316 "Sanitary Waste and Vent Piping."

3.4 ADJUSTING

- A. Operate and adjust lavatories and controls. Replace damaged and malfunctioning lavatories, fittings, and controls.
- B. Adjust water pressure at faucets to produce proper flow.

3.5 CLEANING AND PROTECTION

- A. After completing installation of lavatories, inspect and repair damaged finishes.
- B. Clean lavatories, faucets, and other fittings with manufacturers' recommended cleaning methods and materials.
- C. Provide protective covering for installed lavatories and fittings.
- D. Do not allow use of lavatories for temporary facilities unless approved in writing by Owner.

END OF SECTION





SECTION 230513 - COMMON MOTOR REQUIREMENTS FOR HVAC EQUIPMENT

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes general requirements for single-phase and polyphase, general-purpose, horizontal, small and medium, squirrel-cage induction motors for use on ac power systems up to 600 V and installed at equipment manufacturer's factory or shipped separately by equipment manufacturer for field installation.

1.3 COORDINATION

- A. Coordinate features of motors, installed units, and accessory devices to be compatible with the following:
  - 1. Motor controllers.
  - 2. Torque, speed, and horsepower requirements of the load.
  - 3. Ratings and characteristics of supply circuit and required control sequence.
  - 4. Ambient and environmental conditions of installation location.

PART 2 - PRODUCTS

2.1 GENERAL MOTOR REQUIREMENTS

- A. Comply with NEMA MG 1 unless otherwise indicated.
- B. Comply with IEEE 841 for severe-duty motors.

2.2 MOTOR CHARACTERISTICS

- A. Duty: Continuous duty at ambient temperature of 40 deg C and at altitude of 3300 feet above sea level.
- B. Capacity and Torque Characteristics: Sufficient to start, accelerate, and operate connected loads at designated speeds, at installed altitude and environment, with indicated operating sequence, and without exceeding nameplate ratings or considering service factor.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

2.3 POLYPHASE MOTORS

- A. Description: NEMA MG 1, Design B, medium induction motor.
- B. Efficiency: Premium efficiency.
- C. Service Factor: 1.15.
- D. Rotor: Random-wound, squirrel cage.
- E. Bearings: Regreasable, shielded, antifriction ball bearings suitable for radial and thrust loading.
- F. Temperature Rise: Match insulation rating.
- G. Insulation: Class F.
- H. Code Letter Designation:
  - 1. Motors Smaller than 15 HP: Manufacturer's standard starting characteristic.
- I. Enclosure Material: Cast iron for motor frame sizes 324T and larger; rolled steel for motor frame sizes smaller than 324T.

2.4 SINGLE-PHASE MOTORS

- A. Motors larger than 1/20 hp shall be one of the following, to suit starting torque and requirements of specific motor application:
  - 1. Permanent-split capacitor.
  - 2. Split phase.
  - 3. Capacitor start, inductor run.
  - 4. Capacitor start, capacitor run.
- B. Multispeed Motors: Variable-torque, permanent-split-capacitor type.
- C. Bearings: Prelubricated, antifriction ball bearings or sleeve bearings suitable for radial and thrust loading.
- D. Motors 1/20 HP and Smaller: Shaded-pole type.
- E. Thermal Protection: Internal protection to automatically open power supply circuit to motor when winding temperature exceeds a safe value calibrated to temperature rating of motor insulation. Thermal-protection device shall automatically reset when motor temperature returns to normal range.

PART 3 - EXECUTION (Not Applicable)

END OF SECTION

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 230593 - TESTING, ADJUSTING, AND BALANCING FOR HVAC

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. The Testing, Adjusting, and Balancing agent shall be contracted directly with the Owner. Refer to Section 019500 "Testing, Adjusting, and Balancing."

END OF SECTION



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 230713 - DUCT INSULATION

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes insulating the following duct services:
  - 1. Indoor supply air.

1.3 ACTION SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Product Data: For each type of product indicated. Include thermal conductivity, water-vapor permeance thickness, and jackets (both factory- and field-applied if any). On data submittal sheets where more than one product is described, clearly annotate which product(s) is to be supplied.

1.4 INFORMATIONAL SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Qualification Data: For qualified Installer.
- C. Material Test Reports: From a qualified testing agency acceptable to authorities having jurisdiction indicating, interpreting, and certifying test results for compliance of insulation materials, sealers, attachments, cements, and jackets, with requirements indicated. Include dates of tests and test methods employed.
- D. Field quality-control reports.

1.5 QUALITY ASSURANCE

- A. Installer Qualifications: Skilled mechanics who have successfully completed an apprenticeship program or another craft training program certified by the Department of Labor, Bureau of Apprenticeship and Training.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- B. Surface-Burning Characteristics: For insulation and related materials, as determined by testing identical products according to ASTM E 84, by a testing agency acceptable to authorities having jurisdiction. Factory label insulation and jacket materials and adhesive, mastic, tapes, and cement material containers, with appropriate markings of applicable testing agency.
  - 1. Insulation Installed Indoors: Flame-spread index of 25 or less, and smoke-developed index of 50 or less.
  - 2. Insulation Installed Outdoors: Flame-spread index of 75 or less, and smoke-developed index of 150 or less.

#### 1.6 DELIVERY, STORAGE, AND HANDLING

- A. Packaging: Insulation material containers shall be marked by manufacturer with appropriate ASTM standard designation, type and grade, and maximum use temperature.

#### 1.7 COORDINATION

- A. Coordinate sizes and locations of supports, hangers, and insulation shields specified in Section 230529 "Hangers and Supports for HVAC Piping and Equipment."
- B. Coordinate clearance requirements with duct Installer for duct insulation application. Before preparing ductwork Shop Drawings, establish and maintain clearance requirements for installation of insulation and field-applied jackets and finishes and for space required for maintenance.

#### 1.8 SCHEDULING

- A. Schedule insulation application after pressure testing systems and, where required, after installing and testing heat tracing. Insulation application may begin on segments that have satisfactory test results.
- B. Complete installation and concealment of plastic materials as rapidly as possible in each area of construction.

### PART 2 - PRODUCTS

#### 2.1 INSULATION MATERIALS

- A. Comply with requirements in "Duct Insulation Schedule, General," "Indoor Duct and Plenum Insulation Schedule," and "Aboveground, Outdoor Duct and Plenum Insulation Schedule" articles for where insulating materials shall be applied.
- B. Products shall not contain asbestos, lead, mercury, or mercury compounds.
- C. Products that come in contact with stainless steel shall have a leachable chloride content of less than 50 ppm when tested according to ASTM C 871.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- D. Insulation materials for use on austenitic stainless steel shall be qualified as acceptable according to ASTM C 795.
- E. Foam insulation materials shall not use CFC or HCFC blowing agents in the manufacturing process.
- F. Mineral-Fiber Blanket Insulation: Mineral or glass fibers bonded with a thermosetting resin. Comply with ASTM C 553, Type II and ASTM C 1290, Type III with factory-applied FSK jacket. Factory-applied jacket requirements are specified in "Factory-Applied Jackets" Article.
- G. Mineral-Fiber Board Insulation: Mineral or glass fibers bonded with a thermosetting resin. Comply with ASTM C 612, Type IA or Type IB. For duct and plenum applications, provide insulation with factory-applied ASJ. Factory-applied jacket requirements are specified in "Factory-Applied Jackets" Article.

## 2.2 ADHESIVES

- A. Materials shall be compatible with insulation materials, jackets, and substrates and for bonding insulation to itself and to surfaces to be insulated unless otherwise indicated.
- B. Mineral-Fiber Adhesive: Comply with MIL-A-3316C, Class 2, Grade A.
- C. ASJ Adhesive, and FSK Jacket Adhesive: Comply with MIL-A-3316C, Class 2, Grade A for bonding insulation jacket lap seams and joints.
- D. PVC Jacket Adhesive: Compatible with PVC jacket.

## 2.3 MASTICS

- A. Materials shall be compatible with insulation materials, jackets, and substrates; comply with MIL-PRF-19565C, Type II.
- B. Vapor-Barrier Mastic: Water based; suitable for indoor use on below ambient services.
  - 1. Water-Vapor Permeance: ASTM E 96/E 96M, Procedure B, 0.013 perm at 43-mil dry film thickness.
  - 2. Service Temperature Range: Minus 20 to plus 180 deg F.
  - 3. Solids Content: ASTM D 1644, 58 percent by volume and 70 percent by weight.
  - 4. Color: White.
- C. Breather Mastic: Water based; suitable for indoor and outdoor use on above ambient services.
  - 1. Water-Vapor Permeance: ASTM F 1249, 1.8 perms at 0.0625-inch dry film thickness.
  - 2. Service Temperature Range: Minus 20 to plus 180 deg F.
  - 3. Solids Content: 60 percent by volume and 66 percent by weight.
  - 4. Color: White.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

2.4 LAGGING ADHESIVES

- A. Description: Comply with MIL-A-3316C, Class I, Grade A and shall be compatible with insulation materials, jackets, and substrates.
  - 1. Fire-resistant, water-based lagging adhesive and coating for use indoors to adhere fire-resistant lagging cloths over duct insulation.
  - 2. Service Temperature Range: 0 to plus 180 deg F.
  - 3. Color: White.

2.5 SEALANTS

- A. FSK and Metal Jacket Flashing Sealants:
  - 1. Materials shall be compatible with insulation materials, jackets, and substrates.
  - 2. Fire- and water-resistant, flexible, elastomeric sealant.
  - 3. Service Temperature Range: Minus 40 to plus 250 deg F.
  - 4. Color: Aluminum.
- B. ASJ Flashing Sealants, and Vinyl and PVC Jacket Flashing Sealants:
  - 1. Materials shall be compatible with insulation materials, jackets, and substrates.
  - 2. Fire- and water-resistant, flexible, elastomeric sealant.
  - 3. Service Temperature Range: Minus 40 to plus 250 deg F.
  - 4. Color: White.

2.6 FACTORY-APPLIED JACKETS

- A. Insulation system schedules indicate factory-applied jackets on various applications. When factory-applied jackets are indicated, comply with the following:
  - 1. ASJ: White, kraft-paper, fiberglass-reinforced scrim with aluminum-foil backing; complying with ASTM C 1136, Type I.
  - 2. ASJ-SSL: ASJ with self-sealing, pressure-sensitive, acrylic-based adhesive covered by a removable protective strip; complying with ASTM C 1136, Type I.
  - 3. FSK Jacket: Aluminum-foil, fiberglass-reinforced scrim with kraft-paper backing; complying with ASTM C 1136, Type II.

2.7 TAPES

- A. ASJ Tape: White vapor-retarder tape matching factory-applied jacket with acrylic adhesive, complying with ASTM C 1136.
  - 1. Width: 3 inches.
  - 2. Thickness: 11.5 mils.
  - 3. Adhesion: 90 ounces force/inch in width.
  - 4. Elongation: 2 percent.



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

5. Tensile Strength: 40 lbf/inch in width.
  6. ASJ Tape Disks and Squares: Precut disks or squares of ASJ tape.
- B. FSK Tape: Foil-face, vapor-retarder tape matching factory-applied jacket with acrylic adhesive; complying with ASTM C 1136.
1. Width: 3 inches.
  2. Thickness: 6.5 mils.
  3. Adhesion: 90 ounces force/inch in width.
  4. Elongation: 2 percent.
  5. Tensile Strength: 40 lbf/inch in width.
  6. FSK Tape Disks and Squares: Precut disks or squares of FSK tape.

## 2.8 SECUREMENTS

A. Bands:

1. Aluminum: ASTM B 209, Alloy 3003, 3005, 3105, or 5005; Temper H-14, 0.020 inch thick, 1/2 inch wide with wing seal or closed seal.
2. Springs: Twin spring set constructed of stainless steel with ends flat and slotted to accept metal bands. Spring size determined by manufacturer for application.

B. Insulation Pins and Hangers:

1. Cupped-Head, Capacitor-Discharge-Weld Pins: Copper- or zinc-coated steel pin, fully annealed for capacitor-discharge welding, 0.106-inch-diameter shank, length to suit depth of insulation indicated with integral 1-1/2-inch galvanized carbon-steel washer.
2. Metal, Adhesively Attached, Perforated-Base Insulation Hangers: Baseplate welded to projecting spindle that is capable of holding insulation, of thickness indicated, securely in position indicated when self-locking washer is in place. Comply with the following requirements:
  - a. Baseplate: Perforated, galvanized carbon-steel sheet, 0.030 inch thick by 2 inches square.
  - b. Spindle: Copper- or zinc-coated, low-carbon steel, fully annealed, 0.106-inch-diameter shank, length to suit depth of insulation indicated.
  - c. Adhesive: Recommended by hanger manufacturer. Product with demonstrated capability to bond insulation hanger securely to substrates indicated without damaging insulation, hangers, and substrates.
3. Insulation-Retaining Washers: Self-locking washers formed from 0.016-inch- thick, galvanized-steel sheet, with beveled edge sized as required to hold insulation securely in place but not less than 1-1/2 inches in diameter.
  - a. Protect ends with capped self-locking washers incorporating a spring steel insert to ensure permanent retention of cap in exposed locations.

C. Staples: Outward-clinching insulation staples, nominal 3/4-inch- wide, stainless steel or Monel.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- D. Wire: 0.062-inch soft-annealed, stainless steel.

2.9 CORNER ANGLES

- A. PVC Corner Angles: 30 mils thick, minimum 1 by 1 inch, PVC according to ASTM D 1784, Class 16354-C. White or color-coded to match adjacent surface.
- B. Aluminum Corner Angles: 0.040 inch thick, minimum 1 by 1 inch, aluminum according to ASTM B 209, Alloy 3003, 3005, 3105, or 5005; Temper H-14.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine substrates and conditions for compliance with requirements for installation tolerances and other conditions affecting performance of insulation application.
  - 1. Verify that systems to be insulated have been tested and are free of defects.
  - 2. Verify that surfaces to be insulated are clean and dry.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 PREPARATION

- A. Surface Preparation: Clean and dry surfaces to receive insulation. Remove materials that will adversely affect insulation application.

3.3 GENERAL INSTALLATION REQUIREMENTS

- A. Install insulation materials, accessories, and finishes with smooth, straight, and even surfaces; free of voids throughout the length of ducts and fittings.
- B. Install insulation materials, vapor barriers or retarders, jackets, and thicknesses required for each item of duct system as specified in insulation system schedules.
- C. Install accessories compatible with insulation materials and suitable for the service. Install accessories that do not corrode, soften, or otherwise attack insulation or jacket in either wet or dry state.
- D. Install insulation with longitudinal seams at top and bottom of horizontal runs.
- E. Install multiple layers of insulation with longitudinal and end seams staggered.
- F. Keep insulation materials dry during application and finishing.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- G. Install insulation with tight longitudinal seams and end joints. Bond seams and joints with adhesive recommended by insulation material manufacturer.
- H. Install insulation with least number of joints practical.
- I. Where vapor barrier is indicated, seal joints, seams, and penetrations in insulation at hangers, supports, anchors, and other projections with vapor-barrier mastic.
  - 1. Install insulation continuously through hangers and around anchor attachments.
  - 2. For insulation application where vapor barriers are indicated, extend insulation on anchor legs from point of attachment to supported item to point of attachment to structure. Taper and seal ends at attachment to structure with vapor-barrier mastic.
  - 3. Install insert materials and install insulation to tightly join the insert. Seal insulation to insulation inserts with adhesive or sealing compound recommended by insulation material manufacturer.
- J. Apply adhesives, mastics, and sealants at manufacturer's recommended coverage rate and wet and dry film thicknesses.
- K. Install insulation with factory-applied jackets as follows:
  - 1. Draw jacket tight and smooth.
  - 2. Cover circumferential joints with 3-inch- wide strips, of same material as insulation jacket. Secure strips with adhesive and outward clinching staples along both edges of strip, spaced 4 inches o.c.
  - 3. Overlap jacket longitudinal seams at least 1-1/2 inches. Clean and dry surface to receive self-sealing lap. Staple laps with outward clinching staples along edge at 2 inches o.c.
    - a. For below ambient services, apply vapor-barrier mastic over staples.
  - 4. Cover joints and seams with tape, according to insulation material manufacturer's written instructions, to maintain vapor seal.
  - 5. Where vapor barriers are indicated, apply vapor-barrier mastic on seams and joints and at ends adjacent to duct flanges and fittings.
- L. Cut insulation in a manner to avoid compressing insulation more than 75 percent of its nominal thickness.
- M. Finish installation with systems at operating conditions. Repair joint separations and cracking due to thermal movement.
- N. Repair damaged insulation facings by applying same facing material over damaged areas. Extend patches at least 4 inches beyond damaged areas. Adhere, staple, and seal patches similar to butt joints.
- O. Insulation Installation at Interior Wall and Partition Penetrations (That Are Not Fire Rated): Install insulation continuously through walls and partitions.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

3.4 INSTALLATION OF MINERAL-FIBER INSULATION

- A. Blanket Insulation Installation on Ducts and Plenums: Secure with adhesive and insulation pins.
1. Apply adhesives according to manufacturer's recommended coverage rates per unit area, for 100 percent coverage of duct and plenum surfaces.
  2. Apply adhesive to entire circumference of ducts and to all surfaces of fittings and transitions.
  3. Install cupped-head, capacitor-discharge-weld pins on sides and bottom of horizontal ducts and sides of vertical ducts as follows:
    - a. On duct sides with dimensions 18 inches and smaller, place pins along longitudinal centerline of duct. Space 3 inches maximum from insulation end joints, and 16 inches o.c.
    - b. On duct sides with dimensions larger than 18 inches, place pins 16 inches o.c. each way, and 3 inches maximum from insulation joints. Install additional pins to hold insulation tightly against surface at cross bracing.
    - c. Pins may be omitted from top surface of horizontal, rectangular ducts and plenums.
    - d. Do not overcompress insulation during installation.
    - e. Impale insulation over pins and attach speed washers.
    - f. Cut excess portion of pins extending beyond speed washers or bend parallel with insulation surface. Cover exposed pins and washers with tape matching insulation facing.
  4. For ducts and plenums with surface temperatures below ambient, install a continuous unbroken vapor barrier. Create a facing lap for longitudinal seams and end joints with insulation by removing 2 inches from one edge and one end of insulation segment. Secure laps to adjacent insulation section with 1/2-inch outward-clinching staples, 1 inch o.c. Install vapor barrier consisting of factory- or field-applied jacket, adhesive, vapor-barrier mastic, and sealant at joints, seams, and protrusions.
    - a. Repair punctures, tears, and penetrations with tape or mastic to maintain vapor-barrier seal.
    - b. Install vapor stops for ductwork and plenums operating below 50 deg F at 18-foot intervals. Vapor stops shall consist of vapor-barrier mastic applied in a Z-shaped pattern over insulation face, along butt end of insulation, and over the surface. Cover insulation face and surface to be insulated a width equal to two times the insulation thickness, but not less than 3 inches.
  5. Install insulation on rectangular duct elbows and transitions with a full insulation section for each surface. Install insulation on round and flat-oval duct elbows with individually mitered gores cut to fit the elbow.
  6. Insulate duct stiffeners, hangers, and flanges that protrude beyond insulation surface with 6-inch- wide strips of same material used to insulate duct. Secure on alternating sides of stiffener, hanger, and flange with pins spaced 6 inches o.c.
- B. Board Insulation Installation on Ducts and Plenums: Secure with adhesive and insulation pins.
1. Apply adhesives according to manufacturer's recommended coverage rates per unit area, for 100 percent coverage of duct and plenum surfaces.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

2. Apply adhesive to entire circumference of ducts and to all surfaces of fittings and transitions.
3. Install either capacitor-discharge-weld pins and speed washers or cupped-head, capacitor-discharge-weld pins on sides and bottom of horizontal ducts and sides of vertical ducts as follows:
  - a. On duct sides with dimensions 18 inches and smaller, place pins along longitudinal centerline of duct. Space 3 inches maximum from insulation end joints, and 16 inches o.c.
  - b. On duct sides with dimensions larger than 18 inches, space pins 16 inches o.c. each way, and 3 inches maximum from insulation joints. Install additional pins to hold insulation tightly against surface at cross bracing.
  - c. Pins may be omitted from top surface of horizontal, rectangular ducts and plenums.
  - d. Do not overcompress insulation during installation.
  - e. Cut excess portion of pins extending beyond speed washers or bend parallel with insulation surface. Cover exposed pins and washers with tape matching insulation facing.
4. For ducts and plenums with surface temperatures below ambient, install a continuous unbroken vapor barrier. Create a facing lap for longitudinal seams and end joints with insulation by removing 2 inches from one edge and one end of insulation segment. Secure laps to adjacent insulation section with 1/2-inch outward-clinching staples, 1 inch o.c. Install vapor barrier consisting of factory- or field-applied jacket, adhesive, vapor-barrier mastic, and sealant at joints, seams, and protrusions.
  - a. Repair punctures, tears, and penetrations with tape or mastic to maintain vapor-barrier seal.
  - b. Install vapor stops for ductwork and plenums operating below 50 deg F at 18-foot intervals. Vapor stops shall consist of vapor-barrier mastic applied in a Z-shaped pattern over insulation face, along butt end of insulation, and over the surface. Cover insulation face and surface to be insulated a width equal to two times the insulation thickness, but not less than 3 inches.
5. Install insulation on rectangular duct elbows and transitions with a full insulation section for each surface. Groove and score insulation to fit as closely as possible to outside and inside radius of elbows. Install insulation on round and flat-oval duct elbows with individually mitered gores cut to fit the elbow.
6. Insulate duct stiffeners, hangers, and flanges that protrude beyond insulation surface with 6-inch- wide strips of same material used to insulate duct. Secure on alternating sides of stiffener, hanger, and flange with pins spaced 6 inches o.c.

### 3.5 FINISHES

- A. Insulation with ASJ, Glass-Cloth, or Other Paintable Jacket Material: Paint jacket with paint system identified as specified in Section 099113 "Exterior Painting" and Section 099123 "Interior Painting."
- B. Color: Final color as selected by Architect. Vary first and second coats to allow visual inspection of the completed Work.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- C. Do not field paint aluminum or stainless-steel jackets.

### 3.6 FIELD QUALITY CONTROL

- A. Testing Agency: Engage a qualified testing agency to perform tests and inspections.
- B. Perform tests and inspections.
- C. Tests and Inspections:
  - 1. Inspect ductwork, randomly selected by Architect, by removing field-applied jacket and insulation in layers in reverse order of their installation. Extent of inspection shall be limited to one location for each duct system defined in the "Duct Insulation Schedule, General" Article.
- D. All insulation applications will be considered defective Work if sample inspection reveals noncompliance with requirements.

### 3.7 DUCT INSULATION SCHEDULE, GENERAL

- A. Plenums and Ducts Requiring Insulation:
  - 1. Indoor, concealed supply and outdoor air.
- B. Items Not Insulated:
  - 1. Factory-insulated flexible ducts.
  - 2. Flexible connectors.
  - 3. Vibration-control devices.
  - 4. Factory-insulated access panels and doors.

### 3.8 INDOOR DUCT AND PLENUM INSULATION SCHEDULE

- A. Concealed, round, supply-air duct insulation shall be the following:
  - 1. Mineral-Fiber Blanket: 1-1/2 inches thick and 0.75-lb/cu. ft. nominal density.
- B. Round, exhaust-air duct insulation shall be the following:
  - 1. Mineral-Fiber Blanket: 1-1/2 inches thick and 0.75-lb/cu. ft. nominal density.
- C. Rectangular, supply-air duct insulation shall be one of the following:
  - 1. Mineral-Fiber Blanket: 1-1/2 inches thick and 0.75-lb/cu. ft. nominal density.
  - 2. Mineral-Fiber Board: 1-1/2 inches thick and 2-lb/cu. ft. nominal density.
- D. Rectangular, exhaust-air duct insulation between isolation damper and penetration of building exterior shall be the following:

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1. Mineral-Fiber Blanket: 1-1/2 inches thick and 0.75-lb/cu. ft. nominal density.
2. Mineral-Fiber Board: 2 inches thick and 2-lb/cu. ft. nominal density.

3.9 INDOOR, FIELD-APPLIED JACKET SCHEDULE

- A. Install jacket over insulation material. For insulation with factory-applied jacket, install the field-applied jacket over the factory-applied jacket.
- B. If more than one material is listed, selection from materials listed is Contractor's option.

END OF SECTION





WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 233113 - METAL DUCTS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

A. Section Includes:

1. Single-wall rectangular ducts and fittings.
2. Single-wall round ducts and fittings.
3. Sheet metal materials.
4. Sealants and gaskets.
5. Hangers and supports.

B. Related Sections:

1. Section 230593 "Testing, Adjusting, and Balancing for HVAC" for testing, adjusting, and balancing requirements for metal ducts.
2. Section 233300 "Air Duct Accessories" for dampers, duct-mounting access doors and panels, turning vanes, and flexible ducts.

1.3 PERFORMANCE REQUIREMENTS

- A. Structural Performance: Duct hangers and supports shall withstand the effects of gravity loads and stresses within limits and under conditions described in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."
- B. Airstream Surfaces: Surfaces in contact with the airstream shall comply with requirements in ASHRAE 62.1.

1.4 ACTION SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Product Data: On data submittal sheets where more than one product is described, clearly annotate which product(s) is to be supplied. For each type of the following products:
  1. Sealants and gaskets.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1.5 QUALITY ASSURANCE

- A. ASHRAE Compliance: Applicable requirements in ASHRAE 62.1, Section 5 - "Systems and Equipment" and Section 7 - "Construction and System Start-up."
- B. ASHRAE/IES Compliance: Applicable requirements in ASHRAE/IES 90.1, Section 6.4.4 - "HVAC System Construction and Insulation."

PART 2 - PRODUCTS

2.1 SINGLE-WALL RECTANGULAR DUCTS AND FITTINGS

- A. General Fabrication Requirements: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" based on indicated static-pressure class unless otherwise indicated.
- B. Transverse Joints: Select joint types and fabricate according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 2-1, "Rectangular Duct/Transverse Joints," for static-pressure class, applicable sealing requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."
- C. Longitudinal Seams: Select seam types and fabricate according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 2-2, "Rectangular Duct/Longitudinal Seams," for static-pressure class, applicable sealing requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."
- D. Elbows, Transitions, Offsets, Branch Connections, and Other Duct Construction: Select types and fabricate according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Chapter 4, "Fittings and Other Construction," for static-pressure class, applicable sealing requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."

2.2 SINGLE-WALL ROUND DUCTS AND FITTINGS

- A. General Fabrication Requirements: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Chapter 3, "Round, Oval, and Flexible Duct," based on indicated static-pressure class unless otherwise indicated.
- B. Transverse Joints: Select joint types and fabricate according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 3-1, "Round Duct Transverse Joints," for static-pressure class, applicable sealing requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."
  - 1. Transverse Joints in Ducts Larger Than 60 Inches in Diameter: Flanged.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- C. Longitudinal Seams: Select seam types and fabricate according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 3-2, "Round Duct Longitudinal Seams," for static-pressure class, applicable sealing requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."
  - 1. Fabricate round ducts larger than 90 inches in diameter with butt-welded longitudinal seams.
- D. Tees and Laterals: Select types and fabricate according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 3-5, "90 Degree Tees and Laterals," and Figure 3-6, "Conical Tees," for static-pressure class, applicable sealing requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."

### 2.3 SHEET METAL MATERIALS

- A. General Material Requirements: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" for acceptable materials, material thicknesses, and duct construction methods unless otherwise indicated. Sheet metal materials shall be free of pitting, seam marks, roller marks, stains, discolorations, and other imperfections.
- B. Galvanized Sheet Steel: Comply with ASTM A 653/A 653M.
  - 1. Galvanized Coating Designation: G90.
  - 2. Finishes for Surfaces Exposed to View: Mill phosphatized.
- C. Tie Rods: Galvanized steel, 1/4-inch minimum diameter for lengths 36 inches or less; 3/8-inch minimum diameter for lengths longer than 36 inches.

### 2.4 SEALANT AND GASKETS

- A. General Sealant and Gasket Requirements: Surface-burning characteristics for sealants and gaskets shall be a maximum flame-spread index of 25 and a maximum smoke-developed index of 50 when tested according to UL 723; certified by an NRTL.
- B. Water-Based Joint and Seam Sealant:
  - 1. Application Method: Brush on.
  - 2. Solids Content: Minimum 65 percent.
  - 3. Shore A Hardness: Minimum 20.
  - 4. Water resistant.
  - 5. Mold and mildew resistant.
  - 6. Maximum Static-Pressure Class: 10-inch wg, positive and negative.
  - 7. Service: Indoor or outdoor.
  - 8. Substrate: Compatible with galvanized sheet steel (both PVC coated and bare), stainless steel, or aluminum sheets.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- C. Flanged Joint Sealant: Comply with ASTM C 920.
  - 1. General: Single-component, acid-curing, silicone, elastomeric.
  - 2. Type: S.
  - 3. Grade: NS.
  - 4. Class: 25.
  - 5. Use: O.
- D. Flange Gaskets: Butyl rubber, neoprene, or EPDM polymer with polyisobutylene plasticizer.
- E. Round Duct Joint O-Ring Seals:
  - 1. Seal shall provide maximum leakage class of 3 cfm/100 sq. ft. at 1-inch wg and shall be rated for 10-inch wg static-pressure class, positive or negative.
  - 2. EPDM O-ring to seal in concave bead in coupling or fitting spigot.
  - 3. Double-lipped, EPDM O-ring seal, mechanically fastened to factory-fabricated couplings and fitting spigots.

## 2.5 HANGERS AND SUPPORTS

- A. Hanger Rods for Noncorrosive Environments: Cadmium-plated steel rods and nuts.
- B. Strap and Rod Sizes: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Table 5-1, "Rectangular Duct Hangers Minimum Size," and Table 5-2, "Minimum Hanger Sizes for Round Duct."
- C. Steel Cables for Galvanized-Steel Ducts: Galvanized steel complying with ASTM A 603.
- D. Steel Cables for Stainless-Steel Ducts: Stainless steel complying with ASTM A 492.
- E. Steel Cable End Connections: Cadmium-plated steel assemblies with brackets, swivel, and bolts designed for duct hanger service; with an automatic-locking and clamping device.
- F. Duct Attachments: Sheet metal screws, blind rivets, or self-tapping metal screws; compatible with duct materials.

## PART 3 - EXECUTION

### 3.1 DUCT INSTALLATION

- A. Drawing plans, schematics, and diagrams indicate general location and arrangement of duct system. Indicated duct locations, configurations, and arrangements were used to size ducts and calculate friction loss for air-handling equipment sizing and for other design considerations. Install duct systems as indicated unless deviations to layout are approved on Shop Drawings and Coordination Drawings.
- B. Install ducts according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" unless otherwise indicated.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- C. Install ducts in maximum practical lengths.
- D. Install ducts with fewest possible joints.
- E. Install factory- or shop-fabricated fittings for changes in direction, size, and shape and for branch connections.
- F. Unless otherwise indicated, install ducts vertically and horizontally, and parallel and perpendicular to building lines.
- G. Install ducts close to walls, overhead construction, columns, and other structural and permanent enclosure elements of building.
- H. Install ducts with a clearance of 1 inch, plus allowance for insulation thickness.
- I. Route ducts to avoid passing through transformer vaults and electrical equipment rooms and enclosures.
- J. Where ducts pass through non-fire-rated interior partitions and exterior walls and are exposed to view, cover the opening between the partition and duct or duct insulation with sheet metal flanges of same metal thickness as the duct. Overlap openings on four sides by at least 1-1/2 inches.
- K. Where ducts pass through fire-rated interior partitions and exterior walls, install fire dampers. Comply with requirements in Section 233300 "Air Duct Accessories" for fire and smoke dampers.
- L. Protect duct interiors from moisture, construction debris and dust, and other foreign materials. Comply with SMACNA's "IAQ Guidelines for Occupied Buildings Under Construction," Appendix G, "Duct Cleanliness for New Construction Guidelines."

### 3.2 DUCT SEALING

- A. Seal ducts for duct static-pressure, seal classes, and leakage classes specified in "Duct Schedule" Article according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."

### 3.3 HANGER AND SUPPORT INSTALLATION

- A. Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Chapter 5, "Hangers and Supports."
- B. Building Attachments: Concrete inserts, powder-actuated fasteners, or structural-steel fasteners appropriate for construction materials to which hangers are being attached.
  - 1. Where practical, install concrete inserts before placing concrete.
  - 2. Install powder-actuated concrete fasteners after concrete is placed and completely cured.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

3. Use powder-actuated concrete fasteners for standard-weight aggregate concretes or for slabs more than 4 inches thick.
  4. Do not use powder-actuated concrete fasteners for lightweight-aggregate concretes or for slabs less than 4 inches thick.
- C. Hanger Spacing: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Table 5-1, "Rectangular Duct Hangers Minimum Size," and Table 5-2, "Minimum Hanger Sizes for Round Duct," for maximum hanger spacing; install hangers and supports within 24 inches of each elbow and within 48 inches of each branch intersection.
- D. Hangers Exposed to View: Threaded rod and angle or channel supports.
- E. Support vertical ducts with steel angles or channel secured to the sides of the duct with welds, bolts, sheet metal screws, or blind rivets; support at each floor and at a maximum intervals of 16 feet.
- F. Install upper attachments to structures. Select and size upper attachments with pull-out, tension, and shear capacities appropriate for supported loads and building materials where used.

### 3.4 CONNECTIONS

- A. Make connections to equipment with flexible connectors complying with Section 233300 "Air Duct Accessories."
- B. Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" for branch, outlet and inlet, and terminal unit connections.

### 3.5 PAINTING

- A. Paint interior of metal ducts that are visible through registers and grilles and that do not have duct liner. Apply one coat of flat, black, latex paint over a compatible galvanized-steel primer. Paint materials and application requirements are specified in Section 099113 "Exterior Painting" and Section 099123 "Interior Painting."

### 3.6 START UP

- A. Air Balance: Comply with requirements in Section 230593 "Testing, Adjusting, and Balancing for HVAC."

### 3.7 DUCT SCHEDULE

- A. Fabricate ducts with galvanized sheet steel except as otherwise indicated and as follows:
- B. Supply Ducts:
  1. Ducts Connected to Air Conditioners:

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- a. Pressure Class: Positive 3-inch wg.
- b. Minimum SMACNA Seal Class: A.
- c. SMACNA Leakage Class for Rectangular: 24.
- d. SMACNA Leakage Class for Round and Flat Oval: 12.

C. Exhaust Ducts:

1. Ducts Connected to Exhaust Fans:

- a. Pressure Class: Positive or negative 3-inch wg.
- b. Minimum SMACNA Seal Class: B if negative pressure, and A if positive pressure.
- c. SMACNA Leakage Class for Rectangular: 12.
- d. SMACNA Leakage Class for Round and Flat Oval: 6.

D. Elbow Configuration:

1. Rectangular Duct: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 4-2, "Rectangular Elbows."

- a. Radius Type RE 1 with minimum 1.5 radius-to-diameter ratio.
- b. Radius Type RE 3 with minimum 1.0 radius-to-diameter ratio and two vanes.
- c. Mitered Type RE 2 with vanes complying with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 4-3, "Vanes and Vane Runners," and Figure 4-4, "Vane Support in Elbows."

2. Round Duct: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 3-4, "Round Duct Elbows."

- a. Minimum Radius-to-Diameter Ratio and Elbow Segments: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Table 3-1, "Mitered Elbows." Elbows with less than 90-degree change of direction have proportionately fewer segments.

1) Radius-to Diameter Ratio: 1.5.

- b. Round Elbows, 12 Inches and Smaller in Diameter: Stamped or pleated.
- c. Round Elbows, 14 Inches and Larger in Diameter: Standing seam.

E. Branch Configuration:

1. Rectangular Duct: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 4-6, "Branch Connection."

- a. Rectangular Main to Rectangular Branch: 45-degree entry.
- b. Rectangular Main to Round Branch: Spin in.

2. Round: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 3-5, "90 Degree Tees and Laterals," and Figure 3-6, "Conical Tees." Saddle taps are permitted in existing duct.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- a. Velocity 1000 to 1500 fpm or Lower: Conical tap.
- b. Velocity 1500 fpm or Higher: 45-degree lateral.

END OF SECTION



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 233423 - HVAC POWER VENTILATORS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
  - 1. Centrifugal roof ventilators.

1.3 PERFORMANCE REQUIREMENTS

- A. Project Altitude: Base fan-performance ratings on actual Project site elevations.
- B. Operating Limits: Classify according to AMCA 99.

1.4 ACTION SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Product Data: For each type of product indicated. Include rated capacities, operating characteristics, and furnished specialties and accessories. On data submittal sheets where more than one product is described, clearly annotate which product(s) is to be supplied. Also include the following:
  - 1. Certified fan performance curves with system operating conditions indicated.
  - 2. Certified fan sound-power ratings.
  - 3. Motor ratings and electrical characteristics, plus motor and electrical accessories.
  - 4. Material thickness and finishes, including color charts.
  - 5. Dampers, including housings, linkages, and operators.
  - 6. Roof curbs.
  - 7. Fan speed controllers.
- C. Shop Drawings: Include plans, elevations, sections, details, and attachments to other work.
  - 1. Detail equipment assemblies and indicate dimensions, weights, loads, required clearances, method of field assembly, components, and location and size of each field connection.
  - 2. Wiring Diagrams: For power, signal, and control wiring.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1.5 INFORMATIONAL SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 “Submittal Procedures” and the individual sections specifying the work.
- B. Coordination Drawings: Reflected ceiling plans and other details, drawn to scale, on which the following items are shown and coordinated with each other, using input from Installers of the items involved:
  - 1. Roof framing and support members relative to duct penetrations.
  - 2. Ceiling suspension assembly members.
  - 3. Size and location of initial access modules for acoustical tile.
  - 4. Ceiling-mounted items including light fixtures, diffusers, grilles, speakers, sprinklers, access panels, and special moldings.
- C. Field quality-control reports.

1.6 CLOSEOUT SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 “Submittal Procedures” and the individual sections specifying the work.
- B. Operation and Maintenance Data: For power ventilators to include in emergency, operation, and maintenance manuals.

1.7 MAINTENANCE MATERIAL SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 “Submittal Procedures” and the individual sections specifying the work.
- B. Furnish extra materials that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.
  - 1. Belts: One set for each belt-driven unit.

1.8 QUALITY ASSURANCE

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. AMCA Compliance: Fans shall have AMCA-Certified performance ratings and shall bear the AMCA-Certified Ratings Seal.
- C. UL Standards: Power ventilators shall comply with UL 705. Power ventilators for use for restaurant kitchen exhaust shall also comply with UL 762.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1.9 COORDINATION

- A. Coordinate size and location of structural-steel support members.
- B. Coordinate sizes and locations of concrete bases with actual equipment provided.
- C. Coordinate sizes and locations of roof curbs, equipment supports, and roof penetrations with actual equipment provided.

PART 2 - PRODUCTS

2.1 CENTRIFUGAL ROOF VENTILATORS

- A. Housing: Removable, spun-aluminum, dome top and outlet baffle; square, one-piece, aluminum base with venturi inlet cone.
  - 1. Upblast Units: Provide spun-aluminum discharge baffle to direct discharge air upward, with rain and snow drains and grease collector.
  - 2. Hinged Subbase: Galvanized-steel hinged arrangement permitting service and maintenance.
- B. Fan Wheels: Aluminum hub and wheel with backward-inclined blades.
- C. Belt Drives:
  - 1. Resiliently mounted to housing.
  - 2. Fan Shaft: Turned, ground, and polished steel; keyed to wheel hub.
  - 3. Shaft Bearings: Permanently lubricated, permanently sealed, self-aligning ball bearings.
  - 4. Pulleys: Cast-iron, adjustable-pitch motor pulley.
  - 5. Fan and motor isolated from exhaust airstream.
- D. Accessories:
  - 1. Variable-Speed Controller: Solid-state control to reduce speed from 100 to less than 50 percent.
  - 2. Disconnect Switch: Nonfusible type, with thermal-overload protection mounted outside fan housing, factory wired through an internal aluminum conduit.
  - 3. Motorized Dampers: Parallel-blade dampers mounted in curb base with electric actuator; wired to close when fan stops.
- E. Roof Curbs: Galvanized steel; mitered and welded corners; 1-1/2-inch- thick, rigid, fiberglass insulation adhered to inside walls; and 1-1/2-inch wood nailer. Size as required to suit roof opening and fan base.
  - 1. Configuration: Built-in raised cant and mounting flange.
  - 2. Overall Height: 16 inches.
  - 3. Sound Curb: Curb with sound-absorbing insulation.
  - 4. Pitch Mounting: Manufacture curb for roof slope.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

5. Metal Liner: Galvanized steel.
6. Mounting Pedestal: Galvanized steel with removable access panel.
7. Vented Curb: Unlined with louvered vents in vertical sides.

## 2.2 MOTORS

- A. Comply with NEMA designation, temperature rating, service factor, enclosure type, and efficiency requirements for motors specified in Section 230513 "Common Motor Requirements for HVAC Equipment."
  1. Motor Sizes: Minimum size as indicated. If not indicated, large enough so driven load will not require motor to operate in service factor range above 1.0.
- B. Enclosure Type: Totally enclosed, fan cooled.

## 2.3 SOURCE QUALITY CONTROL

- A. Certify sound-power level ratings according to AMCA 301, "Methods for Calculating Fan Sound Ratings from Laboratory Test Data." Factory test fans according to AMCA 300, "Reverberant Room Method for Sound Testing of Fans." Label fans with the AMCA-Certified Ratings Seal.
- B. Certify fan performance ratings, including flow rate, pressure, power, air density, speed of rotation, and efficiency by factory tests according to AMCA 210, "Laboratory Methods of Testing Fans for Aerodynamic Performance Rating." Label fans with the AMCA-Certified Ratings Seal.

## PART 3 - EXECUTION

### 3.1 INSTALLATION

- A. Install power ventilators level and plumb.
- B. Equipment Mounting:
  1. Comply with requirements for vibration isolation devices specified in Section 230548.13 "Vibration Controls for HVAC."
- C. Secure roof-mounted fans to roof curbs with cadmium-plated hardware. See Section 077200 "Roof Accessories" for installation of roof curbs.
- D. Ceiling Units: Suspend units from structure; use steel wire or metal straps.
- E. Support suspended units from structure using threaded steel rods and elastomeric hangers or spring hangers with vertical-limit stops having a static deflection of 1 inch. Vibration-control devices are specified in Section 230548.13 "Vibration Controls for HVAC."

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- F. Install units with clearances for service and maintenance.
- G. Label units according to requirements specified in Section 230553 "Identification for HVAC Piping and Equipment."

### 3.2 CONNECTIONS

- A. Drawings indicate general arrangement of ducts and duct accessories. Make final duct connections with flexible connectors. Flexible connectors are specified in Section 233300 "Air Duct Accessories."
- B. Install ducts adjacent to power ventilators to allow service and maintenance.
- C. Ground equipment according to Section 260526 "Grounding and Bonding for Electrical Systems."
- D. Connect wiring according to Section 260519 "Low-Voltage Electrical Power Conductors and Cables."

### 3.3 FIELD QUALITY CONTROL

- A. Perform tests and inspections.
  - 1. Manufacturer's Field Service: Engage a factory-authorized service representative to inspect components, assemblies, and equipment installations, including connections, and to assist in testing.
- B. Tests and Inspections:
  - 1. Verify that shipping, blocking, and bracing are removed.
  - 2. Verify that unit is secure on mountings and supporting devices and that connections to ducts and electrical components are complete. Verify that proper thermal-overload protection is installed in motors, starters, and disconnect switches.
  - 3. Verify that cleaning and adjusting are complete.
  - 4. Disconnect fan drive from motor, verify proper motor rotation direction, and verify fan wheel free rotation and smooth bearing operation. Reconnect fan drive system, align and adjust belts, and install belt guards.
  - 5. Adjust belt tension.
  - 6. Adjust damper linkages for proper damper operation.
  - 7. Verify lubrication for bearings and other moving parts.
  - 8. Verify that manual and automatic volume control and fire and smoke dampers in connected ductwork systems are in fully open position.
  - 9. Disable automatic temperature-control operators, energize motor and adjust fan to indicated rpm, and measure and record motor voltage and amperage.
  - 10. Shut unit down and reconnect automatic temperature-control operators.
  - 11. Remove and replace malfunctioning units and retest as specified above.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- C. Test and adjust controls and safeties. Replace damaged and malfunctioning controls and equipment.
- D. Prepare test and inspection reports.

3.4 ADJUSTING

- A. Adjust damper linkages for proper damper operation.
- B. Adjust belt tension.
- C. Comply with requirements in Section 230593 "Testing, Adjusting, and Balancing for HVAC" for testing, adjusting, and balancing procedures.
- D. Replace fan and motor pulleys as required to achieve design airflow.
- E. Lubricate bearings.

3.5 DEMONSTRATION

- A. Train Owner's maintenance personnel to adjust, operate, and maintain exhaust fans.

END OF SECTION

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 260519 - LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
  - 1. Copper building wire rated 600 V or less.
  - 2. Metal-clad cable, Type MC, rated 600 V or less.
  - 3. Connectors, splices, and terminations rated 600 V and less.

1.3 DEFINITIONS

- A. VFC: Variable-frequency controller.

1.4 ACTION SUBMITTALS

- A. Submittals shall comply with the requirements of the Construction Contract Clauses, Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Product Data: For each type of product.
- C. Product Schedule: Indicate type, use, location, and termination locations.

PART 2 - PRODUCTS

2.1 COPPER BUILDING WIRE

- A. Description: Flexible, insulated and uninsulated, drawn copper current-carrying conductor with an overall insulation layer or jacket, or both, rated 600 V or less.
- B. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
  - 1. Alpha Wire Company.
  - 2. American Bare Conductor.
  - 3. Belden Inc.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

4. [Cerro Wire LLC.](#)
5. [Encore Wire Corporation.](#)
6. [General Cable Technologies Corporation.](#)
7. [Okonite Company \(The\).](#)
8. [Service Wire Co.](#)
9. [Southwire Company.](#)
10. [WESCO.](#)

C. Standards:

1. Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and use.
2. RoHS compliant.
3. Conductor and Cable Marking: Comply with wire and cable marking according to UL's "Wire and Cable Marking and Application Guide."

D. Conductors: Copper, complying with ASTM B 3 for bare annealed copper and with ASTM B 8 for stranded conductors.

E. Conductor Insulation:

1. Type THHN and Type THWN-2: Comply with UL 83.

2.2 METAL-CLAD CABLE, TYPE MC

A. Description: A factory assembly of one or more current-carrying insulated conductors in an overall metallic sheath.

B. [Manufacturers:](#) Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:

1. [Alpha Wire Company.](#)
2. [American Bare Conductor.](#)
3. [Belden Inc.](#)
4. [Encore Wire Corporation.](#)
5. [General Cable Technologies Corporation.](#)
6. [Okonite Company \(The\).](#)
7. [Service Wire Co.](#)
8. [Southwire Company.](#)
9. [WESCO.](#)

C. Standards:

1. Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and use.
2. Comply with UL 1569.
3. RoHS compliant.
4. Conductor and Cable Marking: Comply with wire and cable marking according to UL's "Wire and Cable Marking and Application Guide."



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- D. Circuits:
  - 1. Single circuit.
  - 2. Power-Limited Fire-Alarm Circuits: Comply with UL 1424.
- E. Conductors: Copper, complying with ASTM B 3 for bare annealed copper and with ASTM B 8 for stranded conductors.
- F. Ground Conductor: Bare.
- G. Conductor Insulation:
  - 1. Type TFN/THHN/THWN-2: Comply with UL 83.
- H. Armor: Steel, interlocked.
- I. Jacket: PVC applied over armor.

### 2.3 CONNECTORS AND SPLICES

- A. Description: Factory-fabricated connectors, splices, and lugs of size, ampacity rating, material, type, and class for application and service indicated; listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and use.
- B. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
  - 1. [3M Electrical Products.](#)
  - 2. [AFC Cable Systems; a part of Atkore International.](#)
  - 3. [Gardner Bender.](#)
  - 4. [Hubbell Power Systems, Inc.](#)
  - 5. [Ideal Industries, Inc.](#)
  - 6. [ILSCO.](#)
  - 7. [NSi Industries LLC.](#)
  - 8. [O-Z/Gedney; a brand of Emerson Industrial Automation.](#)
  - 9. [Service Wire Co.](#)
  - 10. [TE Connectivity Ltd.](#)
  - 11. [Thomas & Betts Corporation; A Member of the ABB Group.](#)
- C. Jacketed Cable Connectors: For steel jacketed cables, zinc die-cast with set screws, designed to connect conductors specified in this Section.
- D. Lugs: One piece, seamless, designed to terminate conductors specified in this Section.
  - 1. Material: Copper.
  - 2. Type: One hole with standard barrels.
  - 3. Termination: Compression.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

PART 3 - EXECUTION

3.1 CONDUCTOR MATERIAL APPLICATIONS

- A. Branch Circuits: Copper. Solid for No. 10 AWG and smaller; stranded for No. 8 AWG and larger.

3.2 CONDUCTOR INSULATION AND MULTICONDUCTOR CABLE APPLICATIONS AND WIRING METHODS

- A. Exposed Branch Circuits, Including in Crawlspace: Type THHN/THWN-2, single conductors in raceway.
- B. Branch Circuits Concealed in Ceilings, Walls, and Partitions: Type THHN/THWN-2, single conductors in raceway or metal-clad cable, Type MC.

3.3 INSTALLATION OF CONDUCTORS AND CABLES

- A. Conceal cables in finished walls, ceilings, and floors unless otherwise indicated.
- B. Complete raceway installation between conductor and cable termination points according to Section 260533 "Raceways and Boxes for Electrical Systems" prior to pulling conductors and cables.
- C. Use manufacturer-approved pulling compound or lubricant where necessary; compound used must not deteriorate conductor or insulation. Do not exceed manufacturer's recommended maximum pulling tensions and sidewall pressure values.
- D. Use pulling means, including fish tape, cable, rope, and basket-weave wire/cable grips that will not damage cables or raceway.
- E. Install exposed cables parallel and perpendicular to surfaces of exposed structural members, and follow surface contours where possible.
- F. Support cables according to Section 260529 "Hangers and Supports for Electrical Systems."

3.4 CONNECTIONS

- A. Tighten electrical connectors and terminals according to manufacturer's published torque-tightening values. If manufacturer's torque values are not indicated, use those specified in UL 486A-486B.
- B. Make splices, terminations, and taps that are compatible with conductor material and that possess equivalent or better mechanical strength and insulation ratings than unspliced conductors.
- C. Wiring at Outlets: Install conductor at each outlet, with at least 6 inches of slack.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

3.5 IDENTIFICATION

- A. Identify and color-code conductors and cables according to Section 260553 "Identification for Electrical Systems."
- B. Identify each spare conductor at each end with identity number and location of other end of conductor, and identify as spare conductor.

3.6 FIELD QUALITY CONTROL

- A. Perform tests and inspections.
  - 1. Perform each of the following visual and electrical tests:
    - a. Inspect exposed sections of conductor and cable for physical damage and correct connection according to the single-line diagram.
    - b. Test bolted connections for high resistance using one of the following:
      - 1) A low-resistance ohmmeter.
      - 2) Calibrated torque wrench.
      - 3) Thermographic survey.
    - c. Inspect compression-applied connectors for correct cable match and indentation.
    - d. Inspect for correct identification.
    - e. Inspect cable jacket and condition.
    - f. Insulation-resistance test on each conductor for ground and adjacent conductors. Apply a potential of 500-V dc for 300-V rated cable and 1000-V dc for 600-V rated cable for a one-minute duration.
    - g. Continuity test on each conductor and cable.
    - h. Uniform resistance of parallel conductors.
  - B. Cables will be considered defective if they do not pass tests and inspections.
  - C. Prepare test and inspection reports to record the following:
    - 1. Procedures used.
    - 2. Results that comply with requirements.
    - 3. Results that do not comply with requirements, and corrective action taken to achieve compliance with requirements.

END OF SECTION



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 260526 - GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes grounding and bonding systems and equipment.

1.3 ACTION SUBMITTALS

- A. Submittals shall comply with the requirements of the Construction Contract Clauses, Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Product Data: For each type of product indicated.

1.4 INFORMATIONAL SUBMITTALS

- A. Submittals shall comply with the requirements of the Construction Contract Clauses, Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Field quality-control reports.

1.5 QUALITY ASSURANCE

- A. Testing Agency Qualifications: Certified by NETA.

PART 2 - PRODUCTS

2.1 SYSTEM DESCRIPTION

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. Comply with UL 467 for grounding and bonding materials and equipment.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

2.2 MANUFACTURERS

- A. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
1. Advanced Lightning Technology, Ltd.
  2. Burndy; Part of Hubbell Electrical Systems.
  3. Dossert; AFL Telecommunications LLC.
  4. ERICO International Corporation.
  5. Fushi Copperweld Inc.
  6. Galvan Industries, Inc.; Electrical Products Division, LLC.
  7. Harger Lightning & Grounding.
  8. ILSCO.
  9. O-Z/Gedney; a brand of Emerson Industrial Automation.
  10. Robbins Lightning, Inc.
  11. SIEMENS Industry, Inc.; Energy Management Division.
  12. Thomas & Betts Corporation; A Member of the ABB Group.

2.3 CONDUCTORS

- A. Insulated Conductors: Copper wire or cable insulated for 600 V unless otherwise required by applicable Code or authorities having jurisdiction.
- B. Bare Copper Conductors:
1. Solid Conductors: ASTM B 3.
  2. Stranded Conductors: ASTM B 8.
  3. Tinned Conductors: ASTM B 33.
  4. Bonding Cable: 28 kcmil, 14 strands of No. 17 AWG conductor, 1/4 inch in diameter.
  5. Bonding Conductor: No. 4 or No. 6 AWG, stranded conductor.
  6. Bonding Jumper: Copper tape, braided conductors terminated with copper ferrules; 1-5/8 inches wide and 1/16 inch thick.
  7. Tinned Bonding Jumper: Tinned-copper tape, braided conductors terminated with copper ferrules; 1-5/8 inches wide and 1/16 inch thick.

2.4 CONNECTORS

- A. Listed and labeled by an NRTL acceptable to authorities having jurisdiction for applications in which used and for specific types, sizes, and combinations of conductors and other items connected.
- B. Welded Connectors: Exothermic-welding kits of types recommended by kit manufacturer for materials being joined and installation conditions.
- C. Bus-Bar Connectors: Mechanical type, cast silicon bronze, solderless compression-type wire terminals, and long-barrel, two-bolt connection to ground bus bar.
- D. Bus-Bar Connectors: Compression type, copper or copper alloy, with two wire terminals.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- E. Beam Clamps: Mechanical type, terminal, ground wire access from four directions, with dual, tin-plated or silicon bronze bolts.
- F. Cable-to-Cable Connectors: Compression type, copper or copper alloy.
- G. Conduit Hubs: Mechanical type, terminal with threaded hub.
- H. Water Pipe Clamps:
  - 1. Mechanical type, two pieces with zinc-plated bolts.
    - a. Material: Tin-plated aluminum.
    - b. Listed for direct burial.

PART 3 - EXECUTION

3.1 APPLICATIONS

- A. Conductors: Install solid conductor for No. 8 AWG and smaller, and stranded conductors for No. 6 AWG and larger unless otherwise indicated.
- B. Conductor Terminations and Connections:
  - 1. Pipe and Equipment Grounding Conductor Terminations: Bolted connectors.
  - 2. Connections to Structural Steel: Welded connectors.

3.2 EQUIPMENT GROUNDING

- A. Install insulated equipment grounding conductors with all feeders and branch circuits.
- B. Install insulated equipment grounding conductors with the following items, in addition to those required by NFPA 70:
  - 1. Feeders and branch circuits.
  - 2. Lighting circuits.
  - 3. Receptacle circuits.
  - 4. Single-phase motor and appliance branch circuits.
  - 5. Flexible raceway runs.
  - 6. Metal-clad cable runs.
- C. Air-Duct Equipment Circuits: Install insulated equipment grounding conductor to duct-mounted electrical devices operating at 120 V and more, including air cleaners, heaters, dampers, humidifiers, and other duct electrical equipment. Bond conductor to each unit and to air duct and connected metallic piping.
- D. Water Heater, Heat-Tracing, and Antifrost Heating Cables: Install a separate insulated equipment grounding conductor to each electric water heater and heat-tracing cable. Bond conductor to heater units, piping, connected equipment, and components.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

3.3 INSTALLATION

- A. Grounding Conductors: Route along shortest and straightest paths possible unless otherwise indicated or required by Code. Avoid obstructing access or placing conductors where they may be subjected to strain, impact, or damage.
- B. Bonding Interior Metal Ducts: Bond metal air ducts to equipment grounding conductors of associated fans, blowers, electric heaters, and air cleaners. Install bonding jumper to bond across flexible duct connections to achieve continuity.
- C. Connections: Make connections so possibility of galvanic action or electrolysis is minimized. Select connectors, connection hardware, conductors, and connection methods so metals in direct contact are galvanically compatible.
  - 1. Use electroplated or hot-tin-coated materials to ensure high conductivity and to make contact points closer in order of galvanic series.
  - 2. Make connections with clean, bare metal at points of contact.
  - 3. Make aluminum-to-steel connections with stainless-steel separators and mechanical clamps.
  - 4. Make aluminum-to-galvanized-steel connections with tin-plated copper jumpers and mechanical clamps.
  - 5. Coat and seal connections having dissimilar metals with inert material to prevent future penetration of moisture to contact surfaces.

3.4 FIELD QUALITY CONTROL

- A. Perform tests and inspections.
- B. Tests and Inspections:
  - 1. After installing grounding system but before permanent electrical circuits have been energized, test for compliance with requirements.
  - 2. Inspect physical and mechanical condition. Verify tightness of accessible, bolted, electrical connections with a calibrated torque wrench according to manufacturer's written instructions.
- C. Grounding system will be considered defective if it does not pass tests and inspections.
- D. Prepare test and inspection reports.
- E. Report measured ground resistances that exceed the following values:
  - 1. Power and Lighting Equipment or System with Capacity of 500 kVA and Less: 10 ohms.
- F. Excessive Ground Resistance: If resistance to ground exceeds specified values, notify Architect promptly and include recommendations to reduce ground resistance.

END OF SECTION



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 260529 - HANGERS AND SUPPORTS FOR ELECTRICAL SYSTEMS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

A. Section Includes:

1. Steel slotted support systems.
2. Conduit and cable support devices.
3. Support for conductors in vertical conduit.
4. Mounting, anchoring, and attachment components, including powder-actuated fasteners, mechanical expansion anchors, concrete inserts, clamps, through bolts, toggle bolts, and hanger rods.
5. Fabricated metal equipment support assemblies.

1.3 ACTION SUBMITTALS

- A. Submittals shall comply with the requirements of the Construction Contract Clauses, Section 013300 "Submittal Procedures" and the individual sections specifying the work.

- B. Product Data: For each type of product.

1. Include construction details, material descriptions, dimensions of individual components and profiles, and finishes for the following:
  - a. Slotted support systems, hardware, and accessories.
  - b. Clamps.
  - c. Hangers.
  - d. Sockets.
  - e. Eye nuts.
  - f. Fasteners.
  - g. Anchors.
2. Include rated capacities and furnished specialties and accessories.

1.4 INFORMATIONAL SUBMITTALS

- A. Submittals shall comply with the requirements of the Construction Contract Clauses, Section 013300 "Submittal Procedures" and the individual sections specifying the work.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- B. Welding certificates.

1.5 QUALITY ASSURANCE

- A. Welding Qualifications: Qualify procedures and personnel according to the following:

1. AWS D1.1/D1.1M.
2. AWS D1.2/D1.2M.

PART 2 - PRODUCTS

2.1 PERFORMANCE REQUIREMENTS

- A. Surface-Burning Characteristics: Comply with ASTM E 84; testing by a qualified testing agency. Identify products with appropriate markings of applicable testing agency.

1. Flame Rating: Class 1.
2. Self-extinguishing according to ASTM D 635.

2.2 SUPPORT, ANCHORAGE, AND ATTACHMENT COMPONENTS

- A. Steel Slotted Support Systems: Preformed steel channels and angles with minimum 13/32-inch-diameter holes at a maximum of 8 inches o.c. in at least one surface.

1. **Manufacturers:** Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
  - a. [Allied Tube & Conduit; a part of Atkore International.](#)
  - b. [B-line, an Eaton business.](#)
  - c. [ERICO International Corporation.](#)
  - d. [Flex-Strut Inc.](#)
  - e. [Gripple Inc.](#)
  - f. [GS Metals Corp.](#)
  - g. [G-Strut.](#)
  - h. [Haydon Corporation.](#)
  - i. [Metal Ties Innovation.](#)
  - j. [Thomas & Betts Corporation; A Member of the ABB Group.](#)
  - k. [Unistrut; Part of Atkore International.](#)
  - l. [Wesanco, Inc.](#)
2. Standard: Comply with MFMA-4 factory-fabricated components for field assembly.
3. Material for Channel, Fittings, and Accessories: Galvanized steel.
4. Channel Width: Selected for applicable load criteria.
5. Metallic Coatings: Hot-dip galvanized after fabrication and applied according to MFMA-4.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

6. Protect finishes on exposed surfaces from damage by applying a strippable, temporary protective covering before shipping.
- B. Conduit and Cable Support Devices: Steel and malleable-iron hangers, clamps, and associated fittings, designed for types and sizes of raceway or cable to be supported.
- C. Support for Conductors in Vertical Conduit: Factory-fabricated assembly consisting of threaded body and insulating wedging plug or plugs for nonarmored electrical conductors or cables in riser conduits. Plugs shall have number, size, and shape of conductor gripping pieces as required to suit individual conductors or cables supported. Body shall be made of malleable iron.
- D. Structural Steel for Fabricated Supports and Restraints: ASTM A 36/A 36M steel plates, shapes, and bars; black and galvanized.
- E. Mounting, Anchoring, and Attachment Components: Items for fastening electrical items or their supports to building surfaces include the following:
  1. Powder-Actuated Fasteners: Threaded-steel stud, for use in hardened portland cement concrete, steel, or wood, with tension, shear, and pullout capacities appropriate for supported loads and building materials where used.
    - a. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
      - 1) Hilti, Inc.
      - 2) ITW Ramset/Red Head; Illinois Tool Works, Inc.
      - 3) MKT Fastening, LLC.
      - 4) Simpson Strong-Tie Co., Inc.
  2. Mechanical-Expansion Anchors: Insert-wedge-type, zinc-coated steel, for use in hardened portland cement concrete, with tension, shear, and pullout capacities appropriate for supported loads and building materials where used.
    - a. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
      - 1) B-line, an Eaton business.
      - 2) Empire Tool and Manufacturing Co., Inc.
      - 3) Hilti, Inc.
      - 4) ITW Ramset/Red Head; Illinois Tool Works, Inc.
      - 5) MKT Fastening, LLC.
  3. Concrete Inserts: Steel or malleable-iron, slotted support system units are similar to MSS Type 18 units and comply with MFMA-4 or MSS SP-58.
  4. Clamps for Attachment to Steel Structural Elements: MSS SP-58 units are suitable for attached structural element.
  5. Through Bolts: Structural type, hex head, and high strength. Comply with ASTM A 325.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

6. Toggle Bolts: All-steel springhead type.
7. Hanger Rods: Threaded steel.

2.3 FABRICATED METAL EQUIPMENT SUPPORT ASSEMBLIES

- A. Description: Welded or bolted structural-steel shapes, shop or field fabricated to fit dimensions of supported equipment.
- B. Materials: Comply with requirements in Section 055000 "Metal Fabrications" for steel shapes and plates.

PART 3 - EXECUTION

3.1 APPLICATION

- A. Comply with the following standards for application and installation requirements of hangers and supports, except where requirements on Drawings or in this Section are stricter:
  1. NECA 1.
  2. NECA 101
- B. Comply with requirements in Section 078413 "Penetration Firestopping" for firestopping materials and installation for penetrations through fire-rated walls, ceilings, and assemblies.
- C. Comply with requirements for raceways and boxes specified in Section 260533 "Raceways and Boxes for Electrical Systems."
- D. Maximum Support Spacing and Minimum Hanger Rod Size for Raceways: Space supports for EMT, IMC, and RMC as required by NFPA 70. Minimum rod size shall be 1/4 inch in diameter.
- E. Multiple Raceways or Cables: Install trapeze-type supports fabricated with steel slotted or other support system, sized so capacity can be increased by at least 25 percent in future without exceeding specified design load limits.
  1. Secure raceways and cables to these supports with two-bolt conduit clamps.
- F. Spring-steel clamps designed for supporting single conduits without bolts may be used for 1-1/2-inch and smaller raceways serving branch circuits and communication systems above suspended ceilings, and for fastening raceways to trapeze supports.

3.2 SUPPORT INSTALLATION

- A. Comply with NECA 1 and NECA 101 for installation requirements except as specified in this article.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- B. Raceway Support Methods: In addition to methods described in NECA 1, EMT and RMC may be supported by openings through structure members, according to NFPA 70.
- C. Strength of Support Assemblies: Where not indicated, select sizes of components so strength will be adequate to carry present and future static loads within specified loading limits. Minimum static design load used for strength determination shall be weight of supported components plus 200 lb.
- D. Mounting and Anchorage of Surface-Mounted Equipment and Components: Anchor and fasten electrical items and their supports to building structural elements by the following methods unless otherwise indicated by code:
  - 1. To Wood: Fasten with lag screws or through bolts.
  - 2. To New Concrete: Bolt to concrete inserts.
  - 3. To Masonry: Approved toggle-type bolts on hollow masonry units and expansion anchor fasteners on solid masonry units.
  - 4. To Existing Concrete: Expansion anchor fasteners.
  - 5. Instead of expansion anchors, powder-actuated driven threaded studs provided with lock washers and nuts may be used in existing standard-weight concrete 4 inches thick or greater. Do not use for anchorage to lightweight-aggregate concrete or for slabs less than 4 inches thick.
  - 6. To Steel: Welded threaded studs complying with AWS D1.1/D1.1M, with lock washers and nuts.
  - 7. To Light Steel: Sheet metal screws.
  - 8. Items Mounted on Hollow Walls and Nonstructural Building Surfaces: Mount cabinets, panelboards, disconnect switches, control enclosures, pull and junction boxes, transformers, and other devices on slotted-channel racks attached to substrate by means that comply with seismic-restraint strength and anchorage requirements.
- E. Drill holes for expansion anchors in concrete at locations and to depths that avoid the need for reinforcing bars.

### 3.3 INSTALLATION OF FABRICATED METAL SUPPORTS

- A. Comply with installation requirements in Section 055000 "Metal Fabrications" for site-fabricated metal supports.
- B. Cut, fit, and place miscellaneous metal supports accurately in location, alignment, and elevation to support and anchor electrical materials and equipment.
- C. Field Welding: Comply with AWS D1.1/D1.1M.

### 3.4 PAINTING

- A. Touchup: Clean field welds and abraded areas of shop paint. Paint exposed areas immediately after erecting hangers and supports. Use same materials as used for shop painting. Comply with SSPC-PA 1 requirements for touching up field-painted surfaces.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1. Apply paint by brush or spray to provide minimum dry film thickness of 2.0 mils.
- B. Touchup: Comply with requirements in Section 099123 "Interior Painting" for cleaning and touchup painting of field welds, bolted connections, and abraded areas of shop paint on miscellaneous metal.
- C. Galvanized Surfaces: Clean welds, bolted connections, and abraded areas and apply galvanizing-repair paint to comply with ASTM A 780.

END OF SECTION

SECTION 260533 - RACEWAYS AND BOXES FOR ELECTRICAL SYSTEMS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
  - 1. Metal conduits and fittings.
  - 2. Boxes, enclosures, and cabinets.
  - 3. Handholes and boxes for exterior underground cabling.

1.3 ACTION SUBMITTALS

- A. Submittals shall comply with the requirements of the Construction Contract Clauses, Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Product Data: For each type of product.

1.4 INFORMATIONAL SUBMITTALS

- A. Submittals shall comply with the requirements of the Construction Contract Clauses, Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Coordination Drawings: Conduit routing plans, drawn to scale, on which the following items are shown and coordinated with each other, using input from installers of items involved:
  - 1. Structural members in paths of conduit groups with common supports.
  - 2. HVAC and plumbing items and architectural features in paths of conduit groups with common supports.
- C. Qualification Data: For professional engineer.
- D. Source quality-control reports.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

PART 2 - PRODUCTS

2.1 METAL CONDUITS AND FITTINGS

A. Metal Conduit:

1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
  - a. AFC Cable Systems; a part of Atkore International.
  - b. Allied Tube & Conduit; a part of Atkore International.
  - c. Anamet Electrical, Inc.
  - d. Calconduit.
  - e. Electri-Flex Company.
  - f. FSR Inc.
  - g. Korkap.
  - h. NEC, Inc.
  - i. Opti-Com Manufacturing Network, Inc (OMNI).
  - j. O-Z/Gedney; a brand of Emerson Industrial Automation.
  - k. Patriot Aluminum Products, LLC.
  - l. Perma-Cote.
  - m. Picoma Industries, Inc.
  - n. Plasti-Bond.
  - o. Republic Conduit.
  - p. Southwire Company.
  - q. Thomas & Betts Corporation; A Member of the ABB Group.
  - r. Topaz Electric; a division of Topaz Lighting Corp.
  - s. Western Tube and Conduit Corporation.
  - t. Wheatland Tube Company.
2. Listing and Labeling: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
3. GRC: Comply with ANSI C80.1 and UL 6.
4. EMT: Comply with ANSI C80.3 and UL 797.

B. Metal Fittings:

1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
  - a. AFC Cable Systems; a part of Atkore International.
  - b. Allied Tube & Conduit; a part of Atkore International.
  - c. Anamet Electrical, Inc.
  - d. Calconduit.
  - e. Electri-Flex Company.
  - f. FSR Inc.
  - g. Korkap.



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- h. [NEC, Inc.](#)
  - i. [NewBasis.](#)
  - j. [Opti-Com Manufacturing Network, Inc \(OMNI\).](#)
  - k. [O-Z/Gedney; a brand of Emerson Industrial Automation.](#)
  - l. [Patriot Aluminum Products, LLC.](#)
  - m. [Perma-Cote.](#)
  - n. [Picoma Industries, Inc.](#)
  - o. [Plasti-Bond.](#)
  - p. [Republic Conduit.](#)
  - q. [Southwire Company.](#)
  - r. [Thomas & Betts Corporation; A Member of the ABB Group.](#)
  - s. [Topaz Electric; a division of Topaz Lighting Corp.](#)
  - t. [Western Tube and Conduit Corporation.](#)
  - u. [Wheatland Tube Company.](#)
- 2. Comply with NEMA FB 1 and UL 514B.
  - 3. Listing and Labeling: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
  - 4. Fittings, General: Listed and labeled for type of conduit, location, and use.
  - 5. Fittings for EMT:
    - a. Material: Steel or die cast.
    - b. Type: Compression.
- C. Joint Compound for GRC: Approved, as defined in NFPA 70, by authorities having jurisdiction for use in conduit assemblies, and compounded for use to lubricate and protect threaded conduit joints from corrosion and to enhance their conductivity.

## 2.2 BOXES, ENCLOSURES, AND CABINETS

- A. [Manufacturers](#): Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
- 1. [Adalet.](#)
  - 2. [Crouse-Hinds, an Eaton business.](#)
  - 3. [EGS/Appleton Electric.](#)
  - 4. [Erickson Electrical Equipment Company.](#)
  - 5. [FSR Inc.](#)
  - 6. [Hoffman; a brand of Pentair Equipment Protection.](#)
  - 7. [Hubbell Incorporated.](#)
  - 8. [Hubbell Incorporated; Wiring Device-Kellems.](#)
  - 9. [Kraloy.](#)
  - 10. [Milbank Manufacturing Co.](#)
  - 11. [MonoSystems, Inc.](#)
  - 12. [Oldcastle Enclosure Solutions.](#)
  - 13. [O-Z/Gedney; a brand of Emerson Industrial Automation.](#)
  - 14. [Plasti-Bond.](#)
  - 15. [RACO; Hubbell.](#)
  - 16. [Spring City Electrical Manufacturing Company.](#)

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

17. [Stahlin Non-Metallic Enclosures.](#)
  18. [Thomas & Betts Corporation: A Member of the ABB Group.](#)
  19. [Topaz Electric; a division of Topaz Lighting Corp.](#)
  20. [Wiremold / Legrand.](#)
- B. General Requirements for Boxes, Enclosures, and Cabinets: Boxes, enclosures, and cabinets installed in wet locations shall be listed for use in wet locations.
- C. Sheet Metal Outlet and Device Boxes: Comply with NEMA OS 1 and UL 514A.
- D. Cast-Metal Outlet and Device Boxes: Comply with NEMA FB 1, ferrous alloy or aluminum, Type FD, with gasketed cover.
- E. Luminaire Outlet Boxes: Nonadjustable, designed for attachment of luminaire weighing 50 lb. Outlet boxes designed for attachment of luminaires weighing more than 50 lb shall be listed and marked for the maximum allowable weight.
- F. Small Sheet Metal Pull and Junction Boxes: NEMA OS 1.
- G. Cast-Metal Access, Pull, and Junction Boxes: Comply with NEMA FB 1 and UL 1773, cast aluminum or galvanized, cast iron with gasketed cover.
- H. Box extensions used to accommodate new building finishes shall be of same material as recessed box.
- I. Device Box Dimensions: 4 inches square by 2-1/8 inches deep.
- J. Gangable boxes are prohibited.
- K. Hinged-Cover Enclosures: Comply with UL 50 and NEMA 250, Type 1 with continuous-hinge cover with flush latch unless otherwise indicated.
1. Metal Enclosures: Steel, finished inside and out with manufacturer's standard enamel.

### PART 3 - EXECUTION

#### 3.1 RACEWAY APPLICATION

- A. Indoors: Apply raceway products as specified below unless otherwise indicated:
1. Exposed, Not Subject to Physical Damage: EMT.
  2. Exposed, Not Subject to Severe Physical Damage: EMT.
  3. Exposed and Subject to Severe Physical Damage: GRC. Raceway locations include the following:
    - a. Mechanical rooms.
  4. Concealed in Ceilings and Interior Walls and Partitions: EMT.
  5. Boxes and Enclosures: NEMA 250, Type 1.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- B. Minimum Raceway Size: 1/2-inch trade size.
- C. Raceway Fittings: Compatible with raceways and suitable for use and location.
  - 1. Rigid and Intermediate Steel Conduit: Use threaded rigid steel conduit fittings unless otherwise indicated. Comply with NEMA FB 2.10.
  - 2. EMT: Use compression, steel or cast-metal fittings. Comply with NEMA FB 2.10.
  - 3. Flexible Conduit: Use only fittings listed for use with flexible conduit. Comply with NEMA FB 2.20.
- D. Install nonferrous conduit or tubing for circuits operating above 60 Hz. Where aluminum raceways are installed for such circuits and pass through concrete, install in nonmetallic sleeve.

### 3.2 INSTALLATION

- A. Comply with requirements in Section 260529 "Hangers and Supports for Electrical Systems" for hangers and supports.
- B. Comply with NECA 1 and NECA 101 for installation requirements except where requirements on Drawings or in this article are stricter. Comply with NFPA 70 limitations for types of raceways allowed in specific occupancies and number of floors.
- C. Do not fasten conduits onto the bottom side of a metal deck roof.
- D. Keep raceways at least 6 inches away from parallel runs of flues and steam or hot-water pipes. Install horizontal raceway runs above water and steam piping.
- E. Complete raceway installation before starting conductor installation.
- F. Install no more than the equivalent of three 90-degree bends in any conduit run except for control wiring conduits, for which fewer bends are allowed. Support within 12 inches of changes in direction.
- G. Make bends in raceway using large-radius preformed ells. Field bending shall be according to NFPA 70 minimum radii requirements. Use only equipment specifically designed for material and size involved.
- H. Conceal conduit within finished walls, ceilings, and floors unless otherwise indicated. Install conduits parallel or perpendicular to building lines.
- I. Support conduit within 12 inches of enclosures to which attached.
- J. Stub-Ups to Above Recessed Ceilings:
  - 1. Use EMT or RMC for raceways.
  - 2. Use a conduit bushing or insulated fitting to terminate stub-ups not terminated in hubs or in an enclosure.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- K. Threaded Conduit Joints, Exposed to Wet, Damp, Corrosive, or Outdoor Conditions: Apply listed compound to threads of raceway and fittings before making up joints. Follow compound manufacturer's written instructions.
- L. Terminate threaded conduits into threaded hubs or with locknuts on inside and outside of boxes or cabinets. Install bushings on conduits up to 1-1/4-inch trade size and insulated throat metal bushings on 1-1/2-inch trade size and larger conduits terminated with locknuts. Install insulated throat metal grounding bushings on service conduits.
- M. Install raceways square to the enclosure and terminate at enclosures with locknuts. Install locknuts hand tight plus 1/4 turn more.
- N. Do not rely on locknuts to penetrate nonconductive coatings on enclosures. Remove coatings in the locknut area prior to assembling conduit to enclosure to assure a continuous ground path.
- O. Cut conduit perpendicular to the length. For conduits 2-inch trade size and larger, use roll cutter or a guide to make cut straight and perpendicular to the length.
- P. Install pull wires in empty raceways. Use polypropylene or monofilament plastic line with not less than 200-lb tensile strength. Leave at least 12 inches of slack at each end of pull wire. Cap underground raceways designated as spare above grade alongside raceways in use.
- Q. Install raceway sealing fittings at accessible locations according to NFPA 70 and fill them with listed sealing compound. For concealed raceways, install each fitting in a flush steel box with a blank cover plate having a finish similar to that of adjacent plates or surfaces. Install raceway sealing fittings according to NFPA 70.
- R. Install devices to seal raceway interiors at accessible locations. Locate seals so no fittings or boxes are between the seal and the following changes of environments. Seal the interior of all raceways at the following points:
  - 1. Where conduits pass from warm to cold locations, such as boundaries of refrigerated spaces.
  - 2. Conduit extending from interior to exterior of building.
  - 3. Conduit extending into pressurized duct and equipment.
  - 4. Conduit extending into pressurized zones that are automatically controlled to maintain different pressure set points.
  - 5. Where otherwise required by NFPA 70.
- S. Comply with manufacturer's written instructions for solvent welding RNC and fittings.
- T. Mount boxes at heights indicated on Drawings. If mounting heights of boxes are not individually indicated, give priority to ADA requirements. Install boxes with height measured to center of box unless otherwise indicated.
- U. Recessed Boxes in Masonry Walls: Saw-cut opening for box in center of cell of masonry block, and install box flush with surface of wall. Prepare block surfaces to provide a flat surface for a raintight connection between box and cover plate or supported equipment and box.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- V. Horizontally separate boxes mounted on opposite sides of walls so they are not in the same vertical channel.
- W. Locate boxes so that cover or plate will not span different building finishes.
- X. Support boxes of three gangs or more from more than one side by spanning two framing members or mounting on brackets specifically designed for the purpose.
- Y. Fasten junction and pull boxes to or support from building structure. Do not support boxes by conduits.

### 3.3 PROTECTION

- A. Protect coatings, finishes, and cabinets from damage and deterioration.
  - 1. Repair damage to galvanized finishes with zinc-rich paint recommended by manufacturer.
  - 2. Repair damage to PVC coatings or paint finishes with matching touchup coating recommended by manufacturer.

END OF SECTION



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 260553 - IDENTIFICATION FOR ELECTRICAL SYSTEMS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
  - 1. Color and legend requirements for raceways, conductors, and warning labels and signs.
  - 2. Labels.
  - 3. Cable ties.
  - 4. Paint for identification.

1.3 ACTION SUBMITTALS

- A. Submittals shall comply with the requirements of the Construction Contract Clauses, Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Product Data: For each type of product.
  - 1. Include construction details, material descriptions, dimensions of individual components and profiles, and finishes for electrical identification products.
- C. Identification Schedule: For each piece of electrical equipment and electrical system components to be an index of nomenclature for electrical equipment and system components used in identification signs and labels. Use same designations indicated on Drawings.

PART 2 - PRODUCTS

2.1 PERFORMANCE REQUIREMENTS

- A. Comply with ASME A13.1.
- B. Comply with NFPA 70.
- C. Adhesive-attached labeling materials, including label stocks, laminating adhesives, and inks used by label printers, shall comply with UL 969.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- D. Thermal Movements: Allow for thermal movements from ambient and surface temperature changes.

## 2.2 COLOR AND LEGEND REQUIREMENTS

- A. Raceways and Cables Carrying Circuits at 600 V or Less:
  - 1. Legend: Indicate voltage.
- B. Color-Coding for Phase- and Voltage-Level Identification, 600 V or Less: Use colors listed below for ungrounded branch-circuit conductors.
  - 1. Color shall be factory applied.
  - 2. Colors for 208/120-V Circuits:
    - a. Phase A: Black.
    - b. Phase B: Red.
    - c. Phase C: Blue.
  - 3. Color for Neutral: White or gray.
  - 4. Color for Equipment Grounds: Green.
- C. Equipment Identification Labels:
  - 1. Black letters on a white field.

## 2.3 LABELS

- A. Self-Adhesive Wraparound Labels: Preprinted, 3-mil-thick, vinyl flexible label with acrylic pressure-sensitive adhesive.
  - 1. **Manufacturers:** Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
    - a. [A'n D Cable Products.](#)
    - b. [Brady Corporation.](#)
    - c. [Brother International Corporation.](#)
    - d. [emedco.](#)
    - e. [Grafoplast Wire Markers.](#)
    - f. [Ideal Industries, Inc.](#)
    - g. [LEM Products Inc.](#)
    - h. [Marking Services, Inc.](#)
    - i. [Panduit Corp.](#)
    - j. [Seton Identification Products.](#)



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

2. Self-Lamination: Clear; UV-, weather- and chemical-resistant; self-laminating, protective shield over the legend. Labels sized such that the clear shield overlaps the entire printed legend.
3. Marker for Labels: Permanent, waterproof, black ink marker recommended by tag manufacturer.
4. Marker for Labels: Machine-printed, permanent, waterproof, black ink recommended by printer manufacturer.

B. Self-Adhesive Labels: Vinyl, thermal, transfer-printed, 3-mil- thick, multicolor, weather- and UV-resistant, pressure-sensitive adhesive labels, configured for intended use and location.

1. **Manufacturers:** Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
  - a. [A'n D Cable Products.](#)
  - b. [Brady Corporation.](#)
  - c. [Brother International Corporation.](#)
  - d. [emedco.](#)
  - e. [Grafoplast Wire Markers.](#)
  - f. [HellermannTyton.](#)
  - g. [Ideal Industries, Inc.](#)
  - h. [LEM Products Inc.](#)
  - i. [Marking Services, Inc.](#)
  - j. [Panduit Corp.](#)
  - k. [Seton Identification Products.](#)
2. Minimum Nominal Size:
  - a. 1-1/2 by 6 inches for raceway and conductors
  - b. 3-1/2 by 5 inches for equipment.
  - c. As required by authorities having jurisdiction.

2.4 TAGS

A. Write-on Tags:

1. **Manufacturers:** Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
  - a. [Carlton Industries, LP.](#)
  - b. [LEM Products Inc.](#)
  - c. [Seton Identification Products.](#)
2. Polyester Tags: 0.015 inch thick, with corrosion-resistant grommet and cable tie for attachment.
3. Marker for Tags: Permanent, waterproof, black ink marker recommended by tag manufacturer.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

2.5 CABLE TIES

- A. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
1. HellermannTyton.
  2. Ideal Industries, Inc.
  3. Marking Services, Inc.
  4. Panduit Corp.
- B. General-Purpose Cable Ties: Fungus inert, self-extinguishing, one piece, self-locking, and Type 6/6 nylon.
1. Minimum Width: 3/16 inch.
  2. Tensile Strength at 73 Deg F according to ASTM D 638: 12,000 psi.
  3. Temperature Range: Minus 40 to plus 185 deg F.
  4. Color: Black, except where used for color-coding.
- C. UV-Stabilized Cable Ties: Fungus inert, designed for continuous exposure to exterior sunlight, self-extinguishing, one piece, self-locking, and Type 6/6 nylon.
1. Minimum Width: 3/16 inch.
  2. Tensile Strength at 73 Deg F according to ASTM D 638: 12,000 psi.
  3. Temperature Range: Minus 40 to plus 185 deg F.
  4. Color: Black.
- D. Plenum-Rated Cable Ties: Self-extinguishing, UV stabilized, one piece, and self-locking.
1. Minimum Width: 3/16 inch.
  2. Tensile Strength at 73 Deg F according to ASTM D 638: 7000 psi.
  3. UL 94 Flame Rating: 94V-0.
  4. Temperature Range: Minus 50 to plus 284 deg F.
  5. Color: Black.

2.6 MISCELLANEOUS IDENTIFICATION PRODUCTS

- A. Paint: Comply with requirements in painting Sections for paint materials and application requirements. Retain paint system applicable for surface material and location (exterior or interior).
- B. Fasteners for Labels and Signs: Self-tapping, stainless-steel screws or stainless-steel machine screws with nuts and flat and lock washers.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

PART 3 - EXECUTION

3.1 PREPARATION

- A. Self-Adhesive Identification Products: Before applying electrical identification products, clean substrates of substances that could impair bond, using materials and methods recommended by manufacturer of identification product.

3.2 INSTALLATION

- A. Verify and coordinate identification names, abbreviations, colors, and other features with requirements in other Sections requiring identification applications, Drawings, Shop Drawings, manufacturer's wiring diagrams, and operation and maintenance manual. Use consistent designations throughout Project.
- B. Install identifying devices before installing acoustical ceilings and similar concealment.
- C. Verify identity of each item before installing identification products.
- D. Coordinate identification with Project Drawings, manufacturer's wiring diagrams, and operation and maintenance manual.
- E. Apply identification devices to surfaces that require finish after completing finish work.
- F. System Identification for Raceways and Cables under 600 V: Identification shall completely encircle cable or conduit. Place identification of two-color markings in contact, side by side.
  - 1. Secure tight to surface of conductor, cable, or raceway.
- G. Auxiliary Electrical Systems Conductor Identification: Identify field-installed alarm, control, and signal connections.
- H. Elevated Components: Increase sizes of labels, signs, and letters to those appropriate for viewing from the floor.
- I. Accessible Fittings for Raceways: Identify the covers of each junction and pull box of the following systems with the wiring system legend and system voltage. System legends shall be as follows:
  - 1. "POWER."
- J. Vinyl Wraparound Labels:
  - 1. Secure tight to surface of raceway or cable at a location with high visibility and accessibility.
  - 2. Attach labels that are not self-adhesive type with clear vinyl tape, with adhesive appropriate to the location and substrate.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- K. Self-Adhesive Wraparound Labels: Secure tight to surface at a location with high visibility and accessibility.
- L. Self-Adhesive Labels:
  - 1. On each item, install unique designation label that is consistent with wiring diagrams, schedules, and operation and maintenance manual.
  - 2. Unless otherwise indicated, provide a single line of text with 1/2-inch- high letters on 1-1/2-inch- high label; where two lines of text are required, use labels 2 inches high.
- M. Marker Tapes: Secure tight to surface at a location with high visibility and accessibility.
- N. Self-Adhesive Vinyl Tape: Secure tight to surface at a location with high visibility and accessibility.
  - 1. Field-Applied, Color-Coding Conductor Tape: Apply in half-lapped turns for a minimum distance of 6 inches where splices or taps are made. Apply last two turns of tape with no tension to prevent possible unwinding.
- O. Tape and Stencil: Comply with requirements in painting Sections for surface preparation and paint application.
- P. Write-on Tags:
  - 1. Place in a location with high visibility and accessibility.
  - 2. Secure using general-purpose cable ties.
- Q. Cable Ties: General purpose, for attaching tags, except as listed below:
  - 1. Outdoors: UV-stabilized nylon.
  - 2. In Spaces Handling Environmental Air: Plenum rated.

### 3.3 IDENTIFICATION SCHEDULE

- A. Install identification materials and devices at locations for most convenient viewing without interference with operation and maintenance of equipment. Install access doors or panels to provide view of identifying devices.
- B. Identify conductors, cables, and terminals in enclosures and at junctions, terminals, pull points, and locations of high visibility. Identify by system and circuit designation.
- C. Accessible Raceways and Metal-Clad Cables, 600 V or Less, for Service, Feeder, and Branch Circuits, More Than 30 A and 120 V to Ground: Identify with self-adhesive raceway labels.
  - 1. Locate identification at changes in direction, at penetrations of walls and floors, at 50-foot maximum intervals in straight runs, and at 25-foot maximum intervals in congested areas.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- D. Accessible Fittings for Raceways and Cables within Buildings: Identify the covers of each junction and pull box of the following systems with self-adhesive labels containing the wiring system legend and system voltage. System legends shall be as follows:
1. "POWER."

END OF SECTION



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 262726 - WIRING DEVICES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
  - 1. Standard-grade receptacles, 125 V, 20 A.
  - 2. GFCI receptacles, 125 V, 20 A.
  - 3. Toggle switches, 120/277 V, 20 A.
  - 4. Occupancy sensors.
  - 5. Wall plates.

1.3 DEFINITIONS

- A. GFCI: Ground-fault circuit interrupter.
- B. Pigtail: Short lead used to connect a device to a branch-circuit conductor.

1.4 ACTION SUBMITTALS

- A. Submittals shall comply with the requirements of the Construction Contract Clauses, Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Product Data: For each type of product.
- C. Shop Drawings: List of legends and description of materials and process used for premarking wall plates.

1.5 INFORMATIONAL SUBMITTALS

- A. Submittals shall comply with the requirements of the Construction Contract Clauses, Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Field quality-control reports.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1.6 CLOSEOUT SUBMITTALS

- A. Submittals shall comply with the requirements of the Construction Contract Clauses, Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Operation and Maintenance Data: For wiring devices to include in all manufacturers' packing-label warnings and instruction manuals that include labeling conditions.

PART 2 - PRODUCTS

2.1 GENERAL WIRING-DEVICE REQUIREMENTS

- A. Wiring Devices, Components, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and use.
- B. Comply with NFPA 70.
- C. RoHS compliant.
- D. Comply with NEMA WD 1.
- E. Devices that are manufactured for use with modular plug-in connectors may be substituted under the following conditions:
  - 1. Connectors shall comply with UL 2459 and shall be made with stranding building wire.
  - 2. Devices shall comply with requirements in this Section.
- F. Device Color:
  - 1. Wiring Devices Connected to Normal Power System: As selected by Architect unless otherwise indicated or required by NFPA 70 or device listing.
- G. Wall Plate Color: For plastic covers, match device color.
- H. Source Limitations: Obtain each type of wiring device and associated wall plate from single source from single manufacturer.

2.2 STANDARD-GRADE RECEPTACLES, 125 V, 20 A

- A. Duplex Receptacles, 125 V, 20 A:
  - 1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
    - a. Eaton (Arrow Hart).
    - b. Hubbell Incorporated; Wiring Device-Kellems.
    - c. Leviton Manufacturing Co., Inc.



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- d. [Pass & Seymour/Legrand \(Pass & Seymour\).](#)
  2. Description: Two pole, three wire, and self-grounding.
  3. Configuration: NEMA WD 6, Configuration 5-20R.
  4. Standards: Comply with UL 498 and FS W-C-596.
- 2.3 GFCI RECEPTACLES, 125 V, 20 A
- A. Duplex GFCI Receptacles, 125 V, 20 A:
1. **Manufacturers:** Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
    - a. [Eaton \(Arrow Hart\).](#)
    - b. [Hubbell Incorporated; Wiring Device-Kellems.](#)
    - c. [Leviton Manufacturing Co., Inc.](#)
    - d. [Pass & Seymour/Legrand \(Pass & Seymour\).](#)
  2. Description: Integral GFCI with "Test" and "Reset" buttons and LED indicator light. Two pole, three wire, and self-grounding.
  3. Configuration: NEMA WD 6, Configuration 5-20R.
  4. Type: Non-feed through.
  5. Standards: Comply with UL 498, UL 943 Class A, and FS W-C-596.
- 2.4 TOGGLE SWITCHES, 120/277 V, 20 A
- A. Single-Pole Switches, 120/277 V, 20 A:
1. **Manufacturers:** Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
    - a. [Eaton \(Arrow Hart\).](#)
    - b. [Hubbell Incorporated; Wiring Device-Kellems.](#)
    - c. [Leviton Manufacturing Co., Inc.](#)
    - d. [Pass & Seymour/Legrand \(Pass & Seymour\).](#)
  2. Standards: Comply with UL 20 and FS W-S-896.
- B. Pilot-Light, Single-Pole Switches: 120/277 V, 20 A:
1. **Manufacturers:** Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
    - a. [Eaton \(Arrow Hart\).](#)
    - b. [Hubbell Incorporated; Wiring Device-Kellems.](#)

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- c. [Leviton Manufacturing Co., Inc.](#)
  - d. [Pass & Seymour/Legrand \(Pass & Seymour\).](#)
2. Description: Illuminated when switch is on.
  3. Standards: Comply with UL 20 and FS W-S-896.

## 2.5 OCCUPANCY SENSORS

### A. Wall Switch Sensor Light Switch, Dual Technology:

1. **Manufacturers:** Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
  - a. [Eaton \(Arrow Hart\).](#)
  - b. [Hubbell Incorporated; Wiring Device-Kellems.](#)
  - c. [Leviton Manufacturing Co., Inc.](#)
  - d. [Pass & Seymour/Legrand \(Pass & Seymour\).](#)
2. Description: Switchbox-mounted, combination lighting-control sensor and conventional switch lighting-control unit using dual (ultrasonic and passive infrared) technology.
3. Standards: Comply with UL 20.
4. Rated 960 W at 120 V ac for tungsten lighting, 10 A at 120 V ac or 10 A at 277 V ac for fluorescent or LED lighting, and 1/4 hp at 120 V ac.
5. Adjustable time delay of 10 15 20 minutes.

## 2.6 DIMMERS

### A. Wall-Box Dimmers:

1. **Manufacturers:** Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
  - a. [Eaton \(Arrow Hart\).](#)
  - b. [Hubbell Incorporated; Wiring Device-Kellems.](#)
  - c. [Leviton Manufacturing Co., Inc.](#)
  - d. [Lutron Electronics Co., Inc.](#)
  - e. [Pass & Seymour/Legrand \(Pass & Seymour\).](#)
2. Description: Modular, full-wave, solid-state dimmer switch with integral, quiet on-off switches, with audible frequency and EMI/RFI suppression filters.
3. Control: Continuously adjustable slider; with single-pole or three-way switching.
4. Standards: Comply with UL 1472.
  - a. 600 W; dimmers shall require no derating when ganged with other devices.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

5. LED Lamp Dimmer Switches: Modular; compatible with LED lamps; trim potentiometer to adjust low-end dimming; capable of consistent dimming with low end not greater than 20 percent of full brightness.

## 2.7 WALL PLATES

- A. Single Source: Obtain wall plates from same manufacturer of wiring devices.
- B. Single and combination types shall match corresponding wiring devices.
  1. Plate-Securing Screws: Metal with head color to match plate finish.
  2. Material for Finished Spaces: Smooth, high-impact thermoplastic.
  3. Material for Unfinished Spaces: Smooth, high-impact thermoplastic.

## PART 3 - EXECUTION

### 3.1 INSTALLATION

- A. Comply with NECA 1, including mounting heights listed in that standard, unless otherwise indicated.
- B. Coordination with Other Trades:
  1. Protect installed devices and their boxes. Do not place wall finish materials over device boxes, and do not cut holes for boxes with routers that are guided by riding against outside of boxes.
  2. Keep outlet boxes free of plaster, drywall joint compound, mortar, cement, concrete, dust, paint, and other material that may contaminate the raceway system, conductors, and cables.
  3. Install device boxes in brick or block walls so that the cover plate does not cross a joint unless the joint is troweled flush with the face of the wall.
  4. Install wiring devices after all wall preparation, including painting, is complete.
- C. Conductors:
  1. Do not strip insulation from conductors until right before they are spliced or terminated on devices.
  2. Strip insulation evenly around the conductor using tools designed for the purpose. Avoid scoring or nicking of solid wire or cutting strands from stranded wire.
  3. The length of free conductors at outlets for devices shall comply with NFPA 70, Article 300, without pigtails.
  4. Existing Conductors:
    - a. Cut back and pigtail, or replace all damaged conductors.
    - b. Straighten conductors that remain and remove corrosion and foreign matter.
    - c. Pigtail existing conductors is permitted, provided the outlet box is large enough.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

D. Device Installation:

1. Replace devices that have been in temporary use during construction and that were installed before building finishing operations were complete.
2. Keep each wiring device in its package or otherwise protected until it is time to connect conductors.
3. Do not remove surface protection, such as plastic film and smudge covers, until the last possible moment.
4. Connect devices to branch circuits using pigtails that are not less than 6 inches in length.
5. When there is a choice, use side wiring with binding-head screw terminals. Wrap solid conductor tightly clockwise, two-thirds to three-fourths of the way around terminal screw.
6. Use a torque screwdriver when a torque is recommended or required by manufacturer.
7. When conductors larger than No. 12 AWG are installed on 15- or 20-A circuits, splice No. 12 AWG pigtails for device connections.
8. Tighten unused terminal screws on the device.
9. When mounting into metal boxes, remove the fiber or plastic washers used to hold device-mounting screws in yokes, allowing metal-to-metal contact.

E. Receptacle Orientation:

1. Install ground pin of vertically mounted receptacles up, and on horizontally mounted receptacles to the right.
2. Install hospital-grade receptacles in patient-care areas with the ground pin or neutral blade at the top.

F. Device Plates: Do not use oversized or extra-deep plates. Repair wall finishes and remount outlet boxes when standard device plates do not fit flush or do not cover rough wall opening.

G. Dimmers:

1. Install dimmers within terms of their listing.
2. Verify that dimmers used for fan-speed control are listed for that application.
3. Install unshared neutral conductors on line and load side of dimmers according to manufacturers' device, listing conditions in the written instructions.

H. Arrangement of Devices: Unless otherwise indicated, mount flush, with long dimension vertical and with grounding terminal of receptacles on top. Group adjacent switches under single, multigang wall plates.

I. Adjust locations of floor service outlets and service poles to suit arrangement of partitions and furnishings.

3.2 GFCI RECEPTACLES

A. Install non-feed-through GFCI receptacles where protection of downstream receptacles is not required.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

3.3 IDENTIFICATION

- A. Comply with Section 260553 "Identification for Electrical Systems."
- B. Identify each receptacle with panelboard identification and circuit number. Use hot, stamped, or engraved machine printing with black-filled lettering on face of plate, and durable wire markers or tags inside outlet boxes.
- C. Essential Electrical System: Mark receptacles supplied from the essential electrical system to allow easy identification using a self-adhesive label.

3.4 FIELD QUALITY CONTROL

- A. Test Instruments: Use instruments that comply with UL 1436.
- B. Test Instrument for Receptacles: Digital wiring analyzer with digital readout or illuminated digital-display indicators of measurement.
- C. Tests for Receptacles:
  - 1. Line Voltage: Acceptable range is 105 to 132 V.
  - 2. Percent Voltage Drop under 15-A Load: A value of 6 percent or higher is unacceptable.
  - 3. Ground Impedance: Values of up to 2 ohms are acceptable.
  - 4. GFCI Trip: Test for tripping values specified in UL 1436 and UL 943.
  - 5. Using the test plug, verify that the device and its outlet box are securely mounted.
  - 6. Tests shall be diagnostic, indicating damaged conductors, high resistance at the circuit breaker, poor connections, inadequate fault-current path, defective devices, or similar problems. Correct circuit conditions, remove malfunctioning units and replace with new ones, and retest as specified above.
- D. Wiring device will be considered defective if it does not pass tests and inspections.
- E. Prepare test and inspection reports.

END OF SECTION



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 265119 - LED INTERIOR LIGHTING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes the following types of LED luminaires:
  - 1. Downlight.
  - 2. Recessed, linear.
  - 3. Surface mount, nonlinear.

1.3 DEFINITIONS

- A. CCT: Correlated color temperature.
- B. CRI: Color Rendering Index.
- C. Fixture: See "Luminaire."
- D. IP: International Protection or Ingress Protection Rating.
- E. LED: Light-emitting diode.
- F. Lumen: Measured output of lamp and luminaire, or both.
- G. Luminaire: Complete lighting unit, including lamp, reflector, and housing.

1.4 ACTION SUBMITTALS

- A. Submittals shall comply with the requirements of the Construction Contract Clauses, Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Product Data: For each type of product.
  - 1. Arrange in order of luminaire designation.
  - 2. Include data on features, accessories, and finishes.
  - 3. Include physical description and dimensions of luminaires.
  - 4. Include emergency lighting units, including batteries and chargers.
  - 5. Include life, output (lumens, CCT, and CRI), and energy-efficiency data.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- C. Shop Drawings: For nonstandard or custom luminaires.
  - 1. Include plans, elevations, sections, and mounting and attachment details.
  - 2. Include details of luminaire assemblies. Indicate dimensions, weights, loads, required clearances, method of field assembly, components, and location and size of each field connection.
  - 3. Include diagrams for power, signal, and control wiring.
- D. Product Schedule: For luminaires and lamps. Use same designations indicated on Drawings.

1.5 INFORMATIONAL SUBMITTALS

- A. Submittals shall comply with the requirements of the Construction Contract Clauses, Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Qualification Data: For testing laboratory providing photometric data for luminaires.
- C. Product Certificates: For each type of luminaire.
- D. Sample warranty.

1.6 CLOSEOUT SUBMITTALS

- A. Submittals shall comply with the requirements of the Construction Contract Clauses, Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Operation and Maintenance Data: For luminaires and lighting systems to include in operation and maintenance manuals.
  - 1. Provide a list of all lamp types used on Project; use ANSI and manufacturers' codes.

1.7 QUALITY ASSURANCE

- A. Luminaire Photometric Data Testing Laboratory Qualifications: Luminaire manufacturer's laboratory that is accredited under the NVLAP for Energy Efficient Lighting Products.
- B. Luminaire Photometric Data Testing Laboratory Qualifications: Provided by an independent agency, with the experience and capability to conduct the testing indicated, that is an NRTL as defined by OSHA in 29 CFR 1910.7, accredited under the NVLAP for Energy Efficient Lighting Products, and complying with the applicable IES testing standards.
- C. Provide luminaires from a single manufacturer for each luminaire type.
- D. Each luminaire type shall be binned within a three-step MacAdam Ellipse to ensure color consistency among luminaires.



WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1.8 DELIVERY, STORAGE, AND HANDLING

- A. Protect finishes of exposed surfaces by applying a strippable, temporary protective covering before shipping.

1.9 WARRANTY

- A. Warranty: Manufacturer and Installer agree to repair or replace components of luminaires that fail in materials or workmanship within specified warranty period.
- B. Warranty Period: Five year(s) from date of Substantial Completion.

PART 2 - PRODUCTS

2.1 PERFORMANCE REQUIREMENTS

- A. Ambient Temperature: 41 to 104 deg F.
  - 1. Relative Humidity: Zero to 95 percent.
- B. Altitude: Sea level to 1000 feet.

2.2 LUMINAIRE REQUIREMENTS

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. Factory-Applied Labels: Comply with UL 1598. Include recommended lamps. Locate labels where they will be readily visible to service personnel, but not seen from normal viewing angles when lamps are in place.
  - 1. Label shall include the following lamp characteristics:
    - a. "USE ONLY" and include specific lamp type.
    - b. Lamp diameter, shape, size, wattage, and coating.
    - c. CCT and CRI.
- C. Recessed luminaires shall comply with NEMA LE 4.
- D. NRTL Compliance: Luminaires for hazardous locations shall be listed and labeled for indicated class and division of hazard by an NRTL.
- E. FM Global Compliance: Luminaires for hazardous locations shall be listed and labeled for indicated class and division of hazard by FM Global.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

2.3 DOWNLIGHT.

- A. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
1. Amerlux.
  2. Architectural Lighting Works.
  3. Cooper Lighting, an Eaton business.
  4. Edge Lighting.
  5. Edison Price Lighting.
  6. Elite Lighting Corporation.
  7. Eureka.
  8. Focal Point LLC.
  9. Gallium Lighting, LLC.
  10. GE Lighting Solutions.
  11. Juno Lighting Group by Schneider Electric.
  12. Lighting Science Group.
  13. Lighting Services Inc.
  14. Lightolier; a Philips group brand.
  15. Lithonia Lighting; Acuity Brands Lighting, Inc.
  16. MP Lighting.
  17. OSRAM SYLVANIA.
  18. Peerless; Acuity Brands Lighting, Inc.
  19. Pure Lighting.
  20. RAB Lighting.
  21. Sea Gull Lighting.
  22. Specialty Lighting Industries, Inc.
  23. Tech Lighting.
- B. Nominal Operating Voltage: 120 V ac.
- C. Lamp:
1. Minimum allowable efficacy of 80 lm/W.
  2. CRI of minimum 80. CCT of 3000 K.
  3. Rated lamp life of 35,000 hours to L70.
  4. Dimmable from 100 percent to 0 percent of maximum light output.
  5. Internal driver.
  6. Lens Thickness: At least 0.125-inch minimum unless otherwise indicated.
- D. Housings:
1. Extruded-aluminum housing and heat sink.
  2. Clear anodized finish.
  3. Universal mounting bracket.
  4. Integral junction box with conduit fittings.
- E. Doors, Frames, and Other Internal Access: Smooth operating, free of light leakage under operating conditions, and designed to permit relamping without use of tools. Designed to

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

prevent doors, frames, lenses, diffusers, and other components from falling accidentally during relamping and when secured in operating position.

F. Standards:

1. ENERGY STAR certified.
2. RoHS compliant.
3. UL Listing: Listed for damp location.
4. Recessed luminaires shall comply with NEMA LE 4.

2.4 RECESSED, LINEAR

A. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:

1. [Albeo Technologies, Inc; A GE Company.](#)
2. [Architectural Lighting Works.](#)
3. [Axis Lighting, Inc.](#)
4. [Cooper Lighting, an Eaton business.](#)
5. [Elite Lighting Corporation.](#)
6. [Finelite.](#)
7. [Focal Point LLC.](#)
8. [GE Lighting Solutions.](#)
9. [Lithonia Lighting; Acuity Brands Lighting, Inc.](#)
10. [Lumen Pulse.](#)
11. [ON-Q Lighting Systems.](#)
12. [OSRAM SYLVANIA.](#)
13. [RAB Lighting.](#)
14. [Selux Corporation.](#)

B. Nominal Operating Voltage: 120 V ac.

C. Lamp:

1. Minimum allowable efficacy of 85 lm/W.
2. CRI of minimum 80. CCT of 3000 K.
3. Rated lamp life of 35,000 hours to L70.
4. Dimmable from 100 percent to 0 percent of maximum light output.
5. Internal driver.
6. Lens Thickness: At least 0.125-inch minimum unless otherwise indicated.

D. Housings:

1. Extruded-aluminum housing and heat sink.
2. Clear finish.
3. With integral mounting provisions.

E. Doors, Frames, and Other Internal Access: Smooth operating, free of light leakage under operating conditions, and designed to permit relamping without use of tools. Components are

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

designed to prevent doors, frames, lenses, diffusers, and other components from falling accidentally during relamping and when secured in operating position.

F. Standards:

1. ENERGY STAR certified.
2. RoHS compliant.
3. UL Listing: Listed for damp location.
4. NEMA LE 4.

2.5 SURFACE MOUNT, NONLINEAR

A. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:

1. Architectural Lighting Works.
2. Big Ass Solutions.
3. Cooper Lighting, an Eaton business.
4. Edge Lighting.
5. Elite Lighting Corporation.
6. Eureka.
7. Focal Point LLC.
8. GE Lighting Solutions.
9. Lithonia Lighting; Acuity Brands Lighting, Inc.
10. Lumen Pulse.
11. MP Lighting.
12. OSRAM SYLVANIA.
13. Peerless: Acuity Brands Lighting, Inc.
14. Philips Lighting Controls.
15. Pure Lighting.
16. Tech Lighting.

B. Nominal Operating Voltage: 120 V ac.

C. Lamp:

1. Minimum allowable efficacy of 80 lm/W.
2. CRI of minimum 80. CCT of 3000 K.
3. Rated lamp life of 35,000 hours to L70.
4. Dimmable from 100 percent to 0 percent of maximum light output.
5. Internal driver.
6. Lens Thickness: At least 0.125-inch minimum unless otherwise indicated.

D. Housings:

1. Extruded-aluminum housing and heat sink.
2. Clear finish.
3. With integral mounting provisions.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- E. Doors, Frames, and Other Internal Access: Smooth operating, free of light leakage under operating conditions, and designed to permit relamping without use of tools. Components are designed to prevent doors, frames, lenses, diffusers, and other components from falling accidentally during relamping and when secured in operating position.
- F. Standards:
  - 1. ENERGY STAR certified.
  - 2. RoHS compliant.
  - 3. UL Listing: Listed for damp location.

## 2.6 MATERIALS

- A. Metal Parts:
  - 1. Free of burrs and sharp corners and edges.
  - 2. Sheet metal components shall be steel unless otherwise indicated.
  - 3. Form and support to prevent warping and sagging.
- B. Steel:
  - 1. ASTM A 36/A 36M for carbon structural steel.
  - 2. ASTM A 568/A 568M for sheet steel.
- C. Stainless Steel:
  - 1. 1. Manufacturer's standard grade.
  - 2. 2. Manufacturer's standard type, ASTM A 240/240 M.
- D. Galvanized Steel: ASTM A 653/A 653M.
- E. Aluminum: ASTM B 209.

## 2.7 METAL FINISHES

- A. Variations in finishes are unacceptable in the same piece. Variations in finishes of adjoining components are acceptable if they are within the range of approved Samples and if they can be and are assembled or installed to minimize contrast.

## 2.8 LUMINAIRE SUPPORT

- A. Comply with requirements in Section 260529 "Hangers and Supports for Electrical Systems" for channel and angle iron supports and nonmetallic channel and angle supports.
- B. Single-Stem Hangers: 1/2-inch steel tubing with swivel ball fittings and ceiling canopy. Finish same as luminaire.
- C. Wires: ASTM A 641/A 641 M, Class 3, soft temper, zinc-coated steel, 12 gage.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- D. Hook Hangers: Integrated assembly matched to luminaire, line voltage, and equipment with threaded attachment, cord, and locking-type plug.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine substrates, areas, and conditions, with Installer present, for compliance with requirements for installation tolerances and other conditions affecting performance of the Work.
- B. Examine roughing-in for luminaire to verify actual locations of luminaire and electrical connections before luminaire installation.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 TEMPORARY LIGHTING

- A. If approved by the Architect, use selected permanent luminaires for temporary lighting. When construction is sufficiently complete, clean luminaires used for temporary lighting and install new lamps.

3.3 INSTALLATION

- A. Comply with NECA 1.
- B. Install luminaires level, plumb, and square with ceilings and walls unless otherwise indicated.
- C. Install lamps in each luminaire.
- D. Supports:
  - 1. Sized and rated for luminaire weight.
  - 2. Able to maintain luminaire position after cleaning and relamping.
  - 3. Provide support for luminaire without causing deflection of ceiling or wall.
  - 4. Luminaire-mounting devices shall be capable of supporting a horizontal force of 100 percent of luminaire weight and a vertical force of 400 percent of luminaire weight.
- E. Flush-Mounted Luminaires:
  - 1. Secured to outlet box.
  - 2. Attached to ceiling structural members at four points equally spaced around circumference of luminaire.
  - 3. Trim ring flush with finished surface.
- F. Wall-Mounted Luminaires:
  - 1. Attached to structural members in walls.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

2. Do not attach luminaires directly to gypsum board.

3.4 IDENTIFICATION

- A. Identify system components, wiring, cabling, and terminals. Comply with requirements for identification specified in Section 260553 "Identification for Electrical Systems."

3.5 FIELD QUALITY CONTROL

- A. Perform the following tests and inspections:
  1. Operational Test: After installing luminaires, switches, and accessories, and after electrical circuitry has been energized, test units to confirm proper operation.
  2. Test for Emergency Lighting: Interrupt power supply to demonstrate proper operation. Verify transfer from normal power to battery power and retransfer to normal.
- B. Luminaire will be considered defective if it does not pass operation tests and inspections.
- C. Prepare test and inspection reports.

3.6 STARTUP SERVICE

- A. Comply with requirements for startup specified in Section 260943.16 "Addressable-Luminaire Lighting Controls."
- B. Comply with requirements for startup specified in Section 260943.23 "Relay-Based Lighting Controls."

3.7 ADJUSTING

- A. Occupancy Adjustments: When requested within 12 months of date of Substantial Completion, provide on-site assistance in adjusting the direction of aim of luminaires to suit occupied conditions. Make up to two visits to Project during other-than-normal hours for this purpose. Some of this work may be required during hours of darkness.
  1. During adjustment visits, inspect all luminaires. Replace lamps or luminaires that are defective.
  2. Parts and supplies shall be manufacturer's authorized replacement parts and supplies.
  3. Adjust the aim of luminaires in the presence of the Architect.

END OF SECTION





WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

SECTION 284621.13 - CONVENTIONAL FIRE-ALARM SYSTEMS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
  - 1. Notification appliances.

1.3 DEFINITIONS

- A. EMT: Electrical Metallic Tubing.
- B. FACP: Fire Alarm Control Panel.
- C. NICET: National Institute for Certification in Engineering Technologies.

1.4 ACTION SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. General Submittal Requirements:
  - 1. Submittals shall be approved by authorities having jurisdiction prior to submitting them to Architect.
  - 2. Shop Drawings shall be prepared by persons with the following qualifications:
    - a. Trained and certified by manufacturer in fire-alarm system design.
    - b. NICET-certified fire-alarm technician; Level III minimum.
    - c. Licensed or certified by authorities having jurisdiction.
- C. Product Data: For each type of product, including furnished options and accessories.
  - 1. Include construction details, material descriptions, dimensions, and profiles and finishes.
  - 2. Include rated capacities, operating characteristics, and electrical characteristics.
- D. Shop Drawings: For fire-alarm system.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1. Include voltage drop calculations for notification-appliance circuits.
  2. Include input/output matrix.
  3. Include statement from manufacturer that all equipment and components have been tested as a system and meet all requirements in this Specification and in NFPA 72.
- E. Delegated-Design Submittal: For notification appliances and smoke and heat detectors, in addition to submittals listed above, indicate compliance with performance requirements and design criteria, including analysis data, signed and sealed by the qualified professional engineer responsible for their preparation.
1. Indicate audible appliances required to produce square wave signal per NFPA 72.

1.5 INFORMATIONAL SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Qualification Data: For Installer.
- C. Field quality-control reports.
- D. Sample Warranty: For special warranty.

1.6 CLOSEOUT SUBMITTALS

- A. Submittals shall comply with the requirements of Section 013300 "Submittal Procedures" and the individual sections specifying the work.
- B. Operation and Maintenance Data: For fire-alarm systems and components to include in emergency, operation, and maintenance manuals.
  1. In addition to items specified in Section 017823 "Operation and Maintenance Data," include the following:
    - a. Comply with the "Records" section of the "Inspection, Testing and Maintenance" chapter in NFPA 72.
    - b. Provide the "Fire Alarm and Emergency Communications System Record of Completion Documents" according to the "Completion Documents" article in the "Documentation" section of the "Fundamentals" chapter in NFPA 72.
    - c. Complete wiring diagrams showing connections between all devices and equipment. Each conductor shall be numbered at every junction point with indication of origination and termination points.
    - d. Riser diagram.
    - e. Record copy of site-specific software.
    - f. Provide the "Inspection and Testing Form" according to the "Inspection, Testing and Maintenance" chapter in NFPA 72, and include the following:
      - 1) Equipment tested.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

- 2) Frequency of testing of installed components.
  - 3) Frequency of inspection of installed components.
  - 4) Requirements and recommendations related to results of maintenance.
  - 5) Manufacturer's user training manuals.
- g. Manufacturer's required maintenance related to system warranty requirements.
  - h. Abbreviated operating instructions for mounting at fire-alarm control unit and each annunciator unit.

1.7 QUALITY ASSURANCE

- A. Installer Qualifications: Personnel shall be trained and certified by manufacturer for installation of units required for this Project.
- B. NFPA Certification: Obtain certification according to NFPA 72 by an NRTL (nationally recognized testing laboratory).

1.8 PROJECT CONDITIONS

- A. Perform a full test of the existing system prior to starting work. Document any equipment or components not functioning as designed.
- B. Interruption of Existing Fire-Alarm Service: Do not interrupt fire-alarm service to facilities occupied by Owner or others unless permitted under the following conditions and then only after arranging to provide temporary guard service according to requirements indicated:
  - 1. Notify Owner no fewer than seven days in advance of proposed interruption of fire-alarm service.
  - 2. Do not proceed with interruption of fire-alarm service without Owner's written permission.
- C. Use of Devices during Construction: Protect devices during construction unless devices are placed in service to protect the facility during construction.

1.9 SEQUENCING AND SCHEDULING

- A. Existing Fire-Alarm Equipment: Maintain existing equipment fully operational until new equipment has been tested and accepted. As new equipment is installed, label it "NOT IN SERVICE" until it is accepted. Remove labels from new equipment when put into service.

1.10 WARRANTY

- A. Special Warranty: Manufacturer agrees to repair or replace fire-alarm system equipment and components that fail in materials or workmanship within specified warranty period.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

1. Warranty Extent: All equipment and components not covered in the Maintenance Service Agreement.
2. Warranty Period: Five years from date of Substantial Completion.

PART 2 - PRODUCTS

2.1 SYSTEM DESCRIPTION

- A. Source Limitations for Fire-Alarm System and Components: Components shall be compatible with and operate as an extension of existing system. Provide system manufacturer's certification that all components provided have been tested as, and will operate as, a system.
- B. Noncoded system dedicated to fire-alarm service only.
- C. All components provided shall be listed for use with the selected system.
- D. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.

2.2 NOTIFICATION APPLIANCES

- A. Manufacturers: Subject to compliance with requirements, provide products by the following:
  1. Honeywell.
- B. General Requirements for Notification Appliances: Connected to notification-appliance signal circuits, zoned as indicated, equipped for mounting as indicated, and with screw terminals for system connections.
- C. Visible Notification Appliances: Xenon strobe lights complying with UL 1971, with clear or nominal white polycarbonate lens mounted on an aluminum faceplate. The word "FIRE" is engraved in minimum 1-inch-high letters on the lens.
  1. Rated Light Output:
    - a. 15/30/75/110 cd, selectable in the field.
  2. Mounting: Wall mounted unless otherwise indicated.
  3. For units with guards to prevent physical damage, light output ratings shall be determined with guards in place.
  4. Flashing shall be in a temporal pattern, synchronized with other units.
  5. Strobe Leads: Factory connected to screw terminals.
  6. Mounting Faceplate: Factory finished, white.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine areas and conditions for compliance with requirements for ventilation, temperature, humidity, and other conditions affecting performance of the Work.
  - 1. Verify that manufacturer's written instructions for environmental conditions have been permanently established in spaces where equipment and wiring are installed, before installation begins.
- B. Examine roughing-in for electrical connections to verify actual locations of connections before installation.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 EQUIPMENT INSTALLATION

- A. Comply with NFPA 72, NFPA 101, and requirements of authorities having jurisdiction for installation and testing of fire-alarm equipment. Install all electrical wiring to comply with requirements in NFPA 70 including, but not limited to, Article 760, "Fire Alarm Systems."
- B. Connecting to Existing Equipment: Verify that existing fire-alarm system is operational before making changes or connections.
  - 1. Connect new equipment to the existing control panel in the existing part of the building.
  - 2. Expand, modify, and supplement the existing control equipment as necessary to extend the existing control functions to the new points. New components shall be capable of merging with the existing configuration without degrading the performance of either system.
- C. Install wall-mounted equipment, with tops of cabinets not more than 78 inches above the finished floor.
- D. Visible Alarm-Indicating Devices: Install adjacent to each alarm bell or alarm horn and at least 6 inches below the ceiling. Install all devices at the same height unless otherwise indicated.

3.3 PATHWAYS

- A. Pathways above recessed ceilings and in nonaccessible locations may be routed exposed.
  - 1. Exposed pathways located less than 96 inches above the floor shall be installed in EMT.
- B. Pathways shall be installed in EMT.
- C. Exposed EMT shall be painted red enamel.

WOODBURY CAMPUS CENTER BATHROOM INSTALLATION  
UNIVERSITY OF SOUTHERN MAINE  
PORTLAND, MAINE

3.4 IDENTIFICATION

- A. Identify system components, wiring, cabling, and terminals. Comply with requirements for identification specified in Section 260553 "Identification for Electrical Systems."
- B. Install framed instructions in a location visible from fire-alarm control unit.

3.5 GROUNDING

- A. Ground fire-alarm control unit and associated circuits; comply with IEEE 1100. Install a ground wire from main service ground to fire-alarm control unit.
- B. Ground shielded cables at the control panel location only. Insulate shield at device location.

3.6 FIELD QUALITY CONTROL

- A. Field tests shall be witnessed by authorities having jurisdiction.
- B. Manufacturer's Field Service: Engage a factory-authorized service representative to test and inspect components, assemblies, and equipment installations, including connections.
- C. Perform the following tests and inspections:
  - 1. Visual Inspection: Conduct the visual inspection prior to testing.
    - a. Inspection shall be based on completed record Drawings and system documentation that is required by NFPA 72 in Chapter 10 "Fundamentals," Section 10.18.21 "Completion Documents, Preparation."
    - b. Comply with NFPA 72, Chapter 14, "Inspection, Testing, and Maintenance," Section 14.3, "Inspection" and the "Visual Inspection Frequencies" Table; retain the "Initial/Reacceptance" column and list only the installed components.
  - 2. System Testing: Comply with NFPA 72, Chapter 14, "Inspection, Testing, and Maintenance," Section 14.4 "Testing" and the "Test Methods" Table.
  - 3. Test visible appliances for the public operating mode according to manufacturer's written instructions.
  - 4. Factory-authorized service representative shall prepare the "Fire Alarm System Record of Completion" in the "Documentation" section of the "Fundamentals" chapter in NFPA 72 and the "Inspection and Testing Form" in the "Records" section of the "Inspection, Testing and Maintenance" chapter in NFPA 72.
- D. Reacceptance Testing: Perform reacceptance testing to verify the proper operation of added or replaced devices and appliances.
- E. Fire-alarm system will be considered defective if it does not pass tests and inspections.
- F. Prepare test and inspection reports.

END OF SECTION

