NFPA LEGEND

- (S) SMOKE DETECTION
- EMERGENCY LIGHT
- EXIT LIGHT
- (FE) 10# ABC FIRE EXTINGUISHER w/ BRACKET
- NOT AN EXIT SIGN
- 1/2 HR. RATED WALL SEE DETAIL XXXXXXX

NFPA 13R SPRINKLER SYSTEM

FULL NFPA 13R SPRINKLER SYSTEM SHALL BE DESIGNED BY DESIGN BUILD SPRINKLER CONTRACTOR. SYSTEM SHALL BE REVISED AND REVIEWED AND CERTIFIED FOR CONFORMANCE BY THE LOCAL FIRE DEPARTMENT OFFICE PRIOR TO COMMENCMENT OF THE WORK.

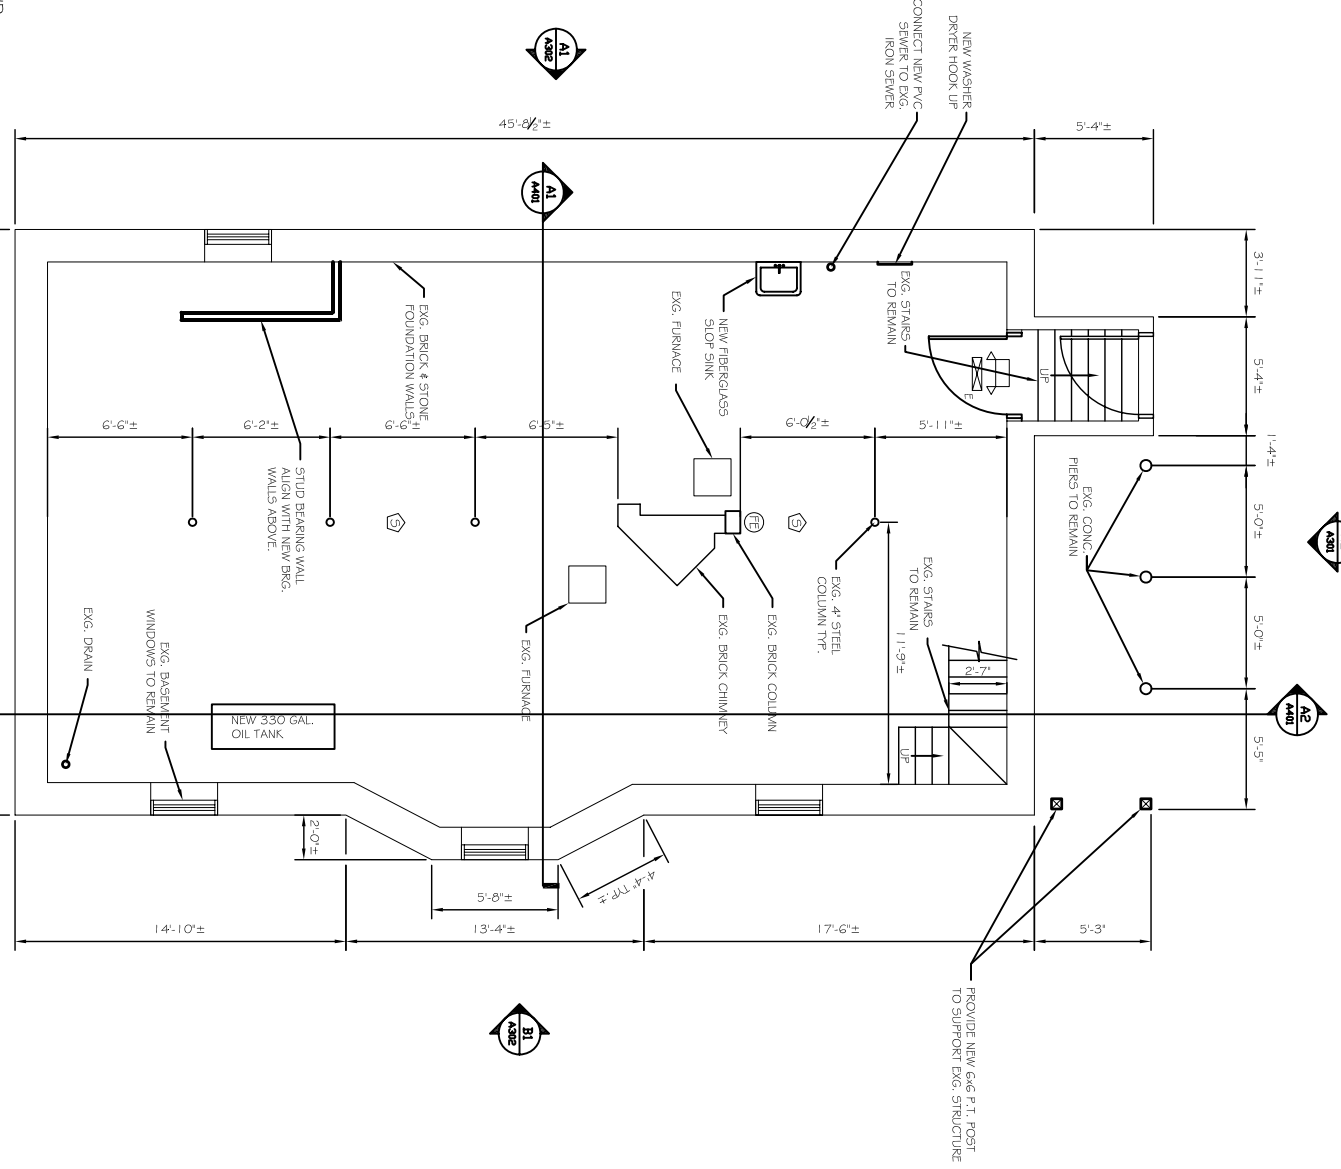

PROPOSED BASEMENT PLAN

A2

SCALE: ¼"= 1'-0"

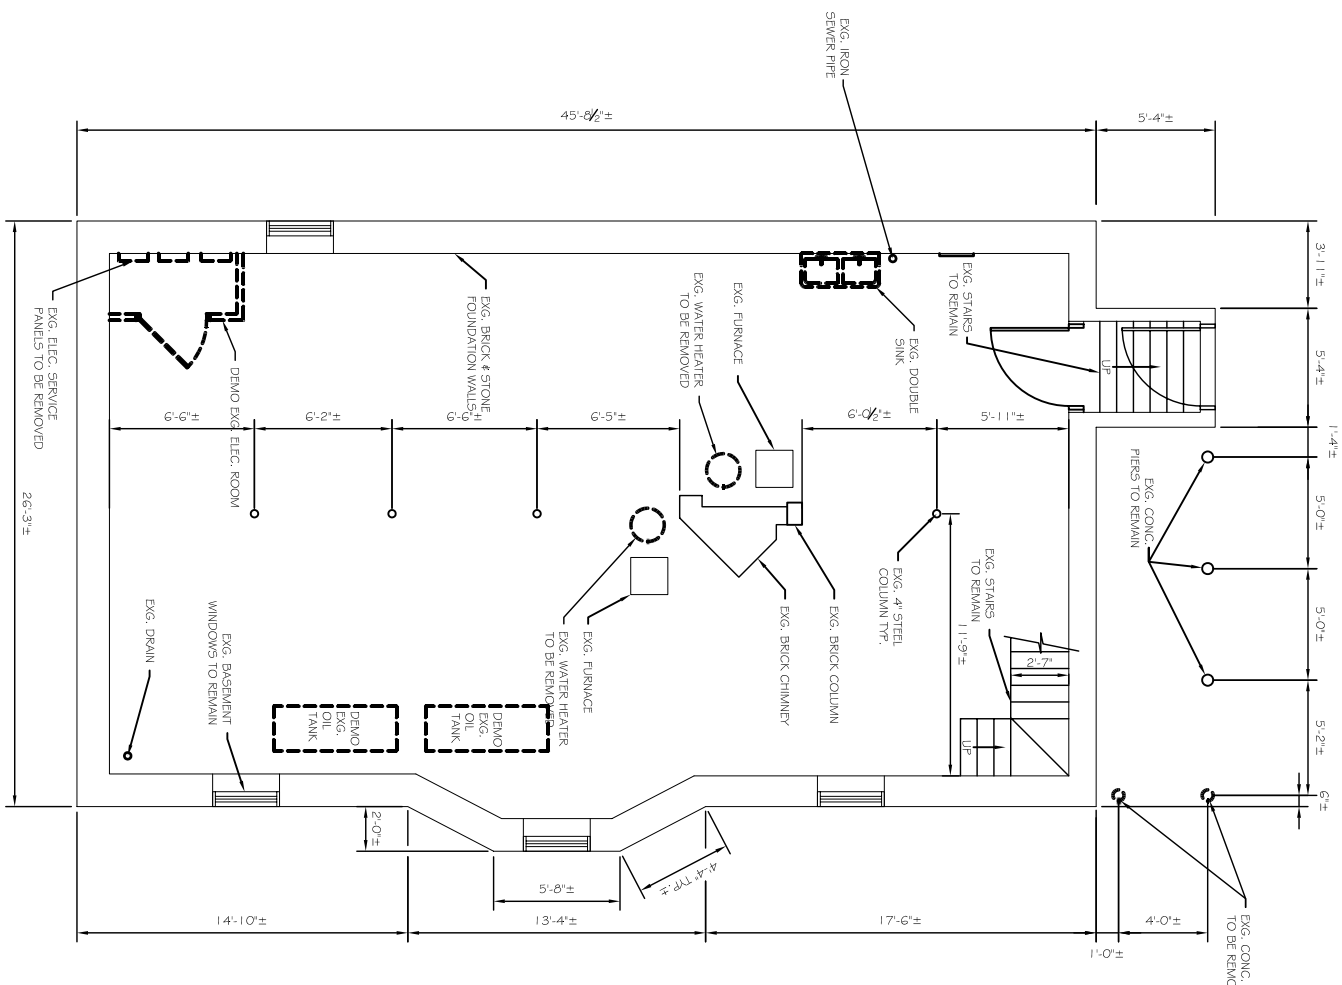

NOTES:
1. ALL EXISTING ITEMS TO REMAIN UNLESS DENOTED "REMOVE"
2. EXG. FURNACES TO BE INSPECTED LISCENCED TECHNICIAN. FURNACES TO REMAIN IF FOUND TO BE IN ACCEPTABLE WORKING CONDITION.
3. CLEAN & TREAT ALL SURFACES FOR MOLD.

EXISTING BASEMENT PLAN W/ DEMO

A1

SCALE: ¼"= 1'-0"

REVISIONS			
No.	BY	DESCRIPTION	DATE
1			
2			
3			
4			

DATE : 12/15/06
SCALE : AS NOTED
DESIGN BY: ASW
DRAWN BY: RSC
FILE #: 06095-A100.DWG
PROJECT NUMBER: 06095
SHEET NO: A100

PROJECT: **BOLES RESIDENCE**
PORTLAND, MAINE
FOR: ELIAS BOLES

SHEET TITLE:
EXISTING + PROPOSED BASEMENT PLAN
ISSUED FOR PERMITTING

THE GENERAL DESIGN AND ELECTRONIC FILE ARE THE PROPERTY OF ASSOCIATED DESIGN PARTNERS, INC. THE REPRODUCTION, COPYING OR ANY OTHER USE OF THIS DOCUMENT WITHOUT WRITTEN CONSENT IS PROHIBITED.

ASSOCIATED DESIGN PARTNERS INC.
80 Leighton Road
Falmouth, Maine 04105
Office: (207) 878-1751
Fax: (207) 878-1788
E-Mail: adp@adpengineering.com