


A



DOOR WILL BE 32x80 FIRE RATED TO 90 MIN.
NEW FIRE DOOR LOCATION IS IN RED
DOOR FRAMING WILL BE 2X4 WOOD AND COVERED
WITH FIRE CODE 5/8" DRYWALL

Reviewed for Code Compliance
Permitting and Inspections Department
Approved with Conditions

10/24/2018

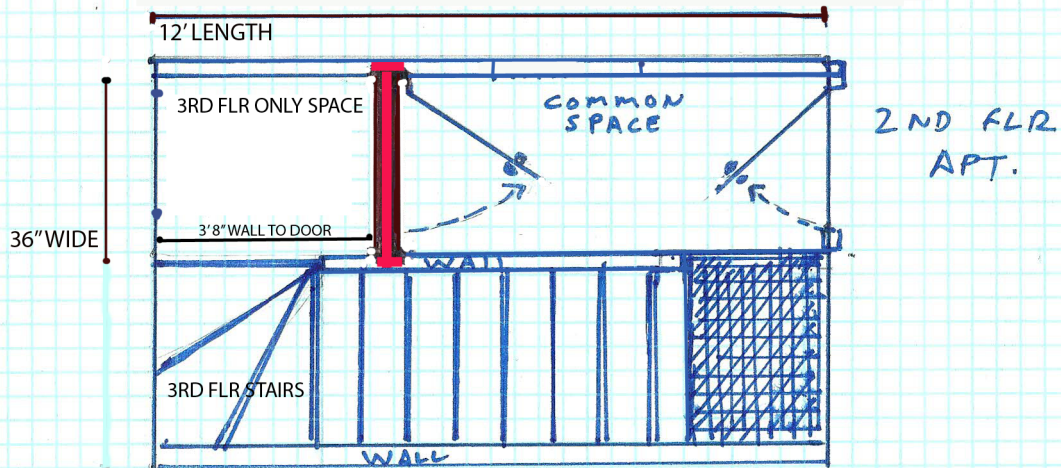




Reviewed for Code Compliance
Permitting and Inspections Department
Approved with Conditions

10/24/2018

B

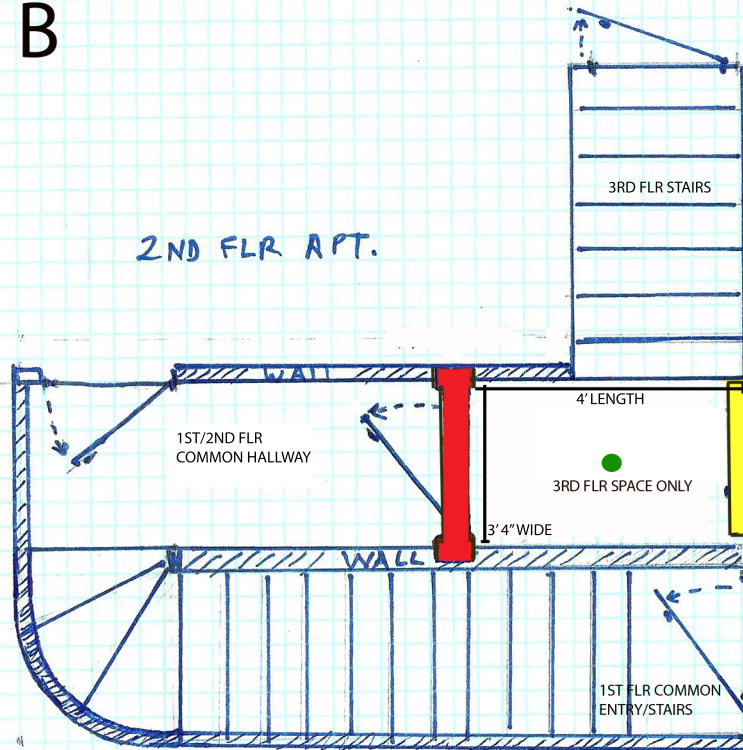

NEW 90 MIN DOOR MARKED IN RED- SIZED 36"X80"
REMOVAL OF UNUSED DOOR IN YELLOW- REFRAMED SPACE 32X80"
ALL FRAMING TO BE 2X4 AND FINISHED WITH 5/8" FIRE CODE SHEETROCK