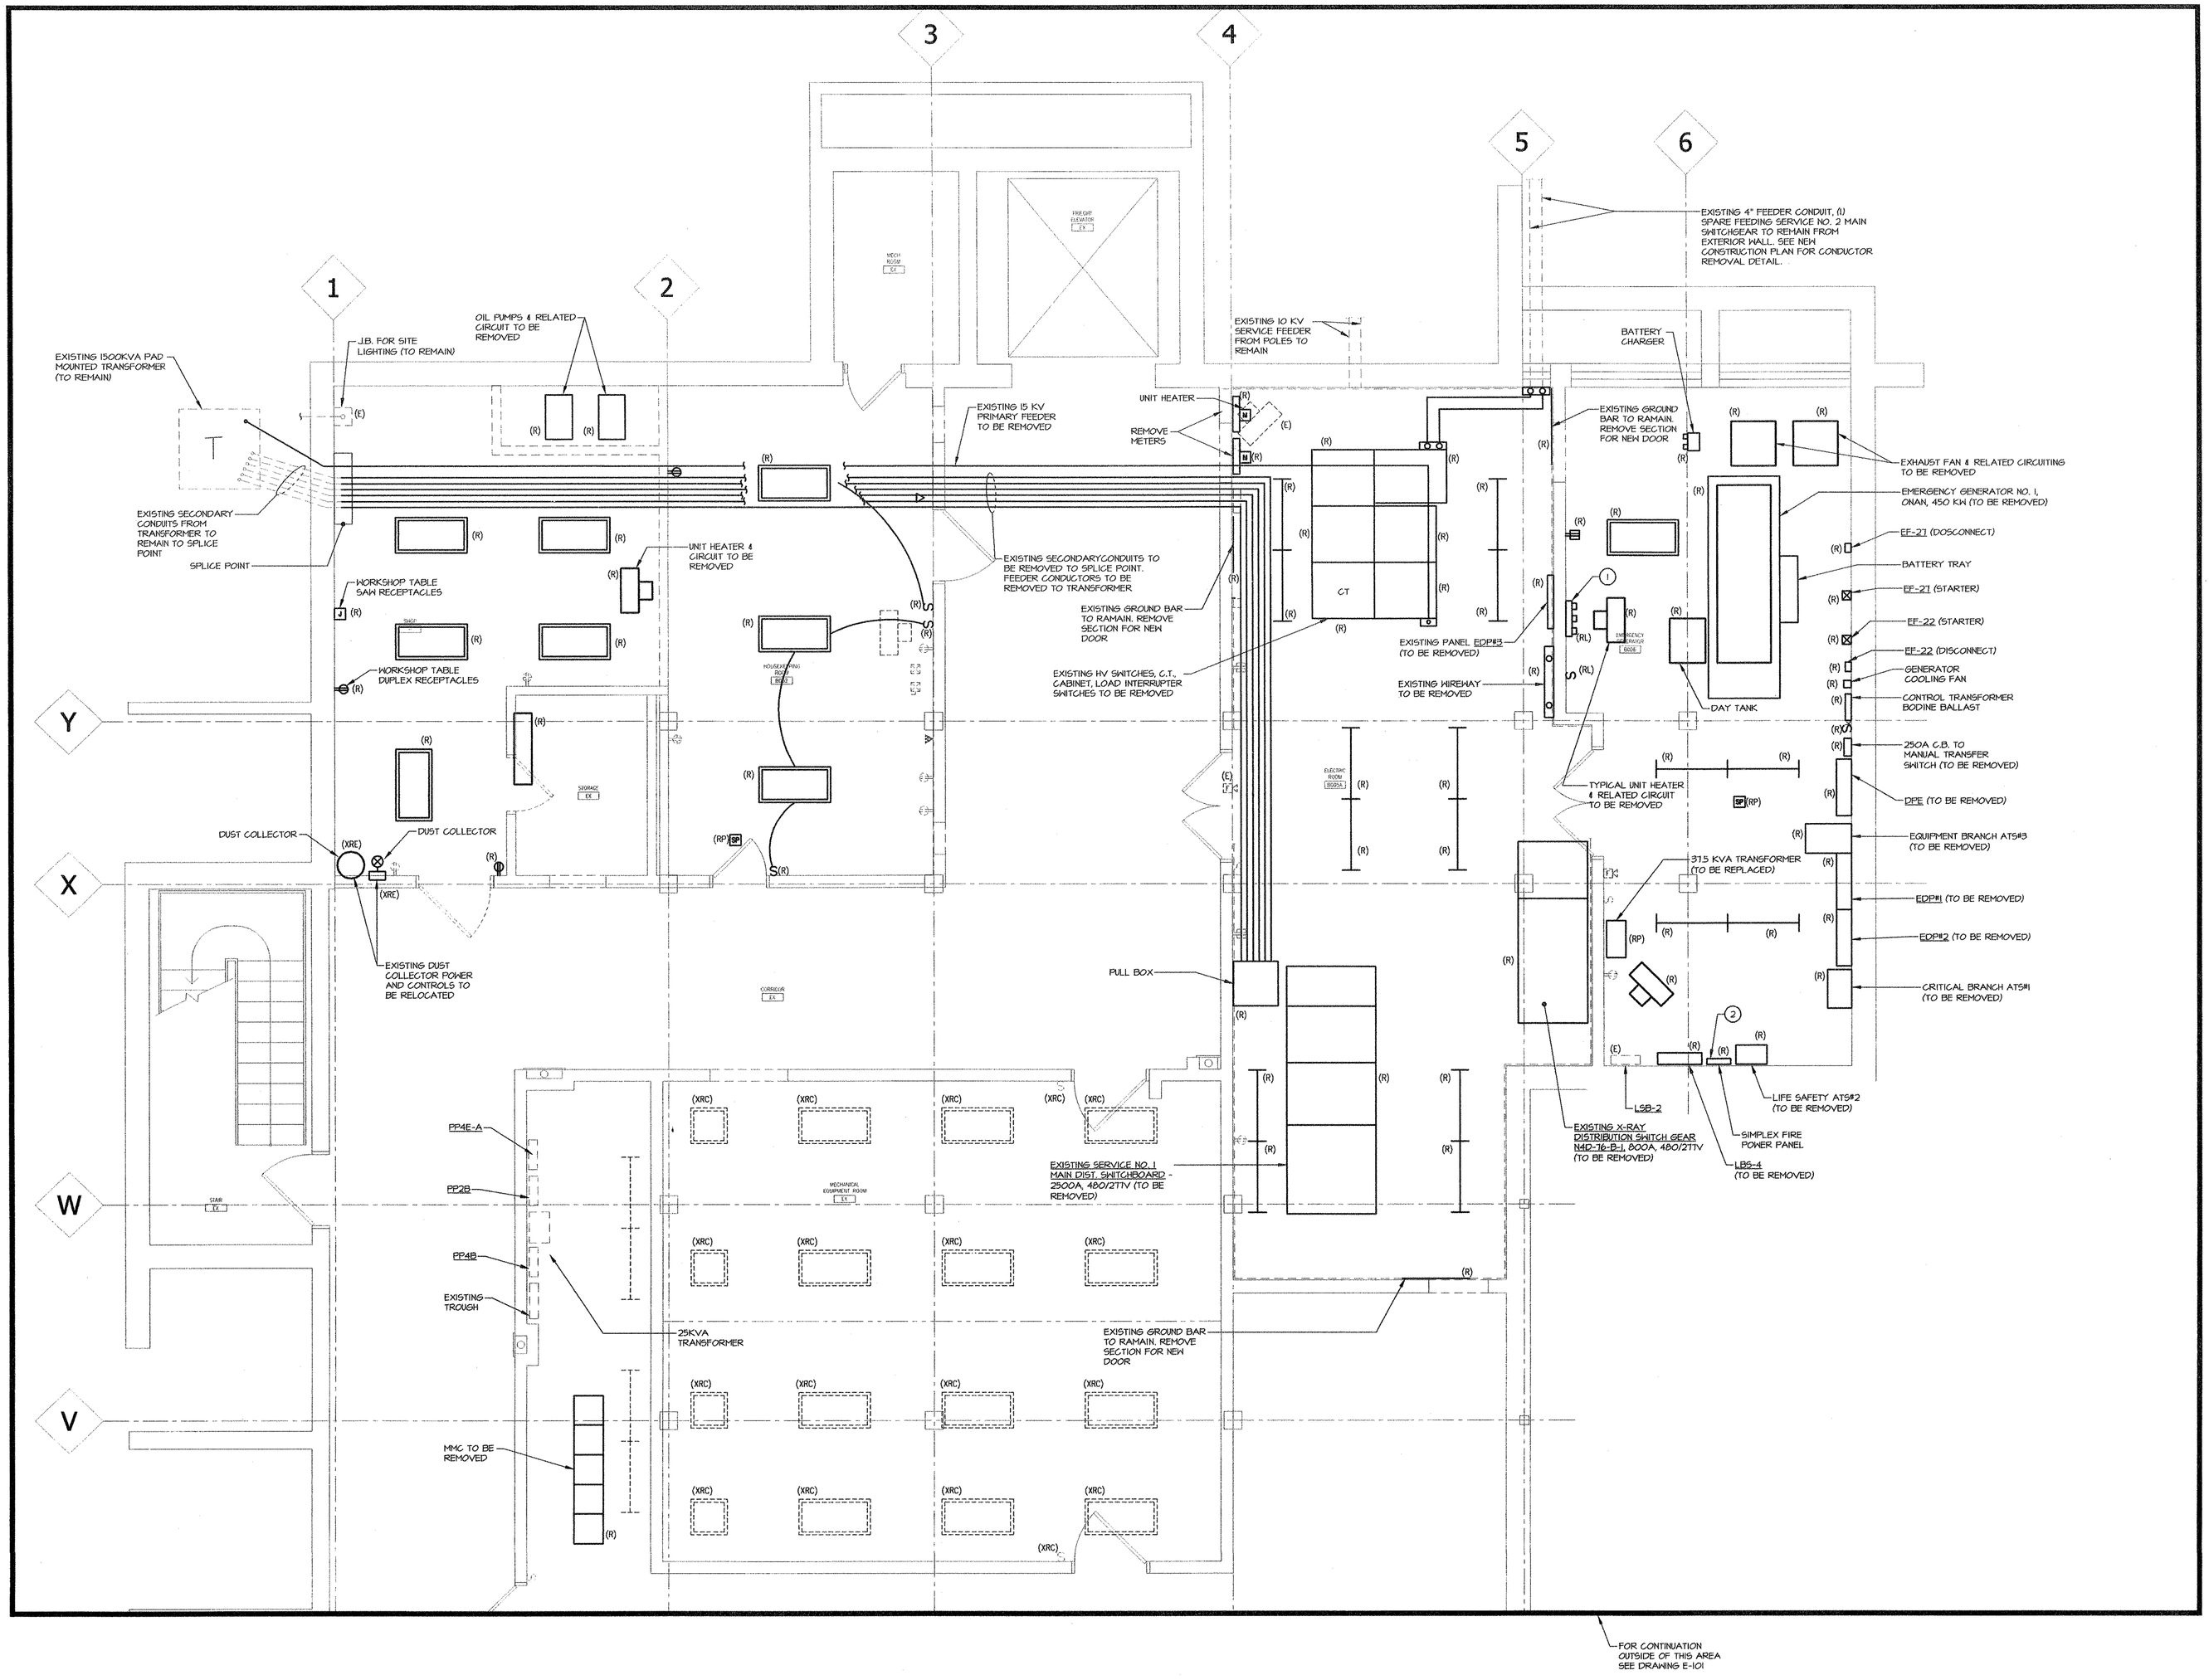

BASEMENT - ELECTRICAL - DEMOLITION

SCALE: 1/4"=1'-0"

DEMOLITION DRAWING NOTES

1. THE CONTRACTOR SHALL DISCONNECT AND REMOVE ALL EXISTING CIRCUITS TO MECHANICAL EQUIPMENT BEING REMOVED. REFER TO MECHANICAL DEMOLITION DRAWINGS FOR LOCATIONS.
2. WHERE ELECTRICAL ITEMS ARE REMOVED, ALL BRANCH CIRCUIT WIRING SHALL BE REMOVED BACK TO PANEL SERVING THE EQUIPMENT. WHERE CIRCUITS SERVE ADDITIONAL DEVICES OR EQUIPMENT REMAINING, WIRING SHALL BE REMOVED BACK TO THE NEAREST ACTIVE JUNCTION BOX.
3. THE CONTRACTOR SHALL MAINTAIN CONTINUITY OF EXISTING CIRCUITS THAT ARE TO REMAIN IN OPERATION.
4. ALL UNUSED CIRCUITS REMAINING AFTER REMOVALS SHALL BECOME SPARE IN PANELS.
5. ALL ELECTRICAL INFORMATION SHOWN IS FROM EXISTING DRAWINGS AND FIELD NOTES AND IS TO BE USED AS GUIDE FOR EQUIPMENT LOCATION. CONTRACTOR SHALL VISIT THE SITE TO VERIFY EXISTING CONDITIONS PRIOR TO SUBMISSION OF BID. NO ADDITIONAL COMPENSATION SHALL BE CONSIDERED FOR FAILURE TO OBSERVE THIS REQUIREMENT.
6. THE CONTRACTOR SHALL REFER TO ARCHITECTURAL DEMOLITION DRAWINGS FOR ADDITIONAL INFORMATION AND SCOPE OF DEMOLITION.
7. ALL MATERIALS AND EQUIPMENT REMOVALS SHALL BE DISPOSED OF AS DIRECTED BY THE OWNER OR THE ARCHITECT.
8. THE CONTRACTOR SHALL DISCONNECT AND REMOVE ALL ELECTRICAL WIRING AND EQUIPMENT AS REQUIRED WITHIN ALL AREAS TO BE RENOVATED. THIS SHALL INCLUDE, BUT NOT BE LIMITED TO, FIXTURES, DEVICES, OUTLETS, SWITCHES, RECEPTACLES, STARTERS, DISCONNECTS, PANELS, FEEDERS, ETC.
9. UNLESS OTHERWISE NOTED, EXISTING DEVICES TO BE REMOVED ARE SHOWN BOLD ON DEMOLITION PLANS.
10. THE CONTRACTOR SHALL REMOVE ALL ELECTRICAL DEVICES FROM EXISTING WALL AND CEILING BEING REMOVED AND MODIFIED UNDER THIS CONTRACT. ALL EXISTING CONDUIT AND WIRING FEEDING THESE DEVICES SHALL BE REMOVED, TERMINATED OR REUSED AS DESCRIBED BELOW.

A. CONDUIT FEEDING DEVICES FROM SLAB SHALL BE CUT OFF BELOW SLAB AND ABANDONED WITH HOLE IN SLAB BEING PATCHED BACK TO MATCH EXISTING. CONDUIT MAY ALSO BE EXTENDED IF NECESSARY, WITH NEW WIRING PULLED THE ENTIRETY OF CIRCUIT.

B. CONDUIT FEEDING DEVICES SHALL BE DISCONNECTED AND REMOVED BACK TO THE SOURCE OR RECONNECTED AS DESCRIBED IN NEW CONSTRUCTION NOTES.

C. ELECTRICAL CONTRACTOR SHALL MAINTAIN THE INTEGRITY OF ALL EXISTING FEED-THROUGH CIRCUITS. WHERE ELECTRICAL DEVICES HAS BEEN REMOVED FROM MIDPOINT OF CIRCUIT, NEW WIRE SHALL BE PULLED AS REQUIRED.

11. ALL DEVICES SHOWN ARE BASED ON EXISTING DRAWINGS AND FIELD NOTES AND SHALL ASSIST CONTRACTOR FOR ESTIMATING PURPOSES ONLY.

DRAWING E-102 NUMBERED NOTES

1. 24"x4"x4" TROUGH WITH (3) FIRE ALARM MODULES BELOW TO BE RELOCATED.
2. EXISTING PANEL TO SERVE SIMPLEX FIRE ALARM PANEL TO BE REMOVED. RELOCATE (1) 20A-2 POLE CIRCUIT TO EXISTING PANEL "LSB-2".

Maine Medical Center
centered around you

Generator MV Gear Replacement

DAI
DiGIORGIO ASSOCIATES INC.
ARCHITECTURE
PLANNING
INTERIOR DESIGN
ENGINEERING

BOSTON
225 FRIEND STREET
BOSTON, MA 02114
TEL. 617.723.7100
FAX. 617.723.9113

MAINE
484 MAINE AVE., SUITE 2B
FARMINGDALE, ME 04344
TEL. 207.582.2400
FAX. 207.582.8320

MID-ATLANTIC REGION
46169 WESTLAKE DR., SUITE 320
POTOMAC FALLS, VA 20165
TEL. 703.421.5600
FAX. 703.421.5669

CONSULTANT:

ISSUE:

LETTER:	DATE:	DESCRIPTION:
A	05/08/09	100% OWNER REVIEW SET
B	08/13/09	ISSUED FOR BID

REVISION:

NO:	DATE:	DESCRIPTION:

KEY PLAN:

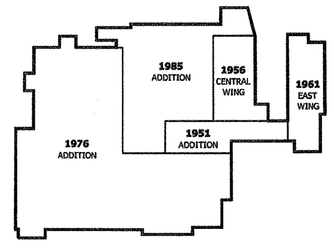

DRAWING TITLE:
BASEMENT ELECTRICAL DEMOLITION

DRAWN BY: MEB	SEAL:
CHECKED BY: AG	
SCALE: AS NOTED	
PROJECT NO.: 093274.00.E	

DRAWING NO.:
E-102

CAD FILE NAME:
R:\Dwg - Engineering\093274.00.E MMC - Generator - MV Gear Replacement\Project\Sheets\Drawing Set\Electrical\E-102.dwg

Monday, August 31, 2009 - 1:35:57 PM - mbenner