


ELECTRICAL DIMENSION PLAN

SCALE: 1/4" = 1'-0"

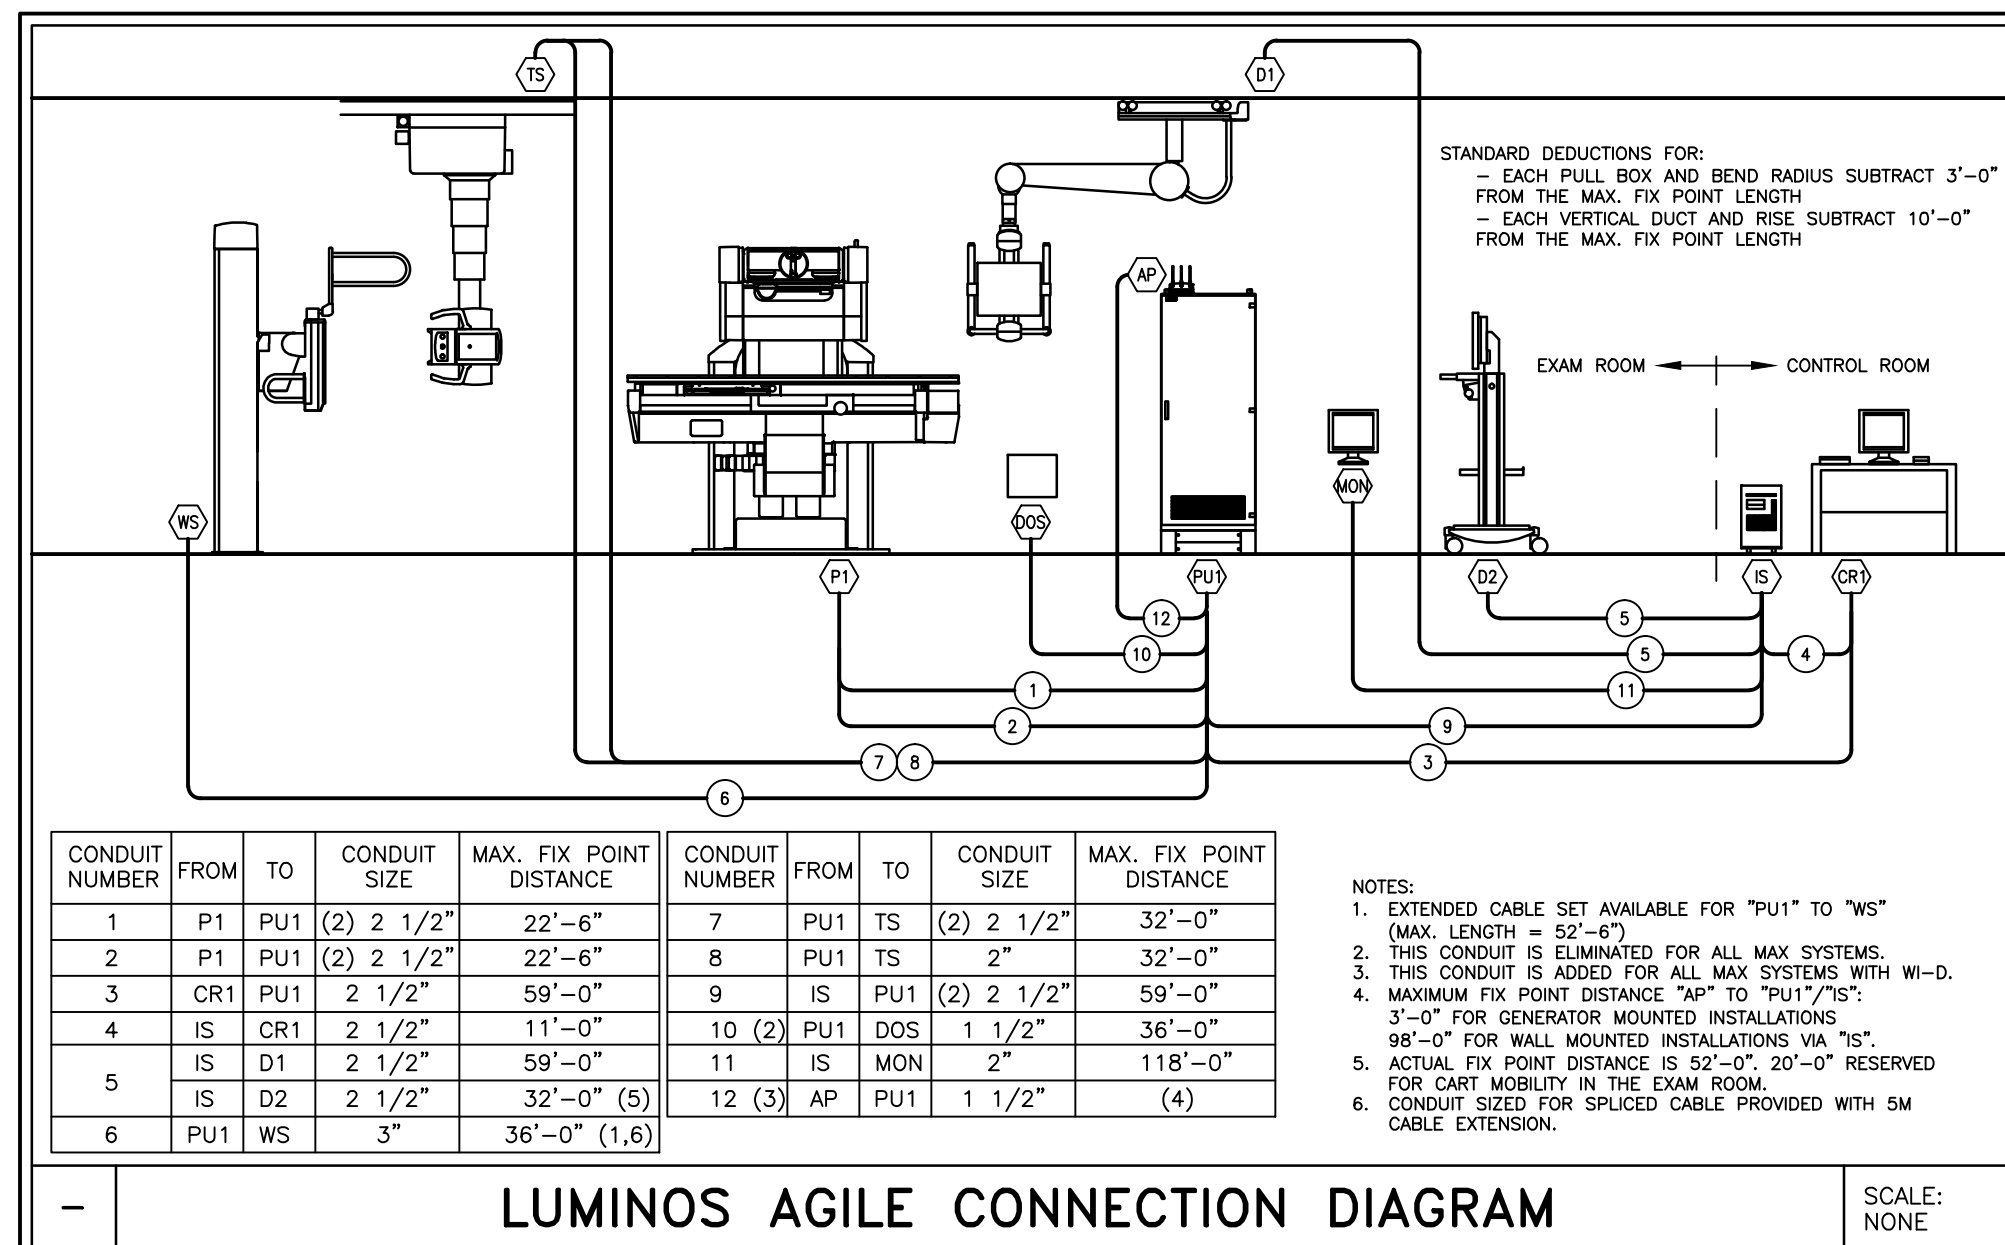

LUMINOS AGILE CONNECTION DIAGRAM

SCALE: NONE

POLYDOROS F80 80kW

X-RAY GENERATOR POWER REQUIREMENTS

INCOMING POWER:	480 VOLTS, 3 PHASE, 60Hz
CIRCUIT BREAKER:	80 AMPS.
GENERATOR OUTPUT:	80 kW
ALLOWABLE IMPEDANCE:	≤ 0.16 Ω
MAXIMUM MOMENTARY LOAD:	126 kVA
LINE VOLTAGE VARIATION:	± 10% MAX.
PHASE IMBALANCE:	± 2%
FREQUENCY VARIATION:	± 1 Hz

NOTE:
ALL INCOMING POWER SUPPLIES, FOR THE SIEMENS EQUIPMENT, ARE TO BE DEDICATED (BACK TO SOURCE) ISOLATED AND INSULATED FROM ANY OTHER EQUIPMENT, SUCH AS, ELEVATORS, GENERATORS, HVAC SYSTEMS, ETC.

A NEUTRAL CONDUCTOR, IF PRESENT, IS NOT USED FOR THE LINE VOLTAGE CONNECTION TO THE SIEMENS EQUIPMENT. IF THE NEUTRAL CONDUCTOR IS PROVIDED, IT SHOULD NOT BE ELECTRICALLY CONNECTED AT ANY POINT IN THE POWER DISTRIBUTION TO THE SIEMENS EQUIPMENT UNLESS SPECIFICALLY REQUIRED. UNINTENTIONAL NEUTRAL TO GROUND BONDS MAY VIOLATE LOCAL AND NATIONAL ELECTRICAL CODES, AS WELL AS CREATE GROUNDING PROBLEMS.

IF AN ON-SITE TRANSFORMER IS REQUIRED TO OBTAIN XP MODALITY OPERATING VOLTAGE, IT MUST BE OF SUFFICIENT CAPACITY AND CHARACTERISTICS TO MAINTAIN SUPPLY VOLTAGE AND IMPEDANCE REQUIREMENTS (TRANSFORMER & CONDUCTORS).

ATTENTION:
SIEMENS MEDICAL SYSTEMS, INC. RECOMMENDS THAT THE INCOMING POWER LINES BE ANALYZED WITH RESPECT TO TRANSIENT SURGES AND IMPULSES, SAGS, AND OVERVOLTAGES.

REV 2

POWER QUALITY

POOR POWER WILL ALTER EQUIPMENT PERFORMANCE

IT IS IN THE CUSTOMER'S INTEREST THAT THE ELECTRICAL CONTRACTOR BE RESPONSIBLE FOR TESTING AND VERIFYING THAT THE EQUIPMENT POWER SUPPLY COMPLIES WITH THE SIEMENS SPECIFICATIONS.

GROUNDING NOTES

EQUIPMENT GROUND CONDUCTOR TO COMPLY WITH THE FOLLOWING:

- 1) SIZED EQUIVALENT TO THE PHASE CONDUCTORS (FULL SIZED GROUND).
- 2) DERIVED FROM THE ELECTRICAL SERVICE, TRANSFORMER OR MAIN DISTRIBUTION PANEL FEEDING THE SIEMENS EQUIPMENT.
- 3) RUN IN THE SAME CONDUIT, TROUGH OR RACEWAY AS THE PHASE CONDUCTORS.
- 4) CONTINUOUS, WITH NO BREAKS OR USE OF CONDUIT, CHASSIS OR EARTH AS THE SOLE GROUNDING PATH.
- 5) BONDED TO CHASSIS AND/OR CONDUIT IN ACCORDANCE WITH THE NEC REQUIREMENTS.
- 6) MINIMIZE CONNECTIONS OR TERMINALS TO ENSURE CONTINUITY OVER THE LIFE OF THE INSTALLATION.
- 7) AS A NORM, THERE SHOULD NOT BE ANY CURRENT PRESENCE ON THE GROUND CONDUCTOR, BUT IT IS ACCEPTABLE TO HAVE <500mA DURING OPERATION OF THE IMAGING EQUIPMENT.

POWER SCHEDULE

ALL CONDUITS AND WIRES SIZES MUST BE DETERMINED BY THE ELECTRICAL ENGINEER OF RECORD PER N.E.C. AND TO MAINTAIN SIEMENS IMPEDANCE REQUIREMENTS.

ITEM	QTY	DESCRIPTION
MP	1	MAIN PANEL WITH CIRCUIT BREAKER FLUSH OR SURFACE MOUNTED.
A	1	BREAKER MUST HAVE TRIPPING DEVICE SO WHEN ANY EPO IS PRESSED THE BREAKER TRIPS.
BREAKER AMPS: SEE POWER REQUIREMENTS		
		VOLTS PHASES NEUTRAL GROUND TOTAL WIRES
	480Y	3 0 1 4 (NOTE 1)

1) ALL WIRES MUST BE SAME SIZE.
NOTE: UNLESS OTHERWISE NOTED, ALL BREAKERS WILL BE 80% RATED

EPO VARIES

NOTE 1 - EPO CIRCUIT #1
MAIN CIRCUIT BREAKER EMERGENCY POWER OFF BUTTON WITH PROTECTIVE COVER THAT PREVENTS ACCIDENTAL ACTIVATION. THE EPO MUST BE OF FAIL-SAFE DESIGN. ALL EPO'S TO HAVE MECHANICAL LATCHING MECHANISM. EPO MUST BE RESET BEFORE MAIN BREAKER CAN RESUME OPERATION. CONTACTS AND WIRING CONFIGURATION TO BE DESIGNED BY ELECTRICAL ENGINEER OF RECORD.

NOTE 2 - EPO CIRCUIT #2
EPO CONTACTS TO BE NORMALLY CLOSED, WIRED IN SERIES, CONNECTED TO UPS ONLY.

THE EPOs MUST BE INSTALLED BY A QUALIFIED ELECTRICAL CONTRACTOR ACCORDING TO NATIONAL ELECTRICAL CODE, STATE AND LOCAL REGULATIONS. MEASURES SHOULD BE TAKEN TO DESIGN THE CIRCUIT IN SUCH A WAY THAT IT WILL ALWAYS WORK WHEN THE MEDICAL EQUIPMENT IS POWERED. THE CUSTOMER IS SOLELY RESPONSIBLE FOR THE IMPLEMENTATION OF THE EPOs AND THEIR ASSOCIATED CIRCUITS AND MUST MAKE THE FINAL DETERMINATION CONSIDERING ALL SITE CONDITIONS AND REGULATORY FACTORS.

ALL ITEMS LISTED IN THIS SCHEDULE SHALL BE SUPPLIED AND INSTALLED BY CUSTOMER/CONTRACTOR.

REV 0

MINIMUM CEILING HEIGHT W/RESTRICTION	CEILING HEIGHT WITHOUT RESTRICTION	RECOMMENDED CEILING HEIGHT
SEE RM HT REQMTS	SEE RM HT REQMTS	9'-6"

PROJECT MANAGER: RICH DEISTER
TEL: (207) 712-3205 EXT:
FAX: (207) 929-3776
EMAIL: RICH.DEISTER@SIEMENS.COM

SIEMENS

BRIGHTON MEDICAL CENTER
335 BRIGHTON AVE., PORTLAND, ME 04102
FLUORO ROOM - LUMINOS AGILE MAX

PROJECT #: **1601355** SHEET: **E-102**

THE USE OR REPRODUCTION OF THIS TITLE BLOCK WITHOUT SIEMENS AUTHORIZATION WILL RESULT IN PROSECUTION UNDER FULL EXTENT OF THE LAW.

ALL RIGHTS ARE RESERVED.

SCALE: AS NOTED REF: #FFKJW.7

DATE: 10/21/16 DRAWN BY: D. CAPSTICK

ATTENTION:

- THIS DRAWING IS DESIGNED TO CONFORM TO FEATURES AND EQUIPMENT REQUIREMENTS PRESENTED AT THE TIME OF THEIR PREPARATION. SINCE BOTH THESE FACTORS ARE SUBJECT TO DESIGN MODIFICATION, THEY ARE NOT TO BE USED FOR CONSTRUCTION PURPOSES.

- THIS SET OF PLANS REPRESENTS A COMPLETE SET OF DETAILS AND SHOULD NOT BE SEPARATED.

- IT IS RECOMMENDED THAT THE SIEMENS DRAWINGS BE INCORPORATED WITH THE CONSTRUCTION DOCUMENTS FOR REFERENCE.

- ALL DIMENSIONS SHOWN ON THIS DRAWING ARE FROM FINISHED SURFACES.

- THIS DRAWING DOES NOT PROVIDE RADIATION SHIELDING REQUIREMENTS FOR X-RAY AND ASSOCIATED EQUIPMENT. THE CUSTOMER IS RESPONSIBLE FOR CONSULTING WITH A REGISTERED RADIATION PHYSICIST TO SPECIFY RADIATION PROTECTION.

10/21/16 R-101 VERSION A DATED 04/07/16 APPROVED BY CUSTOMER FOR FINALS.

SYM DATE DESCRIPTION

-ISSUE BLOCK-