

ARCHITECTURE
PLANNING
INTERIOR DESIGN
ENGINEERING

CONSULTANT:

SYMBOLS & ABBREVIATIONS

EXISTING PIPING TO REMAIN
DEMOLITION DRAWINGS ONLY
NEW PIPING

DRAIN
FIRE PROTECTION PIPING
TYPICAL
SPRINKLER DISTRIBUTION DOWNSTREAM OF FLOOR CONTROL VALVE
PIPING OFFSET UP
TAKEOFF FROM PIPING MAIN
CHECK VALVE
OS & Y GATE VALVE
FLOW SWITCH
EXISTING SPRINKLER HEAD
UPRIGIT SPRINKLER HEAD
HEAD RECESSED TYPE SPRINKLER
CONNECT NEW TO EXISTING
TYPICAL
TYPICAL
EXISTING

DEMOLITION DRAWING NOTES

A. DEMOLITION DRAWINGS ARE DIAGRAMMATIC APPROXIMATIONS OF THE CONTRACTOR'S CHANGES TO INSTALLATIONS. CONTRACTORS IN CHARGE OF INSTALLATIONS MAY HAVE CHANGES TO THE DRAWINGS. IT IS THE INTENT OF THESE DRAWINGS TO SHOW THE FIRE PROTECTION TO BE REMOVED. CONTRACTORS SHALL MAINTAIN OPERATION AND FUNCTION OF ALL EXISTING FIRE PROTECTION PIPING AND EQUIPMENT THROUGHOUT THE PROJECT. CONTRACTORS SHALL BE CLARIFIED AND SEaled IN WRITING WHETHER INDICATED ON DRAWINGS OR NOT.

B. FIRE PROTECTION CONTRACTOR SHALL BE RESPONSIBLE FOR REMOVING EXISTING FIRE PROTECTION CONNECTIONS REQUIRED TO MAINTAIN OPERATION OF EXISTING FIRE PROTECTION PIPING AND EQUIPMENT DURING CONSTRUCTION.

FIRE PROTECTION DRAWING NOTES

A. FIRE PROTECTION SYSTEM AS SHOWN IS THE PROPOSED SYSTEM. CONTRACTORS SHALL VERIFY ONLY FIRE PROTECTION CONTRACTOR LOCATIONS WITH APPROVAL OF GENERAL CONTRACTOR, ARCHITECT AND OWNER.

B. REFER TO ARCHITECTURAL DRAWINGS FOR ALL FIRE / SMOKE RATED PARTITIONS.

C. SPRINKLER LOCATIONS ARE FOR REFERENCE ONLY. CONTRACTORS SHALL VERIFY ALL SPRINKLER TEST CONNECTIONS AND DRAINS BEFORE THAT PROPOSED FIRE PROTECTION IS INSTALLED. CONTRACTORS SHALL VERIFY ALL PIPING, INCLUDING ADEQUATE COVERAGE OF SPRINKLER.

D. ALL SPRINKLERS TO BE LOCATED IN CENTER OF CEILING TILES WHERE APPLICABLE.

E. ALL SPRINKLER TEST CONNECTIONS AND DRAINS SHALL BE LOCATED IN UNOCCUPIED AREAS AND APPROVED BY ARCHITECT AND OWNER.

F. FIRE PROTECTION CONTRACTOR SHALL VERIFY AND PROVIDE FOR SPRINKLER UNOCCUPIED SPACES AND UNOCCUPIED SPACES.

G. FIRE PROTECTION CONTRACTOR SHALL BE RESPONSIBLE FOR REMOVING SPRINKLER HEADS AND ASSOCIATED PIPING AND INSTALLATION OF NEW DOWNSTREAM AND PIPING.

DRAWING FP-101 NUMBERED NOTES

1. EXISTING FIRE PROTECTION PIPING IN THIS AREA TO REMAIN AS IS. THIS AREA IS NOT IN PROJECT.

2. EXISTING SPRINKLER AND ASSOCIATED PIPING TO BE REMOVED.


3. CONNECT NEW SPRINKLER HEAD TO EXISTING PIPING TO REMAIN. MODIFY EXISTING PIPING AS REQUIRED.

ISSUE:

LETTER	DATE	DESCRIPTION
A	08/08/09	100% OWNER REVIEW SET
B	08/11/09	ISSUED FOR BID

REVISION:

NO.	DATE	DESCRIPTION

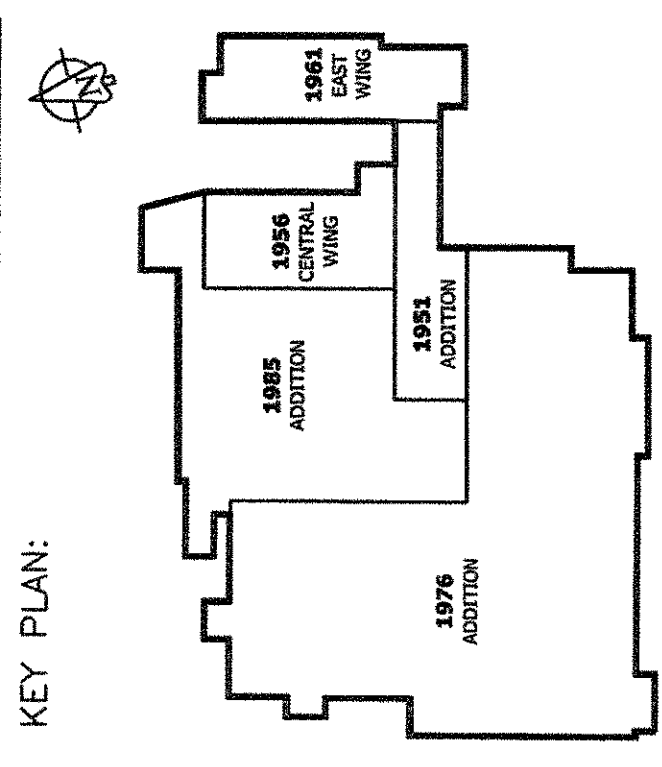

DRAWING TITLE:
BASEMENT & FIRST FLOOR
FIRE PROTECTION

SCALE:

DATE:	
DESIGNED BY:	AG
CHECKED BY:	
SCALE:	AS NOTED
PROJECT NO.:	093274.00LE

DRAWING NO.:
FP-101

© 2009 DAI INC.
100% OWNER REVIEW SET
100% OWNER REVIEW SET
100% OWNER REVIEW SET

