

### HPFF12 Power Supply

Protected Premises: <u>Maine Medical Center - Wound Care Addition</u>	Date: <u>4/13/2015</u>
Address: <u>335 Brighton Avenue</u>	
City: <u>Portland</u> State: <u>ME</u> Zip: <u>04103</u>	
Prepared By: <u>Norris Inc.</u>	Phone: <u>207-883-3473</u>
Address: <u>2257 Broadway</u> Email: _____	
City: <u>South Portland</u> State: <u>ME</u> Zip: <u>04106</u>	

### Secondary Load Requirements

**2.34** Amp Hours

Total Secondary Load from the calculation table below.

Current Draw		Time (hours)	Total (AH)
<b>Secondary Standby Load</b>	x	Required Standby Time	
0.075 A		24 hours	1.80
<b>Secondary Alarm Load</b>	x	Required Alarm Time (hours)	
1.762 A		0.084 hours	0.15
Total Secondary Load			1.95
Derating factor			x 1.2
<b>Secondary Load Requirements</b>			<b>2.34</b>

AH

### Battery Selection

**7** Amp Hours


Select batteries from the list below.

**7.0 AH BAT-1270 Battery (12 volt)**

- Two
  Four (two 12VDC sets in parallel)

**Battery Distribution Chart**

Shows amp-hour distribution of your selections.

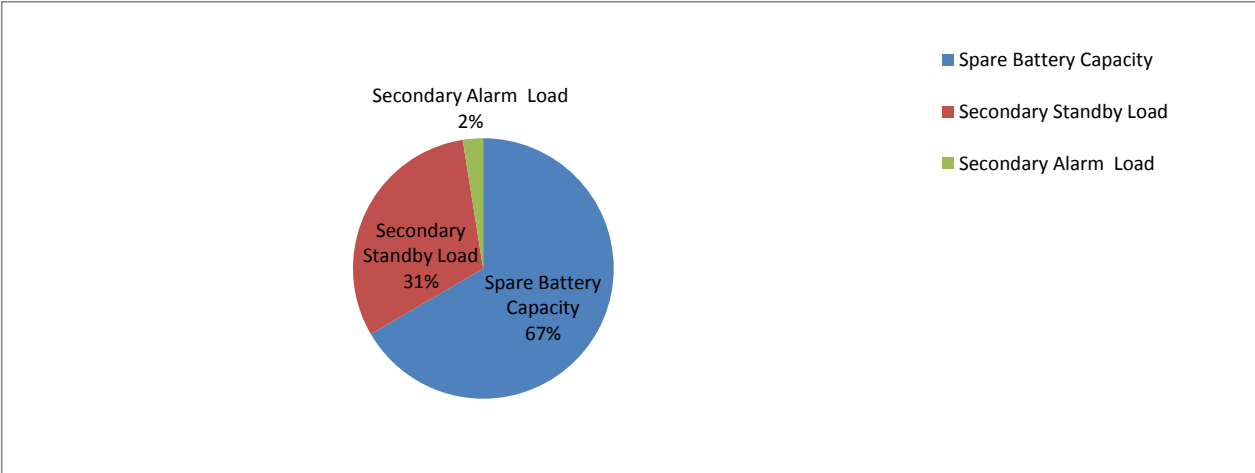

**Comments**

- 1. Batteries will fit in the FACP cabinet.
- 2. Selected battery size meets secondary load requirements.
- 3. The selected batteries (7AH) are within the charger range of this power supply (7-26AH).

Spare Battery Capacity	4.66	Battery Selection (AH) - Secondary Load Requirements (AH)
Secondary Standby Load	2.16	Secondary Standby Load (AH) * Derating Factor
Secondary Alarm Load	0.18	Secondary Alarm Load (AH) * Derating Factor