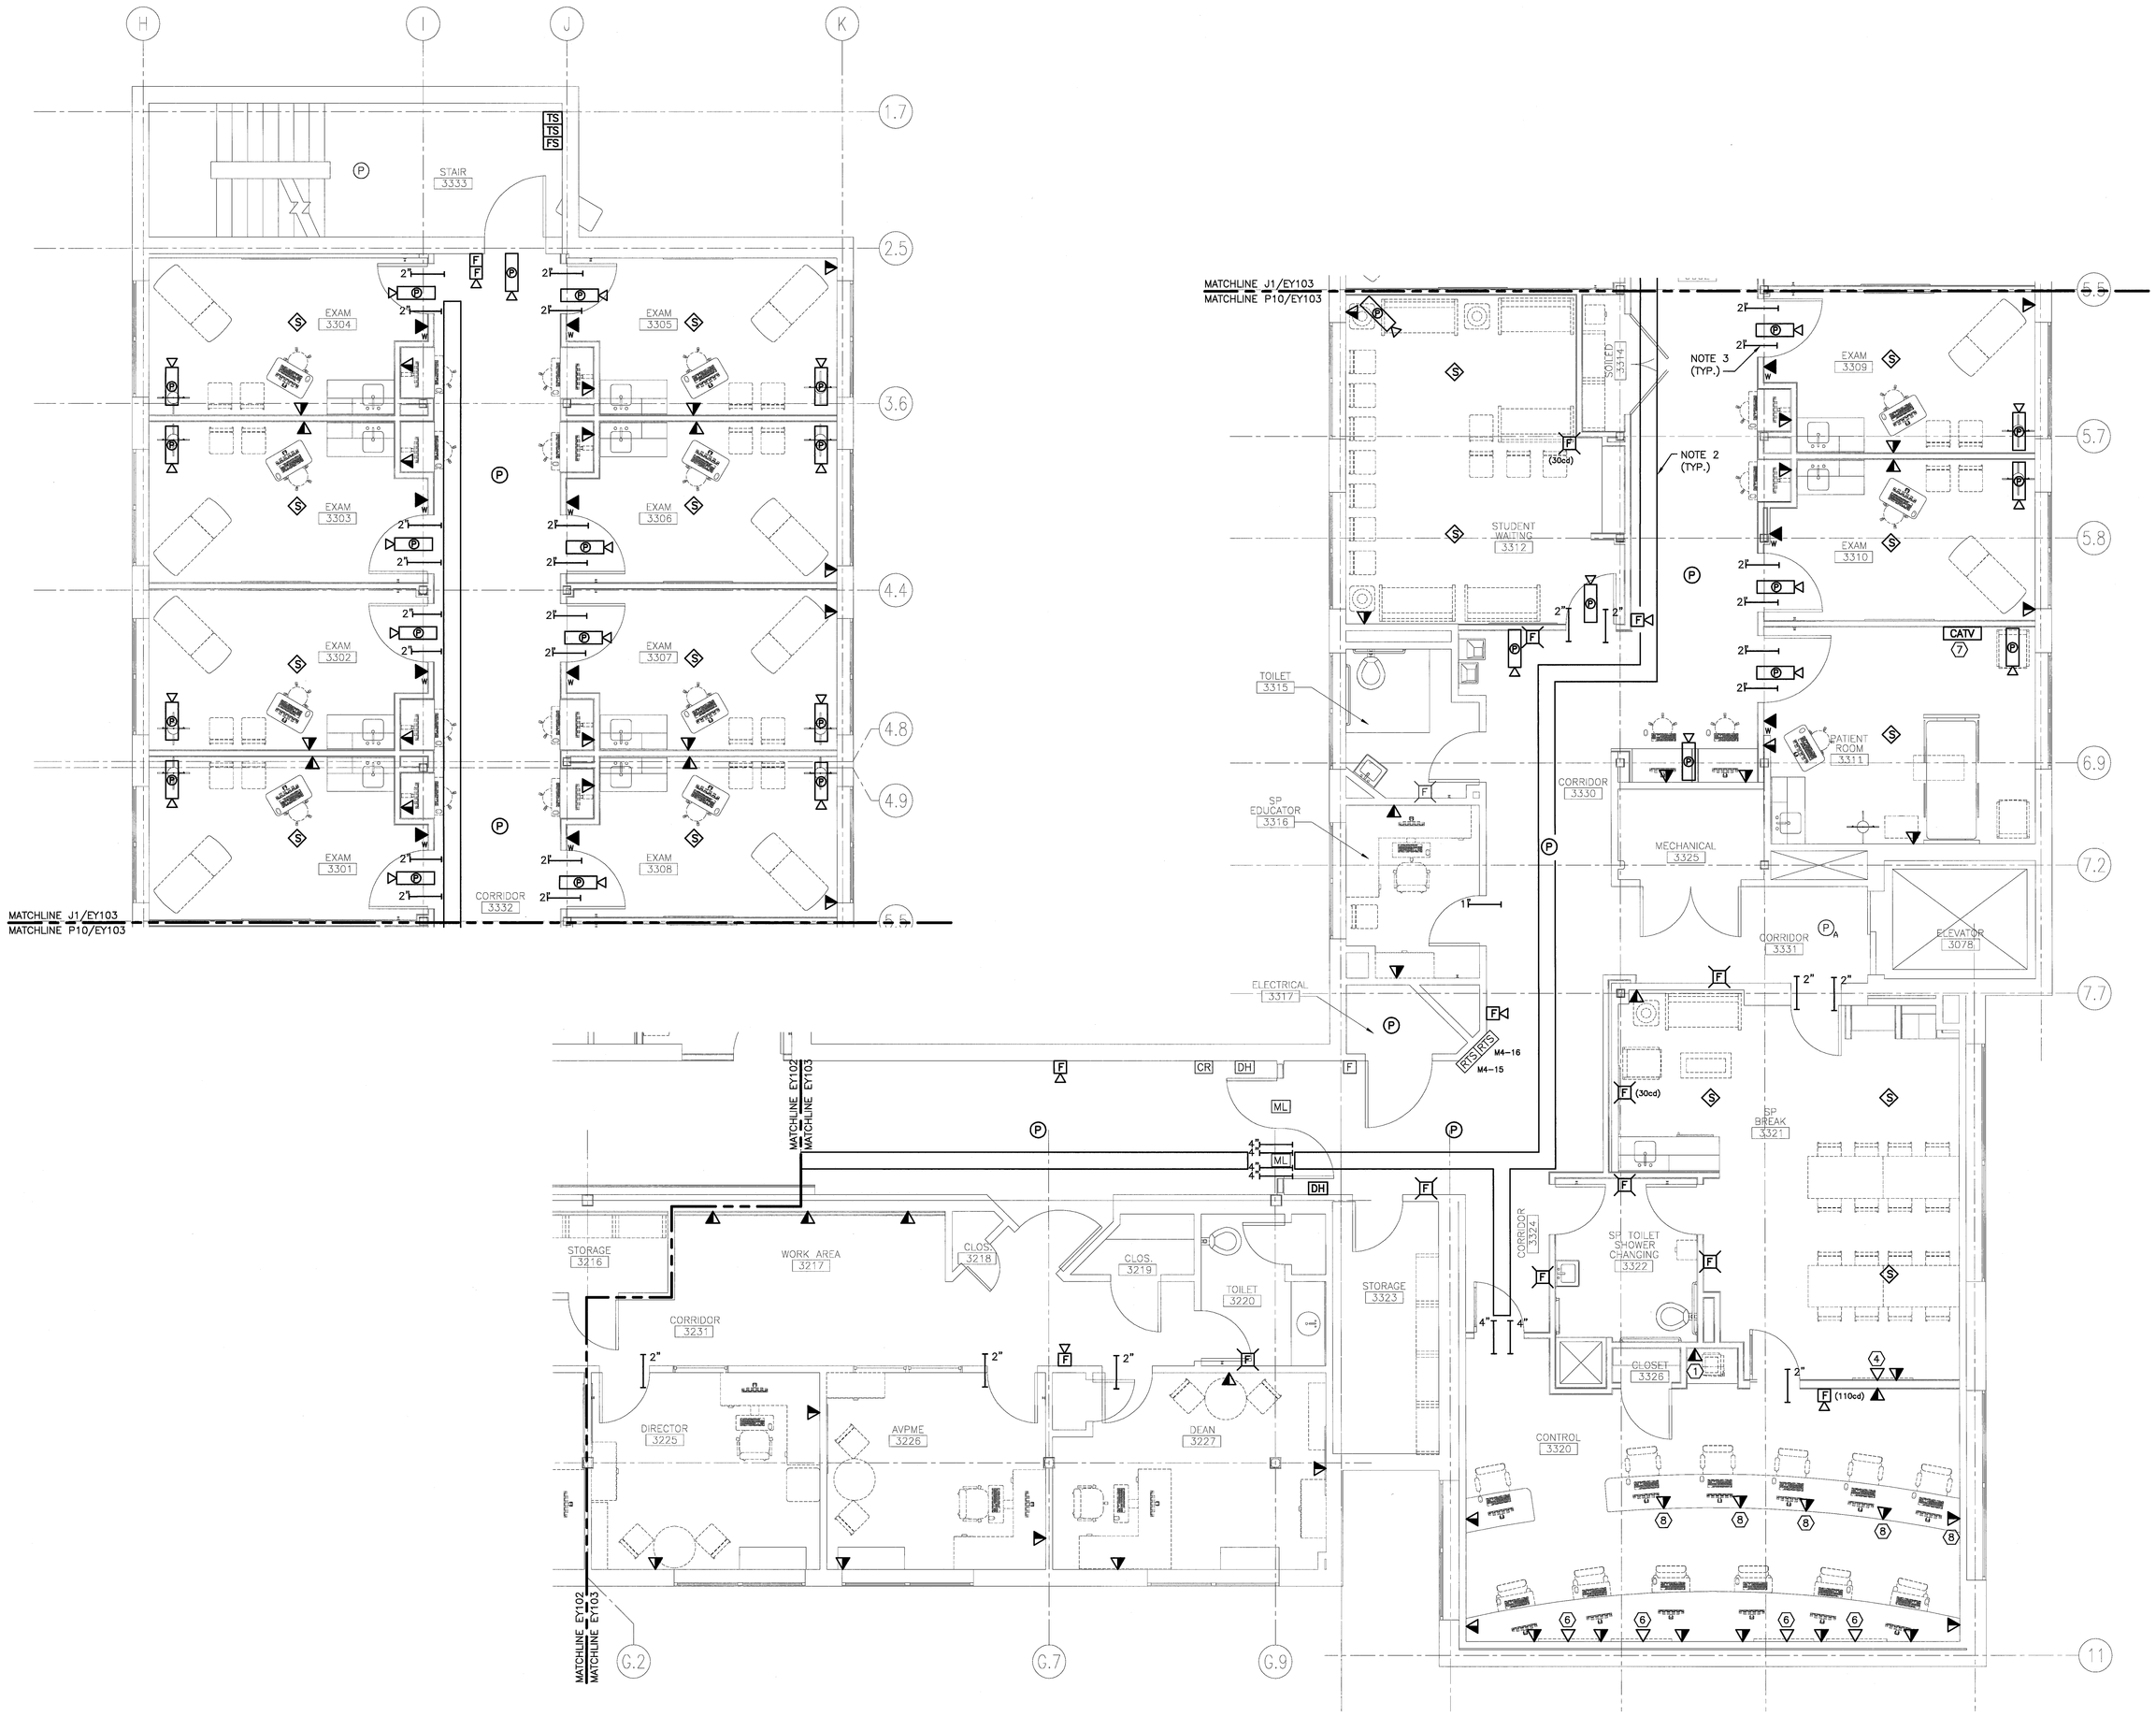

NOTE:

1. SEE SHEET E-001 FOR LEGEND AND GENERAL NOTES.
2. CABLE TRAY (WIRE BASKET TYPE). 12" WIDE UNLESS OTHERWISE NOTED. INSTALL ABOVE CEILING.
3. CONDUIT SLEEVE. SIZE AS NOTED. INSTALL ABOVE CEILING.

KEYED NOTES:

1. INSTALL 8" ABOVE COUNTER TO CENTER.
2. INSTALL 24" AFF TO CENTER
3. INSTALL 36" AFF TO CENTER
4. INSTALL 48" AFF TO CENTER
5. INSTALL 60" AFF TO CENTER
6. INSTALL 72" AFF TO CENTER.
7. INSTALL 84" AFF TO CENTER.
8. VOICE/DATA OUTLET INSTALLED IN CASEWORK.

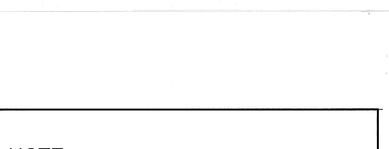

F18 KEY PLAN

REV.	DESCRIPTION	DATE
0	ISSUED FOR CONSTRUCTION	4-24-09

ISSUED FOR CONSTRUCTION
4-24-09

CURRENT ISSUE STATUS:

PROJECT NORTH

STATE OF MAINE — JOHN P. PERRUZZI — NO. 7708 — LICENSED PROFESSIONAL ENGINEER — REV.0 4/23/09

SMRT
ARCHITECTURE
ENGINEERING
PLANNING
INTERIOR DESIGN
COMMISSIONING
144 Fore Street/P.O. Box 618
Portland, Maine 04104
tel. (207) 772-3846
fax. (207) 772-1070
www.smrtinc.com

MAINE MEDICAL CENTER
OFFICE OF MEDICAL EDUCATION
PORTLAND, MAINE

THIRD FLOOR AREA C & D
SYSTEMS PLAN
SHEET TITLE:

SCALE:	1/4"=1'-0"	DATE:	4-24-09
PROJECT MANAGER:	CDP	GRAPHIC SCALE:	0" 1"
JOB CAP/DRAWN:	CAH/CDS		
A/E OF RECORD:	JPP	SHEET No.	
SMRT CAD FILE:	EY103-08093	EY103	
PROJECT No.	08093-00		

©COPYRIGHT 2008 SMRT INC

A1 THIRD FLOOR PLAN

1/4"=1'-0" *