



Date: 04/04/14


# Maine Medical Partners Orthopedic Trauma & Fracture Care

335 Brighton Avenue, Suite 200  
Portland, Maine

**PDT**  
ARCHITECTS  
49 DARTMOUTH STREET  
PORTLAND, MAINE 04101  
207-775-1059  
www.pdtarchs.com

COPYRIGHT 2014  
PDT Architects  
Reuse or reproduction of the  
contents of this document is not  
permitted without written  
permission of PDT Architects.

**MMP - ORTHOPEDIC TRAUMA & FRACTURE CARE**  
BRIGHTON CAMPUS, PORTLAND, MAINE



JOB NO.  
12-110  
DRWN. CHK  
JKP AFF  
SCALE:  
N/A  
ISSUE  
NOVEMBER 26, 2012  
REISSUED:  
JANUARY 15, 2014  
TITLE  
TITLE SHEET,  
ABBREVIATIONS  
& KEY/CODE PLAN  
SHEET  
T1.0


## LIST OF DRAWINGS

ARCHITECTURAL DRAWINGS:	
T1.0	TITLE SHEET, ABBREVIATIONS & KEY/CODE PLAN
D1.0	DEMOLITION PLAN, LEGEND & NOTES
A1.0	FLOOR PLANS, WALL TYPES, NOTES & LEGEND
A2.0	RCP, F & E PLAN, DETAILS, NOTES & LEGEND
A7.0	FINISH SCHEDULE, MATERIALS LEGEND, DOORS & HARDWARE, AND OUTLINE SPECIFICATION
A8.0	INTERIOR ELEVATIONS
A8.1	CASEWORK SECTIONS, & DETAILS

## ABBREVIATIONS

ADJ	ADJUSTABLE	MFR	MANUFACTURER
AFF	ABOVE FINISH FLOOR	MAX	MAXIMUM
BLDG	BUILDING	MTL	METAL
BO	BOTTOM OF	MIN	MINIMUM
CC	CUBICLE CURTAIN	MISC	MISCELLANEOUS
CFMF	COLD FORMED METAL FRAMING	MR	MOISTURE RESISTANT
CG	CORNER GUARD	NIC	NOT IN CONTRACT
CJ	CONTROL JOINT	OC	ON CENTER
CLG	CEILING	PT	PRESSURE TREATED
CL	CENTER LINE	R, RAD	RADIUS
CL	CLOSET	RB	RESILIENT BASE
COL	COLUMN	REF	REFRIGERATOR
CONC	CONCRETE	REQD	REQUIRED
CONST	CONSTRUCTION	REV	REVISION
CONT	CONTINUOUS	RO	ROUGH OPENING
CR	CHAIR RAIL	SAT	SUSPENDED ACOUSTICAL
DIA	DIAMETER	CEL	CEILING TILE
DIM	DIMENSION	SIM	SIMILAR
DW	DISHWASHER	SFRM	SPRAY-APPLIED FIRE RESISTANT MATERIAL
DWG	DRAWING	SPEC	SPECIFICATION
EJ	EXPANSION JOINT	SQ	SQUARE
ELEV	ELEVATION	SS	STAINLESS STEEL
EXIST	EXISTING	STL	STEEL
EXT	EXTERIOR	STD	STANDARD
FD	FLOOR DRAIN	STRUCT	STRUCTURAL
FBO	FURNISHED BY OWNER	SV	SHEET VINYL
FDN	FOUNDATION	TO	TOP OF
FT	FEET	TYP	TYPICAL
GA	GALVE	UNO	UNLESS NOTED OTHERWISE
GC	GENERAL CONTRACTOR	VERT	VERTICAL
GL	GLASS	VIF	VERIFY IN FIELD
GWB	GYPSON WALL BOARD	W/	WITH
HR	HAND RAIL	WB	WALL BUMPER
HM	HOLLOW METAL	W/O	WITHOUT
H, HGT	HEIGHT	WD	WOOD
HOR	HORIZONTAL	WP	WALL PROTECTION
INSUL	INSULATION		
MECH	MECHANICAL		
MED	MEDIUM		

NOTE: REFER TO MATERIALS LEGEND FOR ADDITIONAL FINISH ABBREVIATIONS

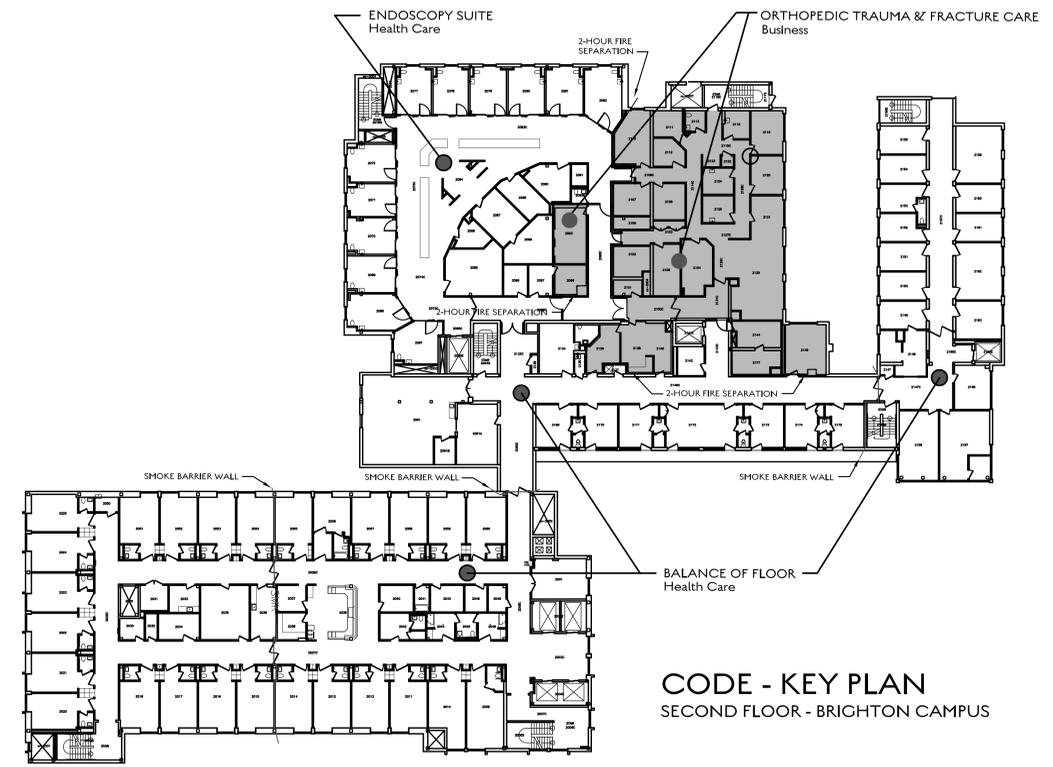

CODE - KEY PLAN  
SECOND FLOOR - BRIGHTON CAMPUS

## CODE SUMMARY

APPLICABLE CODES & GUIDELINES	
Building Code:	IBC 2009 (per MUBEC)
Life Safety Code:	NFPA 101 - 2009
Guidelines:	Guidelines for Design & Construction of Healthcare Facilities 2006


FIRE PROTECTION		BUSINESS (B) Existing		HEALTHCARE (I-2) Existing	
Supervised - Automatic Sprinkler System		IBC	NFPA	IBC	NFPA
OCCUPANCY LOAD	Table 1004.1.1	100 sf/person	Table 7.3.1.2 100 sf/person	Table 1004.1.1	100 sf/person (outpatient areas)
SEPARATION OF OCCUPANCIES			Table 6.1.14.4.1 Separation between business and healthcare occupancies is 2 hours	Table 6.1.14.4.1	Separation between business and healthcare occupancies is 2 hours
NON-SLEEPING SUITES		NA	NA	19.2.5.7.3	Suites more than 2,500 sf shall have not less than two exits access doors remotely located from each other
CONSTRUCTION CLASSIFICATION	602.2	Type 1B	Type 1 (332)	602.2	Type 1B
NUMBER OF EXITS	Table 1021.1	2 Exits for occupant load of 500 or less	39.2.4.1 Not less than two separate exits shall be accessible from every part of every story	Table 1021.1	2 Exits for occupant load of 500 or less
TRAVEL DISTANCE TO EXITS	1016.1	Max. 300' w/ sprinkler	39.2.6.3 Max. 300' w/ supervised sprinkler system	1016.1	Max. 200' w/ sprinkler
REMOVEDNESS OF EXITS			7.5.1.3.2 Distance between exits not less than 1/2 length of max. overall diagonal dimension.		
COMMON PATH OF TRAVEL	1014.3	Max. 100'	39.2.5.3.1 Max. 300' w/ sprinkler	1014.3	75 ft.
DEAD END LIMIT	1018.4	50 ft.	39.2.5.2 50 ft.	1018.4	20 ft.
CORRIDORS	Table 1018.1	No fire rating required w/ sprinkler system	39.3.6 No requirement	Table 1018.1	No fire rating required w/ sprinkler system
HAZARDOUS AREA PROTECTION			39.3.2.2 High hazard areas shall be separated: 1-hour separation; closer; 3/4 hour min. door; sprinkler	Table 18.3.2.1	Storage rms. Larger than 100 sf - 1 Hr. separation; 50-100sf - door closer

Issued: November 26, 2012  
Reissued: January 15, 2014



## ARCHITECTURE INTERIOR DESIGN PLANNING

49 DARTMOUTH STREET  
PORTLAND, ME 04101  
207 775-1059  
207 775-2694 FAX  
www.pdtarchs.com

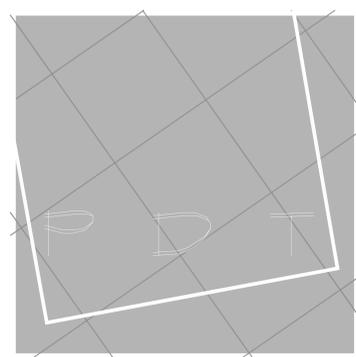

**ARCHITECTS**

Sunday, January 19, 2014 5:20:40 PM BRIDGTON ANN FISHER

H:\MASTER PROJ FILES\MMP - 12110 - ORTHO TRAUMA\12110-WORKING FILES\CAD\CDS\12110-MMP-BMC-COVER-REV/DWG