




Install Date: 5/10/2017
 Jewish Community Alliance
 57 Ashmont Street
 Portland, ME 04101
 Cintas Fire Protection
 603-717-7300

Cintas Fire Protection
 3 Tallwood Drive
 Bow, NH 03304
 Cintas Fire Protection
 603-717-7300
 quinnj@cintas.com
 JQ

System 2
 System 2

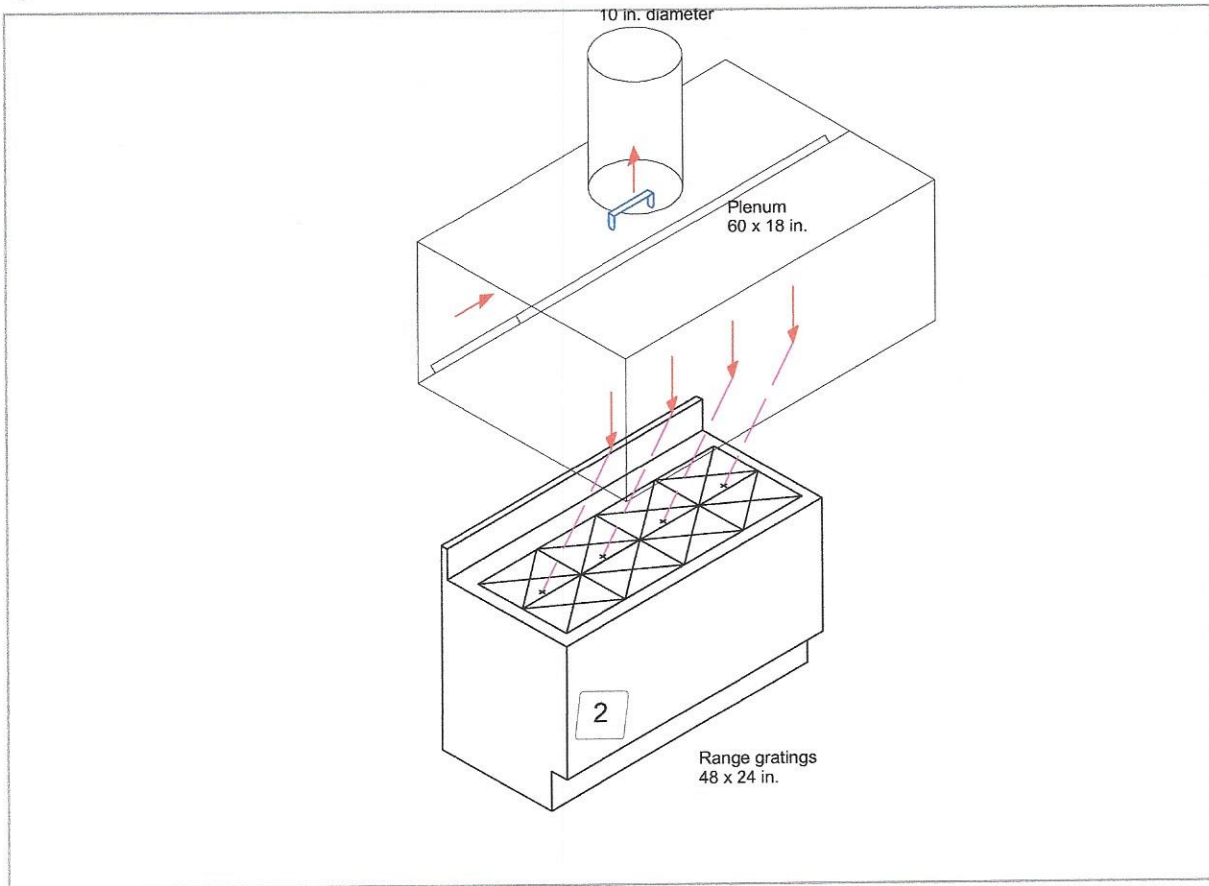

Flow Summary:

Coverage	Overall Dimensions	Nozzle	Flows	Nozzle Location
Hood: Single Bank	60 x 54 in.	1N	1	2-4 in. from filter face, center of height dimension, aimed down filter length.
Duct: Round	10 x 0 in.	1W	1	2-8 in. into center of duct opening, aimed up
Range: 8 burners	48 x 24 in.	1F x4	4	40-48 in., front edge of burner, nozzle flats parallel with burner front-to-rea ... See Note 2
Total Flow Points			6	