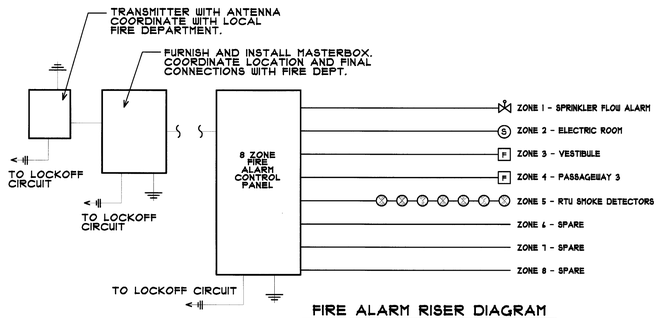

FIRE ALARM RISER DIAGRAM

N.T.S.

LEGEND

- DUCT SMOKE DETECTOR AT EACH HVAC UNIT RETURN DUCT (SHUT-DOWN UNIT WHEN SMOKE IS DETECTED)
- SMOKE DETECTOR (CEILING MOUNTED)
- ~~HEAT DETECTOR (ABOVE CEILING)~~
- SPRINKLER SYSTEM FLOW ALARM
- FIRE ALARM PULL STATION @ 42" A.F.F.
- FIRE ALARM AUDIO VISUAL DEVICE @ 80" A.F.F.
- FIRE ALARM VISUAL DEVICE @ 80" A.F.F.
- FIRE ALARM EXTERIOR STROBE. COORDINATE LOCATION WITH FIRE DEPARTMENT.

FIRE ALARM SYSTEM NOTES

1 - A FIRE ALARM SYSTEM:
- ☐ NOT REQUIRED BY LOCAL CODE.
- ☒ IS REQUIRED BY LOCAL CODE.

2 - PROVIDE REMOTE FIRE ALARM SYSTEM MONITORING.

3 - THE FIRE ALARM SUPPLIER SHALL FURNISH AND INSTALL A COMPLETE FIRE ALARM SYSTEM AS DESCRIBED IN SECTION 14720 OF THE WALGREENS CRITERIA SPECIFICATIONS. THE SYSTEM SHALL BE MONITORED BY WALGREENS PREFERRED FIRE ALARM VENDORS, SEE NATIONAL ACCOUNT NOTE BELOW.

4 - ALL WORK AND MATERIALS SHALL CONFORM WITH NFPA 72 AND LOCAL CODE REQUIREMENTS.

5 - ALL SPLICES SHALL BE MADE ON SCREW TYPE TERMINAL BLOCKS - NO WIRENUTS

6 - RED PAINTED TERMINAL CABINETS WITH HINGED LOCKABLE COVERS SHALL BE PROVIDED AT ALL JUNCTION POINTS.

7 - ALL FA CABLES TO BE FURNISHED BY ELEC. CONTR. SLEEVE IN EMT WHERE EXPOSED & SUBJECT TO DAMAGE.

8 - COLOR CODE PER NFPA 72

9 - COORDINATE LOCATION OF ALL DEVICES WITH LOCAL FIRE INSPECTION OFFICIAL.

10 - LOCAL CODES AND/OR OFFICIALS MAY REQUIRE ADDITIONAL DETECTION OR SIGNALING DEVICES WHICH ARE TO BE INCLUDED IN THE BASE BID.

NATIONAL ACCOUNT

CONTACT ADT SECURITY SERVICES, INC. AT (800) 640-9390 FOR ALL WALGREENS PROJECTS.

FIRE ALARM CONTRACTOR SHALL SUBMIT SHOP DRAWINGS, CUT SHEETS, AND OPERATION NARRITIVE TO FIRE DEPT. FOR REVIEW AND APPROVAL PRIOR TO INSTALLATION.

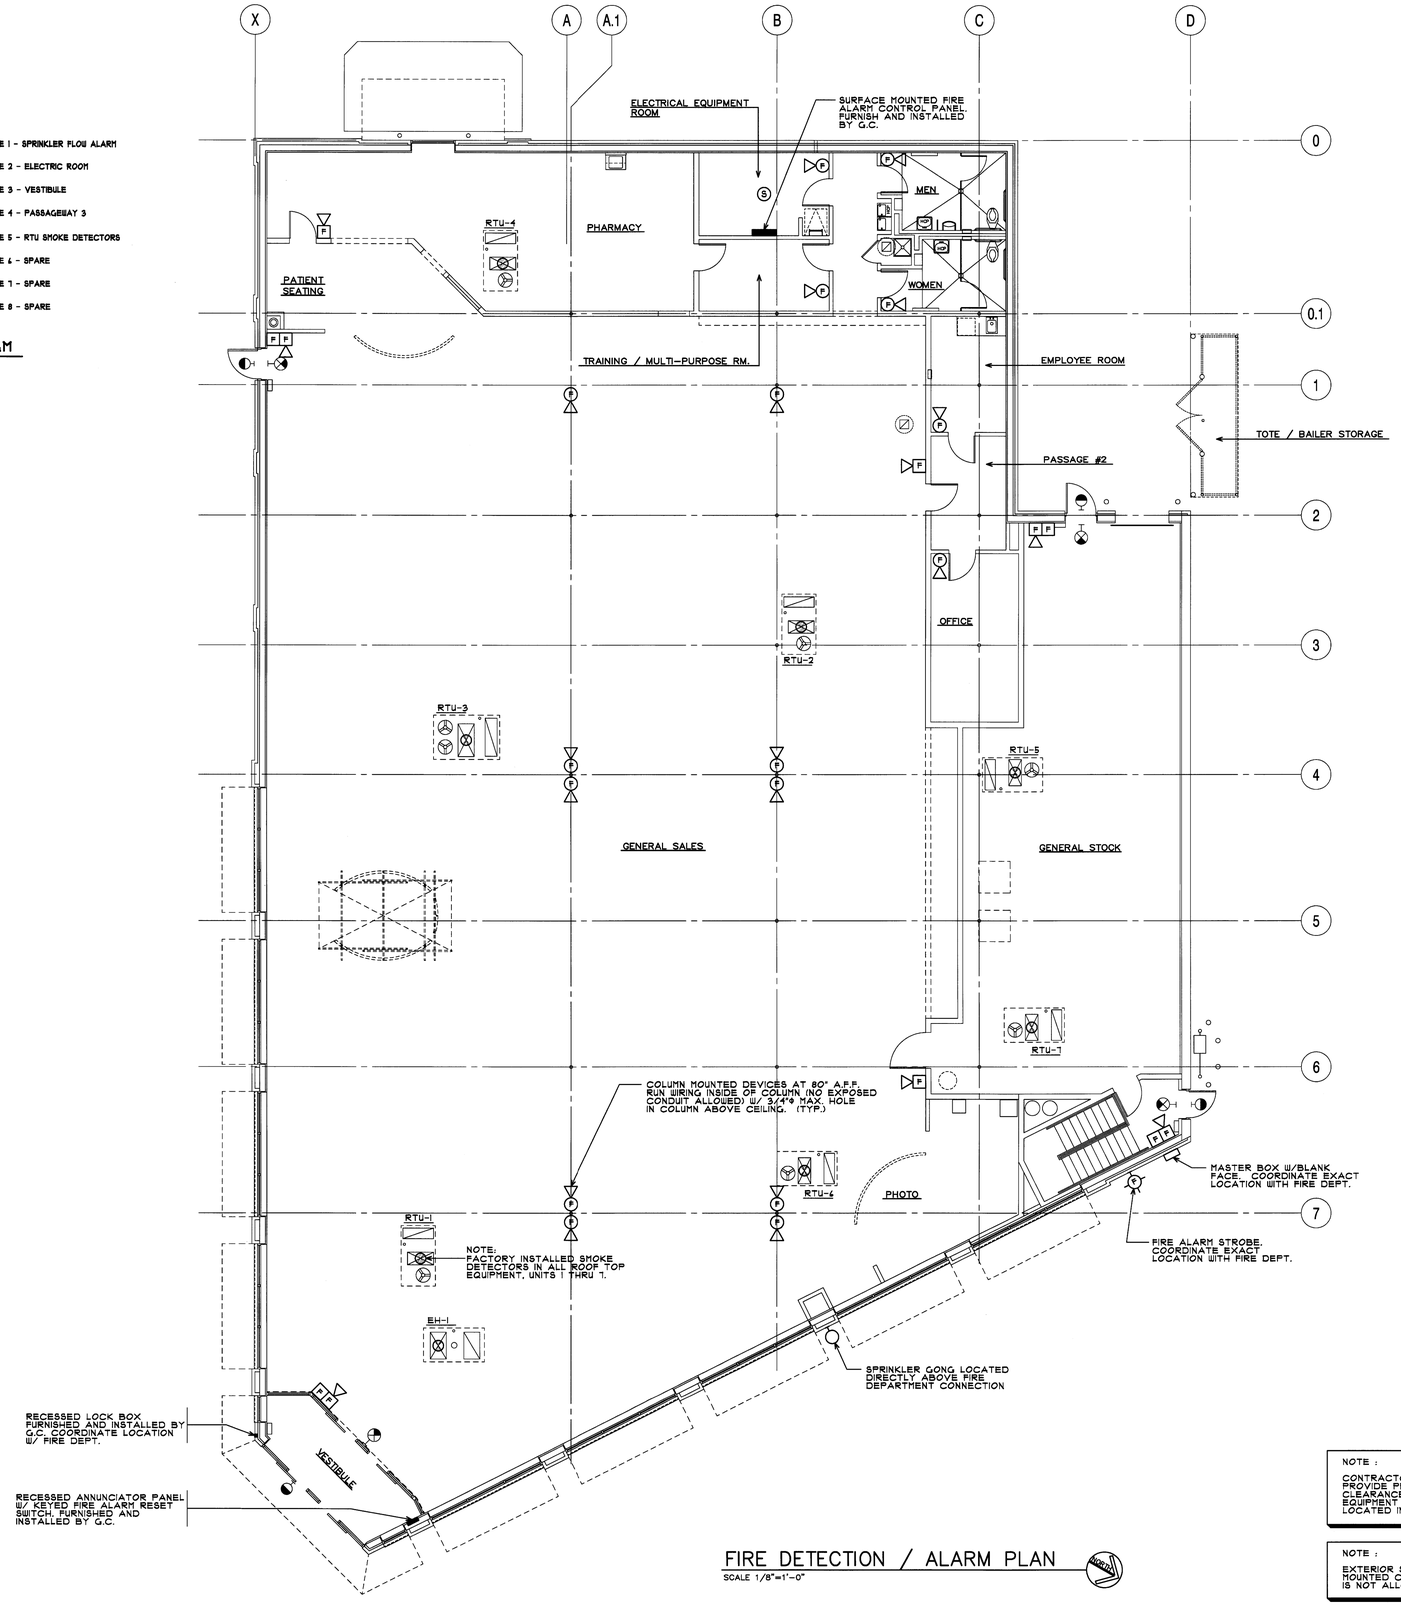

FIRE DETECTION / ALARM PLAN

SCALE 1/8"=1'-0"

NOTE :
CONTRACTOR SHALL PROVIDE PROPER CLEARANCES FOR ALL EQUIPMENT AND PANELS LOCATED IN ELEC. RM.

NOTE :
EXTERIOR SURFACE MOUNTED CONDUIT IS NOT ALLOWED.

MOESER & ASSOCIATES
206 AYER ROAD HARVARD, MA 978-456-6905
ARCHITECT

DRAWINGS/SPECIFICATIONS BY:
- ☐ WALGREENS'
- ■ LANDLORD'S CONSULTANT

ALL CONSTRUCTION WORK, UNLESS NOTED OTHERWISE, BY:
- ☐ WALGREENS' CONTRACTOR
- ■ LANDLORD'S CONTRACTOR (TURNKEY CONSTRUCTION)

STORE	BUILDING
NEW . . . . . ■	NEW . . . . . ■
REMODELING . . . . . ☐	EXISTING . . . . . ☐
RELOCATION . . . . . ☐	NEW SHELL ONLY . . ☐
OTHERS . . . . . ☐	

NO.	DATE	BY	DESCRIPTION	CONST

REVISIONS

CERTIFICATION AND SEAL

I HEREBY CERTIFY THAT THIS PLAN AND SPECIFICATION WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A DULY REGISTERED ARCHITECT OR ENGINEER UNDER THE LAWS OF THE STATE OF MAINE AS SIGNIFIED BY MY HAND AND SEAL.

FISCAL 2007 CRITERIA - STORE #12325

WALGREENS
616 FOREST AVENUE
PORTLAND, MAINE

DRAWING TITLE
FIRST FLOOR FIRE DETECTION AND ALARM PLAN

CADD PLOT:
VOID PLOT:
RELEASED TO CONSTRUCTION

SCALE: AS NOTED
DRAWN BY: RJV
DATE: 12-10-08
REVIEWED BY: SAM

DRAWING NO.
FP1.2