

2012-11-5361 FAFS



Non-Water-Based Fire Suppression System Permit

If you or the property owner owes real estate or property taxes or user charges on any property within the city, payment arrangements must be made before permits of any kind are accepted.

Installation address: 740 Forest Ave CBL: 126-B-5

Exact location: (within structure) _____

Type of occupancy(s) (NFPA & ICC): Restaurant

Building owner: The Great Lost Bear

Managing Supervisor: _____ License No: _____

Supervisor phone: _____ E-mail: _____

Installing contractor: Fireage Equipment License No: N/A

Contractor phone: 207-784-7525 E-mail: _____

The suppression work to be done will be: New: Renovation: Addition to existing system:

This is an amendment to an existing permit: Yes: NO Permit no: _____

System Type: Net Chemical

NFPA Standard: _____ Edition: _____

*Non-NFPA systems are not approved for use within the City of Portland.

Download a new copy of this document from www.portlandmaine.gov/fire for every submittal. Attach all working documents as required on electronic PDF's in addition to full sized plans.

<p>COST OF WORK: <u>\$2,000.⁰⁰</u></p> <p>PERMIT FEE: <u>\$40.⁰⁰</u></p> <p>(\$10 PER \$1,000 + \$30 FOR THE FIRST \$1,000)</p>


11723

Submit all information to the Building Inspections Department, 389 Congress Street, Room 315, Portland, Maine 04101.

Prior to acceptance of any fire protection system, a complete commissioning and acceptance test must be coordinated with all fire system contractors and the Fire Department, and proper documentation of such test(s) provided.

All installation(s) must comply with NFPA and the Fire Department Technical Standard(s).

Applicant signature: [Signature] Date: Oct 23, 12.



PROJECT:

PREPARED BY:

Great East Bay


DATE / TIME:

QUOTE NO.:

JOB NO.:

Comments:

Blank lines for comments

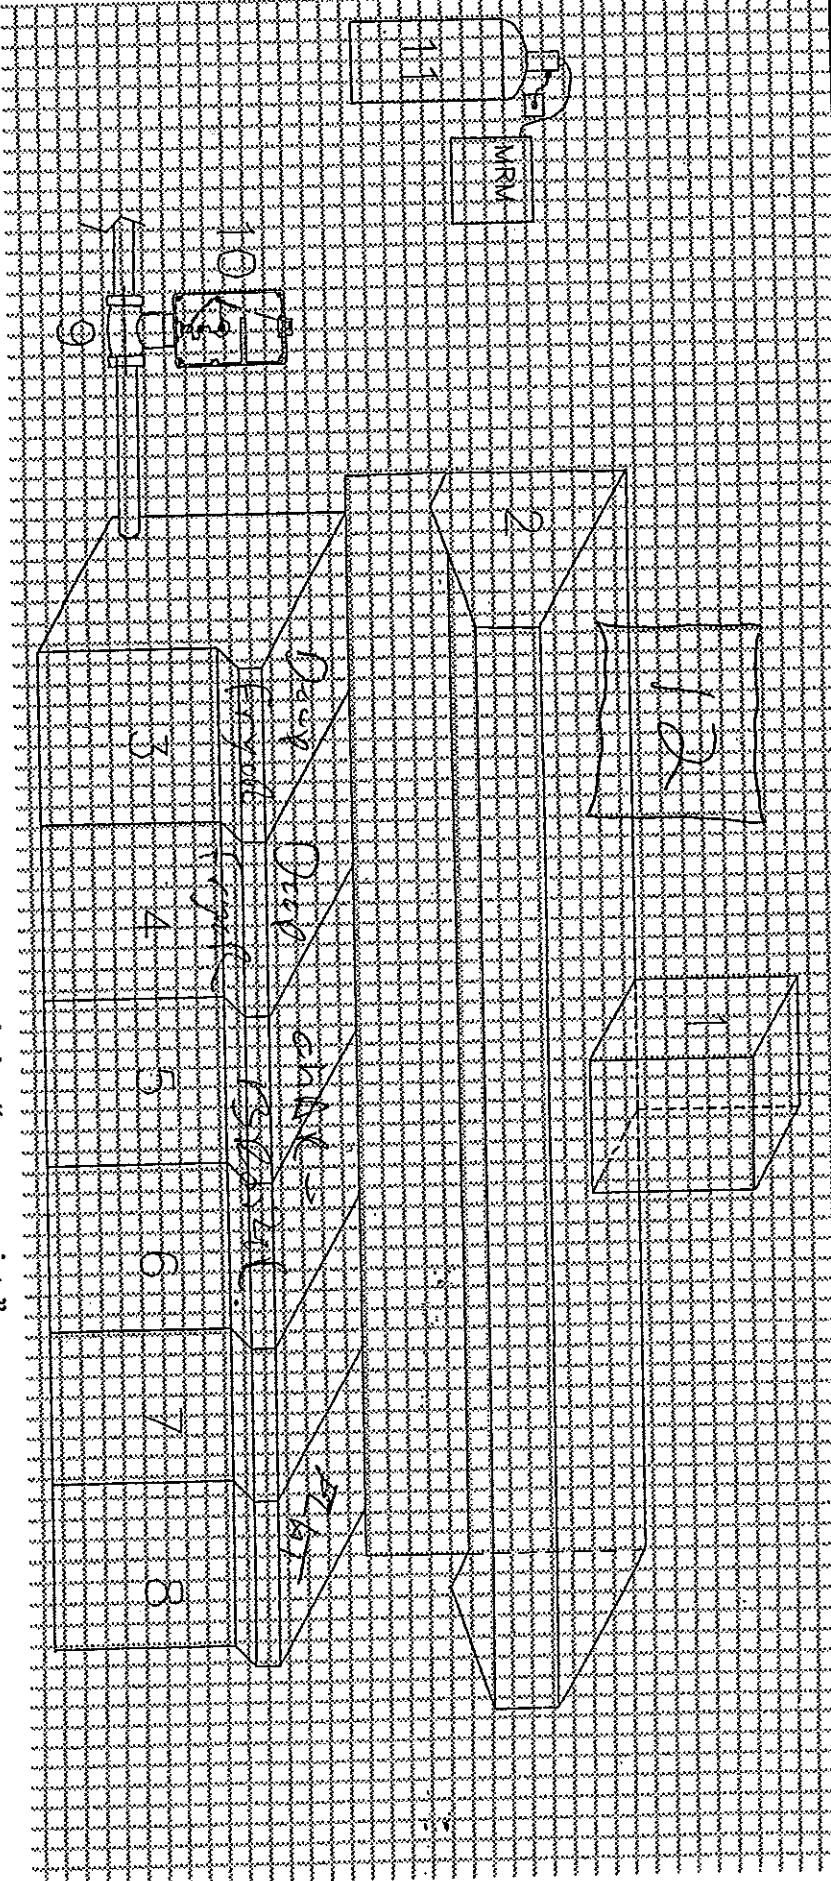

System Description "as appropriate"

- | | qty. | size | x | size | | qty. | size | x | size |
|---------------|------|------|---|------|--|-------------------|------|---|------|
| 1. Duct: | | | | | | 7. Appliance: | | | |
| 2. Plenum: | | | | | | 8. Appliance: | | | |
| 3. Appliance: | | | | | | 9. Gas Valve: | | | |
| 4. Appliance: | | | | | | 10. Retrofit Kit: | | | |
| 5. Appliance: | | | | | | 11. Agent Cyl.: | | | |
| 6. Appliance: | | | | | | 12. Misc.: | | | |