


SCOPE OF WORK:
 FURNISH & INSTALL A 3 GALLON
 PYRD-CHEM WET CHEMICAL KITCHEN HOOD
 FIRE SUPPRESSION SYSTEM PER NFPA 17A,
 NFPA 96 AND UL 300 TO PROTECT: (1)
 6'-4" PLENUM, 10"x10" EXHAUST DUCT,
 (2) 4 BURNER RANGE AT THE DEERING
 PAVILION IN PORTLAND, ME.

ISOMETRIC VIEW

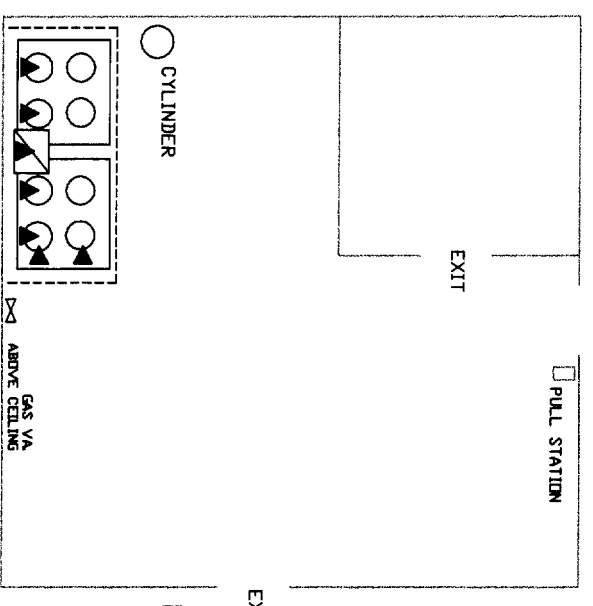

PLAN VIEW

tyco Fire & Security 2000 West Street Westbrook, ME 04091 LOCAL OFFICE: WESTBROOK, ME.		Deering Pavilion CONTRACT NAME: DEERING PAVILION PORTLAND, ME.	
APPROVALS <input type="checkbox"/> IN <input type="checkbox"/> OUT		SYSTEM INFO SYSTEM NAME/NO. _____ SYSTEM TYPE _____ WAKE SYSTEM _____ HAZARD CLASSIFICATION _____	
REVISIONS <input type="checkbox"/> IN <input type="checkbox"/> OUT		CONTRACT WKS. BE STOPPED CONTRACT NO. PYRD-CHEM	
NO. DATE BY REVISION DESCRIPTION		HYDRAULIC DESIGN DATA RISE/FALL _____ AREA OF HOSE _____ CONTRACT NO. _____ ENGINEERING DEPARTMENT _____	
BEST LOCATION: _____ DATE: JULY 2006		SCALE: 1/8"=1'-0" DRAWN BY: B.H. CHECKED BY: T.H. THESE PLANS PREPARED AT: WESTBROOK, ME.	
DRAWING NO. 1 OF 1		DATE: JULY 2006	