


FOUNDATION / FIRST FLOOR PLAN NOTES:


1. TOP OF SLAB = 60'-0" U.O. AS SHOWN AS
2. TOP OF EXTERIOR WALL = TOP OF SLAB TYPICAL U.O. SUCH AS AT DOORS SHOWN SHAGED.
3. SLAB-ON-GRADE CONSTRUCTION IS 4" THICK WITH 1" DEEP SAWCUT CONTROL JOINTS AT 14'-0" MAXIMUM EACH WAY. SEE SECTIONS AND TYPICAL DETAILS FOR REINFORCEMENT AT SLAB EDGES.
4. PROVIDE 1" DEEP SAWCUT CONTROL JOINTS AT 14'-0" MAXIMUM EACH WAY BETWEEN COLUMN LINES AND DIAGONALLY OFF ALL INSIDE CORNERS WITHIN 12 HOURS OF PLACING SLAB.
5. ELEV. 1 INDICATES TOP OF FOOTING ELEVATION. COORDINATE REQUIRED TOP OF EXCAVATION WITH FOOTING THICKNESS PER FOOTING SCHEDULE AND SECTIONS.
6. FOUNDATION WALL PENETRATIONS NOT SHOWN. CHECK FOR OTHER TRADES AND PROVIDE SLEEVES AND ANCHOR BOLTS THROUGH WALLS AS REQUIRED.
7. SEE S.300 AND S.301 FOR ALL TYPICAL CONCRETE DETAILS.

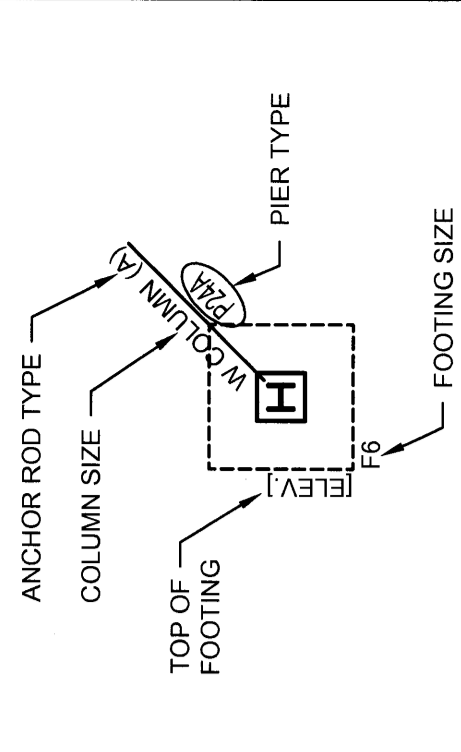

PIER SCHEDULE		
MARK	TOP ELEV.	SIZE
(P24)	59'-0"	24" SQ.
(P25)	59'-5"	60" SQ.


FOOTING SCHEDULE		
MARK	SIZE (U.O. ON PLAN)	REINFORCING
F4	4'-0" SQ. X 1'-0"	(5) #6 B.E.W.
F5	5'-0" SQ. X 1'-0"	(6) #6 B.E.W.
F6	6'-0" SQ. X 1'-0"	(7) #6 B.E.W.
F7	7'-0" SQ. X 1'-0"	(8) #6 B.E.W.
F8	8'-0" SQ. X 2'-0"	(10) #6 B.E.W.
F9	9'-0" SQ. X 2'-0"	(10) #6 B.E.W.
F10	10'-0" SQ. X 2'-0"	(10) #6 B.E.W.
F11	12'-0" SQ. X 2'-0"	(10) #6 B.E.W.
F12	12'-0" SQ. X 2'-0"	(10) #6 B.E.W.

- NOTES:**
1. UNDER SIDE OF COLUMN BASE PLATE ELEVATION IS 5' BELOW FINISHED GRADE. REFER TO SCHEDULE TO COORDINATE PLAN AND SCHEDULE.
 2. SEE TYPICAL CONCRETE DETAILS FOR ARRANGEMENT OF VERTICAL PIER REINFORCING AND TIES. SEE SECTIONS FOR VERTICAL SPACING OF TIES AND DOWNELS TO FOOTINGS.

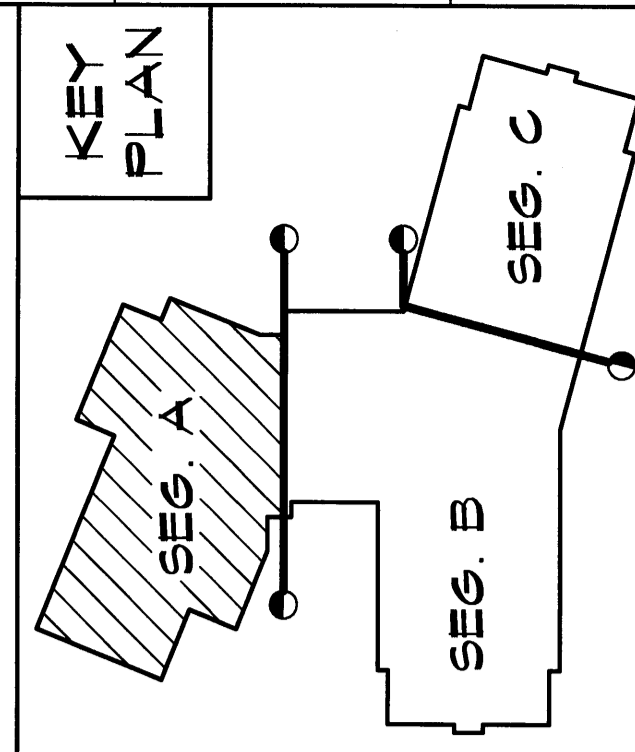

REV.	DESCRIPTION	DATE
0		10/01/00

PERMIT APPLICATION
SUBMISSION 3-18-09
 CURRENT ISSUE STATUS:

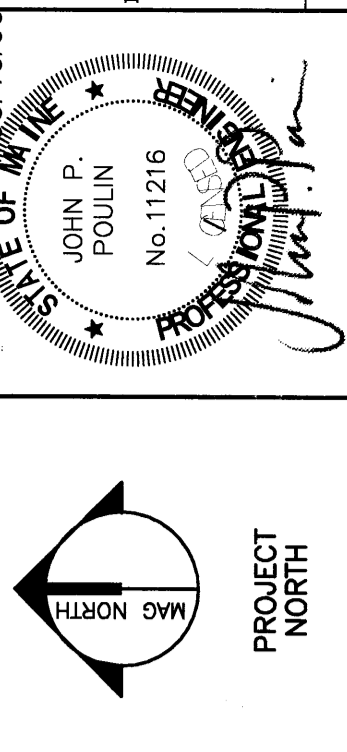


WBRC
 ARCHITECTS - ENGINEERS
 100 WASHINGTON STREET, SUITE 200
 PORTLAND, MAINE 04101-5200

OCEAN AVENUE ELEMENTARY
 SCHOOL
 PORTLAND, ME

FOUNDATION & FIRST FLOOR
SLAB PLAN - SEGMENT A

SHEET TITLE:	331610-S-101-A
WBRC JOB FILE:	331610
PROJECT NO.:	AS NOTED
SCALE:	1" = 1'-0"
PROJECT MANAGER:	MEJ
DRAWN BY:	ADJ/BAS
CHECKED BY:	JPT
SHEET NO.:	S-101-A

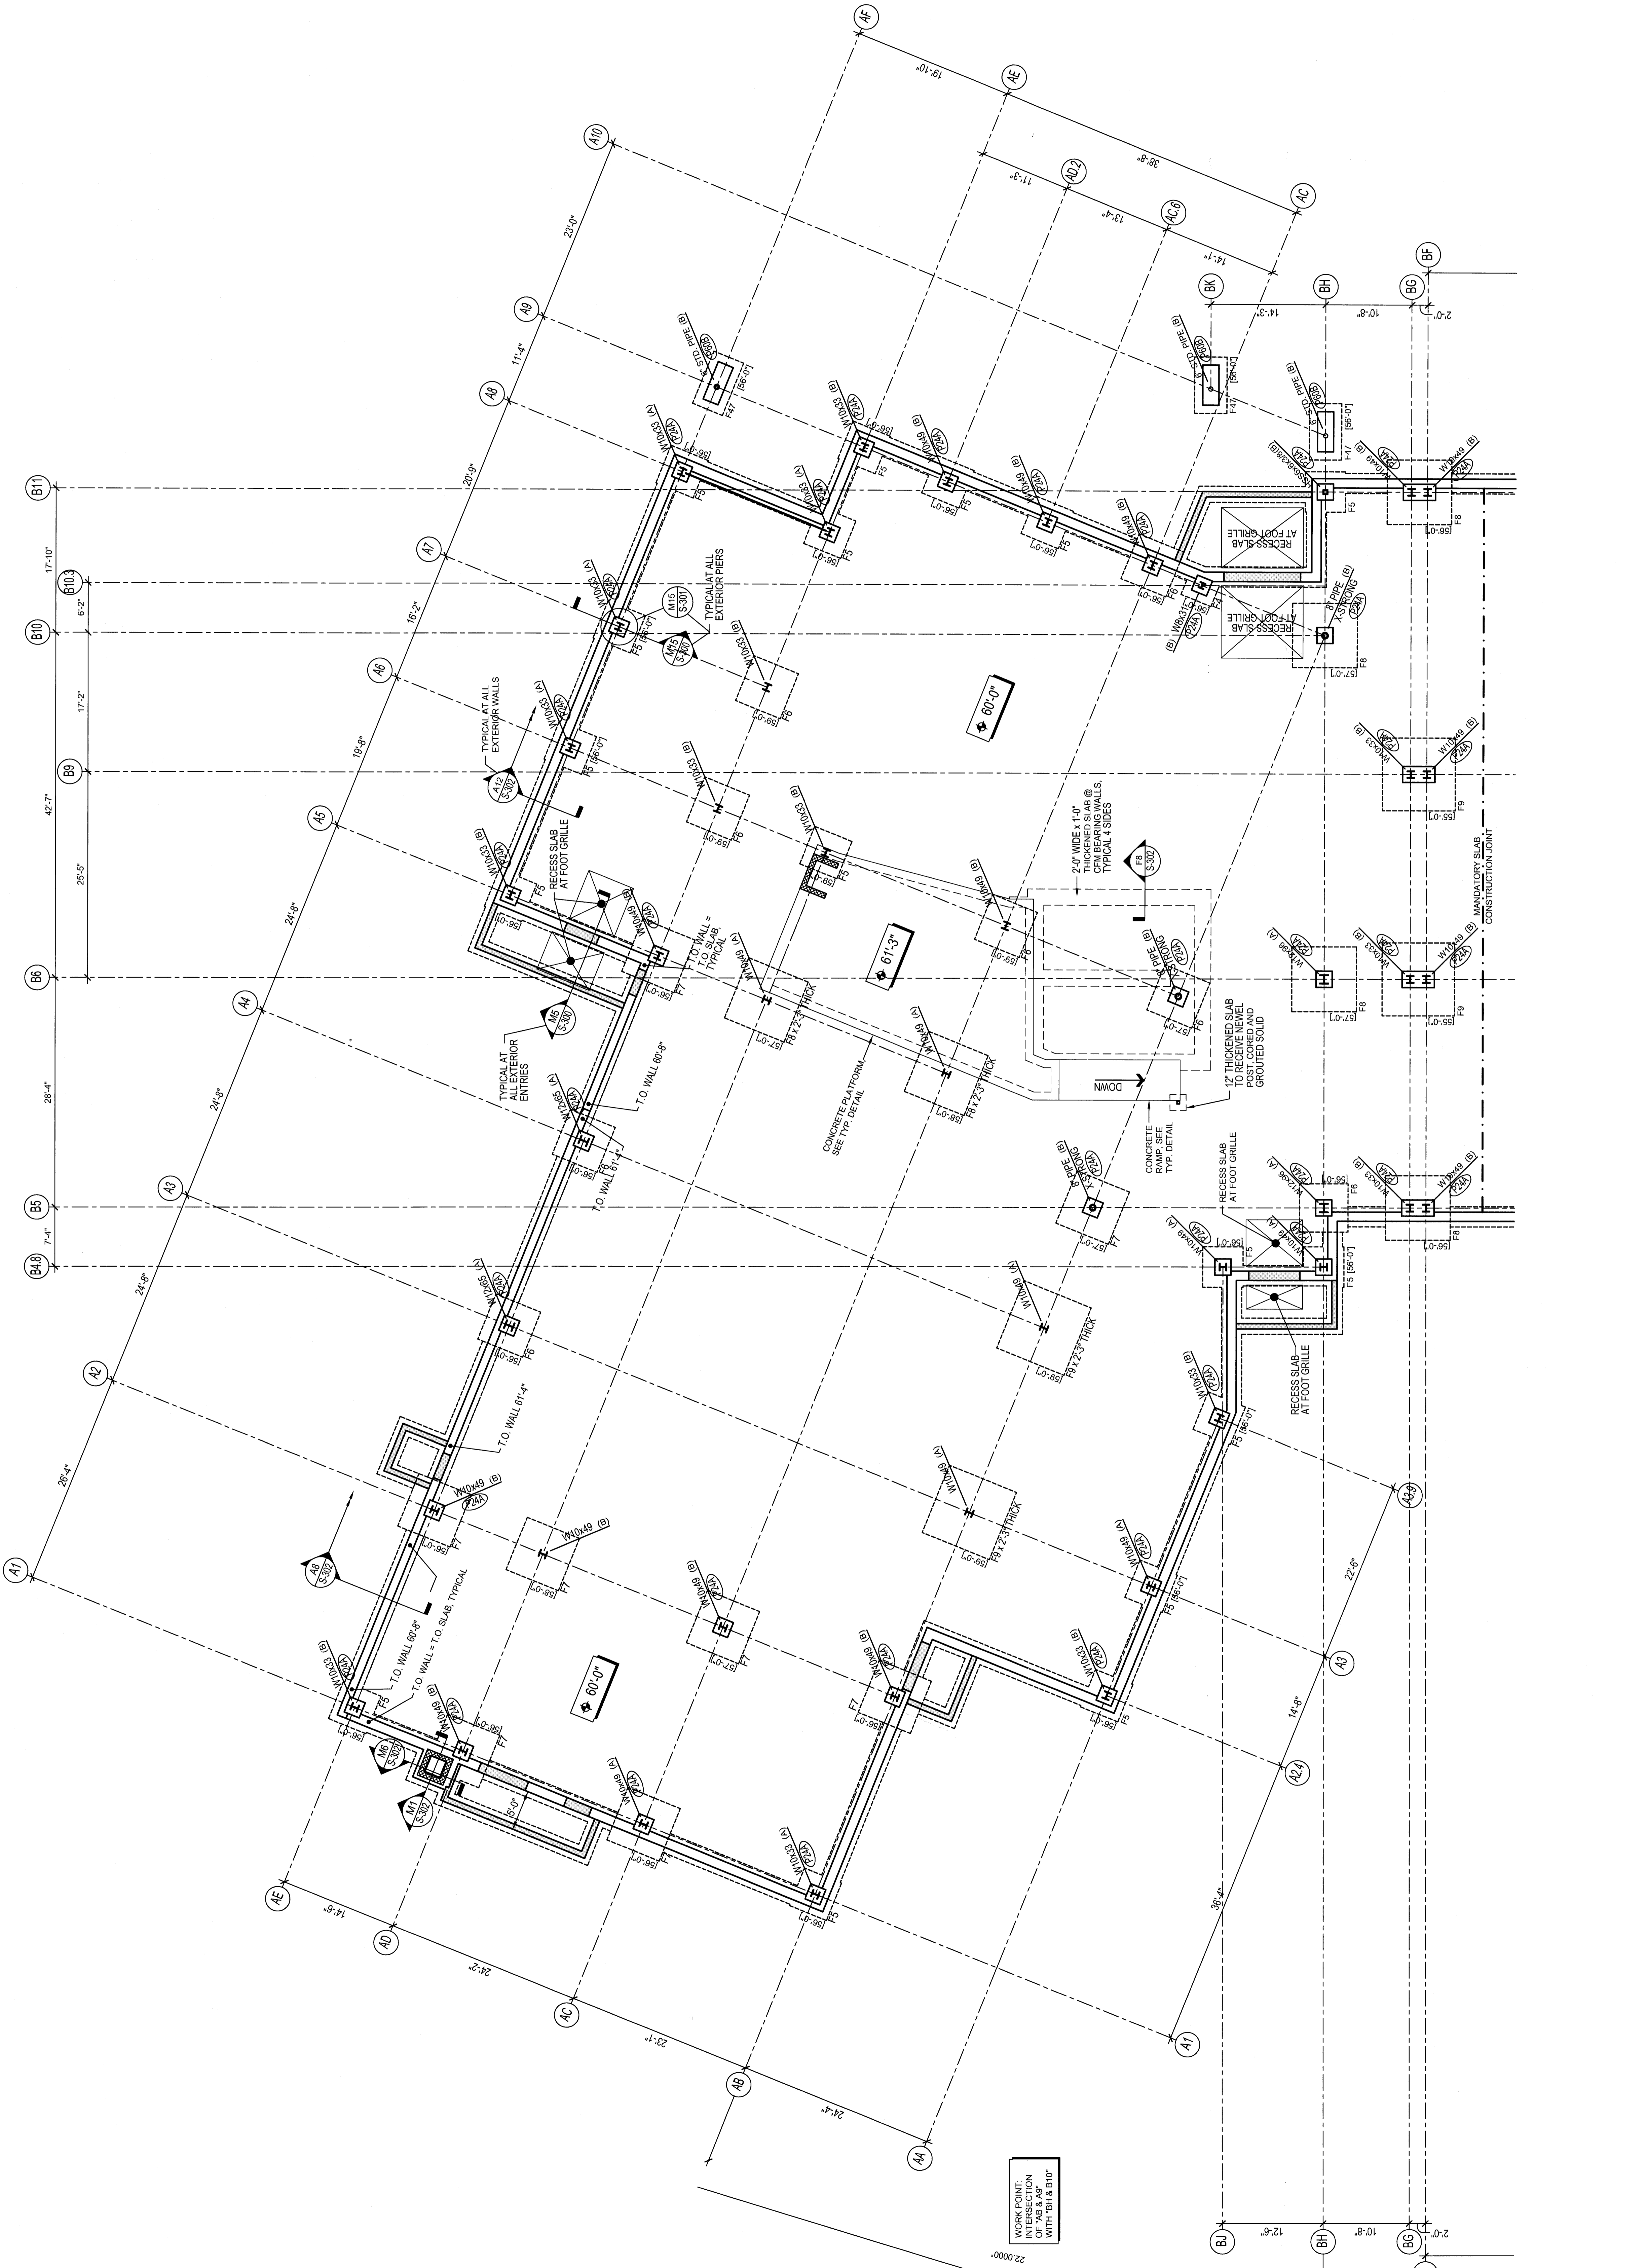

SEGMENT A: FOUNDATION & FIRST FLOOR SLAB PLAN

A1

1/8" = 1'-0"