3/18/2009 3:05 PM I:\330\-340\331610-AE501 WALL TYPES.DWG MARK.STILLYMAN
SCHOOL\SHEETS\331610-AE501 WALL TYPES.DWG - SD TO CAD\650\OCEAN AVENUE ELEMENTARY SCHOOL\OCEAN AVE. ELEMENTARY SCHOOL

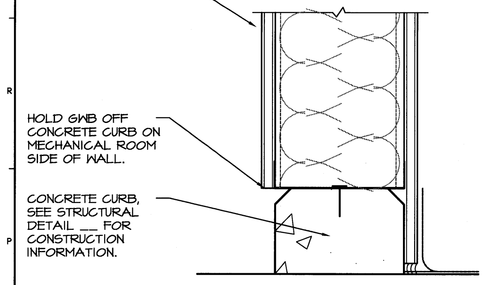

N1 CONCRETE CURB WALL

3"=1'-0" --

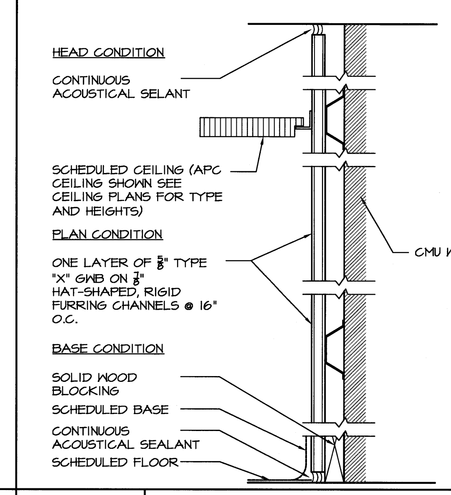

N4 7/8" METAL STUD CHASE WALL - M13

3/4"=1'-0" --

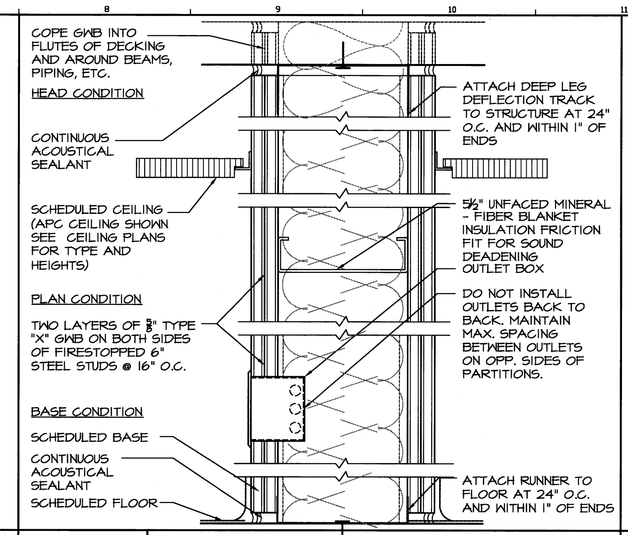

N8 6" METAL STUD WALL 2HR - M9

3"=1'-0" --

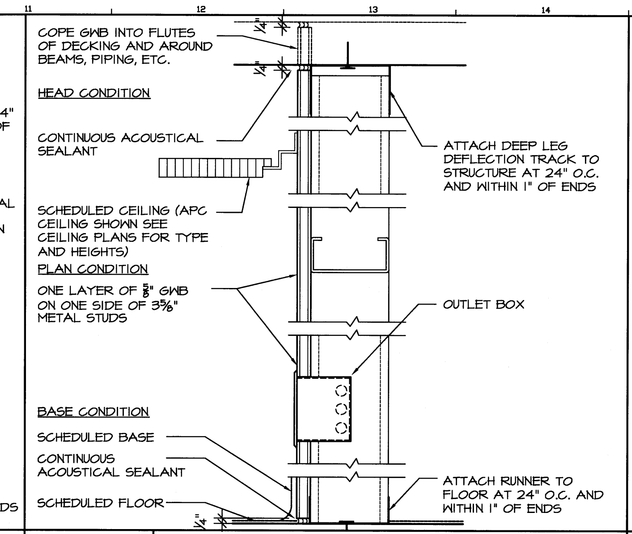

N11 3 5/8" METAL CHASE STUD WALL - M5

3"=1'-0" --

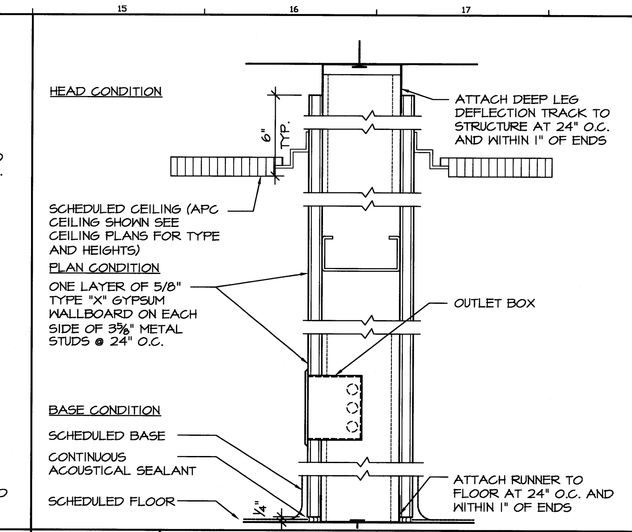

N15 3 5/8" METAL STUD WALL - M1

3"=1'-0" --

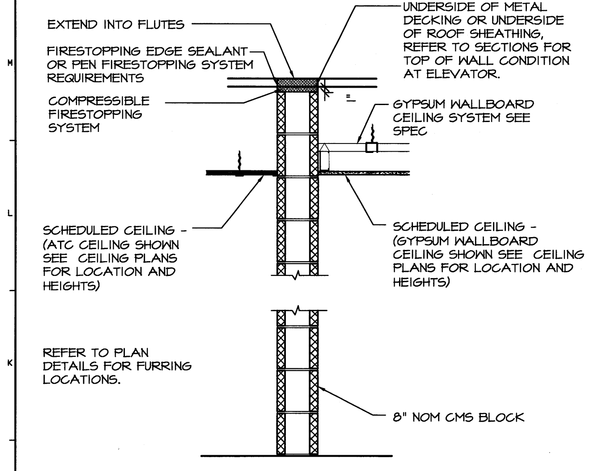

J1 8" NOM CMU WALL 1 HR - C4

3/4"=1'-0" UL #U906

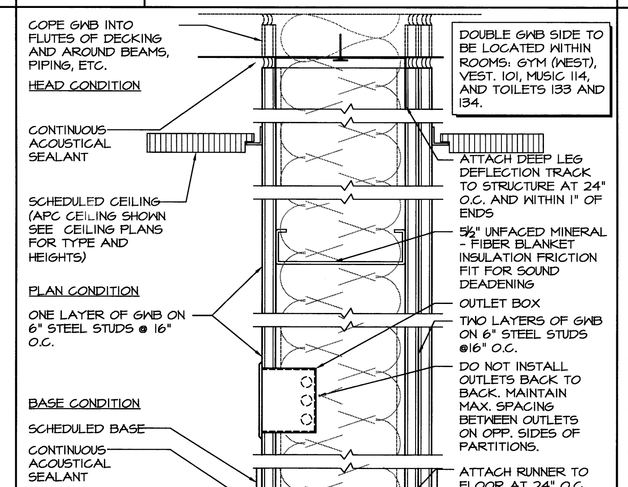

J4 6" METAL STUD SOUND WALL - M20

3/4"=1'-0" --

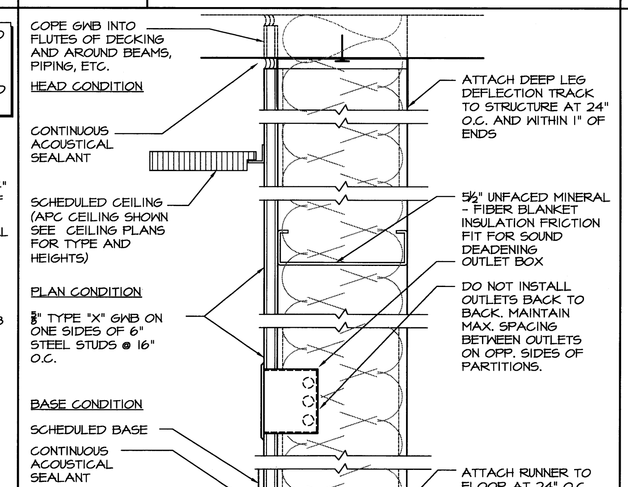

J8 6" METAL CHASE STUD WALL - M10

3"=1'-0" --

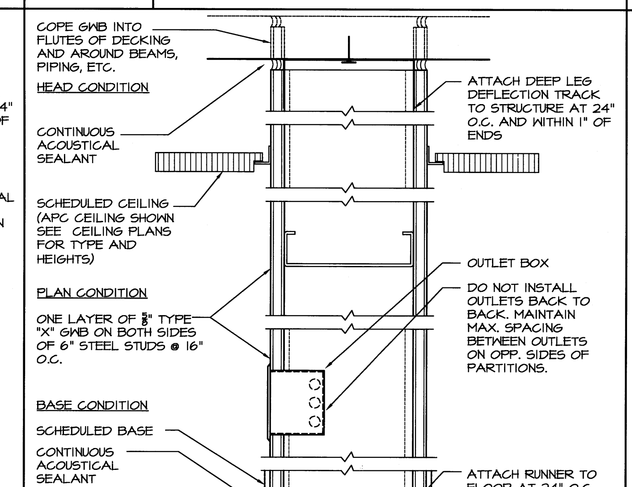

J11 6" METAL STUD WALL - M6

3"=1'-0" --

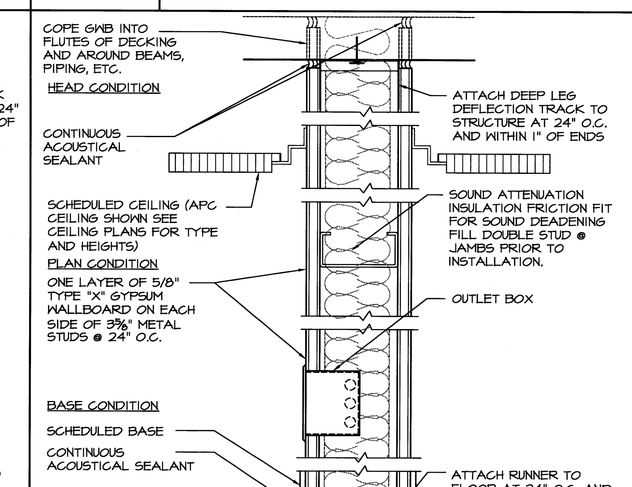

J15 3 5/8" METAL STUD WALL SOUND - M2

3"=1'-0" --

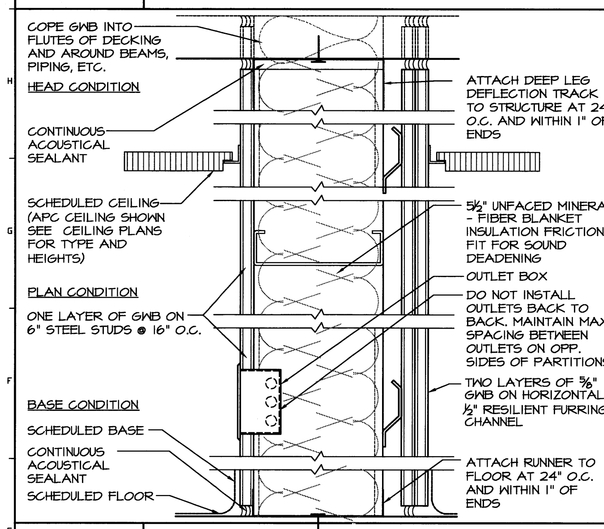

E1 6" METAL STUD SOUND, WALL 1 HR - M24

3/4"=1'-0" --

RESILIENT CHANNELS TO BE LOCATED ON THE CONFERENCE ROOM 128 SIDE OF THE PARTITION.

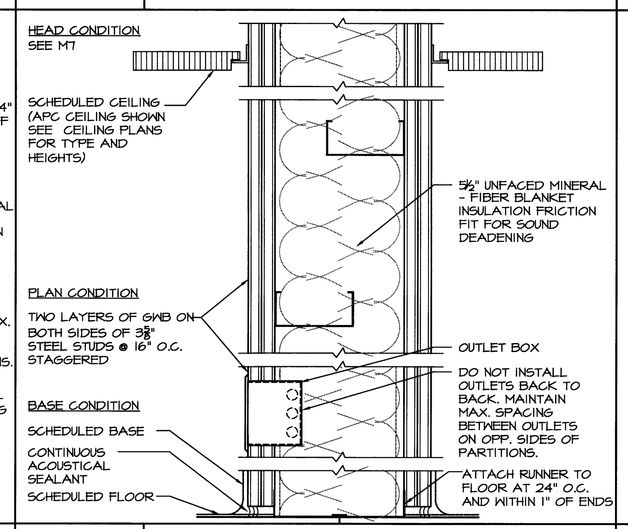

E4 6" METAL STUD SOUND WALL - 21

3/4"=1'-0" --

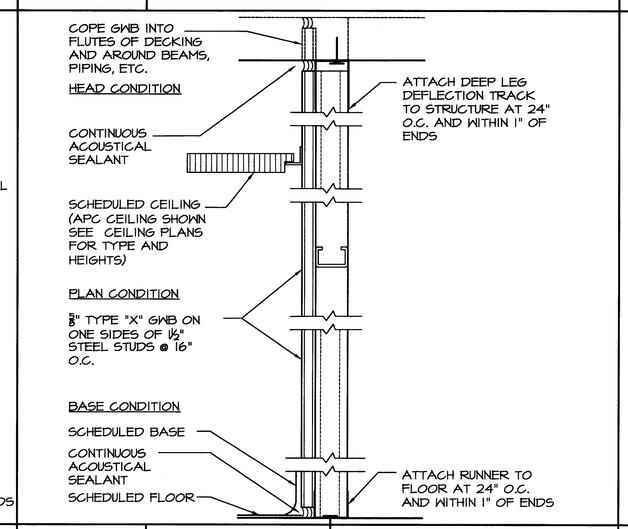

E8 1-1/2" METAL CHASE STUD WALL - M11

3"=1'-0" --

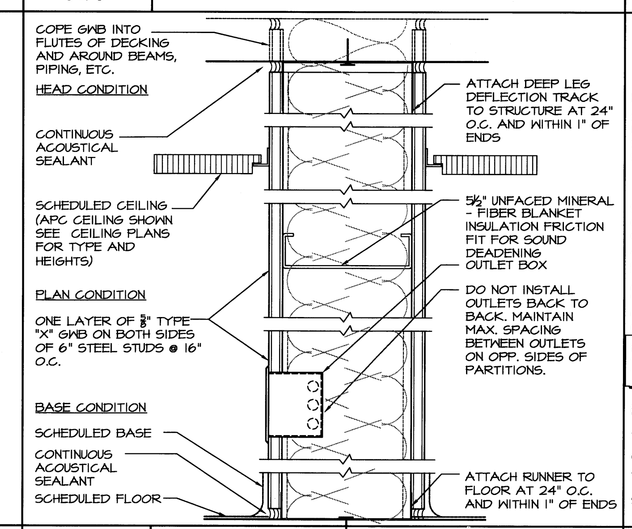

E11 6" METAL STUD WALL SOUND - M7

3"=1'-0" --

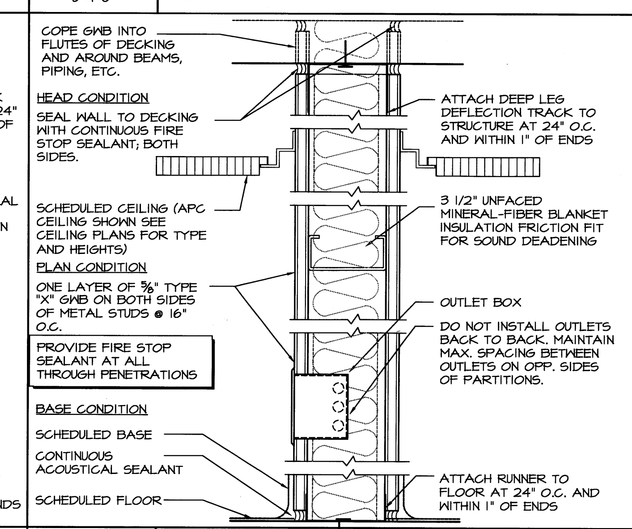

E15 3 5/8" METAL STUD WALL 2HR - M3

3"=1'-0" --

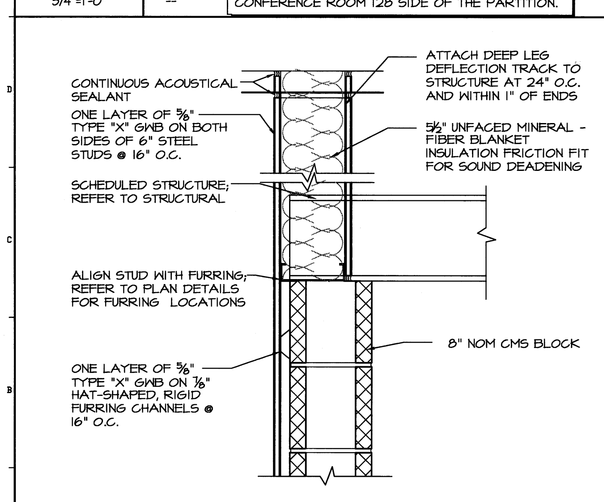

A1 MASONRY/METAL STUD TRANSITION

1 1/2" = 1'-0" AE101-A

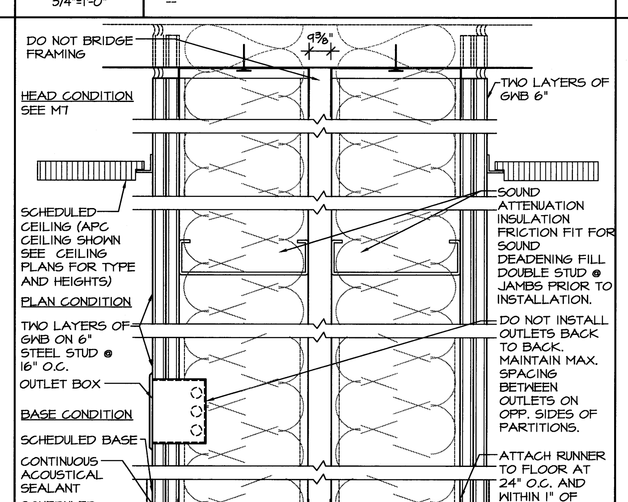

A4 (2) 6" METAL STUD SOUND WALL - M23

3/4"=1'-0" --

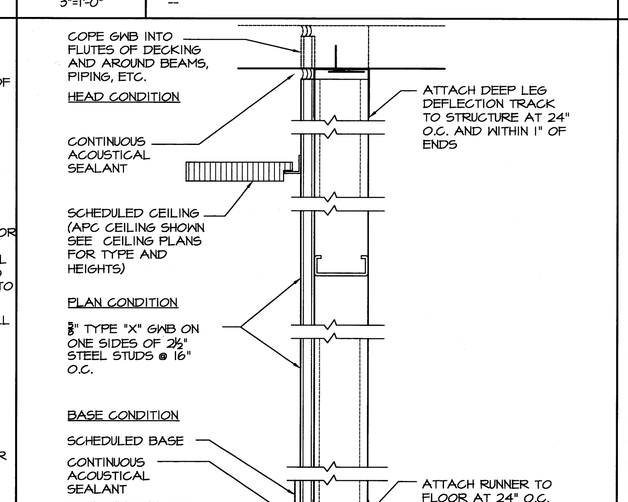

A8 2-1/2" METAL CHASE STUD WALL - M12

3"=1'-0" --

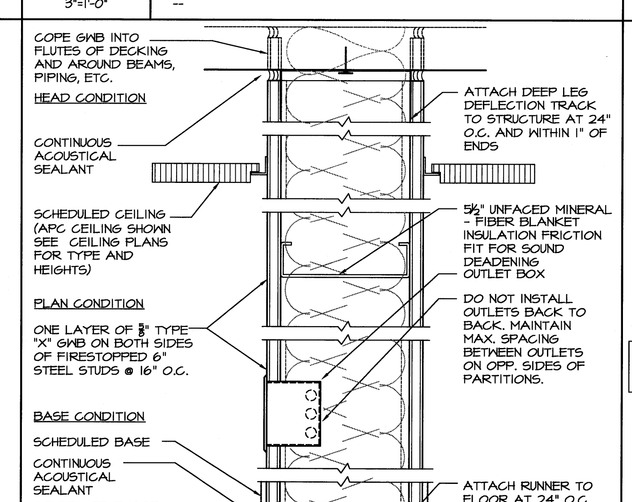

A11 6" METAL STUD WALL 1HR - M8

3"=1'-0" --

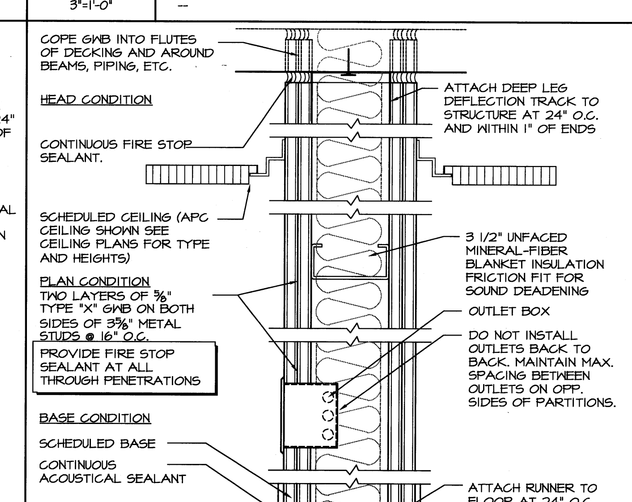

A15 3 5/8" METAL STUD WALL 2 HR M4

3"=1'-0" --

WALL TYPE NOTES NOTES:

1. ALL WALL PARTITIONS TYPES M7 UNLESS NOTED OTHERWISE.
2. ALL WALL PARTITIONS ARE TO EXTEND FROM FLOOR SLAB TO UNDERSIDE OF METAL DECKING OR UNDERSIDE OF ROOF TRUSSES UNLESS OTHERWISE NOTED.
3. VERIFY UN-BRACED WALL HEIGHT REQUIREMENTS WITH SPECIFICATION AND PROVIDE DIAGONAL BRACING AS REQUIRED.
4. TYPICAL AT WALL TRACKS, IN ADDITION TO FASTENING TRACK TO THE CONCRETE SLAB, ADHERE TRACK TO SLAB WITH (1) ROW OF CAULK DOWN THE CENTER.
5. PROVIDE IMPACT RESISTANT GWB TO A HEIGHT OF 8'-0" AT THE PERIMETER OF THE GYM AND CAFETERIA. PROVIDE 4' OF IMPACT RESISTANT GWB ABOVE THE WAINSCOTING IN THE LOBBY AND CORRIDORS.
6. PROVIDE CEMENTITIOUS BACKER UNIT BEHIND ALL CERAMIC TILE.
7. PROVIDE MOISTURE RESISTANT GWB AT THE PERIMETER OF ALL TOILET AND LOCKER ROOMS.
8. ALL INSULATION AT WALLS WITH AN STC RATING SHALL BE ACOUSTICAL SOUND ABSORPTION INSULATION
9. ALL PENETRATIONS AT WALLS WITH AN STC RATING SHALL BE ACOUSTICALLY SEALED
10. WALLS OVER 25'-0" IN HEIGHT TO HAVE 6" 20 GA STUDS AT 16" O.C.

REV.	DESCRIPTION	DATE
--	--	--
--	--	--
--	--	--
0	----	00.00.00

PERMIT APPLICATION SUBMISSION 3-18-09

CURRENT ISSUE STATUS:

MICHAEL E. JOHANNING No. 3067 REGISTERED ARCHITECT STATE OF MAINE 5-18-09

WBRC ARCHITECTS · ENGINEERS
WWW.WBRCAE.COM
BANGOR, MAINE 207-947-4111
PORTLAND, MAINE 207-828-4111
SARASOTA, FLORIDA 941-316-0177

OCEAN AVENUE ELEMENTARY SCHOOL
PORTLAND, ME

PROJECT:

WALL TYPES

SHEET TITLE:

WBRC CAD FILE:	331610-AE501
PROJECT No.	331610
GRAPHIC SCALE	0" 1"
SCALE:	AS NOTED
PROJECT MANAGER:	MEJ
SHEET No.	AE501
DRAWN BY:	RAD
CHECKED BY:	MEJ

© COPYRIGHT 2009 WBRC