LEGEND

ALL DEVICES, FIXTURES, ETC. SHALL BE NEW UNLESS DESIGNATED WITH THE FOLLOWING TAGS:

- E EXISTING TO REMAIN
- ER EXISTING RELOCATED
- NR NEW TO REPLACE EXISTING IN EXISTING LOCATION
- R EXISTING TO BE REMOVED
- RR REMOVE & RELOCATE EXISTING

- NIGHT LIGHT
- FLUORESCENT FIXTURE - UPPERCASE LETTER IS TYPE, LOWERCASE LETTER IS SWITCH CONTROL GROUP - RECTANGLES INDICATE NUMBER FIXTURES IN A ROW.
- CEILING MOUNTED FIXTURE - NOTES SAME AS ABOVE
- WALL MOUNTED FIXTURE - NOTES SAME AS ABOVE
- CEILING MOUNTED EXIT SIGN - ARROW INDICATES DIRECTIVE ARROW ON SIGN
- WALL MOUNTED EXIT SIGN - ARROW INDICATES DIRECTIVE ARROW ON SIGN
- EMERGENCY LIGHTING BATTERY PACK WITH EMERGENCY LAMPS AS SHOWN
- REMOTE EMERGENCY LAMP LIGHT FIXTURES
- SPST FLUSH WALL TOGGLE SWITCH - MOUNT AT 48" A.F.F TO CENTER - LETTER INDICATES SWITCH GROUP
- S_3 THREE-WAY TOGGLE SWITCH - NOTES SAME AS SPST SWITCH ABOVE
- S_D DIMMER SWITCH - NOTES SAME AS SPST SWITCH ABOVE
- S_4 FOUR-WAY TOGGLE SWITCH - NOTES SAME AS SPST SWITCH ABOVE
- S_V VACANCY SENSOR (MANUAL ON/AUTO OFF) - NOTES SAME AS ABOVE
- S_P PILOT LIGHT SWITCH - NOTES SAME AS ABOVE
- 20 AMP DUPLEX CONVENIENCE RECEPTACLE - MOUNT AT 18" A.F.F. TO CENTER UNLESS INDICATED OTHERWISE - "GFI" INDICATES GROUND FAULT DEVICE, *** INDICATES GFI PROTECTED BY UPSTREAM DEVICE, "WP" INDICATES WEATHERPROOF, "IG" INDICATES INSULATED/ISOLATED GROUND, "C" INDICATES CEILING MOUNTED, "F" INDICATES FLOOR MOUNTED
- 20 AMP QUADRAPLEX (DOUBLE DUPLEX) - NOTES SAME AS ABOVE
- SPECIAL PURPOSE OUTLET OR EQUIPMENT CONNECTION - COORDINATE LOCATION AND TYPE OF CONNECTION WITH EQUIPMENT BEING SERVED.
- JUNCTION BOX WITH COVER
- MOTOR - SIZE AS INDICATED - COORDINATE W/ ACTUAL EQUIPMENT BEING SERVED
- S_M MANUAL STARTER - COORDINATE WITH EQUIPMENT BEING SERVED
- SINGLE THROW FUSED DISCONNECT SWITCH - NEMA ENCLOSURE AS REQUIRED
- REMOTE CONTROL MAGNETIC STARTER - COORDINATE W/ EQUIPMENT BEING SERVED
- GROUND
- BRANCH CIRCUIT RUN IN CEILING OR IN WALLS
- LOW VOLTAGE OR CONTROL WIRING - #12 MINIMUM OR AS NOTED
- MULTI-CONDUCTOR BRANCH CIRCUIT - NUMBER OF HASHMARKS IS NUMBER OF WIRES (NOT INCLUDING GROUND WIRE) - WITHOUT HASHMARKS IS TWO WIRE
- HOMERUN TO CIRCUIT AND PANEL INDICATED - NUMBER OF ARROWS IS NUMBER OF PHASE WIRES - NUMBER OF WIRES AS INDICATED ABOVE
- CONTINUATION OF CIRCUIT
- DIRECTIVE ARROW
- PANELBOARD - SEE PANELBOARD SCHEDULE(S)
- COMBINATION VOICE/DATA JACK - "V" INDICATES NUMBER OF VOICE LINES, "D" INDICATES NUMBER OF DATA LINES, PROVIDE (1) EACH UNLESS NOTED OTHERWISE - "U" INDICATES 48" TO CENTER A.F.F.
- VOICE JACK - NOTES SAME AS VOICE/DATA JACK ABOVE - "W" INDICATES WALL PHONE, (1) VOICE LINE ONLY
- DATA JACK - NOTES SAME AS VOICE/DATA JACK ABOVE
- TV TELEVISION JACK - NOTES SAME AS RECEPTACLES
- RECESSED FLOOR OR CEILING MOUNTED BOX - POWER & COMMUNICATIONS AS SHOWN-"F" INDICATES FLOOR MOUNTED, "C" INDICATES CEILING MOUNTED - NOTES SAME AS VOICE/DATA JACK ABOVE
- WALL MOUNTED CLOCK
- SP C CEILING SPEAKER (SOUND OR INTERCOM SYSTEM AS SHOWN)
- SP WALL SPEAKER (SOUND OR INTERCOM SYSTEM AS SHOWN)
- H TELEPHONE/INTERCOM SYSTEM HAND SET
- SP GYM/CAFETERIA LOUDSPEAKER - "M" INDICATES MONITOR TYPE SPEAKER
- CEILING MOUNTED PROJECTOR TO BE OWNER SUPPLIED/ OWNER INSTALLED
- S_{VC} SPEAKER VOLUME CONTROL SWITCH
- W WIRELESS ACCESS DATA POINT - MOUNTED ABOVE SUSPENDED CEILING, UNLESS OTHERWISE NOTED
- M DUAL-JACK MICROPHONE OUTLET
- CABLE TRAY
- FACP FIRE ALARM SYSTEM CONTROL PANEL
- FAA FIRE ALARM ANNUNCIATOR
- H FIRE ALARM SYSTEM CEILING MOUNTED HEAT DETECTOR
- S FIRE ALARM SYSTEM CEILING MOUNTED SMOKE DETECTOR
- S FIRE ALARM SYSTEM DUCT MOUNTED SMOKE DETECTOR
- F FIRE ALARM SYSTEM WALL MOUNTED FIRE ALARM SYSTEM MANUAL PULL STATION
- FAA FIRE ALARM SYSTEM WALL MOUNTED VOICE/VISUAL DEVICE WITH VISUAL DEVICE CANDELLA RATING AS NOTED
- FAA FIRE ALARM SYSTEM WALL MOUNTED VISUAL DEVICE ONLY - CANDELLA RATING AS NOTED
- DH FIRE ALARM SYSTEM DOOR HOLD-OPEN DEVICE CONNECTION - "" INDICATES DUAL FUNCTION TO BE TIED TO SECURITY SYSTEM AS WELL AS FIRE ALARM SYSTEM.
- PS FIRE ALARM SYSTEM/SPRINKLER SYSTEM PRESSURE SWITCH
- FS FIRE ALARM SYSTEM/SPRINKLER SYSTEM FLOW SWITCH
- TS FIRE ALARM SYSTEM/SPRINKLER SYSTEM TAMPER SWITCH
- OS CEILING MOUNTED OCCUPANCY SENSOR
- PE CEILING MOUNTED PHOTOCELL
- (PAR) PARTIAL CIRCUIT
- WP WEATHER PROOF
- OS/OI OWNER SUPPLIED & OWNER INSTALLED ITEM
- 84" MOUNTING HEIGHT FOR DEVICE (A.F.F. TO CENTER LINE OF DEVICE)
- SACP SECURITY ALARM SYSTEM CONTROL PANEL
- CR ACCESS CONTROL SYSTEM PROXIMITY CARD READER
- DS ACCESS CONTROL SYSTEM DOOR POSITION SWITCH
- DL ACCESS CONTROL SYSTEM ELECTRIC DOOR LOCK BY DIV. 8. PROVIDE CONDUIT & WIRING ONLY.
- MD INTRUSION DETECTION SYSTEM MOTION DETECTOR
- SIREN SECURITY ALARM SYSTEM SIREN/STROBE
- HD HANDICAP ELECTRICALLY-ASSISTED DOOR OPENER PUSHBUTTON
- INT INTERCOM SYSTEM CONTROL PANEL
- FA-PE FIRE ALARM SYSTEM POWER EXTENDER
- MSB MAIN SWITCH BANK - MOUNT @ 48" AFF TO CENTER- REFER TO DETAIL A8/E-501 FOR MORE INFORMATION
- TCC TEACHER CONTROL CENTER - SAME NOTES AS MAIN SWITCH BANK ABOVE
- PCC POWER CONTROL CENTER - MOUNTED ABOVE ACCESSIBLE CEILING IN SHOWN LOCATION - REFER TO DETAIL A8/E-501 FOR MORE INFORMATION.
- IC INTERCOM SYSTEM SUB-STATION - WITH "M" INDICATES MASTER STATION
- KEY KEYPAD - FOR ACCESS CONTROL OR INTRUSION DETECTION SYSTEM AS NOTED

LIGHT FIXTURE SCHEDULE

TYPE	DESCRIPTION	SIZE	MANUFACTURER CAT. NO.	LENS/LOUVER	LAMPS ①	BALLASTS ①	EFFICIENCY MAINE CODE	MINIMUM EFFICIENCY	WATTS PER FIXTURE ②	VOLT.	NOTES
A	CEILING SUSPENDED DIRECT/INDIRECT	8' L	FINELITE S10-WCB-8'-3T8-91W-CCO-277-AC 18"-FE	WHITE CROSS BAFFLE	32W T8	DIMMING ELECTRONIC	CUSTOM	79.4%	93W	277	
B	CEILING RECESSED DIRECT/INDIRECT	1' X 4'	ALERA LIGHTING LUM14-232G-MPO-EIU	PERFORATED METAL	32W T8	ELECTRONIC	L16	58.7%	54W	UNV	
C	CEILING SUSPENDED DIRECT/INDIRECT	8' L	ALERA LIGHTING CVL-8-2T8-20/80-FCM12-LD-E277	STRAIGHT BLADES	32W T8	ELECTRONIC	L16	71.6%	132W	277	MOUNT @ 8'-0" AFF TO BOTTOM, PROVIDE W/ INLINE WIRING
C1	CEILING SUSPENDED DIRECT/INDIRECT	12' L	ALERA LIGHTING CVL-12-2T8-20/80-FCM12-LD-ED277	STRAIGHT BLADES	32W T8	DIMMING ELECTRONIC	L16	71.6%	198W	277	MOUNT @ 8'-0" AFF TO BOTTOM, PROVIDE W/ INLINE WIRING
C2	CEILING SUSPENDED DIRECT/INDIRECT	4' L	ALERA LIGHTING CV-4-2T8-PERF-CM24-E-277-MW-4	PERFORATED METAL	32W T8	ELECTRONIC	L16		35W	277	MOUNT @ 8'-0" AFF TO BOTTOM, PROVIDE W/ INLINE WIRING
D	CEILING SUSPENDED HIGH BAY FLUORESCENT	4' L	COLUMBIA LIGHTING LHEM4-454-WCBST-EU-LHEMWG	STRAIGHT BLADES	54W T5HO	ELECTRONIC	L16	60.1%	234W	UNV	MOUNT @ 22'-0" AFF TO BOTTOM, UNO
E	CEILING SUSPENDED PENDANT	18" Ø	FC LIGHTING FCP663-277-232-E-SA-RA	CLEAR RIBBED ACRYLIC	32W TRIPLE	ELECTRONIC	L25	82.8%	72W	277	MOUNT @ 14'-0" AFF TO BOTTOM IN CAFETERIA. MOUNT @ 18'-0"AFF TO BOTTOM IN LIBRARY.
F	EXT. POLE MOUNTED SITE LIGHT	14' H	KIM LIGHTING 1SA-SAR3-100PMH277-**-HS/KSS20-4120-SA-**	CLEAR TEMPERED GLASS	100W MH	PULSE START	-	-	100W	277	FINISH TO BE DETERMINED BY ARCH.
F1	EXT. POLE MOUNTED SITE LIGHT	18' H	KIM LIGHTING 1SA-SAR3-150PMH277-**-HS/KSS20-4120-SA-**	CLEAR TEMPERED GLASS	150W MH	PULSE START	-	-	150W	277	FINISH TO BE DETERMINED BY ARCH.
F2	EXT. POLE MOUNTED SITE LIGHT	14' H	KIM LIGHTING 1SA-SAR2-100PMH277-**-HS/KSS14-4120-SA-**	CLEAR TEMPERED GLASS	100W MH	PULSE START	-	-	100W	277	FINISH TO BE DETERMINED BY ARCH.
F3	EXT. POLE MOUNTED SITE LIGHT	20' H	KIM LIGHTING 1SA-SAR3-150PMH277-**-HS/KSS20-4120-SB-**	CLEAR TEMPERED GLASS	150W MH	PULSE START	-	-	300W	277	FINISH TO BE DETERMINED BY ARCH.
F4	EXT. POLE MOUNTED SITE LIGHT	20' H	KIM LIGHTING 1SA-SAR4-150PMH277-**-HS/KSS20-4120-SA-**	CLEAR TEMPERED GLASS	150W MH	PULSE START	-	-	150W	277	FINISH TO BE DETERMINED BY ARCH.
F5	EXT. POLE MOUNTED SITE LIGHT	18' H	KIM LIGHTING 1SA-SAR4-150PMH277-**-HS/KSS20-4120-SA-**	CLEAR TEMPERED GLASS	150W MH	PULSE START	-	-	150W	277	FINISH TO BE DETERMINED BY ARCH.
G	EXT. POLE MOUNTED SITE LIGHT	16' H	KIM LIGHTING FM-NS2H4-150PMH277/KRS16-4120-FM-**	CLEAR TEMPERED GLASS	150W MH	PULSE START	-	-	150W	277	FINISH TO BE DETERMINED BY ARCH.
H	CEILING SURFACE WRAPAROUND	4' L	COLUMBIA LIGHTING RO4-132-EDU	PRISMATIC ACRYLIC	32W T8	PROG. START ELECTRONIC	L16	86.9%	29W	UNV	
J	WALL MOUNTED FLUORESCENT	4' L	LUMAX INDUSTRIES COD13248-EO4SA-EB	RIBBED ACRYLIC	32W T8	ELECTRONIC	L16	75.1%	35W	UNV	MOUNT @ 8'-0" ABOVE LANDING TO CENTER, UNO. PROVIDE W/ INTEGRAL EMERGENCY BALLAST. NO SUBSTITUTIONS
J1	WALL MOUNTED FLUORESCENT	2' L	LUMAX INDUSTRIES COD11702-EO4SA-EB	RIBBED ACRYLIC	17W T8	ELECTRONIC	L16	75.1%	17W	UNV	MOUNT @ 8'-0" ABOVE LANDING TO CENTER, UNO. PROVIDE W/ INTEGRAL EMERGENCY BALLAST. NO SUBSTITUTIONS
K	CEILING MOUNTED WALL WASH	4' L	FINELITE SX2-O-4'-1T8-SC-96W-277-SM-FE	WHITE CROSS BAFFLE	32W T8	ELECTRONIC	L16	54.2%	35W	277	
L	CEILING SUSPENDED INDUSTRIAL	4' L	COLUMBIA LIGHTING CSR4-232-EPU-CSRWG4	WIRE GUARD	32W T8	PROG. START ELECTRONIC	L16	89.8%	55W	UNV	MOUNT @ 8'-0" AFF TO BOTTOM, UNO
M	CEILING RECESSED PARABOLIC	2' X 4'	COLUMBIA LIGHTING 4524-332G-LD26-S-EU	4" DEEP PARABOLIC	32W T8	ELECTRONIC	L16	70.5%	96W	UNV	
N	CEILING RECESSED TROFFER	2' X 4'	COLUMBIA LIGHTING ST824-232G-FSA12-EU	PRISMATIC ACRYLIC	32W T8	ELECTRONIC	L31	85.5%	54W	UNV	
N1	CEILING RECESSED TROFFER - GASKETED	2' X 4'	COLUMBIA LIGHTING ST824-232G-FSA12-EU-G1	PRISMATIC ACRYLIC	32W T8	ELECTRONIC	L31	85.5%	54W	UNV	PROVIDE W/ GASKETED LENS
P	ELEVATOR PIT LIGHT	2' X 4'	HUBBELL LIGHTING VWGG-150	GLASS GLOBE WIRE GUARD	150W A21	-	-	-	150W	120	
Q	CEILING RECESSED DOWNLIGHT	8" Ø	PRESCOLITE CFQB26277V STF802WB	OPEN	26W QUAD	ELECTRONIC	L25	75.8%	26W	UNV	
R	DISPLAY CASE LIGHTING	4' L	BIRCHWOOD LIGHTING 560 T8 IB UNV 132	OPEN	32W T8	ELECTRONIC	-	-	35W	UNV	
R1	DISPLAY CASE LIGHTING	2' L	BIRCHWOOD LIGHTING 560 T8 IB UNV 117	OPEN	17W T8	ELECTRONIC	-	-	17W	UNV	
S	EXT. CANOPY MOUNTED CYLINDER	8" Ø	PRESCOLITE HO8806 BR 277V **	OPEN	50W MH	HPF	-	-	50W	277	
T	CEILING SURFACE DOME LIGHT	14" Ø	FC LIGHTING FCSX1090 277 2/26Q E WH	OPAL POLYCARBONATE	26W QUAD	ELECTRONIC	L25	-	26W	277	
U	CEILING MOUNTED 2-CIRCUIT TRACK	8' L	PRESCOLITE AKTFCP3B ZAKTB38Z/AKT8Z/AKTPFCZ/ AKTSPAZ/ AKTCSKZ	BARN DOORS	150W PAR38 PER HEAD	ELECTRONIC	-	-	750W	120	MOUNT TO JOIST ABOVE @ 13'-0" AFF TO BOTTOM OF TRACK. PROVIDE ALL ACCESSORIES NECESSARY FOR TRACK. PROVIDE (3) COLOR FILTERS PER TRACK HEAD. COLORS TBD BY OWNER
U1	CEILING MOUNTED 2-CIRCUIT TRACK	8' L	TIMES SQUARE LIGHTING QL1 EHM-S-TA2S-S/TS 8S/SPUS **S/SP 4PS	BARN DOORS	300W T3 PER HEAD	ELECTRONIC	-	-	1500W	120	MOUNT TO JOIST ABOVE @ 13'-0" AFF TO BOTTOM OF TRACK. PROVIDE ALL ACCESSORIES NECESSARY FOR TRACK. PROVIDE (3) COLOR FILTERS PER TRACK HEAD. COLORS TBD BY OWNER
V	EXT. WALL MOUNTED WALLPACK	-	HUBBELL LIGHTING LMC 50P 8 *	TEMPERED GLASS	50W MH	HPF	-	-	50W	277	COLOR TBD BY ARCH. COORDINATE MOUNTING HEIGHT W/ EXT. ELEVATIONS.
W	CEILING SUSPENDED PENDANT	2' X 2'	G LIGHTING G-25021-J2-W-*-E-6-060	WHITE OPAL ACRYLIC	26W QUAD	ELECTRONIC	L25	69.3%	156W	277	MOUNT @ 20'-0" AFF TO BOTTOM, UNO. FINISH TBD BY ARCH.
X	WALL MOUNTED DECORATIVE SCONCE	-	G LIGHTING G-60194-F-W-*-4	WHITE OPAL ACRYLIC	26W QUAD	ELECTRONIC	L25	-	52W	277	FINISH TBD BY ARCH. MOUNT @ 5'-6" AFF TO CENTER, UNO.
X1	WALL MOUNTED DECORATIVE SCONCE	-	G LIGHTING G-60070-*-A-T-*	ART GLASS	26W QUAD	ELECTRONIC	L25	-	52W	277	FINISH & LENS TBD BY ARCH. MOUNT @ 5'-6" AFF TO CENTER, UNO.
Y	CEILING RECESSED WALL WASH	4' L	ALERA LIGHTING EN84-1T8G-LD8-E277	CROSS BAFFLE	32W T8	ELECTRONIC	L16	-	28W	277	PROVIDE UV BLOCKING TUBE GUARDS ON LAMPS.
Z	EXT. CANOPY MOUNTED SHALLOW CYLINDER	-	PRESCOLITE CFSCB826EBZ-STCB8CLSS	CROSS BAFFLE	26W QUAD	ELECTRONIC	L25	43%	57W	277	0°F STARTING TEMP. BALLAST
EX EX	EXIT SIGNAGE	-	DUAL LITE LXURWE	RED LETTERS	LED	-	-	-	-	120/277	REFER TO PLANS FOR MOUNTING & # OF FACES.
EB	EMERGENCY BATTERY PACK- WITHOUT HEADS	-	DUAL LITE LM40-12V	-	-	-	-	-	-	12VDC/ 277VAC	
EB H	EMERGENCY BATTERY PACK - WITHOUT HEADS - HIGH CAPACITY	-	DUAL LITE LM80-12V	-	-	-	-	-	-	12VDC/ 277VAC	
EM	EMERGENCY REMOTE HEAD	-	DUAL LITE CPR*W1205	BULLET	5W MR16	-	-	-	VARIES	12VDC/ 277VAC	REFER TO PLANS FOR # OF HEADS.
WP WP EM	EMERGENCY REMOTE HEAD-WEATHERPROOF	-	DUAL LITE OCR**0605 0110263	BULLET	5W MR16	-	-	-	VARIES	12VDC/ 277VAC	FINISH TBD BY ARCH. REFER TO PLANS FOR # OF HEADS.

LIGHT FIXTURE SCHEDULE NOTES:

① ALL T8 LAMPS AND BALLASTS SHALL BE ELIGIBLE "SUPER T8" SYSTEMS PER EFFICIENCY MAINE'S "QUALIFYING HIGH PERFORMANCE T8s" TABLE.

② TOTAL WATTAGE INCLUDES LAMPS AND BALLAST.

ABBREVIATIONS

A	AMPERES	GND	GROUND
AFF	ABOVE FINISHED FLOOR	HP	HORSEPOWER, HEAT PUMP
AFG	ABOVE FINISHED GRADE	JB	JUNCTION BOX
ATS	AUTOMATIC TRANSFER SWITCH	KVA	KILO VOLT AMPS
BATT	BATTERY	KW	KILOWATT(S)
BHEC	BANGOR HYDRO ELECTRIC CO.	LCP	LIGHTING CONTROL PANEL
BKR	BREAKER	LTG	LIGHTING
BLDG	BUILDING	MAX	MAXIMUM
CB	CIRCUIT BREAKER	MIN	MINIMUM
CKT	CIRCUIT	N	NEW
CLG	CEILING	OC	ON CENTER
CMP	CENTRAL MAINE POWER CO.	PVC	POLYVINYL CHLORIDE
CT	CURRENT TRANSFORMER	PTZ	PAN/TILT/ZOOM CAMERA CONTROL
DN	DOWN	RECEP	RECEPTACLE
DWG	DRAWING	TEL	TELEPHONE
EMERG	EMERGENCY	TYP	TYPICAL
EMT	ELECTRICAL METALLIC TUBING	UG	UNDERGROUND
EQUIP	EQUIPMENT	V	VOLTS
FA	FIRE ALARM	W	WATTS
FAA	FIRE ALARM ANNUNCIATOR	WG	WIRE GUARD
FACP	FIRE ALARM CONTROL PANEL	WM	WIREMOLD
FIN	FINISH, FINISHED	WP	WEATHERPROOF
FLR	FLOOR		

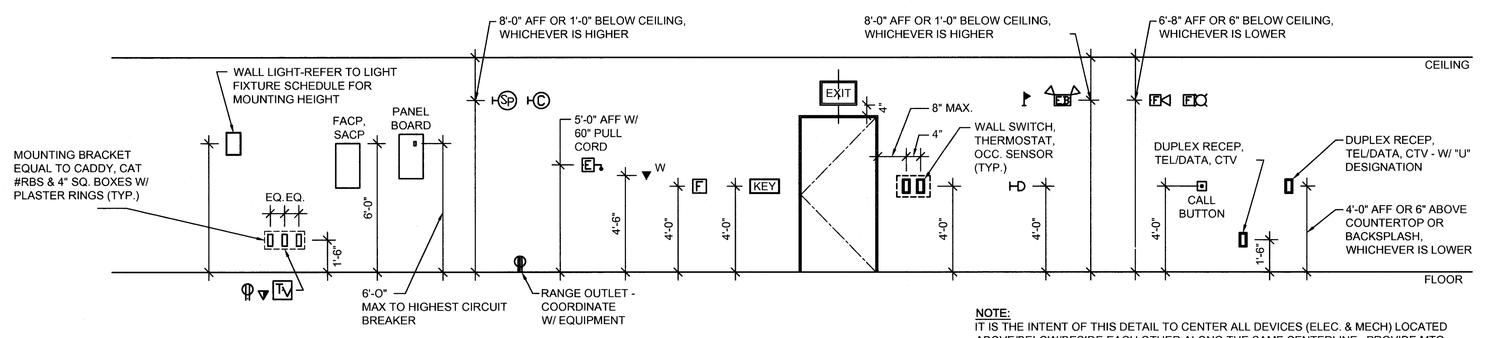

MOUNTING HEIGHT DETAIL

NOT TO SCALE

NOTE:
IT IS THE INTENT OF THIS DETAIL TO CENTER ALL DEVICES (ELEC. & MECH) LOCATED ABOVE/BELOW/BESIDE EACH OTHER ALONG THE SAME CENTERLINE. PROVIDE MTG. BLOCKING/SUPPORTS AS REQ'D.

REV.	DESCRIPTION	DATE
--	--	--
--	--	--
--	--	--
0	----	00.00.00

PERMIT APPLICATION SUBMISSION 3-18-09

CURRENT ISSUE STATUS:

STATE OF MAINE STEPHEN J. PLANT No.10272 LICENSED PROFESSIONAL ENGINEER
01-11-09

WBRC ARCHITECTS • ENGINEERS
WWW.WBRCAE.COM
BANGOR, MAINE 207-942-4321
PORTLAND, MAINE 207-828-4321
SARASOTA, FLORIDA 941-556-0707

PROJECT: OCEAN AVENUE ELEMENTARY SCHOOL
PORTLAND, ME

SHEET TITLE: ELECTRICAL LEGEND & LIGHT FIXTURE SCHEDULE

WBRC CAD FILE:	331610-E-001
PROJECT No.	331610
SCALE:	N.T.S.
PROJECT MANAGER:	MEJ
DRAWN BY:	LJW
CHECKED BY:	SJL
GRAPHIC SCALE:	0" 1"
SHEET No.	E-001

© COPYRIGHT 2009 WBRC

3/18/2009 12:41 PM L:\3301-3400\3316\0-E-001 ELECTRICAL LEGEND & LIGHT FIXTURE SCHEDULE.DWG LJRAJADE
ELEMENTARY SCHOOL - 5D TO CAD\#5\OCEAN AVENUE ELEMENTARY SCHOOL\OCEAN AVE. ELEMENTARY SCHOOL