
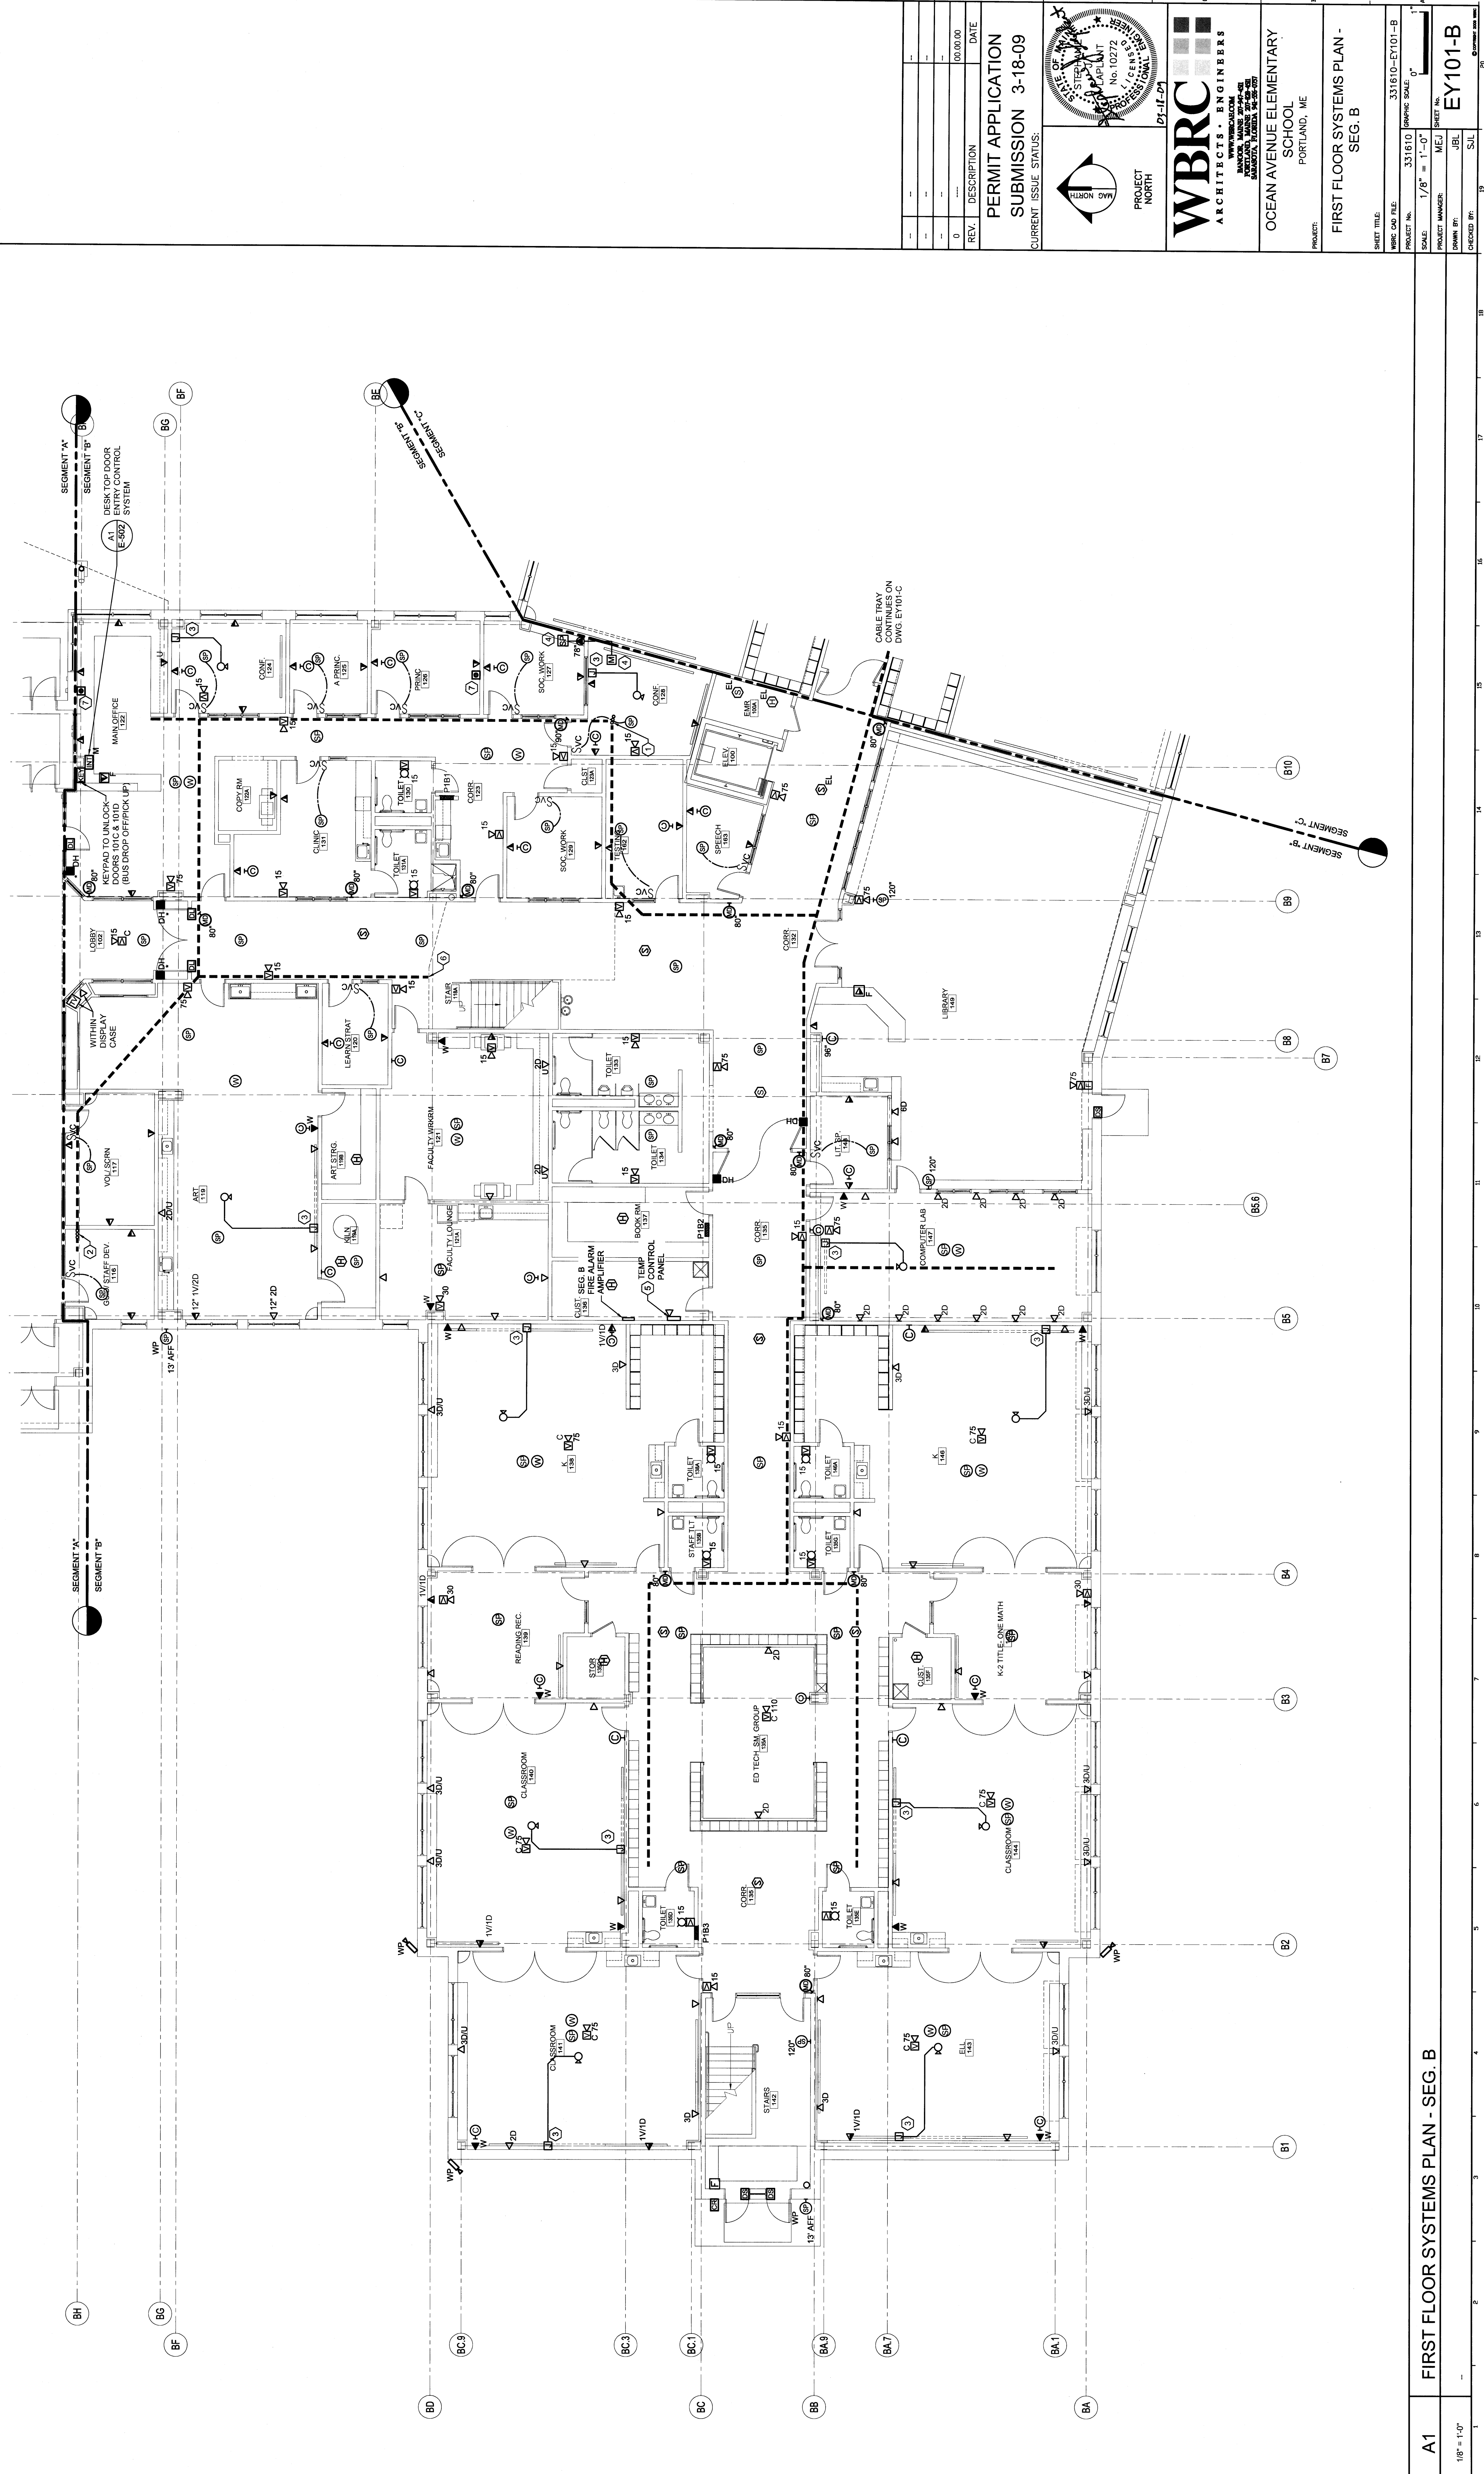


**TECHNICAL NOTES:**

- PROVIDE 3/4" CONDUITS FROM 6" ABOVE FIRST FLOOR CABLE TRAY TO 8" ABOVE A.F.F. IN IT ROOM 24C.
- PROVIDE 3/4" CONDUITS FROM IT 200 RACKS TO 6" ABOVE CABLE TRAY. SEE SHEET EY101-B FOR CONTINUATION.
- PROVIDE 4" x 4" CEILING MOUNTED JUNCTION BOX AT PROJECTOR LOCATION AND 4" x 4" FLUSH WALL MOUNTED JUNCTION BOX AT 18" AFF AT TEACHER LOCATION. REFER TO DETAIL 78E-503 FOR MORE INFORMATION.
- OBSERVATION AUDIO MONITORING SYSTEM. REFER TO DETAIL E1E-502 FOR MORE INFORMATION.
- PROVIDE DATA JACK W/ STATIC IP ADDRESS AT HVAC CONTROL PANEL.
- TERMINATE CABLE TRAY AT SOFFIT WALL.
- ACCESS CONTROL SYSTEM PING BUTTON - FIELD CHANGING FIELD LOCATION BENEATH OWNERS FURNITURE OR CASEWORK.

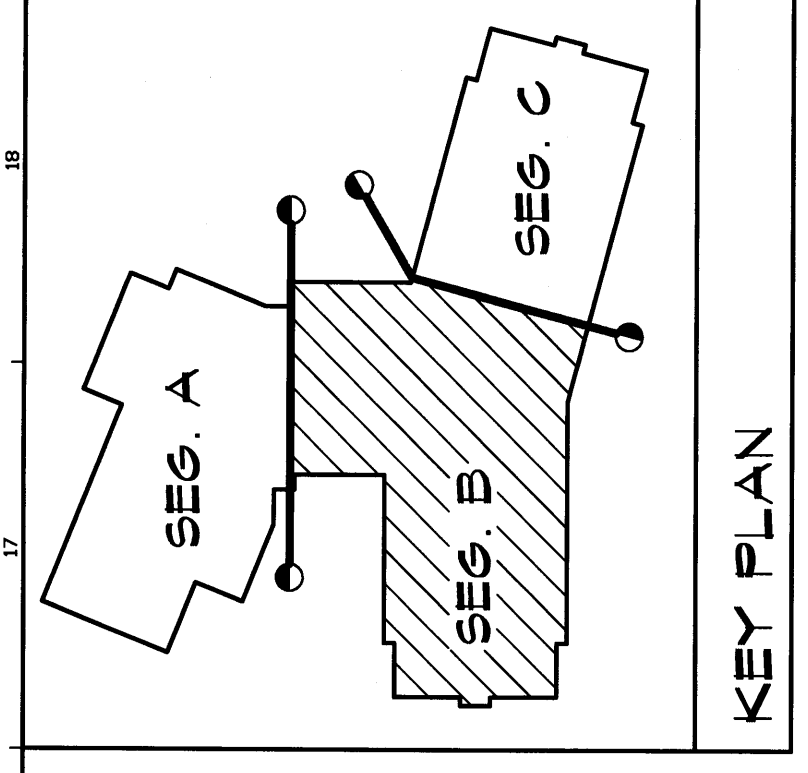

REV.	DESCRIPTION	DATE
0		03/18/09

**PERMIT APPLICATION**  
**SUBMISSION 3-18-09**  
 CURRENT ISSUE STATUS:



**WBRC**  
 ARCHITECTS • ENGINEERS  
 WWW.WBRC-MA.COM  
 1000 WASHINGTON ST., SUITE 200  
 PORTLAND, ME 04101-4000

**OCEAN AVENUE ELEMENTARY SCHOOL**  
 PORTLAND, ME

PROJECT:  
**FIRST FLOOR SYSTEMS PLAN - SEG. B**

SHEET TITLE:  
 331610-ET101-B

PROJECT NO.: 331610 DRAWING SCALE: 0'

SCALE: 1/8" = 1'-0"

PROJECT NUMBER: MEJ  
 SHEET NO.: EY101-B

DRAWN BY: JBL  
 CHECKED BY: SLL