


Above Ground Swimming Pool

Electrical Wiring Requirements per
Article 680 of The National Electrical
Code & Underwriters Laboratories Listing

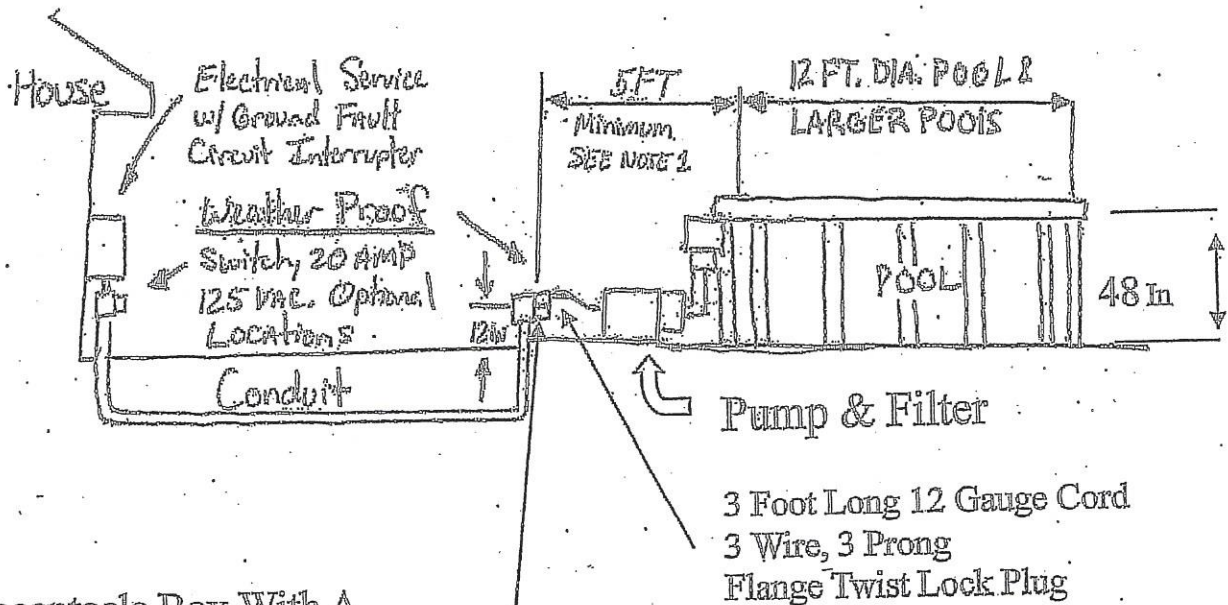

Receptacle Box With A
Hubbell NO.2310 Receptacle
20A, 125 VAC, or Equivalent
Twist Lock Receptacle That
Meets Nema L5-2 Configuration

20 AMP 3 Prong
Twist Lock Plug End

Note: 1 Do Not Locate Receptacle Box Closer Than 5
FT from inside Pool Wall or Installation
Will not be in compliance with Article 680 of the N.E.C.
Electrical Code nor will Filter & Pump hoses reach for
Proper Installation.