


Proposed Fire Protection

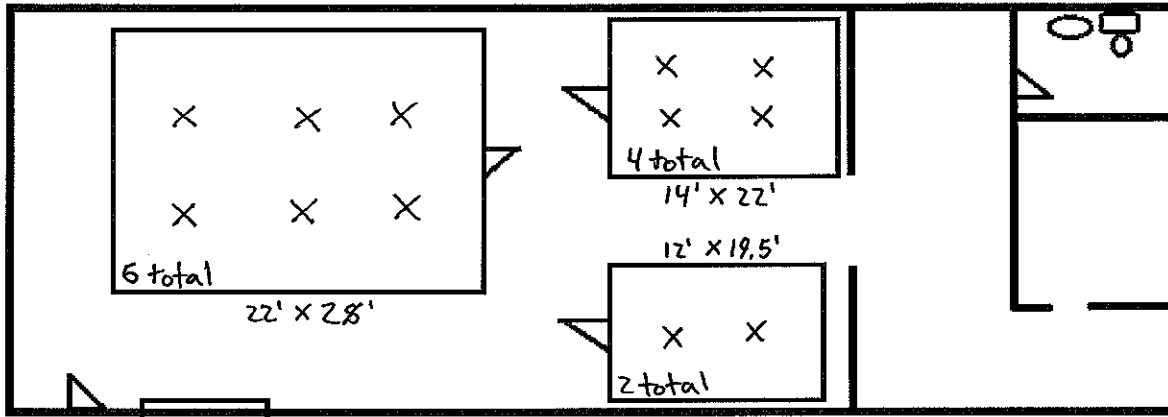

X = Sprinkler Head

Extend existing NFPA #13 wet sprinkler system to feed new sprinkler heads inside the 3 new rooms.