

(EXTEND 3 FT. MIN. BEYOND SIDEWALK LIMITS) 2" CRUSHED GRAVEL BASE (MeDOT 703.06 TYPE "A") (95% COMPACTION - SEE PROJECT MANUAL)

(95% COMPACTION - SEE PROJECT MANUAL) — 600X MIRAFI SOIL STABILIZER OR EQUAL AS SPECIFIED — SUITABLE SUBGRADE (SEE PROJECT MANUAL)

4-1/2" CRUSHED GRAVEL BASE (MeDOT 703.06 TYPE "A")

95% COMPACTED GRANULAR FILL — SEE SPEC.


SUITABLE UNDISTURBED SUBGRADE -(SEE PROJECT MANUAL)

WALK/STRUCTURE JOINT DETAIL

BUILDING FOUNDATION.

CONCRETE SIDEWALK DETAIL

1. INSTALL POLYSTYRENE ROD W/ ELASTIC SEALANT AT ALL LOCATIONS WHERE CONCRETE WALKWAYS ABUT

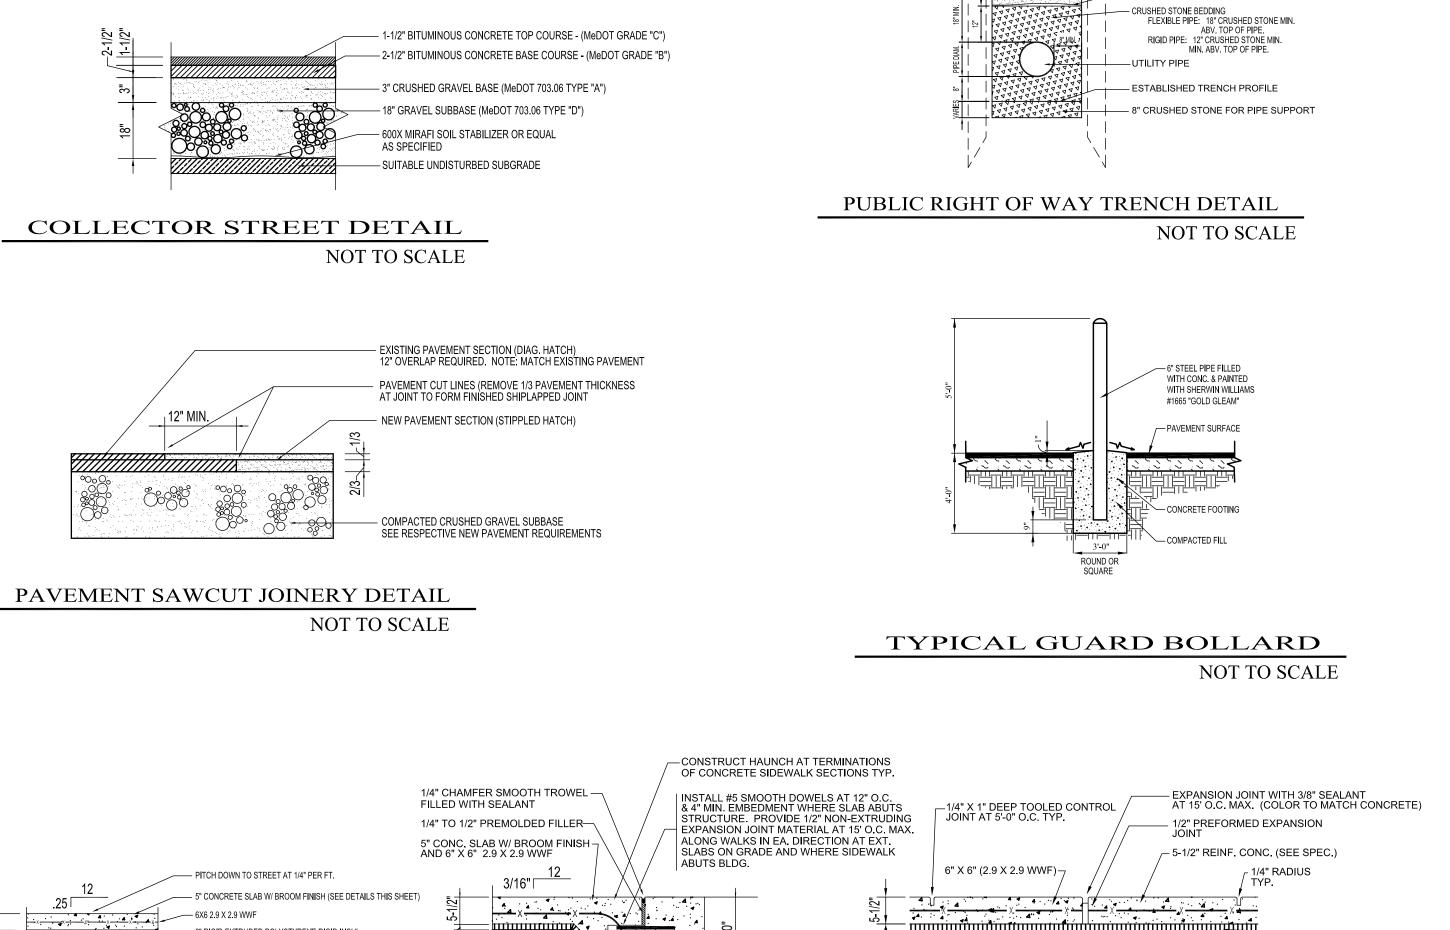

BUILDING FOUNDATION WALL

CONT. POLYETHYLENE EDGING -

— EXISTING CATCH BASIN

EXISTING FINISHED GRADE

SILTSACK PLACED IN EX. FRAME. - INSTALLATION OF EXIST. GRATE PERMITTED DURING CONSTRUCTION

SEE UTILITY PLAN FOR REQUIRED LOCATIONS

CATCH BASIN PROTECTION DETAIL (SILTSACK)

TYPICAL PLANTING BED DETAIL

— SILTSACK BY ACF ENVIRONMENTAL (A.H. HARRIS & SONS, INC.)

NEW INSTALLATION

NOT TO SCALE

EAVE DRIP STONE BED DETAIL

1" ROUNDED WASHED RIVERBED STONE

B—2" DOW "STYROFOAM" PERIMETER INSUL.

12" COMPACTED GRANULAR BACKFILL MIN.

- WOVEN LANDSCAPING FABRIC

CONC. FDN. WALL

UNDISTURBED EARTH

NOT TO SCALE

---- NEW CATCH BASIN

FINISHED GRADE ELEVATION

— 6" SHREDDED CEDAR (DARK) MULCH

12" PLANTING BED MIXTURE (SEE SPEC.)

-2" DOW "STYROFOAM" PERIMETER INSUL.

COMPACTED GRANULAR BACKFILL

- WOVEN LANDSCAPING FABRIC

CONC. FDN. WALL

UNDISTURBED EARTH

NOT TO SCALE

—1-1/2" HOT BITUMINOUS PAVEMENT (GRADE "C")

----2-1/2" HOT BITUMINOUS PAVEMENT (GRADE "B)"

-EXISTING PAVED SURFACE

-----18" AGGREGATE SUBBASE (MeDOT 703.06 TYPE "B") 2" EXTRUDED POLYSTYRENE INSUL. (2 FT. WIDE) OVER
— ALL SANITARY, STORM, FDN. DRAIN AND DOMESTIC
WATER SERVICE PIPING.

600X MIRAFI SOIL STABILIZER OR EQUAL AS SPECIFIED

3" AGGREGATE BASE (MeDOT 703.06 TYPE "A")

24" MIN. COMPACTED STRUCTURAL FILL (SEE SPEC.)

EXPANSION JOINT DETAIL

2. LOCATE CONTROL JOINTS AT 5'-0" O.C. MAX.

3. LOCATE EXPANSION JOINTS AT 20'-0" O.C. MAX.

1. MAINTAIN 2" CLEARANCE (TYP.) BETWEEN ALL CONCRETE SURFACES AND WIRE FABRIC OR DOWEL REINF.

NOT TO SCALE

4. INSTALL POLYSTYRENE ROD W/ ELASTIC SEALANT AT ALL LOCATIONS WHERE CONCRETE WALKWAYS ABUT

NOTES:

-SAWCUT PAVEMENT EACH SIDE FOR NEW PIPING TRENCH


STAKED AT 4' O.C. MAX

6" LOAM AND SEED ----


EXISTING CATCH BASIN

CONT. POLYETHYLENE EDGING —
STAKED AT 4' O.C. MAX

6" LOAM AND SEED \neg

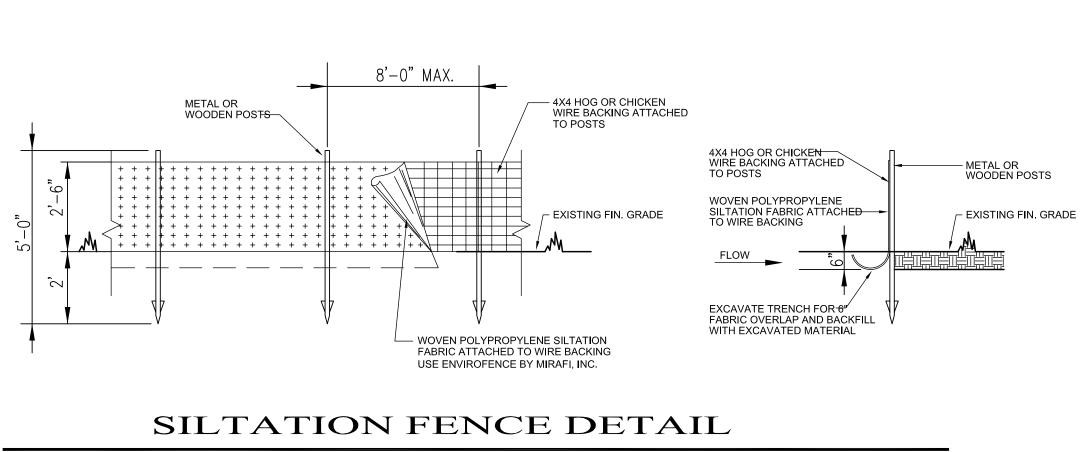


NOT TO SCALE SILTATION FABRIC WITH INTEGRAL MESH AND POSTS MAY BE USED

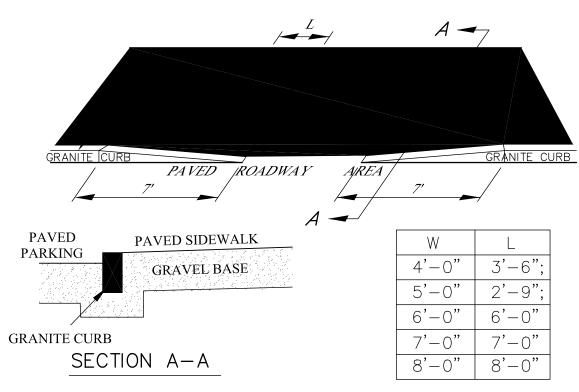

1) THE DIMENSIONS SHOWN AT ROADWAY EDGE ARE FIXED DISTANCES. 2) RAMP CROSS SECTION TO BE SAME AS ADJACENT SIDEWALK (DEPTH OF SURFACE AND FOUNDATION)

3) IN NO CASE ARE THE RAMPS TO BE PLACED BEHIND THE STOP LINE.

SIDEWALK TIP-DOWN DETAIL NOT TO SCALE

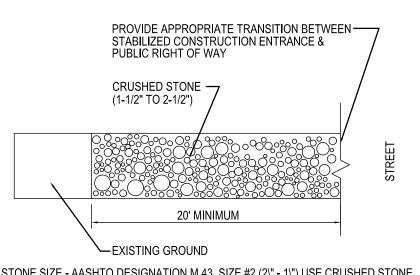


1. STONE SIZE - AASHTO DESIGNATION M 43, SIZE #2 (2\" - 1\") USE CRUSHED STONE 2. LENGTH - AS EFFECTIVE BUT NOT LESS THAN 50'

3. THICKNESS - NOT LESS THAN 8" 4. WIDTH - NOT LESS THAN FULL WIDTH OF ALL POINTS OF INGRESS OR EGRRESS 5. WASHING - WHEN NECESSARY, WHEELS SHALL BE CLEANED TO REMOVE SEDIMENT PRIOR TO ENTRANCE ONTO PUBLIC RIGHT OF WAY, WHEN WASHING IS REQUIRED, IT SHALL BE DONE ON AN AREA STABILIZRD WITH CRUSHED STONE WHICH DRAINS INTO AN APPROVED SEDIMENT TRAP OR SEDIMENT BASIN. ALL SEDIMENT SHALL BE PREVENTED FROM ENTERING ANY STORM DRAIN, DITCH, OR WATERCOURSE THROUGH USE OF SAND BAGS, GRAVEL, BOARDS, OR OTHER APPROVED METHODS.

6. MAINTENANCE - THE STABILIZED CONSTRUCTION ENTRANCE SHALL BE MAINTAINED IN A CONDITION WHICH WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO PUBLIC RIGHTS OF WAY. THIS MAY REQUIRE PERIODIC TOP DRESSING WITH ADDITIONAL STONE AS CONDITIONS DEMAND AND REPAIR AND/OR CLEANOUT OF ANY MEASURED USES TO TRAP SEDIMENT. ALL SEDIMENT SPILLED, DROPPED WASHED, OR TRACKED ONTO PUBLIC RIGHT OF WAYS MUST BE REMOVED IMMEDIATELY.

STABILIZED CONSTRUCTION ENTRANCE NOT TO SCALE

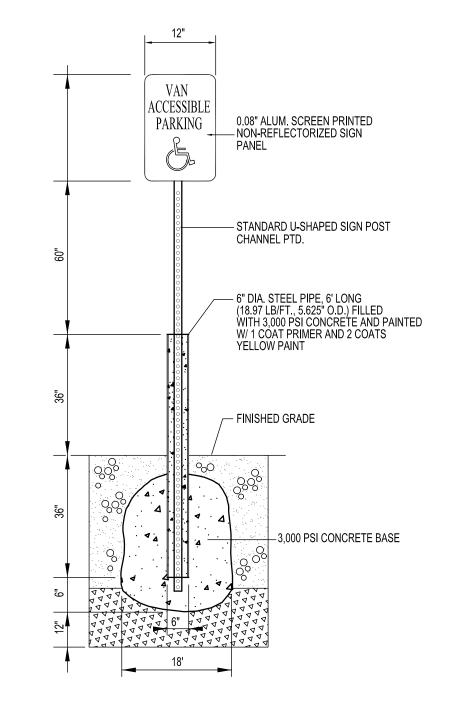



SIGN BOLLARD DETAIL NOT TO SCALE



- 600X MIRAFI SOIL STABILIZER OR EQUAL


— SUITABLE UNDISTURBED SUBGRADE



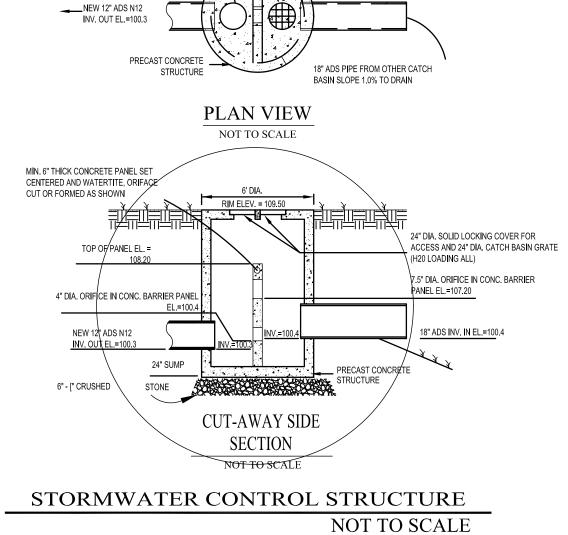


24" DIA. SOLID LOCKING COVER FOR


ACCESS AND 24" DIA. CATCH BASIN GRATE <

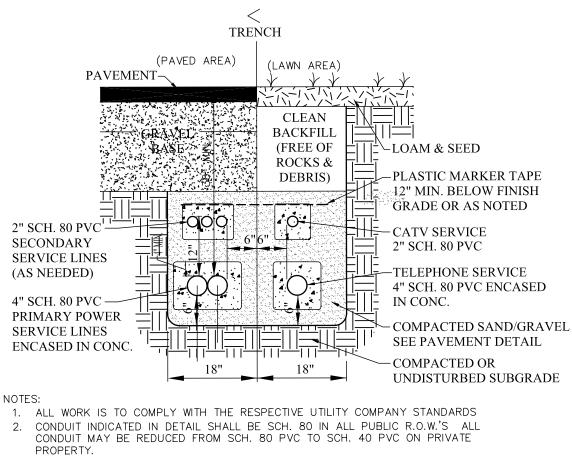

PUBLIC R.O.W. UNDERGROUND UTILITY TRENCH DETAIL NOT TO SCALE

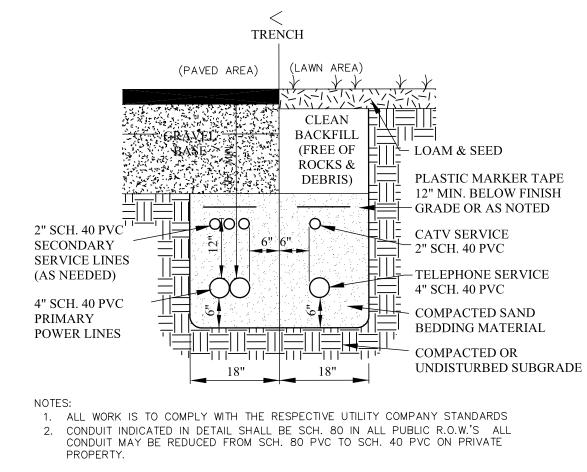

PRIVATE PROPERTY UNDERGROUND UTILITY TRENCH DETAIL NOT TO SCALE

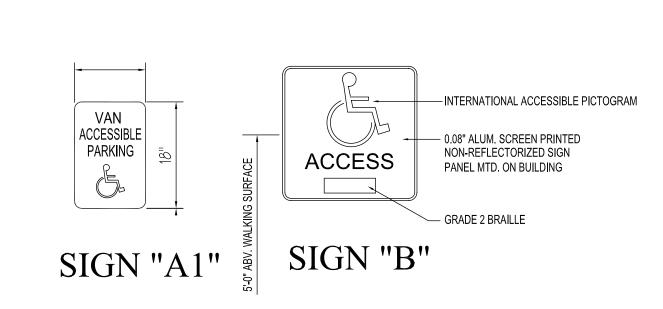

ACCESS**I**BLE


PARKING

SIGN "A"


REL. FOR PRICING & PERMITTING - JUNE 25, 2012 NOT FOR CONSTRUCTION


ST. BRIGID CATHOLIC SCHOOL FR. HAYES CENTER - STAIR ADDITION 695 STEVENS AVENUE

PORTLAND, MAINE 04103



DAVID "

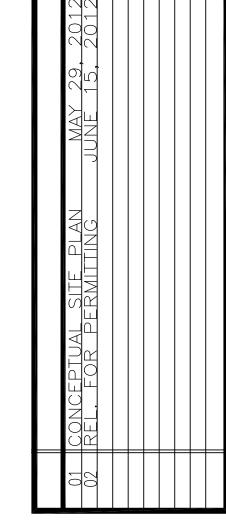

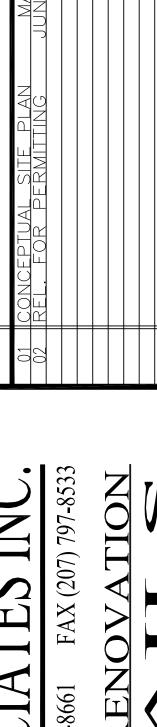

SECTION