



N:\Projects\2014\14088 - UNE - Alumni Hall\DD Drawing Files\14088.dwg May 01, 2015 - 9:01am

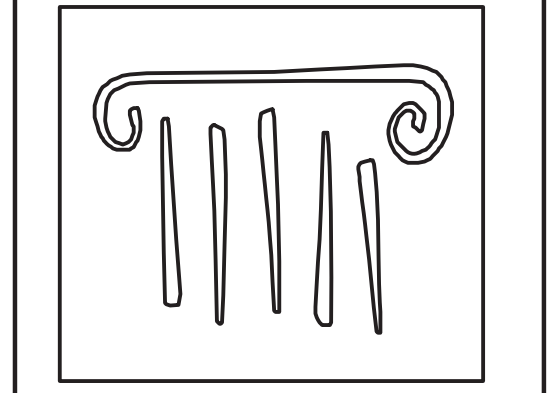

65 NEWBURY STREET
 PORTLAND, ME 04101
 207.761.9000
 info@portcityarch.com
 WWW.PORTCITYARCH.COM

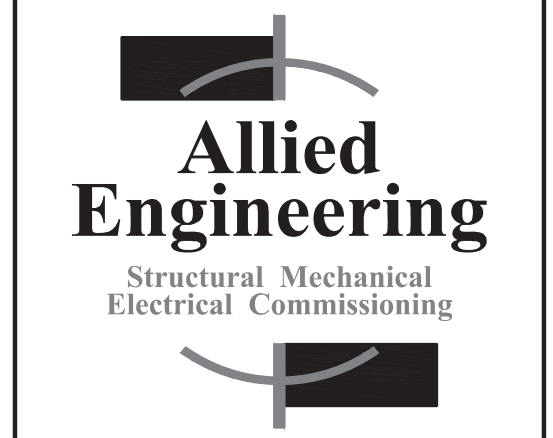

160 Veranda Street
 Portland, Maine 04103
 T: 207.221.2260
 F: 207.221.2266
 Web: www.allied-eng.com

ALLIED PROJECT No: 14088
 Graphic Scale:
 1" = 1/2" = 0' 1"



REVISIONS		
No.	Description	Date

PERMIT SET

UNIVERSITY OF
 NEW ENGLAND
 PORTLAND, MAINE


ALUMNI HALL
 RENOVATION

LIGHTING PLAN ~
 SECOND FLOOR

Project Number 14525
 Date May 1, 2015
 Drawn by DLL
 Checked by SRM

EL1.3
 Scale AS NOTED

- 1 LIGHTING CONTROL SHALL BE MANUAL-ON/MANUAL-OFF VIA INDICATED SWITCHING.
- 2 LIGHTING CONTROL SHALL BE AUTOMATIC-ON/AUTOMATIC-OFF VIA CEILING MOUNTED OCCUPANCY SENSORS, WITH MANUAL DIMMING OF TWO CONTROL GROUPS. SEE DETAIL XX/E-XXX.
- 3 LIGHTING SHALL BE CONTROLLED BY AN ARCHITECTURAL DIMMING SYSTEM - BASIS OF DESIGN IS LUTRON GRAFIK EYE 4000 SERIES WITH GP DIMMING PANEL AND 8-ZONE CONTROLLER WITH 4 PRE-SET SCENES. WHERE INDICATED, OCCUPANCY SENSORS SHALL FUNCTION AS INPUTS TO THE DIMMING SYSTEM TO PROVIDE AUTOMATIC SHUTOFF.
- 4 LIGHTING CONTROL SHALL BE MANUAL-ON/MANUAL-OFF WITH DIMMING VIA INDICATED CONTROLS.
- 5 LIGHTING CONTROL SHALL BE AUTOMATIC-ON/AUTOMATIC-OFF VIA OCCUPANCY SENSORS.
- 6 LIGHTING CONTROL SHALL BE AUTOMATIC ON/AUTOMATIC-OFF VIA TIME CLOCK AND PHOTOCELL.
- 7 LIGHTING CONTROL SHALL BE MANUAL-ON/AUTOMATIC-OFF VIA SWITCH BOX TYPE OCCUPANCY SENSOR.

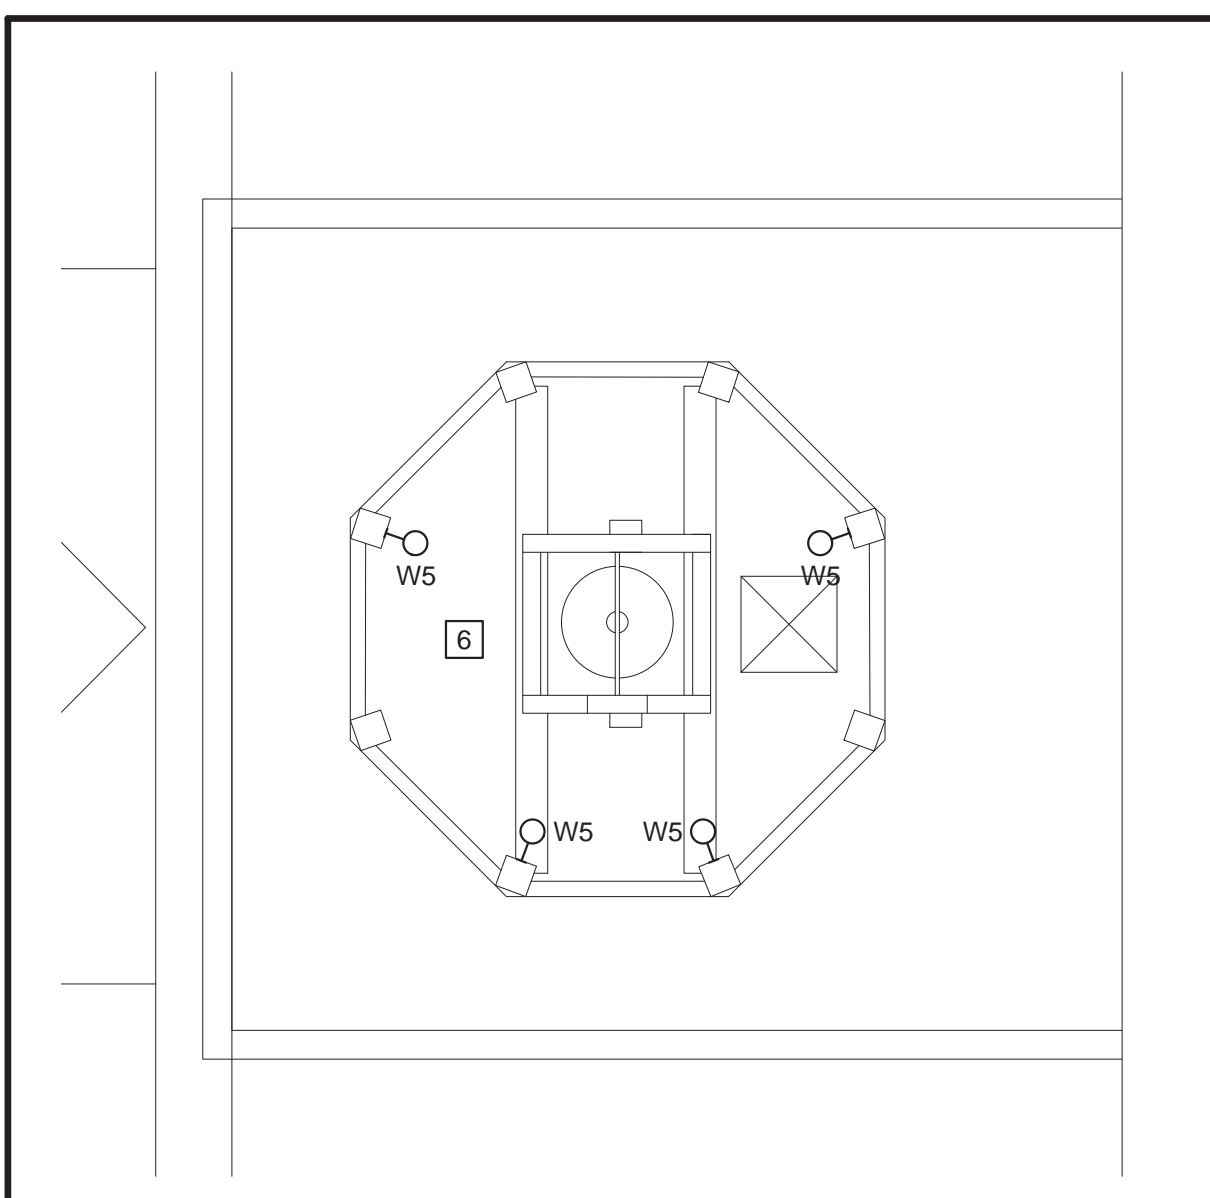

A1	LIGHTING PLAN ~ SECOND FLOOR	1/4" = 1'-0"	A7	TOWER PLAN	1/4" = 1'-0"	A9	LIGHTING CONTROL NOTES
----	------------------------------	--------------	----	------------	--------------	----	------------------------