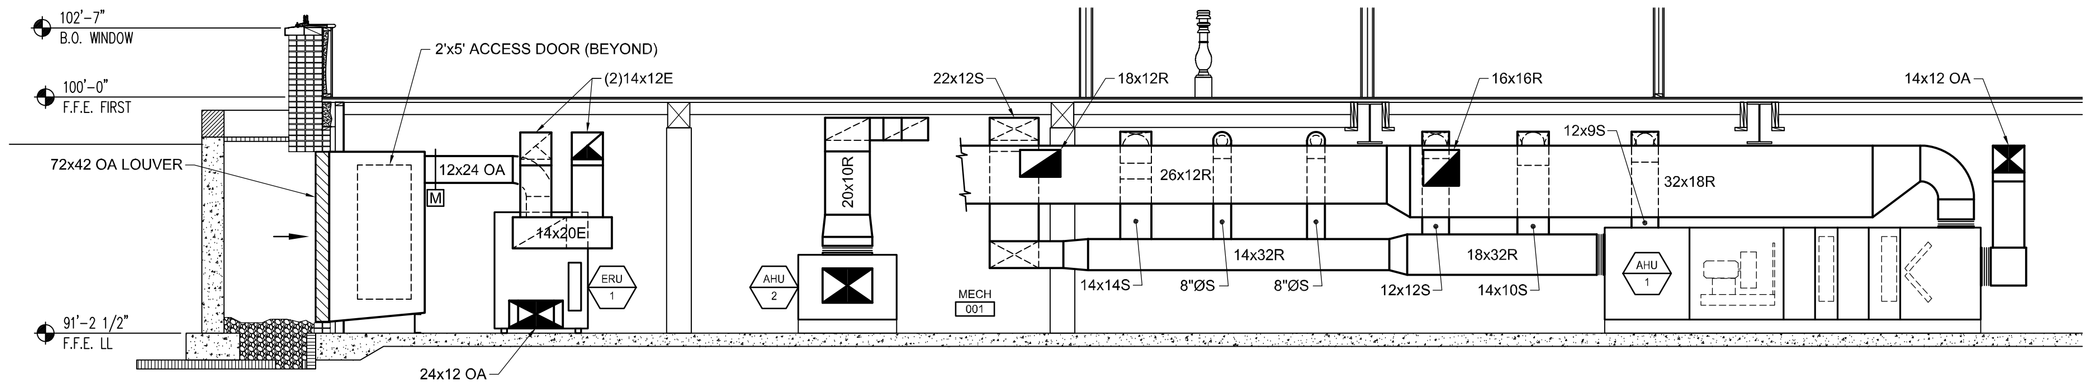

F1 | DETAIL ~ SECTION THRU LOWER LEVEL MECHANICAL ROOM

1/4" = 1'-0"

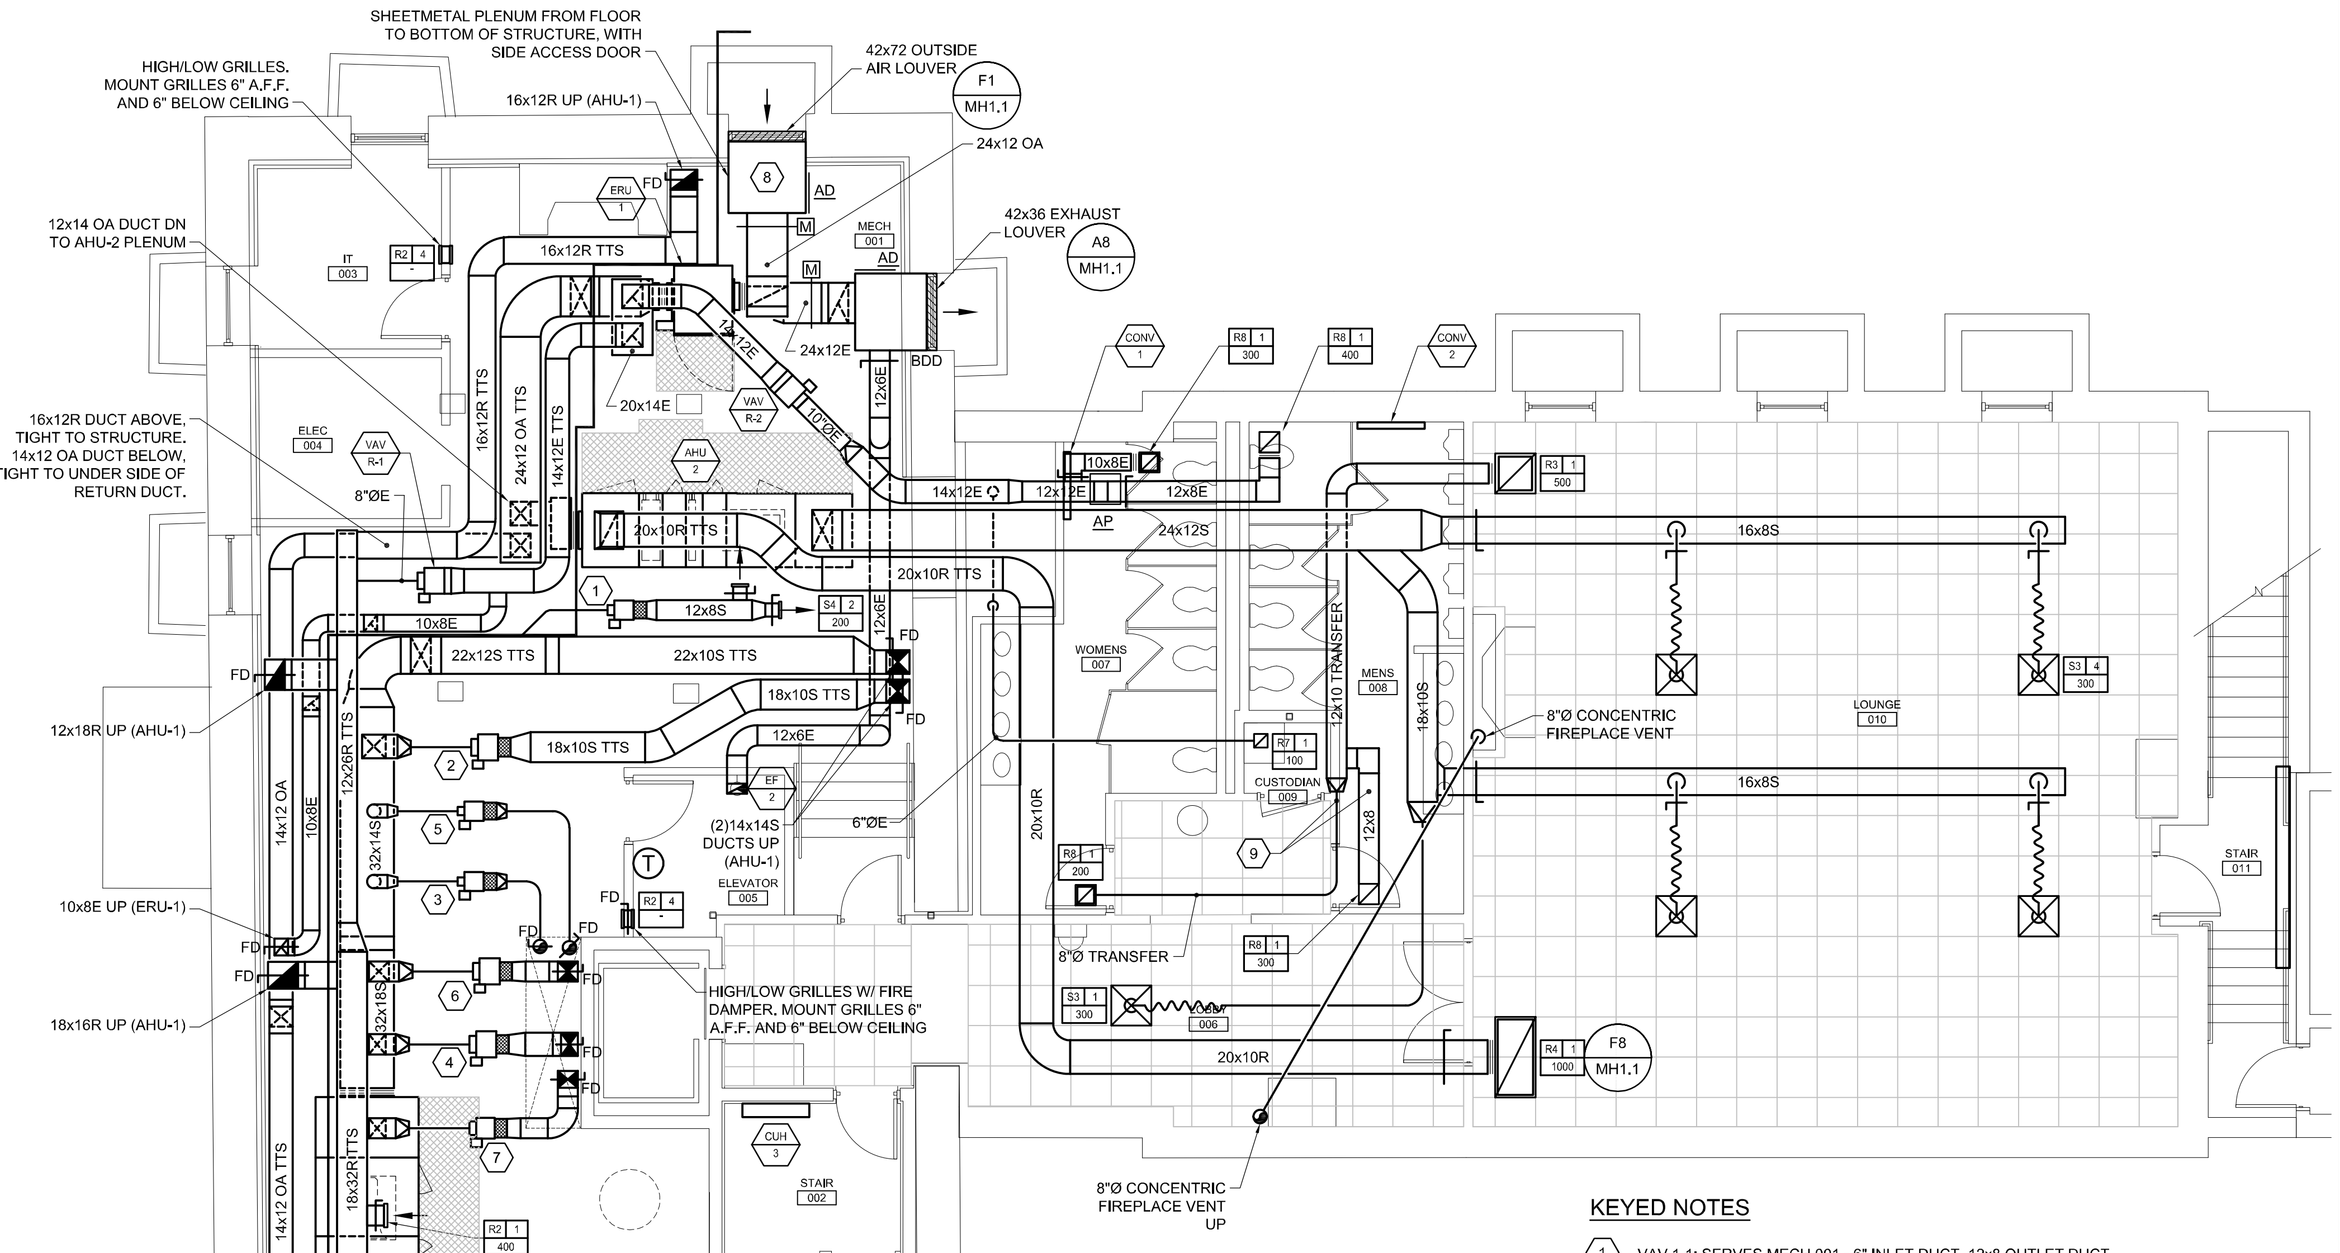

KEYED NOTES

1. VAV 1-1: SERVES MECH 001 - 6" INLET DUCT, 12x8 OUTLET DUCT
2. VAV 1-2: SERVES CONFERENCE 107 - 12" INLET DUCT
3. VAV 1-3: SERVES LOBBY 101 - 5" INLET DUCT, 8"Ø OUTLET DUCT UP
4. VAV 1-4: SERVES LOBBY 104/CONFERENCE 105 - 10" INLET DUCT, 10x14 OUTLET DUCT UP
5. VAV 1-5: SERVES LOUNGE 201 - 5" INLET DUCT, 8"Ø OUTLET DUCT UP
6. VAV 1-8: SERVES ADMIN 207/PROVOST 209 - 10" INLET DUCT, 12x12 OUTLET DUCT UP
7. VAV 1-9: SERVES OFFICE 206/LOBBY 204 - 8" INLET DUCT, 9x12 OUTLET DUCT UP
8. DUCTWORK PLENUM SHALL BE G90 GALVANIZED STEEL
9. INSTALL MECHANICAL REMOTE VOLUME ADJUSTER FOR CONCEALED VOLUME DAMPER. LOCATE ADJUSTER IN CUSTODIAL ROOM 009

A1 | MECHANICAL PLAN ~ LOWER LEVEL

3/16" = 1'-0"

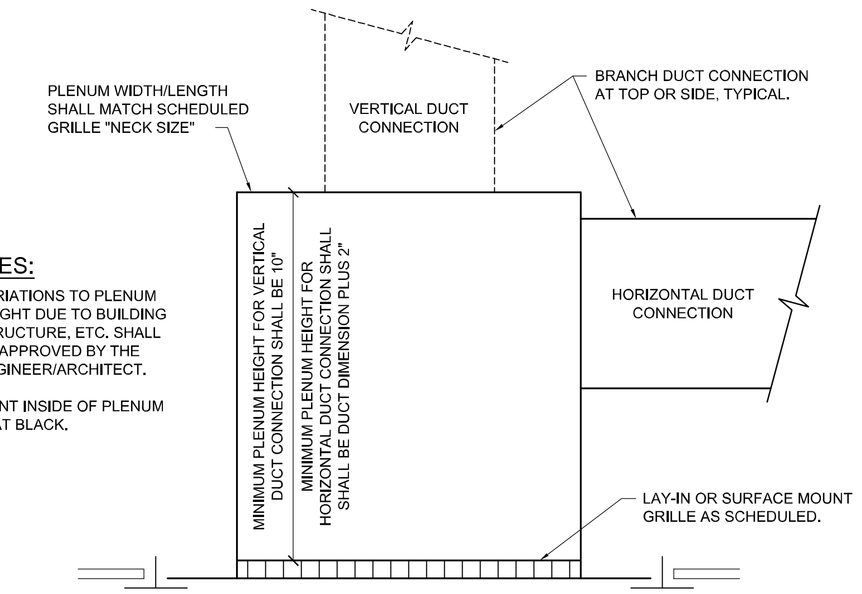

NOTES:

1. VARIATIONS TO PLENUM HEIGHT DUE TO BUILDING STRUCTURE, ETC. SHALL BE APPROVED BY THE ENGINEER/ARCHITECT.
2. PAINT INSIDE OF PLENUM FLAT BLACK.

F8 | DETAIL ~ RETURN AIR REGISTER BOOT

NOT TO SCALE

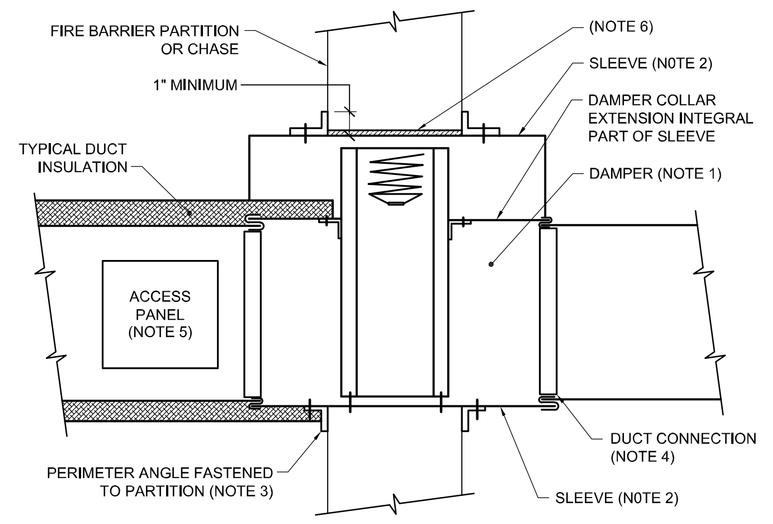

NOTES:

1. A VERTICAL DAMPER IS SHOWN. HORIZONTAL DAMPER INSTALLATION IS SIMILAR, FOLLOW MANUFATURER'S INSTRUCTIONS, INCLUDING FASTENER OPTIONS AND GAGES FOR SLEEVE AND PERIMETER ANGLES. FIRE DAMPERS MUST BE INSTALLED IN THE PARTITION OR FLOOR AND NOT OUTSIDE THE PENETRATION.
2. GALVANIZED SLEEVE: GAGE NOT LESS THAN CONNECTING DUCT. FASTEN SLEEVE TO DAMPER FRAME AND TO PERIMETER ANGLES.
3. PERIMETER ANGLES: GALVANIZED STEEL, NOT LESS THAN 1-1/2" x 1-1/2" (40x40mm), 14 GAGE, TO PROVIDE 1" (25mm) MINIMUM OVERLAP OF OPENING ON ALL 4 SIDES.
4. BREAKAWAY DUCT CONNECTION: CONTRACTOR'S OPTION OF TYPES SHOWN IN SMACNA LPDS, FIG. 2-13, SEAL JOINTS.
5. ACCESS PANELS: SIZE AND LOCATION TO PERMIT SERVICING THE FUSIBLE LINK OR LINKS.

C8 | DETAIL ~ TYPICAL FIRE DAMPER INSTALLATION

NOT TO SCALE

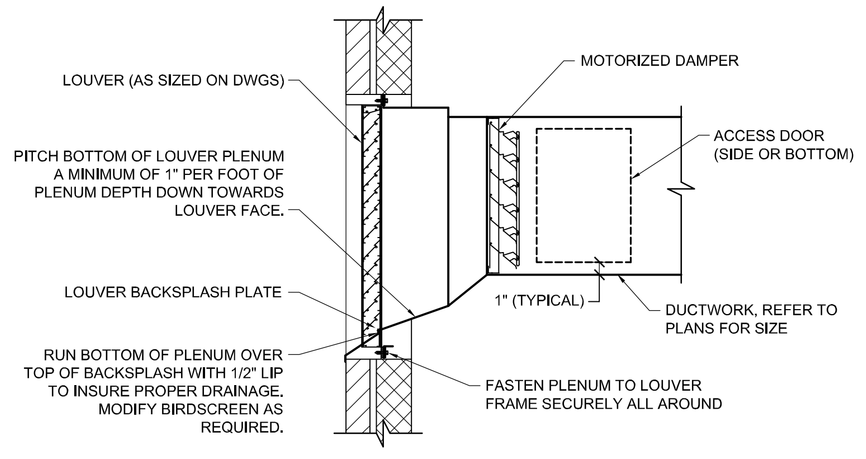

NOTES:

1. DETAIL IS BASED UPON RUSKIN MODEL No. ELF375D. FOR ALTERNATE MANUFACTURERS, COORDINATE AS REQUIRED FOR WEATHERTIGHT INSTALLATION PER MANUFACTURER'S RECOMMENDATIONS.
2. COORDINATE LOUVER FRAME CONSTRUCTION WITH SIDING MANUFACTURER TO INSURE PROPER FLASHING CAPABILITIES FOR A WEATHERTIGHT INSTALLATION.
3. SEAL BOTTOM OF PLENUM WATER TIGHT.

A8 | DETAIL ~ EXTERIOR ERU-1 LOUVER

NOT TO SCALE

65 NEWBURY STREET
PORTLAND, ME 04101
207.761.9000
info@portcityarch.com
WWW.PORTCITYARCH.COM

STATE OF MAINE
IAN A. MACDONALD
No. 8990
LICENSED
PROFESSIONAL ENGINEER

Allied Engineering
Structural Mechanical
Electrical Commissioning

160 Veranda Street
Portland, Maine 04103
T: 207.221.2260
F: 207.221.2266
Web: www.allied-eng.com

ALLIED PROJECT No: 14088

Graphic Scale: 1" 1/2" 0 1"

CONSTRUCTION DOCUMENT SET - FOR CONSTRUCTION

REVISIONS

No.	Description	Date
1	Addendum 1	9-08-15
2	Addendum 2	9-17-15
3	Addendum 3	7-9-15
4	Addendum 4	7-24-15

UNIVERSITY OF NEW ENGLAND
PORTLAND, MAINE

ALUMNI HALL RENOVATION

MECHANICAL PLAN ~ LOWER LEVEL

Project Number	14525
Date	August 7, 2015
Drawn by	REW
Checked by	HAG

MH1.1

Scale AS NOTED

N:\Projects\2014\14088 ~ UNE - Alumni Hall\00 Drawing Files\14088M.dwg Aug 05, 2015 - 9:44am