


IF THIS SHEET IS NOT 24 X 36 IT IS A REDUCED SCALE PRINT - SCALE ACCORDINGLY

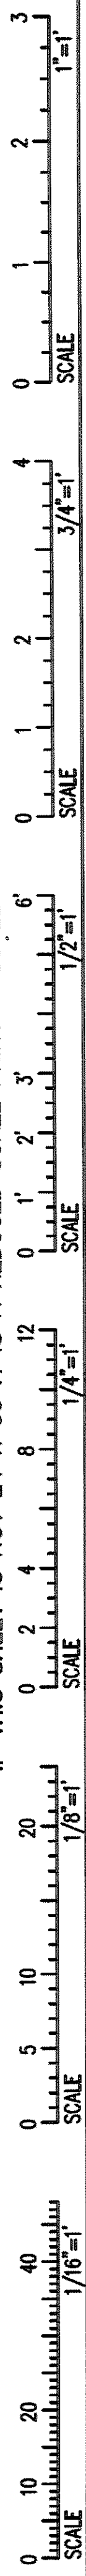

| PANEL: VPL-1 | | | | | | | | | | LOCATION: HALL 022 | | | | | | | | | |
|-------------------------------|-------|------------------|-------|-----|-----|------|------|---|---|-----------------------|-----|-----------------|-----|------------------|----|-----|-------|--|--|
| MAIN: 200A MCB | | | | | | | | | | AIC: 10k | | | | | | | | | |
| VOLT/PHASE: 208/120V, 3PH, 4W | | | | | | | | | | COMMENTS: (ALTERNATE) | | | | | | | | | |
| MOUNTING: RECESSED | | | | | | | | | | | | | | | | | | | |
| CIRCUIT BREAKER | | LOAD DESCRIPTION | | LTG | REC | MISC | MISC | | | REC | LTG | CIRCUIT BREAKER | | LOAD DESCRIPTION | | AMP | POLES | | |
| AMP | POLES | | | KVA | KVA | KVA | A | B | C | KVA | KVA | KVA | AMP | POLES | | | | | |
| 1 | 20 | 1 | SPARE | | | | | | | | | | 20 | 1 | 2 | | | | |
| 3 | 20 | 1 | SPARE | | | | | | | | | | 20 | 1 | 4 | | | | |
| 5 | 20 | 1 | SPARE | | | | | | | | | | 20 | 1 | 6 | | | | |
| 7 | 20 | 1 | SPARE | | | | | | | | | | 20 | 1 | 8 | | | | |
| 9 | 20 | 1 | SPARE | | | | | | | | | | 20 | 1 | 10 | | | | |
| 11 | 20 | 1 | SPARE | | | | | | | | | | 20 | 1 | 12 | | | | |
| 13 | 20 | 1 | SPARE | | | | | | | | | | 20 | 1 | 14 | | | | |
| 15 | 20 | 1 | SPARE | | | | | | | | | | 20 | 1 | 16 | | | | |
| 17 | 20 | 1 | SPARE | | | | | | | | | | 20 | 1 | 20 | | | | |
| 19 | 20 | 1 | SPARE | | | | | | | | | | 20 | 1 | 22 | | | | |
| 21 | 20 | 1 | SPARE | | | | | | | | | | 20 | 1 | 24 | | | | |
| 23 | 20 | 1 | SPARE | | | | | | | | | | 20 | 1 | 26 | | | | |
| 25 | 20 | 1 | SPARE | | | | | | | | | | 20 | 1 | 28 | | | | |
| 27 | 20 | 1 | SPARE | | | | | | | | | | 20 | 1 | 30 | | | | |
| 29 | 20 | 1 | SPARE | | | | | | | | | | 20 | 1 | 32 | | | | |
| 31 | 20 | 2 | SPARE | | | | | | | | | | 20 | 1 | 34 | | | | |
| 33 | 20 | 1 | SPARE | | | | | | | | | | 20 | 1 | 36 | | | | |
| 35 | 20 | 1 | SPARE | | | | | | | | | | 20 | 1 | 38 | | | | |
| 37 | 20 | 1 | SPARE | | | | | | | | | | 20 | 1 | 40 | | | | |
| 39 | 20 | 1 | SPARE | | | | | | | | | | 20 | 1 | 42 | | | | |
| 41 | 20 | 1 | SPARE | | | | | | | | | | 20 | 1 | 44 | | | | |
| 43 | 20 | 1 | SPARE | | | | | | | | | | 20 | 1 | 46 | | | | |
| 45 | | | | | | | | | | | | | | | 48 | | | | |
| 47 | | | | | | | | | | | | | | | 50 | | | | |
| 49 | | | | | | | | | | | | | | | 52 | | | | |
| 51 | | | | | | | | | | | | | | | 54 | | | | |
| 53 | | | | | | | | | | | | | | | 56 | | | | |
| 55 | | | | | | | | | | | | | | | 58 | | | | |
| 57 | | | | | | | | | | | | | | | 60 | | | | |
| 59 | | | | | | | | | | | | | | | 62 | | | | |
| 61 | | | | | | | | | | | | | | | 64 | | | | |
| 63 | | | | | | | | | | | | | | | 66 | | | | |
| 65 | | | | | | | | | | | | | | | 68 | | | | |
| 67 | | | | | | | | | | | | | | | 70 | | | | |
| 69 | | | | | | | | | | | | | | | 72 | | | | |
| 71 | | | | | | | | | | | | | | | 74 | | | | |
| 73 | | | | | | | | | | | | | | | 76 | | | | |
| 75 | | | | | | | | | | | | | | | 78 | | | | |
| 77 | | | | | | | | | | | | | | | 80 | | | | |
| 79 | | | | | | | | | | | | | | | 82 | | | | |
| 81 | | | | | | | | | | | | | | | 84 | | | | |
| 83 | | | | | | | | | | | | | | | | | | | |

CONNECTED LOAD (KVA):
DEMAND LOAD (KVA):

TOTAL CONNECTED LOAD (KV):
TOTAL DEMAND LOAD (KVA):

CONNECTED LOAD (A):
DEMAND LOAD (A):

| PANEL: SBVPL-1 | | | | | | | | | | LOCATION: HALL 022 | | | | | | | | | |
|-------------------------------|-------|------------------|-------|-----|-----|------|------|---|---|-----------------------|-----|-----------------|-----|------------------|----|-----|-------|--|--|
| MAIN: 100A MCB | | | | | | | | | | AIC: 10K | | | | | | | | | |
| VOLT/PHASE: 208/120V, 3PH, 4W | | | | | | | | | | COMMENTS: (ALTERNATE) | | | | | | | | | |
| MOUNTING: RECESSED | | | | | | | | | | | | | | | | | | | |
| CIRCUIT BREAKER | | LOAD DESCRIPTION | | LTG | REC | MISC | MISC | | | REC | LTG | CIRCUIT BREAKER | | LOAD DESCRIPTION | | AMP | POLES | | |
| AMP | POLES | | | KVA | KVA | KVA | A | B | C | KVA | KVA | KVA | AMP | POLES | | | | | |
| 1 | 20 | 1 | SPARE | | | | | | | | | | 20 | 1 | 2 | | | | |
| 3 | 20 | 1 | SPARE | | | | | | | | | | 20 | 1 | 4 | | | | |
| 5 | 20 | 1 | SPARE | | | | | | | | | | 20 | 1 | 6 | | | | |
| 7 | 20 | 1 | SPARE | | | | | | | | | | 20 | 1 | 8 | | | | |
| 9 | 20 | 1 | SPARE | | | | | | | | | | 20 | 1 | 10 | | | | |
| 11 | 20 | 1 | SPARE | | | | | | | | | | 20 | 1 | 12 | | | | |
| 13 | 20 | 1 | SPARE | | | | | | | | | | 20 | 1 | 14 | | | | |
| 15 | 20 | 1 | SPARE | | | | | | | | | | 20 | 1 | 16 | | | | |
| 17 | 20 | 1 | SPARE | | | | | | | | | | 20 | 1 | 18 | | | | |
| 19 | | | | | | | | | | | | | | | 20 | | | | |
| 21 | | | | | | | | | | | | | | | 22 | | | | |
| 23 | | | | | | | | | | | | | | | 24 | | | | |
| 25 | | | | | | | | | | | | | | | 26 | | | | |
| 27 | | | | | | | | | | | | | | | 28 | | | | |
| 29 | | | | | | | | | | | | | | | 30 | | | | |
| 31 | | | | | | | | | | | | | | | 32 | | | | |
| 33 | | | | | | | | | | | | | | | 34 | | | | |
| 35 | | | | | | | | | | | | | | | 36 | | | | |
| 37 | | | | | | | | | | | | | | | 38 | | | | |
| 39 | | | | | | | | | | | | | | | 40 | | | | |
| 41 | | | | | | | | | | | | | | | 42 | | | | |

CONNECTED LOAD (KVA):
DEMAND LOAD (KVA):

TOTAL CONNECTED LOAD (KV):
TOTAL DEMAND LOAD (KVA):

CONNECTED LOAD (A):
DEMAND LOAD (A):

| PANEL: NMR-1 | | | | | | | | | | LOCATION: NMR 004 | | | | | | | | | |
|-------------------------------|-------|------------------|--|-----|-----|------|------|---|---|-----------------------|-----|-----------------|-----|------------------|----|-----|-------|--|--|
| MAIN: 100A MCB | | | | | | | | | | AIC: 10K | | | | | | | | | |
| VOLT/PHASE: 208/120V, 3PH, 4W | | | | | | | | | | COMMENTS: (ALTERNATE) | | | | | | | | | |
| MOUNTING: RECESSED | | | | | | | | | | | | | | | | | | | |
| CIRCUIT BREAKER | | LOAD DESCRIPTION | | LTG | REC | MISC | MISC | | | REC | LTG | CIRCUIT BREAKER | | LOAD DESCRIPTION | | AMP | POLES | | |
| AMP | POLES | | | KVA | KVA | KVA | A | B | C | KVA | KVA | KVA | AMP | POLES | | | | | |
| 1 | | | | | | | | | | | | | | | 2 | | | | |
| 3 | | | | | | | | | | | | | | | 4 | | | | |
| 5 | | | | | | | | | | | | | | | 6 | | | | |
| 7 | | | | | | | | | | | | | | | 8 | | | | |
| 9 | | | | | | | | | | | | | | | 10 | | | | |
| 11 | | | | | | | | | | | | | | | 12 | | | | |
| 13 | | | | | | | | | | | | | | | 14 | | | | |
| 15 | | | | | | | | | | | | | | | 16 | | | | |
| 17 | | | | | | | | | | | | | | | 18 | | | | |
| 19 | | | | | | | | | | | | | | | 20 | | | | |
| 21 | | | | | | | | | | | | | | | 22 | | | | |
| 23 | | | | | | | | | | | | | | | 24 | | | | |
| 25 | | | | | | | | | | | | | | | 26 | | | | |
| 27 | | | | | | | | | | | | | | | 28 | | | | |
| 29 | | | | | | | | | | | | | | | 30 | | | | |
| 31 | | | | | | | | | | | | | | | 32 | | | | |
| 33 | | | | | | | | | | | | | | | 34 | | | | |
| 35 | | | | | | | | | | | | | | | 36 | | | | |
| 37 | | | | | | | | | | | | | | | 38 | | | | |
| 39 | | | | | | | | | | | | | | | 40 | | | | |
| 41 | | | | | | | | | | | | | | | 42 | | | | |

CONNECTED LOAD (KVA):
DEMAND LOAD (KVA):

TOTAL CONNECTED LOAD (KV):
TOTAL DEMAND LOAD (KVA):

CONNECTED LOAD (A):
DEMAND LOAD (A):

PORT CITY ARCHITECTURE
65 NEWBURY STREET
PORTLAND, ME 04101
207.761.9000
207.761.2010
lita@portcityarch.com

VANZELM ENGINEERS
VANZELM HEYWOOD & SHADFORD, INC.
10 TALCOTT NOTCH FARMINGTON, CT 06032
TEL: (860) 294-8860 FAX: (860) 294-3998

PROJECT NO.: 2007120.00

BECKER
structural engineers, inc.

SYTDesign CONSULTANTS
CIVIL, ENGINEERING & LANDSCAPE ARCHITECTURE

ALLIED/COOK CONSTRUCTION

Favreau
ESTIMOTE

Titan Mechanical, Inc.
Design, Build, Operate - Mechanical Contracting

UNIVERSITY OF NEW ENGLAND
COLLEGE OF PHARMACY
716 STEVENS AVENUE,
PORTLAND, ME

| * DATE | DESCRIPTION |
|----------------|-------------|
| | BID SET |
| Date Issued | 02/08/08 |
| Project Number | 06506 |

SHEET NAME
ELECTRICAL SCHEDULES - ALTERNATE

Drawn By
AMM

Checked By
MER

E4.4

BID SET - NOT FOR CONSTRUCTION