

PORT CITY ARCHITECTURE

65 NEWBURY STREET
PORTLAND, ME 04101
207.761.9000
fax: 207.761.2010
lita@portcityarch.com

VANZELM
ENGINEERS

VANZELM HEYWOOD & SHADFORD, INC.
15 TALCOTT NOTCH FARMINGTON, CT 06032
TEL: (860) 284-5066 FAX: (860) 284-5068

PROJECT NO.: 2007120.00

BECKER
structural engineers, inc.

SYTD
CONSULTANTS
CIVIL ENGINEERING & LANDSCAPE ARCHITECTURE

ALLIED/COOK
CONSTRUCTION

Furrau
MECHANICAL

Titan Mechanical, Inc.
Civil, Mechanical, Electrical, Plumbing, Fire Protection, and Construction

UNIVERSITY OF NEW ENGLAND

COLLEGE OF PHARMACY

716 STEVENS AVENUE,
PORTLAND, ME

#	DATE	DESCRIPTION
		BID SET
	02/08/08	Date Issued
	06506	Project Number

SHEET NAME
**FIRE PROTECTION
LEGEND, SCHEDULE &
NOTES**

Drawn By	SMS
Checked By	DWM

FPO.1

FIRE PROTECTION ABBREVIATIONS

ACV	ALARM CHECK VALVE
AFF	ABOVE FINISHED FLOOR
AFG	ABOVE FINISHED GRADE
ATS	AUTOMATIC TRANSFER SWITCH
BFP	BACKFLOW PREVENTER
BOP	BOTTOM OF PIPE
CTE	CONNECT TO EXISTING
DCVA	DOUBLE CHECK VALVE ASSEMBLY
DN	DOWN
DPV	DRY PIPE VALVE
EC	EXTENDED COVERAGE
EL	ELEVATION
ETR	EXISTING TO REMAIN
EX	EXISTING
FCVA	FLOOR CONTROL VALVE ASSEMBLY
FDC	FIRE DEPARTMENT CONNECTION
FHC	FIRE HOSE CABINET
FHR	FIRE HOSE RACK
FHV	FIRE HOSE VALVE
FPC	FIRE PUMP CONTROLLER
FPTH	FIRE PUMP TEST HEADER
FS	FLOW SWITCH
FSP	FIRE STANDPIPE
FVC	FIRE VALVE CABINET
G	CAGE GUARD
GPM	GALLONS PER MINUTE
HD	HEAT DETECTOR
HT	HIGH TEMPERATURE
IT	INTERMEDIATE TEMPERATURE
JP	JOCKEY PUMP
JPC	JOCKEY PUMP CONTROLLER
LPS	LOW PRESSURE SWITCH
NC	NORMALLY CLOSED
NIC	NOT IN CONTRACT
NO	NORMALLY OPEN
PA	PREACTION
PAC	PREACTION ALARM VALVE CABINET
PIV	POST INDICATOR VALVE
PRV	PRESSURE REGULATING VALVE
PS	PRESSURE SWITCH
PSI	POUNDS PER SQUARE INCH
RCV	RISER CONTROL VALVE
RPD	REDUCED PRESSURE BACKFLOW PREVENTER ASSEMBLY
RR	REMOVE & RELOCATE
SP	SPRINKLER
SS	SUPERVISORY SWITCH
TYP	TYPICAL
UG	UNDERGROUND
VF	VERIFY IN FIELD

FIRE PROTECTION SYMBOLS

○	CONCEALED SPRINKLER
●	PENDENT SPRINKLER
×	UPRIGHT SPRINKLER
⊙	DRY PIPE SPRINKLER
▲	DRY SIDEWALL SPRINKLER
△	WET SIDEWALL SPRINKLER
⊖	EXISTING SPRINKLER TO REMAIN
×	EXISTING UPRIGHT SPRINKLER TO REMAIN
▲	EXISTING SIDEWALL SPRINKLER TO REMAIN
⊖R	EXISTING SPRINKLER TO BE REMOVED
×R	EXISTING UPRIGHT SPRINKLER TO BE REMOVED
▲R	EXISTING SIDEWALL SPRINKLER TO BE REMOVED
⊖	ALARM CHECK VALVE RISER ASSEMBLY
⊖	DRY PIPE VALVE RISER ASSEMBLY
⊖	PREACTION VALVE RISER ASSEMBLY
⊖	SPRINKLER FLOW SWITCH
⊖	PRESSURE SWITCH
⊖	LOW PRESSURE SWITCH
⊖	SUPERVISORY SWITCH (TAMPER SWITCH)
⊖	ANGLE HOSE VALVE W/CAP & CHAIN
PRV	PRESSURE REGULATING ANGLE HOSE VALVE
⊖	PRESSURE RELIEF VALVE
⊖	VALVE IN PIPE RISER
⊖	OS&Y VALVE (SUPERVISED)
⊖	GATE VALVE (SUPERVISED)
⊖	BALL VALVE (SUPERVISED AND NON-SUPERVISED)
⊖	BUTTERFLY VALVE (SUPERVISED)
⊖	VALVE IN PIPE DROP
N	CHECK VALVE
⊖	BACKFLOW PREVENTER ASSEMBLY (DCVA) WITH SHUTOFF VALVES
⊖	BACKFLOW PREVENTER ASSEMBLY (RPD) WITH SHUTOFF VALVES
⊖	PRESSURE REGULATING VALVE (X = PSI SETTING)
⊖	POST INDICATOR VALVE (SUPERVISED)
FDC	POST MOUNTED FIRE DEPARTMENT CONNECTION (REFER TO SPECIFICATIONS FOR TYPE)
FDC	WALL MOUNTED FIRE DEPARTMENT CONNECTION (REFER TO SPECIFICATIONS FOR TYPE)
⊖	FIRE PUMP TEST HEADER (REFER TO SPECIFICATIONS FOR TYPE)
⊖	PUMP
⊖	PRESSURE GAUGE
⊖	ELECTRIC ALARM BELL
⊖	WATER MOTOR GONG
⊖	THRUST BLOCK
ATS	AUTOMATIC TRANSFER SWITCH
FPC	FIRE PUMP CONTROLLER
JPC	JOCKEY PUMP CONTROLLER
PAC	PREACTION ALARM ASSEMBLY CABINET
RAP	REMOTE ALARM PANEL
⊖	CONNECT TO EXISTING
⊖	CURB GATE VALVE & BOX
FCVA	FLOOR CONTROL VALVE ASSEMBLY
FVC	FIRE VALVE CABINET
S	SMOKE DETECTOR
H	HEAT DETECTOR

FIRE PROTECTION LEGEND

→	FLOW DIRECTION
—	FIRE LINE
—	FIRE SERVICE BURIED
—	WET SPRINKLER SYSTEM
—	DRY PIPE SPRINKLER SYSTEM
—	DRAIN PIPING
—	FIRE DEPARTMENT CONNECTION
—	FIRE PUMP TEST HEADER PIPING
—	PREACTION SPRINKLER SYSTEM
—	EXISTING PIPING OR EQUIPMENT
—	REMOVE EXISTING PIPING OR EQUIPMENT
⊖	PIPE DOWN
⊖	PIPE UP
⊖	PIPE DROP
—	CAPPED PIPE







LEGEND NOTE

THESE ARE THE GENERAL LEGENDS OF SYMBOLS AND ABBREVIATIONS, AND SHALL BE USED AS A DICTIONARY TO DEFINE ITEMS INDICATED ON DRAWINGS. NOT ALL SYMBOLS OR ABBREVIATIONS DEFINED ARE NECESSARILY USED ON THIS PROJECT.

FIRE PROTECTION GENERAL NOTES

- THE FIRE PROTECTION CONTRACTOR IS RESPONSIBLE FOR THE FOLLOWING:
- THESE GENERAL NOTES ARE APPLICABLE TO ALL FIRE PROTECTION DRAWINGS.
 - DRAWINGS ARE DIAGRAMMATIC AND SHOW THE GENERAL INTENT OF WORK. SEE DETAILS, RISERS, AND SPECIFICATIONS FOR ADDITIONAL INFORMATION.
 - THE DRAWINGS INDICATE A SUGGESTED SPRINKLER LAYOUT AND THAT EACH AREA IS COVERED BY SPRINKLER PROTECTION AS REQUIRED PER CODE. THE SPRINKLER QUANTITIES SHALL NOT BE COUNTED AS A TAKE OFF OR AS EXACT LOCATIONS. REFER TO NFPA STANDARDS FOR EXACT SPACING, DENSITY, AND LOCATION REQUIREMENTS.
 - SPRINKLERS IN FINISHED CEILING AREAS SHALL ALWAYS BE LOCATED IN THE CENTER OF CEILING TILES IN BOTH DIRECTIONS UNLESS INDICATED OTHERWISE.
 - REVIEW THE ARCHITECTURAL REFLECTED CEILING PLANS AS PART OF THIS CONTRACT FOR ADDITIONAL INFORMATION SUCH AS CEILING HEIGHTS, TYPES, SOFFITS AND OR OTHER DEVICE LOCATIONS.
 - REVIEW THE ELECTRICAL DIVISION DRAWINGS AND COORDINATE THE FIRE PROTECTION WORK WITH LOCATIONS OF LIGHTS, AND CEILING MOUNTED DEVICES WHICH MAY INTERFERE WITH SPRINKLER HEAD LOCATIONS OR SPRAY PATTERNS.
 - REVIEW THE HVAC DIVISION DRAWINGS AND COORDINATE THE FIRE PROTECTION WORK WITH LOCATIONS OF CEILING MOUNTED DEVICES SUCH AS DIFFUSERS, GRILLS, REGISTERS, LOCATIONS OF HEAT PRODUCING EQUIPMENT AND DUCTWORK REQUIRING SPRINKLER PROTECTION BELOW IT.
 - PROVIDE PIPE EXPANSION JOINTS AT ALL BUILDING EXPANSION JOINT LOCATIONS AND APPROVED SEISMIC EXPANSION LOOPS AT ALL BUILDING SEISMIC JOINT LOCATIONS AS REQUIRED PER NFPA STANDARDS AND BUILDING CODES. REVIEW ARCHITECTURAL AND STRUCTURAL DRAWINGS FOR EXACT LOCATIONS OF EXPANSION AND SEISMIC JOINTS.
 - REFER TO SITE PLAN AND CIVIL ENGINEER'S DOCUMENTS FOR ADDITIONAL INFORMATION PERTAINING TO COORDINATION OF SITE UTILITIES, BOTH EXISTING AND NEW.
 - IN RENOVATION WORK, COORDINATE SYSTEMS SHUTDOWN WITH OWNER IN ORDER TO MAKE NEW PIPING CONNECTIONS. ALLOW MINIMUM OF TEN (10) DAYS ADVANCE NOTICE FOR OWNER APPROVAL TO PROCEED WITH CONTRACT WORK.

IF THIS SHEET IS NOT 24 X 36 IT IS A REDUCED SCALE PRINT - SCALE ACCORDINGLY

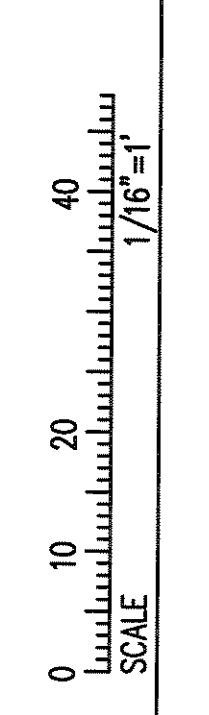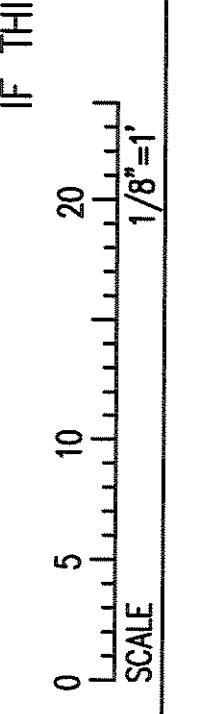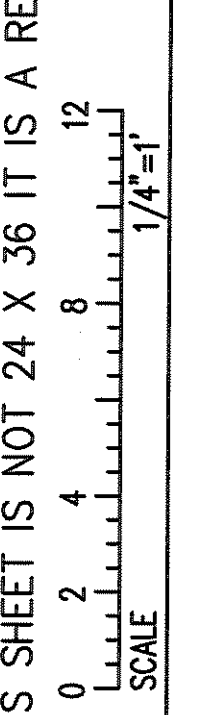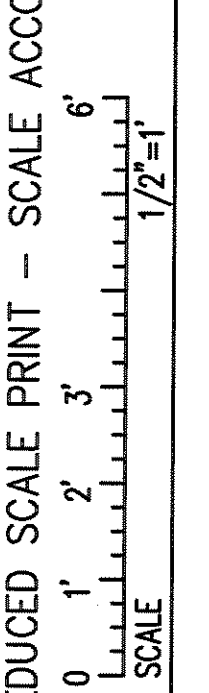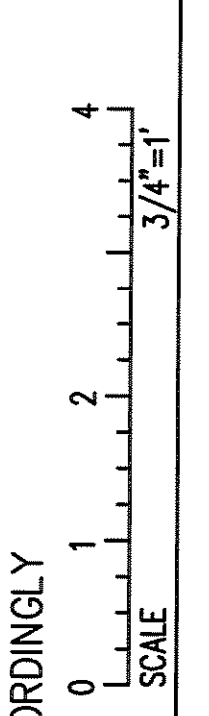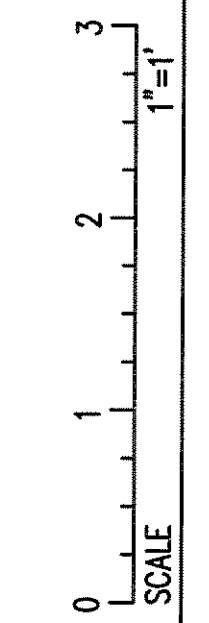

BID SET - NOT FOR CONSTRUCTION