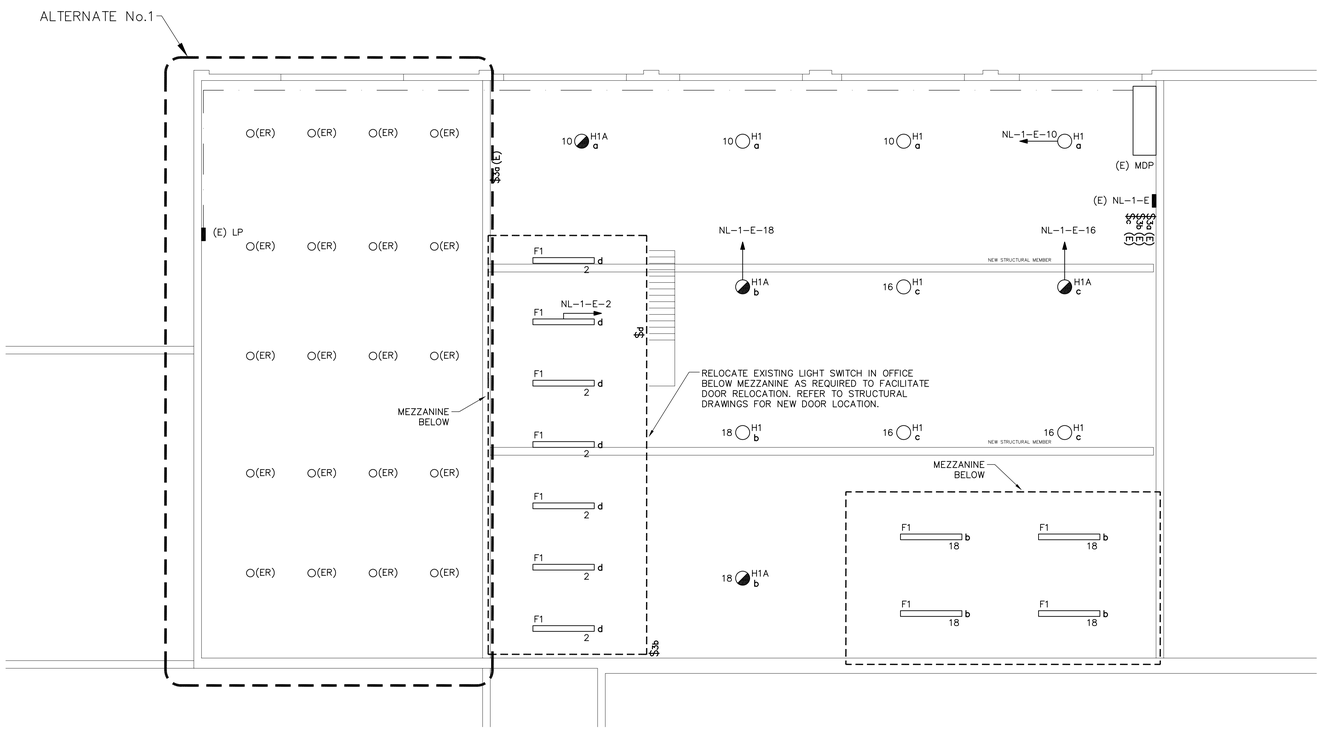

A1	ELECTRICAL PLAN
1/8" = 1'-0"	

H1 — CEILING MOUNTED HID LIGHT FIXTURE ~ LITHONIA THR 250MP PA22 120V WITH 3000K LAMP OR APPROVED EQUAL ~ MOUNT 20'AFF

H1A — CEILING MOUNTED HID LIGHT FIXTURE ~ LITHONIA THR 250MP PA22 120V QRSTD WITH 3000K LAMP OR APPROVED EQUAL ~ MOUNT 20'AFF

F1 — FLUORESCENT INDUSTRIAL STRIP LIGHT ~ LITHONIA TEJ432EB120 WITH 32W T8 3000K LAMPS ~ (2) LAMPS IN CROSS SECTION OR APPROVED EQUAL ~ MOUNT 9'AFF

208/120 VOLT, 3 PHASE PANELBOARD, SURFACE MOUNTED

$a — SINGLE POLE LIGHT SWITCH ~ 20A,125/277V ~ MOUNT 48"AFF LETTER INDICATES LIGHTS SWITCHED ~ TYPICAL

$3 — THREE-WAY LIGHT SWITCH ~ MOUNT 48"AFF

(E) — EXISTING ITEM TO REMAIN

(ER) — EXISTING ITEM TO BE REMOVED AND REINSTALLED

— KEY NOTE

HOMERUN ~ (2)#12+(1)#12G UNO

EXISTING 2" FEEDER FROM MDP TO PANEL LP

E9	ELECTRICAL LEGEND
NO SCALE	

1. BRANCH CIRCUIT WIRING NOT SHOWN. EXISTING WIRING MAY, AT THE CONTRACTOR'S DISCRETION, REMAIN CONNECTED AND PROTECTED FROM WEATHER AND PHYSICAL DAMAGE DURING CONSTRUCTION UNLESS NOTED OTHERWISE OR PROHIBITED BY THE AUTHORITY HAVING JURISDICTION.
2. UPON COMPLETION OF THE PROJECT, ALL WIRING AND CONDUITS WITHIN CEILING SPACES SHALL BE SUPPORTED AND SECURED IN ACCORANCE WITH THE LATEST EDITION OF THE NATIONAL ELECTRICAL CODE.
3. WHERE EXISTING WIRING IS REMOVED AND REPLACED, MATCH EXISTING CIRCUITING AS CLOSELY AS PERMITTED BY CURRENT CODES AND REGULATIONS.
4. ALL REPLACEMENT WIRING AND ELECTRICAL WORK SHALL FULLY COMPLY WITH THE LATEST EDITION OF THE NATIONAL ELECTRICAL CODE.
5. REMOVE EXISTING ELECTRICAL ITEMS AS REQUIRED TO COMPLETE THE WORK OF DIVISION 16 AND TO FACILITATE THE WORK OF OTHER DIVISIONS, WHETHER THOSE ITEMS ARE INDICATED ON THIS PLAN OR NOT.
6. PROVIDE ALL CONDUIT, WIRING, JUNCTION BOXES, ETC REQUIRED TO PROVIDE A COMPLETE AND OPERATIONAL ELECTRICAL SYSTEM IN ACCORDANCE WITH THE INTENT OF DIVISION 16, WHETHER THOSE ITEMS ARE INDICATED ON THIS DRAWING OR NOT.
7. ALL ELECTRICAL DEVICES, EQUIPMENT, FIXTURES, ETC. SHALL BE PROTECTED FROM DAMAGE DURING CONSTRUCTION.
8. COORDINATE ALL ELECTRICAL WORK WITH THE WORK OF OTHER DIVISIONS.
9. POWER WIRING FOR EQUIPMENT & CONTROL IS TO BE PERFORMED BY DIVISION 16. CONTROL WIRING BY DIVISION 15.
10. NO WIRING OR CONDUIT THAT BECOMES UNUSED AS PART OF THIS PROJECT SHALL BE ABANDONED IN PLACE.

B9	ELECTRICAL GENERAL NOTES
–	

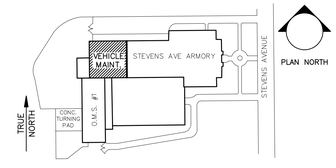

A9	KEYPLAN
–	

allied engineering, inc.
FULL SERVICE CONSULTING ENGINEERS
STRUCTURAL MECHANICAL •ELECTRICAL • ENVIRONMENTAL CONSTRUCTION ADMINISTRATION
One Westbrook Common, Westbrook, Maine 04092-2804
Telephone No. 207-854-8126 • Fax No. 207-854-0633
E-Mail: info@allied-eng.com • www.allied-eng.com

REVISIONS

NUMBER	DATE	BY	DESCRIPTION

Date: APRIL 2, 2004
Drawn By: CRH
Checked By: CAF/SRM
Project Mgr: WEF
Project No: 02017
Cad File: 02017E.DWG
Graphic Scale: 0 1"

ELECTRICAL PLAN VEHICLE MAINTENANCE

ARMORY RE-ROOFING
STEVENS AVE.
PORTLAND, MAINE

© COPYRIGHT 2004 ALLIED ENGINEERING, INC.

E-100

03/30/2004