



- DRAWING KEYNOTE**
- △ 120V POWER FOR AUTOMATIC FLUSH VALVES. FIELD COORDINATE FINAL LOCATION.
 - △ COORDINATE WITH HEADBOARD MANUFACTURER FOR WIRING TERMINATIONS. PROVIDE CIRCUITS AS INDICATED. REFER TO DEAL 2/EP101.
 - △ 120V POWER FOR ELEVATOR CAB RECEPTACLE AND LIGHTING.
 - △ 120V POWER FOR HAND DRYER. FIELD COORDINATE FINAL LOCATION.
 - △ COORDINATE AND PROVIDE RECEPTACLE OR HARDWIRED CONNECTION FOR WATER COOLER.
 - △ MOUNT RECEPTACLE AT 48" AFF. COORDINATE FINAL MOUNTING HEIGHT WITH BUILDING OWNER'S EQUIPMENT REQUIREMENTS.
 - △ 120V POWER FOR VAV BOXES. FIELD COORDINATE FINAL CONNECTIONS.
 - △ APPROXIMATE ROUTE OF SERVICE ENTRANCE CONDUCTORS UNDER SLAB IN 125 AND 126 AND IN CRAWL SPACE TO MAIN DISTRIBUTION SWITCHBOARD.
 - △ AC UNIT POWER FROM OUTDOOR CU UNIT.
 - △ SEE 1/EP101 FOR CONTINUATION.
 - △ SEE 3/EP101 FOR CONTINUATION.
 - △ FOR LCD SCREEN.
 - △ FOR TRAP PRIMER TP-3.

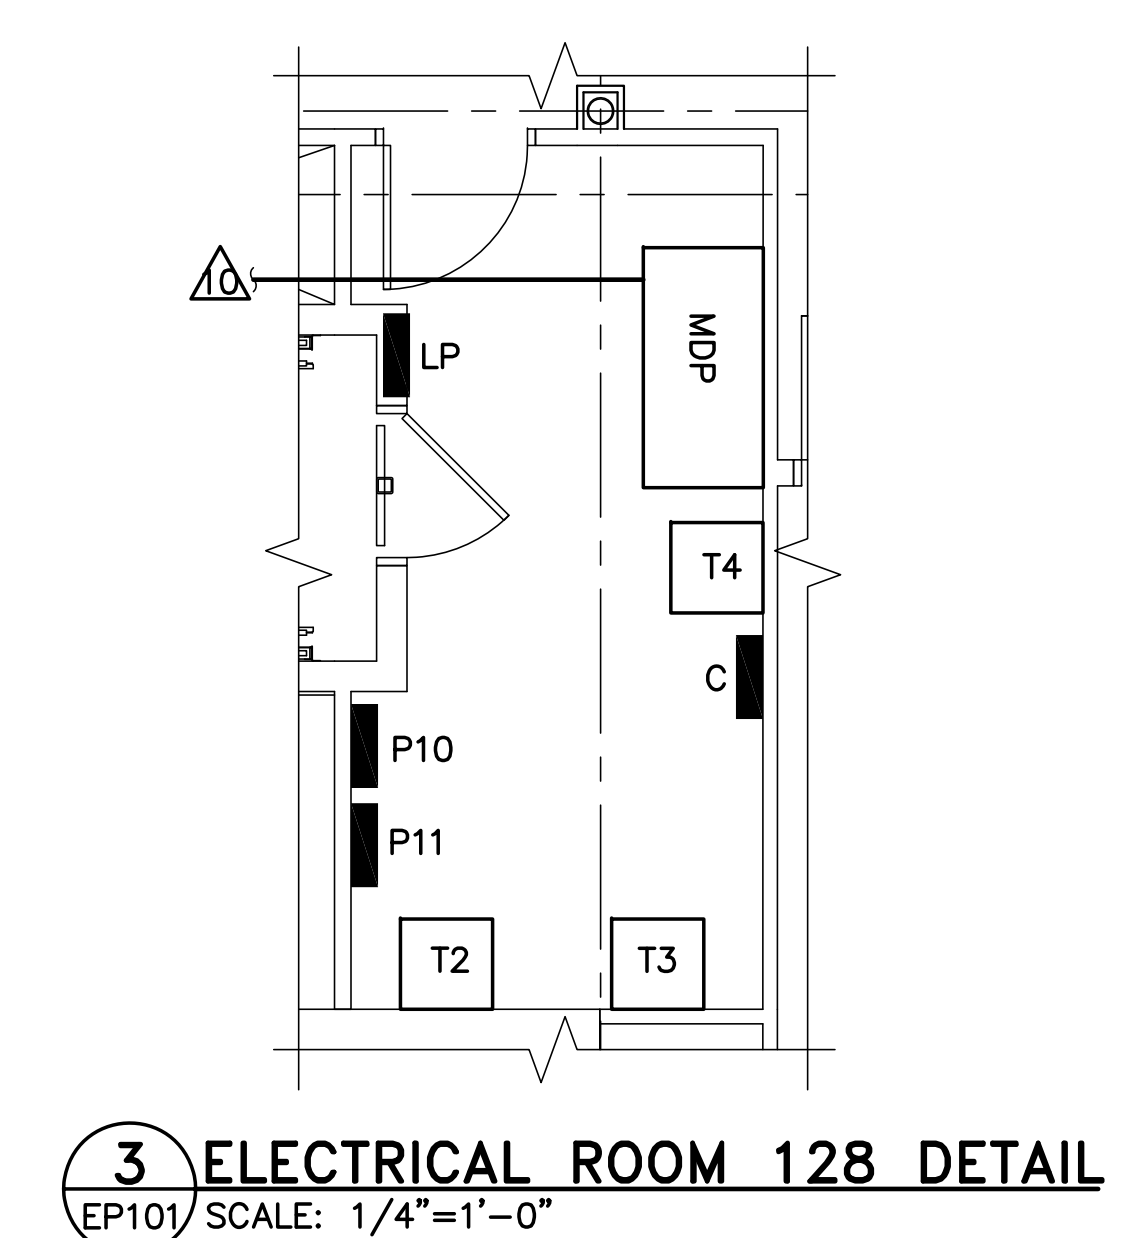

1 FIRST FLOOR PLAN
EP101/SCALE: 1/8"=1'-0"

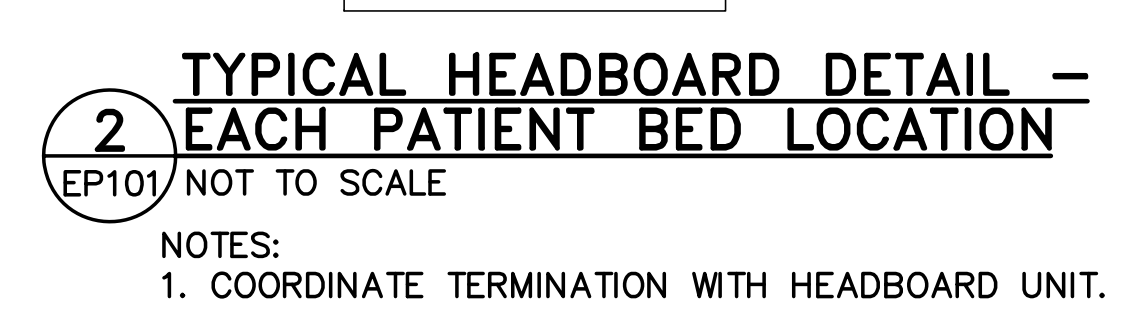