


2 FUNCTION ROOM 104 BLDG SECTION
 MP102 SCALE: 1/8"=1'-0"

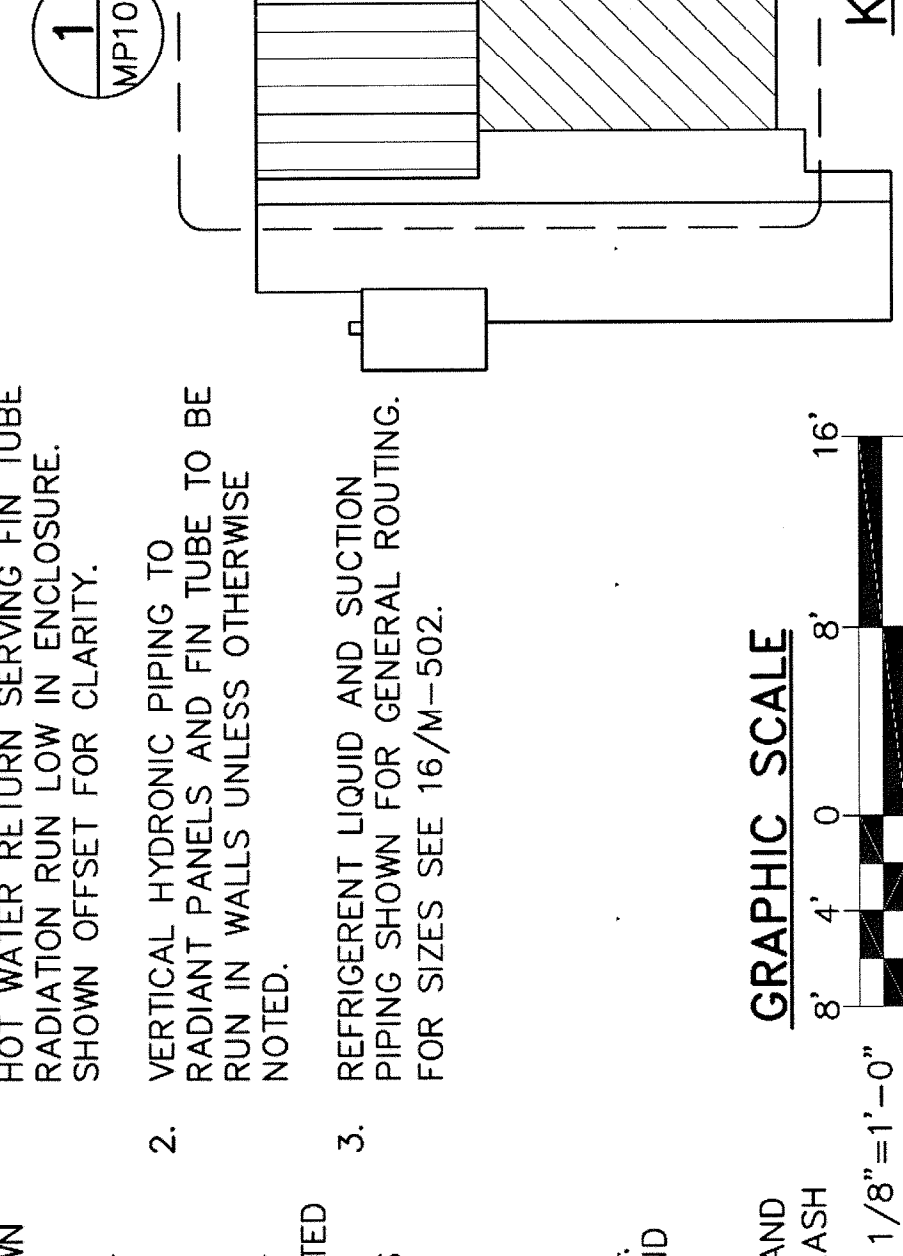

DRAWING KEYNOTES

1. PROVIDE CONDENSATE DRAIN PIPING DOWN TO MOP RECEIVER.
2. INSURE PANEL RADIATOR RATED OUTPUT INCLUDES THE DERATING FACTOR FOR PLACEMENT ALONG AN INSIDE WALL.
3. PANEL RADIATOR LENGTHS SHALL BE OF SUFFICIENT LENGTH TO SATISFY THE LISTED HEAT OUTPUT AND COVER THE ENTIRE SPACE BETWEEN CHASES OR END WALLS WITH PROVIDED.
4. REFER TO MP101 FOR PIPING IN CRAWL SPACE.
5. TO HEATING COIL H.C.-2 CONTROL VALVE LOCATED IN 204S STORAGE ROOM, SECOND FLOOR. SEE MP103.
6. 1" CONDENSATE DRAIN THROUGH WALL AND ELBOW DOWN. TERMINATE 6" ABOVE SPLASH GUARD.

DRAWING NOTES

1. HOT WATER RETURN SERVING FIN TUBE RADIATION RUN LOW IN ENCLOSURE. SHOWN OFFSET FOR CLARITY.
2. VERTICAL HYDRONIC PIPING TO RADIANT PANELS AND FIN TUBE TO BE RUN IN WALLS UNLESS OTHERWISE NOTED.
3. REFRIGERANT LIQUID AND SUCTION PIPING SHOWN FOR GENERAL ROUTING. FOR SIZES SEE 15/A-502.

1 FIRST FLOOR MECHANICAL PIPING PART PLAN
 MP102 SCALE: 1/8"=1'-0"



GRAPHIC SCALE
 16'
 8'
 4'
 0'
 CHECK GRAPHIC SCALE BEFORE USING