

WOODS AND PLASTICS

SECTION 064000 - INTERIOR ARCHITECTURAL WOODWORK

- 1.1 SUMMARY
A. INTERIOR STANDING AND RUNNING TRIM
B. FLUSH WOOD PANELING AND WAINSCOTS.
C. MELAMINE CABINETS.
D. SOLID-SURFACING-MATERIAL COUNTERTOPS.
E. CLOSET AND UTILITY SHELVING.
1.2 QUALITY ASSURANCE
A. QUALITY STANDARD: AWI.
1.3 MATERIALS
A. WOOD PRODUCTS: COMPLY WITH THE FOLLOWING:
1. HARDBOARD: AHA A135.4, MADE WITH BINDER CONTAINING NO UREA FORMALDEHYDE.
2. MEDIUM-DENSITY FIBERBOARD: ANSI A208.2, GRADE 130, MADE WITH BINDER CONTAINING NO UREA FORMALDEHYDE.
3. MOISTURE RESISTANT MEDIUM-DENSITY FIBERBOARD: ANSI A208.2, GRADE MD, MR50, MADE WITH BINDER CONTAINING NO UREA FORMALDEHYDE.
4. STRAW-BASED PARTICLEBOARD: ANSI A208.1, GRADE M-2, EXCEPT FOR DENSITY, MADE WITH ADHESIVE CONTAINING NO UREA FORMALDEHYDE.
5. SOFTWOOD PLYWOOD: DOC PS 1
6. VENEER-FACED PANEL PRODUCTS (HARDWOOD PLYWOOD): HPVA HP-1, MADE WITH ADHESIVE CONTAINING NO UREA FORMALDEHYDE.
B. ADHESIVES, GENERAL: DO NOT USE ADHESIVES THAT CONTAIN UREA FORMALDEHYDE.
C. VOC LIMITS FOR INSTALLATION ADHESIVES AND GLUES: USE INSTALLATION ADHESIVES THAT COMPLY WITH THE FOLLOWING LIMITS FOR VOC CONTENT WHEN CALCULATED ACCORDING TO 40 CFR 59, SUBPART D (EPA METHOD 24):
1. WOOD GLUES: 30 G/L
2. PANEL ADHESIVE: 50 G/L
3. MULTIPURPOSE CONSTRUCTION ADHESIVE: 70 G/L
4. CONTACT ADHESIVE: 80 G/L
a. SPECIAL PURPOSE: 250 G/L
D. CLOSET AND UTILITY SHELVING:
1. GRADE: ECONOMY.
2. SHELF MATERIAL: 3/4-INCH(19-MM) THERMOSET DECORATIVE PANEL WITH PVC OR POLYESTER EDGE BANDING.
3. CLEATS: 3/4-INCH(19-MM) PANEL PRODUCT.
E. SHOP FINISHING:
1. GRADE: SAME GRADE AS WOODWORK.
2. EXTENT: ALL WOODWORK SHOP FINISHED.
1.4 INSTALLATION
A. SCRIBE AND CUT MILLWORK TO FIT ADJOINING WORK, REFINISH CUT SURFACES, AND REPAIR DAMAGED FINISH AT CUTS.
B. ANCHOR MILLWORK TO ANCHORS OR BLOCKING BUILT IN OR DIRECTLY ATTACHED TO SUBSTRATES. SECURE WITH COUNTERSUNK, CONCEALED FASTENERS AND BLIND NAILING AS REQUIRED FOR COMPLETE INSTALLATION. USE FINE NAILS OR FINISHING SCREWS FOR EXPOSED FASTENING.
C. CABINETS: INSTALL WITHOUT DISTORTION SO DOORS AND DRAWERS FIT OPENINGS PROPERLY AND ARE ACCURATELY ALIGNED. ADJUST HARDWARE TO CENTER DOORS AND DRAWERS IN OPENINGS AND TO PROVIDE UNENCUMBERED OPERATION. COMPLETE INSTALLATION OF HARDWARE AND ACCESSORY ITEMS AS INDICATED.
1. INSTALL CABINETS WITH NO MORE THAN 1/8 INCH IN 96-INCH(3 MM IN 2400-MM) SAG, BOW, OR OTHER VARIATION FROM A STRAIGHT LINE.
D. COUNTERTOPS: ANCHOR SECURELY BY SCREWING THROUGH CORNER BLOCKS OF BASE CABINETS OR OTHER SUPPORTS INTO UNDERSIDE OF COUNTERTOP.
1. ALIGN ADJACENT SOLID-SURFACING-MATERIAL COUNTERTOPS AND FORM SEAMS TO COMPLY WITH MANUFACTURER'S WRITTEN RECOMMENDATIONS USING ADHESIVE IN COLOR TO MATCH COUNTERTOP. CAREFULLY DRESS JOINTS SMOOTH, REMOVE SURFACE SCRATCHES, AND CLEAN ENTIRE SURFACE.
2. INSTALL COUNTERTOPS WITH NO MORE THAN 1/8 INCH IN 96-INCH (3 MM IN 2400-MM) SAG, BOW, OR OTHER VARIATION FROM A STRAIGHT LINE.
3. SECURE COVED BACKSPASHES TO TOPS PER MANUFACTURER'S FABRICATION MANUAL AND TO WALLS WITH ADHESIVE.
4. CALK SPACE BETWEEN BACKSPASH AND WALL WITH SEALANT SPECIFIED IN DIVISION 7 SECTION "JOINT SEALANTS."

END OF SECTION 064000

WOODS AND PLASTICS

SECTION 064400 - PLASTIC PANELING

- PART 1 - GENERAL
1.1 SUMMARY
A. SECTION INCLUDES THE FOLLOWING:
1. GLASS-FIBER REINFORCED PLASTIC (FRP) WALL PANELING.
2. MOLDING, ADHESIVES, AND JOINT SEALANTS.
1.2 PLASTIC SHEET PANELING
A. GLASS-FIBER-REINFORCED PLASTIC PANELING: GELCOAT-FINISHED, GLASS-FIBER REINFORCED PLASTIC PANELS COMPLYING WITH ASTM D 5319.
1. LOW-EMITTING MATERIALS: PANELING SHALL COMPLY WITH THE TESTING AND PRODUCT REQUIREMENTS OF THE CALIFORNIA DEPARTMENT OF PUBLIC HEALTH SERVICES' STANDARD PRACTICE FOR THE TESTING OF VOLATILE ORGANIC EMISSIONS FROM VARIOUS SOURCES USING SMALL-SCALE ENVIRONMENTAL CHAMBERS.*
2. NOMINAL THICKNESS: NOT LESS THAN 0.09 INCHES.
3. COLOR: WHITE.
4. MOLDING COLOR: WHITE.
5. SURFACE FINISH: MOLDED PEBBLE TEXTURE.
B. UNREINFORCED POLYPROPYLENE PANELING: SOLID POLYPROPYLENE PANELS MADE FROM NO LESS THAN 80 PERCENT RECYCLED MATERIAL.
1. LOW-EMITTING MATERIALS: PANELING SHALL COMPLY WITH THE TESTING AND PRODUCT REQUIREMENTS OF THE CALIFORNIA DEPARTMENT OF PUBLIC HEALTH'S (FORMERLY, THE CALIFORNIA DEPARTMENT OF HEALTH SERVICES) STANDARD METHOD FOR THE TESTING AND EVALUATION OF VOLATILE ORGANIC CHEMICAL EMISSIONS FROM INDOOR SOURCES USING ENVIRONMENTAL CHAMBERS.*
2. NOMINAL THICKNESS: NOT LESS THAN 0.09 INCHES.
3. COLOR: WHITE.
4. MOLDING COLOR: WHITE.
5. SURFACE FINISH: MOLDED PEBBLE TEXTURE.
1.3 ADHESIVES
A. AS RECOMMENDED BY PLASTIC PANELING MANUFACTURER.
1. VOC LIMIT: 50 G/L.
1.4 ACCESSORIES
A. TRIM ACCESSORIES: MANUFACTURER'S STANDARD ONE-PIECE VINYL EXTRUSIONS DESIGNED TO RETAIN AND COVER EDGES OF PANELS. PROVIDE DIVISION BARS, INSIDE CORNERS, OUTSIDE CORNERS, AND CAPS AS NEEDED TO CONCEAL EDGES.
1. COLOR: WHITE.

END OF SECTION 064400

THERMAL AND MOISTURE PROTECTION

SECTION 078413 - PENETRATION FIRESTOPPING

- 1.1 SUBMITTALS
A. PRODUCT DATA: FOR EACH TYPE OF PRODUCT INDICATED.
1.2 QUALITY ASSURANCE
A. INSTALLER QUALIFICATIONS: AN FM GLOBAL-APPROVED FIRESTOP CONTRACTOR OR A UL-QUALIFIED FIRESTOP CONTRACTOR.
B. FIRE-TEST-RESPONSE CHARACTERISTICS: TESTED PER ASTM E 814 BY QUALIFIED TESTING AND INSPECTING AGENCY.
1.3 PENETRATION FIRESTOPPING
A. PENETRATIONS IN FIRE-RESISTANCE-RATED WALLS: F-RATINGS PER ASTM E 814 OR UL 1479.
B. PENETRATIONS IN HORIZONTAL ASSEMBLIES: F- AND T-RATINGS PER ASTM E 814 OR UL 1479.
C. PENETRATIONS IN SMOKE BARRIERS: L-RATINGS PER UL 1479.
D. W-RATINGS: PER UL 1479.
E. VOC CONTENT OF INTERIOR SEALANTS: PROVIDE INTERIOR SEALANTS AND SEALANT PRIMERS THAT COMPLY WITH THE FOLLOWING LIMITS FOR VOC CONTENT WHEN CALCULATED ACCORDING TO 40 CFR 59, SUBPART D (EPA METHOD 24):
1. SEALANTS: 250 G/L
2. SEALANT PRIMERS FOR NONPOROUS SUBSTRATES: 250 G/L.
3. SEALANT PRIMERS FOR POROUS SUBSTRATES: 775 G/L.
1.4 INSTALLATION
A. IDENTIFICATION: PREPRINTED METAL OR PLASTIC LABELS, PERMANENTLY ATTACHED.
1.5 FIELD QUALITY CONTROL
A. INSPECTION OF INSTALLED FIRESTOP SYSTEMS: BY OWNER-ENGAGED AGENCY ACCORDING TO ASTM E 2174 REQUIREMENTS.

END OF SECTION 078413

THERMAL AND MOISTURE PROTECTION

SECTION 078446 - FIRE-RESISTIVE JOINT SYSTEMS

- 1.1 SUMMARY
A. FIRE-RESISTIVE JOINT SYSTEMS FOR THE FOLLOWING:
1. JOINTS IN OR BETWEEN FIRE-RESISTANCE-RATED CONSTRUCTIONS.
2. JOINTS AT EXTERIOR CURTAIN-WALL/FLOOR INTERSECTIONS.
3. JOINTS IN SMOKE BARRIERS.
1.2 PERFORMANCE REQUIREMENTS
A. FIRE-RESISTANCE RATINGS OF JOINT SYSTEMS IN AND BETWEEN FIRE-RESISTANCE-RATED CONSTRUCTIONS: EQUALING OR EXCEEDING THE FIRE-RESISTANCE RATINGS OF CONSTRUCTION THAT THEY JOIN, [AND WITH MOVEMENT CAPABILITIES INDICATED] AS DETERMINED BY UL 2079.
1.3 SUBMITTALS
A. PRODUCT DATA: FOR EACH TYPE OF PRODUCT INDICATED.
1.4 QUALITY ASSURANCE
A. FIRE-TEST-RESPONSE CHARACTERISTICS: TESTED BY QUALIFIED TESTING AND INSPECTING AGENCY.
1.5 FIRE-RESISTIVE JOINT SYSTEMS
A. DESIGNATION SYSTEM FOR JOINTS IN OR BETWEEN FIRE-RESISTANCE-RATED CONSTRUCTIONS: ALPHANUMERIC SYSTEMS LISTED IN UL'S "FIRE RESISTANCE DIRECTORY" UNDER PRODUCT CATEGORY "HBMN."
B. JOINTS IN OR BETWEEN FIRE-RESISTANCE-RATED CONSTRUCTION: EQUAL TO OR EXCEEDING THE FIRE-RESISTANCE RATING OF CONSTRUCTION THEY WILL JOIN.
C. JOINTS AT EXTERIOR CURTAIN-WALL/FLOOR INTERSECTIONS: EQUAL TO OR EXCEEDING THE FIRE-RESISTANCE RATING OF THE FLOOR ASSEMBLY.
D. JOINTS IN SMOKE BARRIERS:
1. L-RATING: NOT EXCEEDING 5.0 CFM/FT (0.00775 CU. MS X M) OF JOINT AT 0.30 INCH WG (74.7 PA) AT BOTH AMBIENT AND ELEVATED TEMPERATURES.
E. EXPOSED FIRE-RESISTIVE JOINT SYSTEMS: PROVIDE PRODUCTS WITH FLAME-SPREAD AND SMOKE-DEVELOPED INDEXES OF LESS THAN 25 AND 450, RESPECTIVELY, AS DETERMINED PER ASTM E 84.
F. VOC CONTENT: FIRE-RESISTIVE JOINT SYSTEM SEALANTS SHALL COMPLY WITH THE FOLLOWING LIMITS FOR VOC CONTENT WHEN CALCULATED ACCORDING TO 40 CFR 59, SUBPART D (EPA METHOD 24):
1. ARCHITECTURAL SEALANTS: 250 G/L.
2. SEALANT PRIMERS FOR NONPOROUS SUBSTRATES: 250 G/L.
3. SEALANT PRIMERS FOR POROUS SUBSTRATES: 775 G/L.
G. SEALANT PRIMERS FOR POROUS SUBSTRATES: 775 G/L.
H. ACCESSORIES: FORMING MATERIALS AND OTHER COMPONENTS NEEDED TO INSTALL FILL MATERIALS AND MAINTAIN RATINGS REQUIRED.

END OF SECTION 078446

THERMAL AND MOISTURE PROTECTION

SECTION 079200 - JOINT SEALANTS

- 1.1 MATERIALS
A. VOC CONTENT OF INTERIOR SEALANTS: PROVIDE INTERIOR SEALANTS AND SEALANT PRIMERS THAT COMPLY WITH THE FOLLOWING LIMITS FOR VOC CONTENT WHEN CALCULATED ACCORDING TO 40 CFR 59, SUBPART D (EPA METHOD 24):
1. SEALANTS: 250 G/L
2. SEALANT PRIMERS FOR NONPOROUS SUBSTRATES: 250 G/L.
3. SEALANT PRIMERS FOR POROUS SUBSTRATES: 775 G/L.
B. SUITABILITY FOR CONTACT WITH FOOD: WHERE SEALANTS ARE INDICATED FOR JOINTS THAT WILL COME IN REPEATED CONTACT WITH FOOD, PROVIDE PRODUCTS THAT COMPLY WITH 21 CFR 177.2600.
C. ELASTOMERIC JOINT SEALANTS: LIQUID APPLIED, CHEMICALLY CURING; ASTM C 920.
1. MULTICOMPONENT NONSAG NEUTRAL-CURING SILICONE SEALANT ES-1.
2. SINGLE-COMPONENT MILDEW-RESISTANT NEUTRAL-CURING SILICONE SEALANT ES-2.
3. SINGLE-COMPONENT MILDEW-RESISTANT ACID-CURING SILICONE SEALANT ES-3.
4. SINGLE-COMPONENT MILDEW-RESISTANT ACID-CURING RTV SILICONE SEALANT ES-4.
5. MULTICOMPONENT NONSAG POLYUREA SEALANT ES-5.
6. MULTICOMPONENT NONSAG POLYUREA FILLER ES-6.
D. LATEX SEALANT LS-1: COMPLY WITH ASTM C 834, TYPE P, GRADE NF.
E. JOINT-SEALANT BACKING:
1.2 JOINT-SEALANT SCHEDULE
A. JOINT-SEALANT APPLICATION JS-1: EXTERIOR HORIZONTAL NONTRAFFIC AND TRAFFIC ISOLATION AND CONTRACTION JOINTS IN CAST-IN-PLACE CONCRETE SLABS.
1. JOINT SEALANT: ES-5.
B. JOINT-SEALANT APPLICATION JS-2: EXTERIOR PERIMETER JOINTS BETWEEN WALL AND FRAMES OF DOORS AND WINDOWS.
1. JOINT SEALANT: ES-1.
C. JOINT-SEALANT APPLICATION JS-3: EXTERIOR CONTROL AND EXPANSION JOINTS IN HORIZONTAL TRAFFIC SURFACES OF BRICK PAVERS, CERAMIC TILE, STONE PAVING UNITS, CONCRETE TILE.
1. JOINT SEALANT: MULTICOMPONENT POURABLE POLYSULFIDE SEALANT.
2. JOINT-SEALANT COLOR: AS SELECTED BY ARCHITECT FROM MANUFACTURER'S FULL RANGE.
D. JOINT-SEALANT APPLICATION JS-4: INTERIOR PERIMETER JOINTS OF EXTERIOR OPENINGS.
1. JOINT SEALANT: ES-3.
E. JOINT-SEALANT APPLICATION JS-5: INTERIOR CERAMIC TILE EXPANSION, CONTROL, CONTRACTION, AND ISOLATION JOINTS IN HORIZONTAL TRAFFIC SURFACES.
1. JOINT SEALANT: ES-3.
2. JOINT-SEALANT COLOR: AS NOTED.
F. JOINT-SEALANT APPLICATION JS-6: INTERIOR JOINTS BETWEEN PLUMBING FIXTURES AND ADJOINING WALLS, FLOORS, AND COUNTERS.
1. JOINT SEALANT: ES-3.
2. JOINT-SEALANT COLOR: TRANSLUCENT.
G. JOINT-SEALANT APPLICATION JS-7: VERTICAL JOINTS ON EXPOSED SURFACES OF INTERIOR PARTITIONS.
1. JOINT SEALANT: ES-3.
H. JOINT-SEALANT APPLICATION JS-8: PERIMETER JOINTS BETWEEN INTERIOR WALL SURFACES AND FRAMES OF INTERIOR DOORS, WINDOWS.
1. JOINT SEALANT: ES-3.
I. JOINT-SEALANT APPLICATION JS-9: HVAC JOINTS.
1. JOINT SEALANT: ES-2.
2. JOINT-SEALANT COLOR: ALUMINUM.
J. JOINT-SEALANT APPLICATION JS-10: NON-POROUS MATERIAL TO NON-POROUS MATERIAL.
1. JOINT SEALANT: ES-4.
2. JOINT-SEALANT COLOR: CLEAR.

END OF SECTION 079200

DOORS AND WINDOWS

SECTION 083450 - DOUBLE ACTING SWING DOORS

- PART 1 - GENERAL
1.1 SUMMARY
A. SECTION INCLUDES:
1. SOLID-CORE DOUBLE ACTING SWING DOORS WITH PLASTIC LAMINATE FACES.
1.2 SUBMITTALS
A. PRODUCT DATA: FOR EACH TYPE OF PRODUCT INDICATED. INCLUDE CONSTRUCTION DETAILS, MATERIAL DESCRIPTIONS, CORE DESCRIPTIONS, FIRE-RESISTANCE RATING, TEMPERATURE-RISE RATINGS, AND FINISHES.
B. SHOP DRAWINGS: INCLUDE THE FOLLOWING:
1. ELEVATIONS OF EACH DOOR AND FRAME.
2. DETAILS OF DOORS, INCLUDING VERTICAL AND HORIZONTAL EDGE DETAILS AND METAL THICKNESSES.
3. FRAME DETAILS FOR EACH FRAME TYPE, INCLUDING DIMENSIONED PROFILES AND METAL THICKNESSES.
4. LOCATIONS OF REINFORCEMENT AND PREPARATIONS FOR HARDWARE.
5. DETAILS OF ACCESSORIES.
6. DETAILS OF MOLDINGS, REMOVABLE STOPS, AND GLAZING.
1.3 STANDARD DOUBLE ACTING SWING DOORS
A. GENERAL: PROVIDE DOORS OF DESIGN INDICATED, NOT LESS THAN THICKNESS INDICATED, FABRICATED WITH SMOOTH SURFACES, WITHOUT VISIBLE JOINTS OR SEAMS ON EXPOSED FACES UNLESS OTHERWISE INDICATED. COMPLY WITH ANSISDI A250.8.
1. DESIGN: AS INDICATED.
B. CORE CONSTRUCTION: 3/4" EXTERIOR GRADE SOLID WOOD CORE MADE WITH ADHESIVES AND COMPOSITE WOOD PRODUCTS THAT DO NOT CONTAIN UREA FORMALDEHYDE.
1. VERTICAL EDGES FOR DOUBLE-ACTING DOORS: ROUND VERTICAL EDGES WITH 2-1/8-INCH(64-MM) RADIUS.
2. TOP AND BOTTOM EDGES: CLOSED WITH FLUSH OR INVERTED 0.042-INCH-(1.0-MM-) THICK, END CLOSURES OR CHANNELS OF SAME MATERIAL AS FACE SHEETS.
3. TOLERANCES: COMPLY WITH SDI 117, "MANUFACTURING TOLERANCES FOR STANDARD STEEL DOORS AND FRAMES."
C. INTERIOR DOORS: FACE SHEETS FABRICATED FROM DECORATIVE HIGH PRESSURE LAMINATE. PROVIDE DOORS COMPLYING WITH REQUIREMENTS INDICATED BELOW BY REFERENCING ANSISDI A250.8 FOR LEVEL AND ANSISDI A250.4 FOR PHYSICAL PERFORMANCE LEVEL:
1. LEVEL 1 AND PHYSICAL PERFORMANCE LEVEL C (STANDARD DUTY).
a. WIDTH: AS INDICATED ON DRAWINGS.
D. HARDWARE REINFORCEMENT: FABRICATE ACCORDING TO ANSISDI A250.6 WITH REINFORCING PLATES OF 18 GAUGE STAINLESS STEEL.
E. FABRICATE CONCEALED STIFFENERS AND HARDWARE REINFORCEMENT FROM EITHER COLD- OR HOT-ROLLED STEEL SHEET.
1.4 STOPS AND MOLDINGS
A. MOLDINGS FOR GLAZED LITES IN DOORS: MINIMUM 0.032 INCH(0.8 MM) THICK.
B. LOOSE STOPS FOR GLAZED LITES IN FRAMES: MINIMUM 0.032 INCH(0.8 MM) THICK, FABRICATED FROM SAME MATERIAL AS FRAMES IN WHICH THEY ARE INSTALLED.
1.5 STEEL FINISHES
A. PRIME FINISH: APPLY MANUFACTURER'S STANDARD PRIMER IMMEDIATELY AFTER CLEANING AND PRETREATING.
1. SHOP PRIMER: MANUFACTURER'S STANDARD, FAST-CURING, LEAD- AND CHROMATE-FREE PRIMER COMPLYING WITH ANSISDI A250.10 ACCEPTANCE CRITERIA; RECOMMENDED BY PRIMER MANUFACTURER FOR SUBSTRATE: COMPATIBLE WITH SUBSTRATE AND FIELD-APPLIED COATINGS DESPITE PROLONGED EXPOSURE.
B. FACTORY-APPLIED PAINT FINISH: MANUFACTURER'S STANDARD, COMPLYING WITH ANSISDI A250.3 FOR PERFORMANCE AND ACCEPTANCE CRITERIA.
1.6 COLOR AND GLOSS: AS INDICATED BY MANUFACTURER'S DESIGNATIONS.

END OF SECTION 083450

DOORS AND WINDOWS

SECTION 087100 - DOOR HARDWARE

- 1.1 SUMMARY
A. COMMERCIAL DOOR HARDWARE FOR SWINGING DOORS.
B. OTHER DOORS TO THE EXTENT INDICATED.
C. CYLINDERS FOR DOORS SPECIFIED IN OTHER SECTIONS.
1.2 SUBMITTALS
A. PRODUCT DATA: INCLUDE CONSTRUCTION AND INSTALLATION DETAILS, MATERIAL DESCRIPTIONS, DIMENSIONS OF INDIVIDUAL COMPONENTS AND PROFILES, AND FINISHES.
1.3 WARRANTY
A. WARRANTY PERIOD: ONE YEAR FROM DATE OF SUBSTANTIAL COMPLETION, EXCEPT AS FOLLOWS:
1. MANUAL CLOSERS: 25 YEARS FROM DATE OF INVOICE.
2. CYLINDRICAL LOCKSETS: TWO YEARS FROM DATE OF INVOICE.
3. EXIT DEVICES: FIVE YEARS FROM DATE OF INVOICE.
1.4 MAINTENANCE SERVICE
A. FULL-MAINTENANCE SERVICE: SIX MONTHS.
1.5 PRODUCTS
A. CYLINDERS AND KEYING:
1. CONSTRUCTION KEYING: CONSTRUCTION MASTER KEYS.
2. KEYING SYSTEM:
a. GRAND MASTER KEY.
b. LOCKS MASTER KEYED OR GRAND MASTER KEYED TO EXISTING SYSTEM.
c. ALL CYLINDERS KEYED ALIKE.
d. KEYS: NICKEL SILVER.
1) STAMPING: PERMANENTLY INSCRIBE EACH KEY WITH A LOCKNET KEY CONTROL NUMBER, STATE CODE, AND INCLUDE THE FOLLOWING NOTATION:
a) NOTATION: "DO NOT DUPLICATE."
2) QUANTITY: IN ADDITION TO ONE EXTRA KEY BLANK FOR EACH LOCK, PROVIDE THE FOLLOWING:
a) CYLINDER CHANGE KEYS: TWO.
b) CONSTRUCTION KEYS: FOUR.
c) MASTER KEYS: FOUR.
d) GRAND MASTER KEYS: TWO.
1.6 FIELD QUALITY CONTROL
A. INDEPENDENT ARCHITECTURAL HARDWARE CONSULTANT: CONTRACTOR ENGAGED TO PERFORM INSPECTIONS.
B. OCCUPANCY ADJUSTMENT: THREE MONTHS.

END OF SECTION 087100




STARBUCKS COFFEE COMPANY
2401 UTAH AVENUE SOUTH
SEATTLE, WASHINGTON 98134
(206) 318-1575

THESE DRAWINGS AND SPECIFICATIONS ARE CONFIDENTIAL AND SHALL REMAIN THE SOLE PROPERTY OF STARBUCKS CORPORATION, WHICH IS THE OWNER OF THE COPYRIGHT IN THIS WORK. THEY SHALL NOT BE REPRODUCED (IN WHOLE OR IN PART), SHARED WITH THIRD PARTIES OR USED IN ANY MANNER ON OTHER PROJECTS OR EXTENSIONS TO THIS PROJECT WITHOUT THE PRIOR WRITTEN CONSENT OF STARBUCKS CORPORATION. THESE DRAWINGS AND SPECIFICATIONS ARE INTENDED TO EXPRESS DESIGN INTENT FOR A PROTOTYPICAL STARBUCKS STORE (WHICH IS SUBJECT TO CHANGE AT ANY TIME) AND DO NOT REFLECT ACTUAL SITE CONDITIONS. NEITHER PARTY SHALL HAVE ANY OBLIGATION NOR LIABILITY TO THE OTHER (EXCEPT STATED ABOVE) UNTIL A WRITTEN AGREEMENT IS FULLY EXECUTED BY BOTH PARTIES.

STARBUCKS TEMPLATE VERSION i2016.12.23

NORR ARCHITECTS PLANNERS
325 N LaSalle St., Suite 500 | Chicago, IL 60604
1.312.424.2400 | www.norr.com

ENGINEER OF RECORD
William J. Abanayake, P.E.
953 Marshall Avenue
St. Louis, Missouri 63119
Phone (314) 772-1782
Fax (314) 772-0908

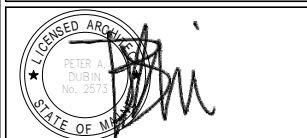

PROJECT NAME: RENOVATION OF STARBUCKS COFFEE PORTLAND, 1080 FOREST AVE., FOREST AVE., PORTLAND, ME 04103 CUMBERLAND COUNTY
PROJECT ADDRESS: 1080 FOREST AVENUE PORTLAND, ME 04103 CUMBERLAND COUNTY

STORE #: 11917
PROJECT #: 37548-037
ISSUE DATE: 08/23/2017
PROGRAM MANAGER: J. BOND
DESIGNER: A. LEE
LEED® AP: N/A
PRODUCTION DESIGNER: E. VEGA
CHECKED BY: P. BENVENUTO

Revision Schedule table with columns: Rev, Date, By, Description

SHEET TITLE: OUTLINE SPECIFICATIONS
SCALE: AS SHOWN

SHEET NUMBER: G-0011

ISSUE FOR CONSTRUCTION 08/23/2017