F2 Original Drawings Fire Suppression System Continued

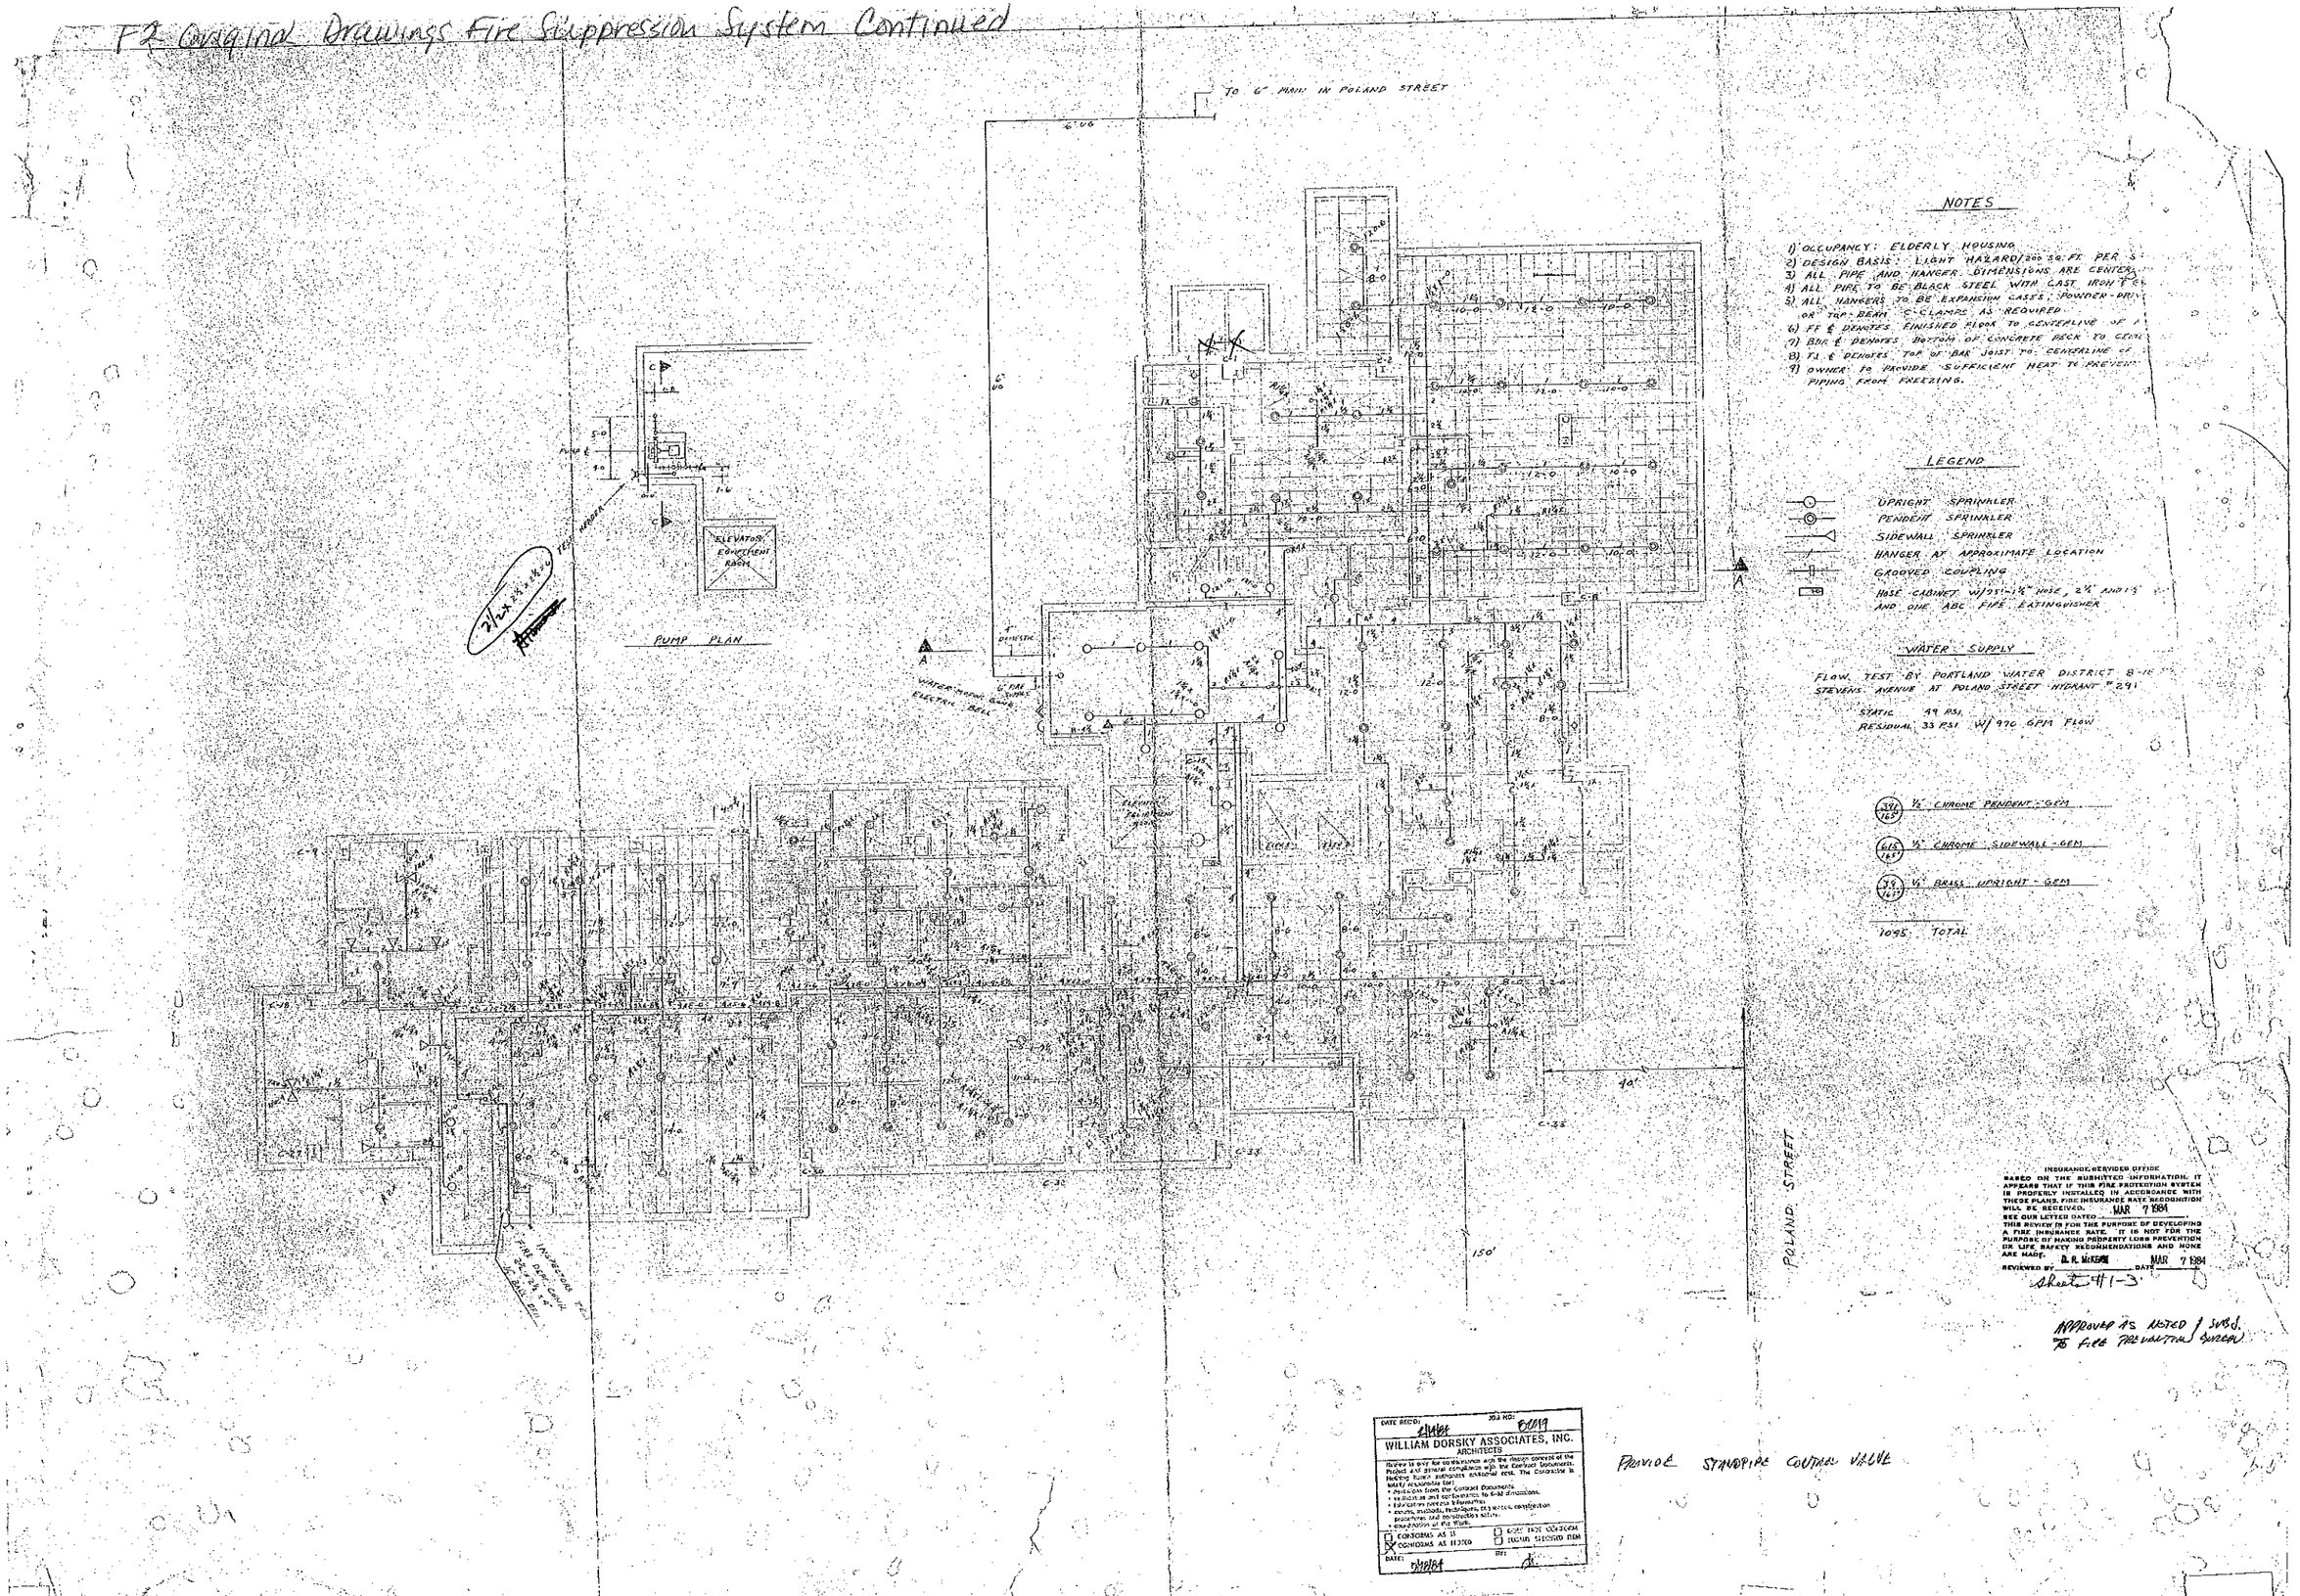

NOTES

1) OCCUPANCY: ELDERLY HOUSING
2) DESIGN BASIS: LIGHT HAZARD/300 SQ. FT. PER S
3) ALL PIPE AND HANGER DIMENSIONS ARE CENTER
4) ALL PIPE TO BE BLACK STEEL WITH CAST IRON F
5) ALL HANGERS TO BE EXPANSION CASES; POWDER-DRI OR TOP BEAM C-CLAMPS AS REQUIRED.
6) FF & E DENOTES FINISHED FLOOR TO CENTERLINE OF
7) BOF & DENOTES BOTTOM OF CONCRETE BEAM TO CEN
8) TJ & DENOTES TOP OF BAR JOIST TO CENTERLINE OF
9) OWNER TO PROVIDE SUFFICIENT HEAT TO PREVENT PIPING FROM FREEZING.

LEGEND

- UPRIGHT SPRINKLER
- PENDENT SPRINKLER
- SIDEWALL SPRINKLER
- HANGER AT APPROXIMATE LOCATION
- GROOVED COUPLING
- HOSE CABINET W/1½"-1½" HOSE, 2½" AND 1½ AND ONE ABC FIRE EXTINGUISHER

WATER SUPPLY

FLOW TEST BY PORTLAND WATER DISTRICT 8-1
STEVENS AVENUE AT POLAND STREET HYDRANT #291

STATIC 49 PSI
RESIDUAL 33 PSI W/ 976 GPM FLOW

339 / 165	½" CHROME PENDENT - GEM
615 / 167	½" CHROME SIDEWALL - GEM
79 / 167	½" BRASS UPRIGHT - GEM
1095	TOTAL

INSURANCE SERVICES OFFICE
BASED ON THE SUBMITTED INFORMATION, IT APPEARS THAT IF THIS FIRE PROTECTION SYSTEM IS PROPERLY INSTALLED IN ACCORDANCE WITH THESE PLANS, FIRE INSURANCE RATE RECOGNITION WILL BE RECEIVED. MAR 7 1984
SEE OUR LETTER DATED _____
THIS REVIEW IS FOR THE PURPOSE OF DEVELOPING A FIRE INSURANCE RATE. IT IS NOT FOR THE PURPOSE OF MAKING PROPERTY LOSS PREVENTION OR LIFE SAFETY RECOMMENDATIONS AND NONE ARE MADE. D. R. WATSON MAR 7 1984
REVIEWED BY _____ DATE _____
Sheet #1-3

APPROVED AS NOTED / SUBJ. TO FIRE PREVENTION BUREAU

DATE RECD: 2/16/84 JOB NO: 8019
WILLIAM DORSKY ASSOCIATES, INC.
ARCHITECTS
Review is only for conformance with the design concept of the Project and general compliance with the contract documents. Making these comments conditional only. The Contractor is solely responsible for:
- deviation from the contract documents
- verification of all conditions & dimensions
- fabrication processes & techniques
- coordination of the Work
- safety methods, techniques, sequences, procedures and construction safety.
☐ CONFORMS AS IT ☐ DOES NOT CONFORM
☒ CONFORMS AS NOTED ☐ REVISE & RESUBMIT ITEM
DATE: 2/16/84 BY: dk

PROVIDE STANDPIPE CONTROL VALVE